



Circuit Reliability Review

Santa Monica

January 2017

Providing Safe, Reliable, and Affordable Power

Southern California Edison is modernizing the power grid to meet the changing needs and expectations of our customers and to help California achieve its clean energy goals.

We are investing more than \$12 billion into our power grid between 2015 – 2017 with the goal of increasing power reliability through significant upgrades. These investments include:

- Updating thousands of transmission and distribution poles
- Replacing hundreds of miles of underground cables
- Replacing hundreds of underground structures such as vaults and manholes
- Upgrading critical distribution equipment; capacitor banks, switches, and circuit breakers
- Building new distribution circuits to serve electrical demands in our communities
- Inspecting and replacing overhead conductor and equipment to improve public safety

Our investments in local communities will help ensure that customers receive safe, reliable, and affordable electricity now and in the future.

Understanding Your Reliability Report

As your electric utility, we want you to always have power when you need it. To get there, we constantly track and monitor electric outages across our service territory, and we measure our “system reliability” from this data.

The two metrics we rely on are common in the electric utility industry: the System Average Interruption Duration Index (SAIDI) and the System Average Interruption Frequency Index (SAIFI). Both are described in more detail on the next page.

Replacing and upgrading our infrastructure will help SCE maintain or improve SAIDI and SAIFI measurements.

This report provides historical reliability data for the circuits that serve your jurisdiction and our proposed infrastructure upgrades for the current year.

To view other reliability reports, visit [sce.com>Outage Center>Maintaining Reliable Service](https://sce.com/Outage-Center/Maintaining-Reliable-Service)

Reliability Metrics

MOMENTARY OUTAGES:

OUTAGES LASTING 5 MINUTES OR LESS

MAIFI:

- The number of times the average customer is interrupted by Momentary outages each year.

SUSTAINED OUTAGES:

OUTAGES LASTING LONGER THAN 5 MINUTES

SAIFI:

- The number of times the average customer is interrupted by Sustained outages each year.

SAIDI:

- The cumulative amount of time the average customer is interrupted by Sustained outages each year.

Cities in the Santa Monica District

Beverly Hills

Culver City

Franklin Canyon

Ladera Heights

Los Angeles

Marina Del Rey

Santa Monica

Universal City

West Hollywood

Reliability by SCE District (No Exclusions)

District Name	2012				2013				2014				2015				2016			
	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking
ANTELOPE VALLEY	78.60	28	0.56	31	94.42	22	0.62	31	51.05	35	0.59	34	104.34	22	0.68	30	107.67	24	0.87	29
ARROWHEAD	129.58	13	1.31	7	180.59	7	1.39	8	193.25	5	1.59	5	362.61	4	3.97	1	659.46	3	2.85	5
BARSTOW	184.80	7	1.15	12	204.33	6	1.40	7	201.53	4	1.34	10	187.11	8	1.17	12	134.83	18	1.35	9
BIG CREEK	1184.25	1	4.52	1	176.51	8	3.08	1	920.25	1	1.34	11	422.77	2	3.42	2	1062.01	2	4.99	1
BISHOP	463.09	2	1.25	9	104.44	17	0.51	35	118.79	17	0.59	35	298.11	6	2.22	4	168.59	8	1.22	14
BLYTHE	225.88	6	1.53	3	483.13	1	1.38	9	707.54	2	2.42	2	427.00	1	1.52	7	396.38	5	2.71	6
CATALINA	78.46	30	0.72	29	105.94	16	2.97	2	97.02	24	4.17	1	42.56	35	2.25	3	65.01	35	3.66	3
COVINA	108.73	19	0.92	19	100.51	19	0.86	20	91.60	27	0.87	22	100.08	23	0.81	25	112.13	22	0.97	24
DOMINGUEZ HILLS	117.22	18	0.82	24	89.17	26	0.80	21	82.30	29	0.71	28	130.63	15	0.97	17	146.38	12	1.11	17
FOOTHILL	91.69	25	0.90	20	85.80	27	0.79	24	93.35	25	0.93	21	109.64	20	0.95	20	142.81	14	1.03	21
FULLERTON	68.99	33	0.42	35	90.57	25	0.79	22	82.23	30	0.72	27	76.59	29	0.67	31	92.72	30	0.76	34
HUNTINGTON BEACH	95.78	23	0.89	21	66.51	32	0.68	29	79.61	31	0.78	25	98.32	25	0.95	19	128.02	20	1.26	12
KERNVILLE	226.76	5	1.31	6	232.18	4	1.96	3	178.69	8	1.99	3	286.38	7	0.96	18	2421.32	1	3.67	2
LONG BEACH	75.83	31	0.55	33	75.11	30	0.70	28	66.33	34	0.61	32	164.46	9	0.89	23	135.16	17	0.86	31
MENIFEE	99.32	22	0.84	23	107.39	15	1.26	10	156.68	11	1.32	12	111.46	19	0.98	16	156.75	9	1.31	10
MONROVIA	108.11	20	1.13	15	99.12	20	1.02	16	133.32	14	1.16	16	96.68	26	0.88	24	116.57	21	0.84	32
MONTEBELLO	131.06	12	1.13	14	118.08	13	1.17	12	158.34	10	1.16	15	150.28	12	1.18	11	133.52	19	1.17	15
ONTARIO	93.09	24	0.87	22	77.39	29	0.79	23	97.91	23	1.00	19	94.04	27	0.74	27	105.07	27	0.93	27
PALM SPRINGS	175.92	8	1.27	8	112.80	14	0.77	25	107.04	20	0.71	29	99.54	24	0.80	26	107.58	25	1.07	19
REDLANDS	120.13	16	1.11	16	96.48	21	1.04	15	154.25	12	1.04	18	124.52	17	1.01	14	137.11	16	0.98	23
RIDGECREST	229.65	4	1.44	4	161.95	9	1.12	13	176.84	9	1.57	6	148.90	13	1.01	15	254.31	6	1.05	20
SADDLEBACK	83.01	27	0.73	27	70.69	31	0.53	34	99.07	22	0.74	26	46.03	34	0.39	35	65.99	34	0.65	35
SAN JOAQUIN	135.90	10	1.04	18	244.44	2	1.45	6	138.25	13	1.17	14	127.50	16	1.05	13	108.44	23	1.09	18
SANTA ANA	78.60	29	0.55	32	93.35	24	0.74	26	91.68	26	0.84	23	67.46	32	0.71	29	97.27	29	1.00	22
SANTA BARBARA	153.81	9	1.15	13	82.00	28	0.70	27	183.78	7	1.38	9	152.37	11	1.52	6	156.66	10	1.41	8
SANTA MONICA	101.69	21	0.79	25	122.78	12	1.00	17	110.76	19	0.99	20	75.41	30	0.62	32	91.08	31	0.95	26
SOUTH BAY	122.68	15	1.17	10	142.15	10	1.49	5	125.28	16	1.39	8	164.07	10	1.31	8	183.90	7	1.88	7
TEHACHAPI	117.96	17	1.43	5	232.67	3	1.12	14	130.70	15	1.29	13	298.96	5	1.21	9	97.29	28	1.13	16
THOUSAND OAKS	127.73	14	1.05	17	93.86	23	0.91	18	104.37	21	1.10	17	106.59	21	0.92	21	143.78	13	1.31	11
VALENCIA	62.01	35	0.46	34	51.04	34	0.53	33	79.23	32	0.61	33	72.27	31	0.61	33	105.09	26	0.97	25
VENTURA	134.81	11	1.15	11	100.52	18	1.21	11	183.79	6	1.65	4	148.85	14	1.19	10	150.41	11	1.24	13
VICTORVILLE	67.70	34	0.66	30	61.33	33	0.63	30	68.85	33	0.63	31	87.03	28	0.91	22	79.35	33	0.92	28
WHITTIER	72.60	32	0.74	26	135.04	11	0.86	19	87.60	28	0.70	30	114.52	18	0.73	28	137.34	15	0.81	33
WILDOMAR	88.54	26	0.72	28	40.51	35	0.56	32	118.49	18	0.81	24	52.70	33	0.60	34	84.01	32	0.87	30
YUCCA VALLEY	319.82	3	3.41	2	216.97	5	1.50	4	304.25	3	1.49	7	389.08	3	1.80	5	463.68	4	3.39	4
SCE SystemWide	108.13		0.89		102.61		0.91		112.00		0.96		114.83		0.92		134.48		1.10	

Exclusions are days which utilities are allowed to remove from their metrics because the outages on those days were caused by a severe acts of nature.


**In the columns showing "Rank," lower numbers indicate poorer performance.

Overview of Santa Monica

There are 48 circuits that serve Santa Monica


Circuit Type	Sum of Customers	Circuit Type	Sum of Customers	Circuit Type	Sum of Customers	Circuit Type	Sum of Customers
AIRCRAFT(16KV)	34	PALISADES(4.16KV)	15				
ALBATROSS(16KV)	4,704	PARMAN(16KV)	3,985				
ASHLAND(4.16KV)	666	PICKERING(4.16KV)	306				
BEACHCOMBER(16KV)	3,941	PURDUE(16KV)	1,903				
CARLYLE(4.16KV)	423	REGENT(4.16KV)	228				
CEDAR(4.16KV)	1,243	RIPTIDE(16KV)	4,716				
CHELSEA(4.16KV)	913	SECURITY(4.16KV)	95				
CLOVERFIELD(4.16KV)	1,075	SIXTEENTH ST.(4.16K	737				
COURTLAND(16KV)	529	SUNTOWER(16KV)	860				
CYRUS(16KV)	289	SURFRIDER(16KV)	110				
DEAUVILLE(4.16KV)	38	TAFT(16KV)	959				
DEBUG(16KV)	2,720	TRADEWIND(16KV)	2,871				
DELAWARE(16KV)	1,424	TWENTY SIX ST(4.16k	311				
EAST MONTANA(4.16KV)	247	TWENTY THREE ST(4.	52				
FRANKLIN(16KV)	99	TWENTY TWO ST(4.1	67				
GATEWAY(4.16KV)	864	WADSWORTH(4.16KV)	1,804				
GEORGIAN(4.16KV)	285	WALGROVE(16KV)	588				
IRWIN HTS(4.16KV)	1,024	YALE(4.16KV)	613				
JONES(4.16KV)	1,233						
KANSAS(4.16KV)	1,399						
LASSEN(4.16KV)	590						
MADISON(16KV)	1,410						
MARSHALL(16KV)	3,295						
MCEWAN(16KV)	541						
MEDICAL(4.16KV)	1,041						
NAVY(16KV)	3,181						
NEON(16KV)	1,712						
NINTH ST(4.16KV)	150						
NOMAD(16KV)	42						
NORTHSIDE(4.16KV)	1,119						
Grand Total	56,451						

Reliability History of Circuits Serving Santa Monica (No Exclusions)

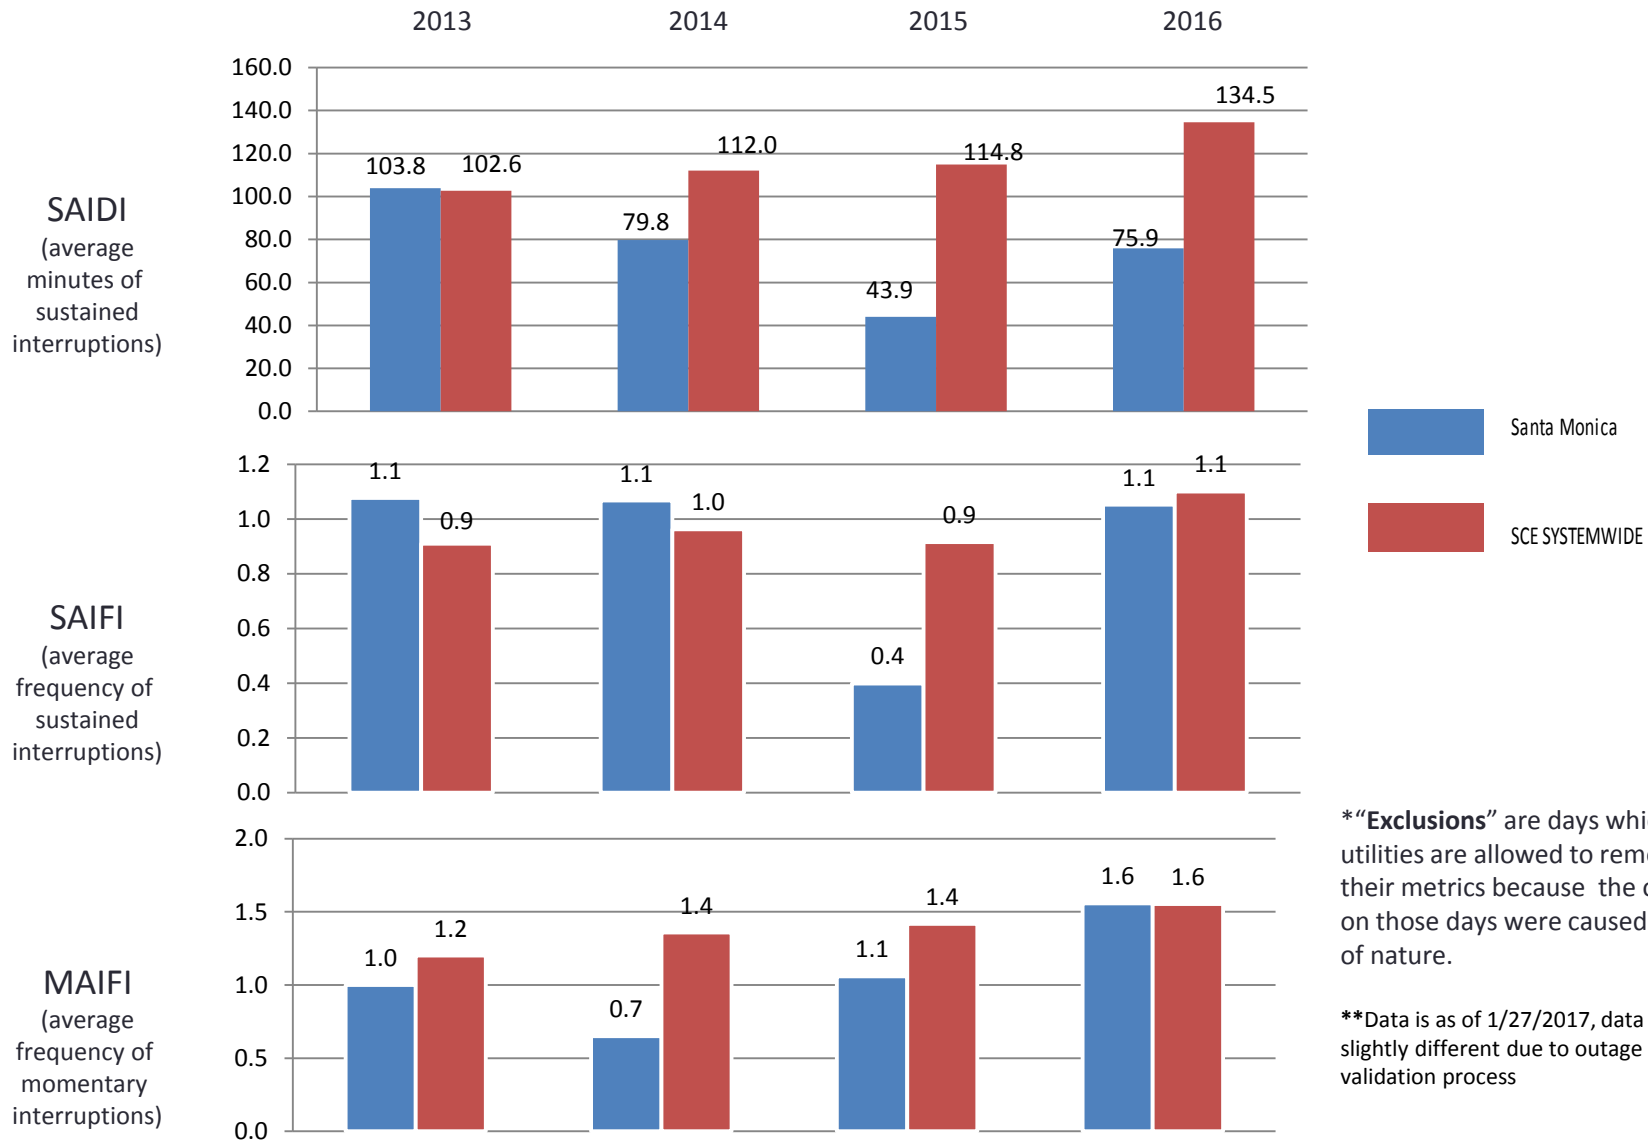

Causes of Repair Outages in Santa Monica Circuits 2016 YTD


Contributions to SAIDI by Outage Cause

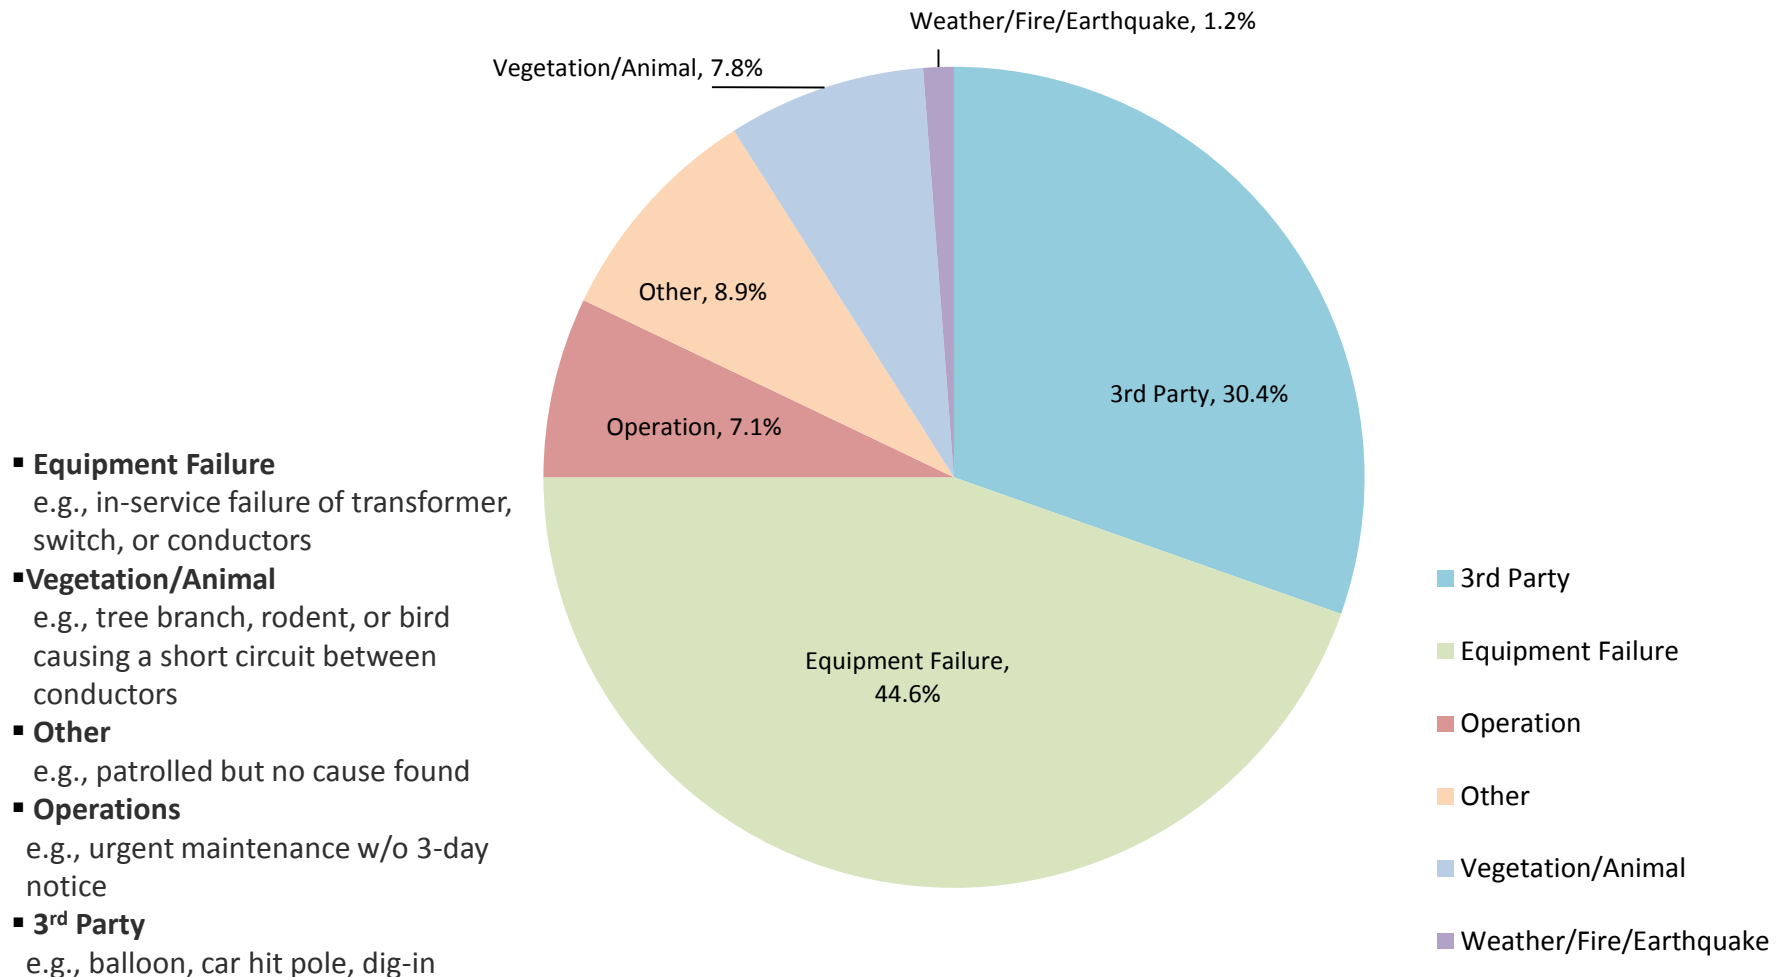

SAIDI = the cumulative amount of time the average customer is interrupted by “sustained” outages each year.


Causes of Repair Outages in Santa Monica Circuits 2016 YTD


Contributions to SAIFI by Outage Cause

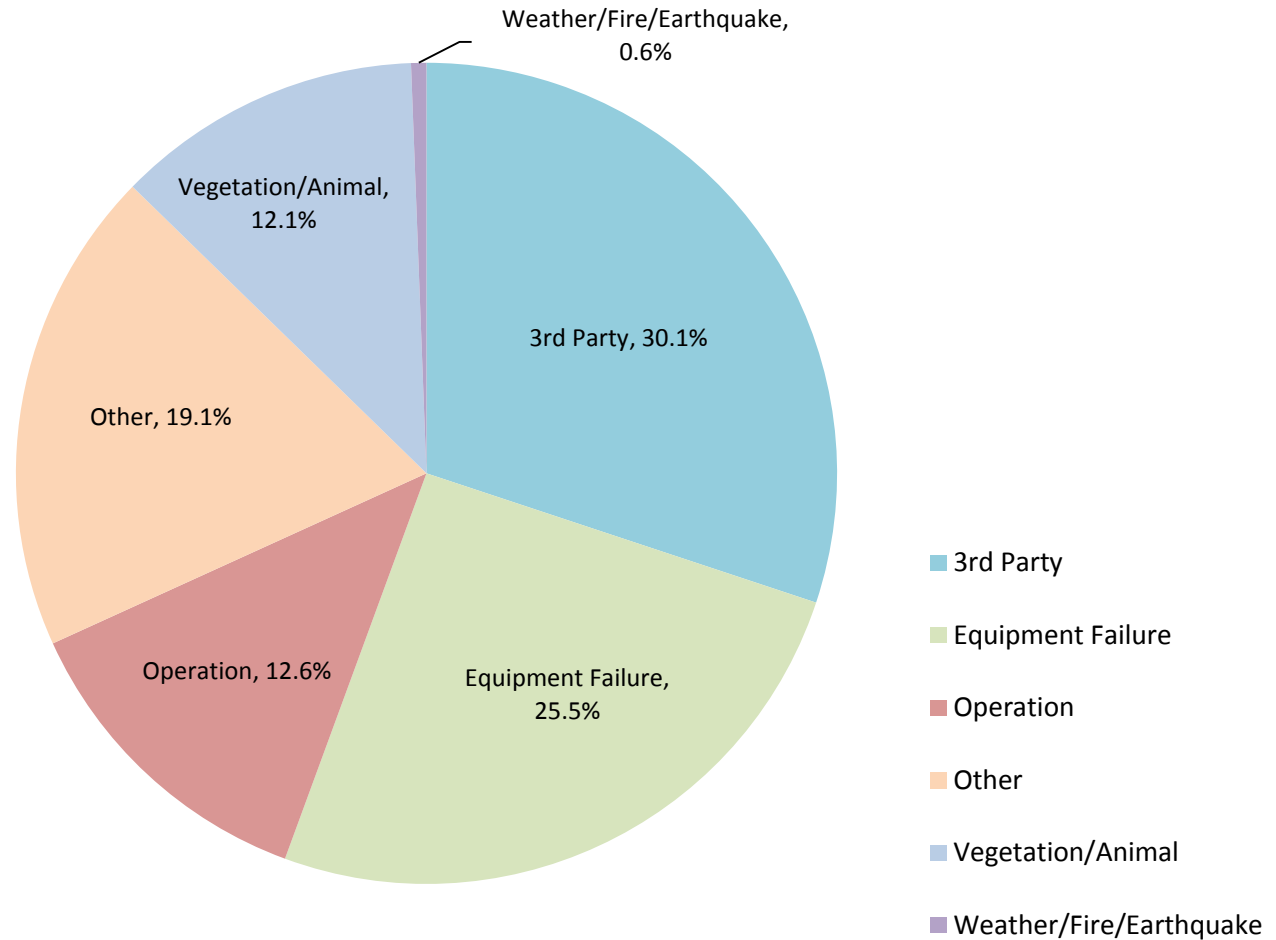

- **Equipment Failure**
e.g., in-service failure of transformer, switch, or conductors
- **Vegetation/Animal**
e.g., tree branch, rodent, or bird causing a short circuit between conductors
- **Other**
e.g., patrolled but no cause found
- **Operations**
e.g., urgent maintenance w/o 3-day notice
- **3rd Party**
e.g., balloon, car hit pole, dig-in

SAIFI = the number of times the average customer is interrupted by “sustained” outages each year.

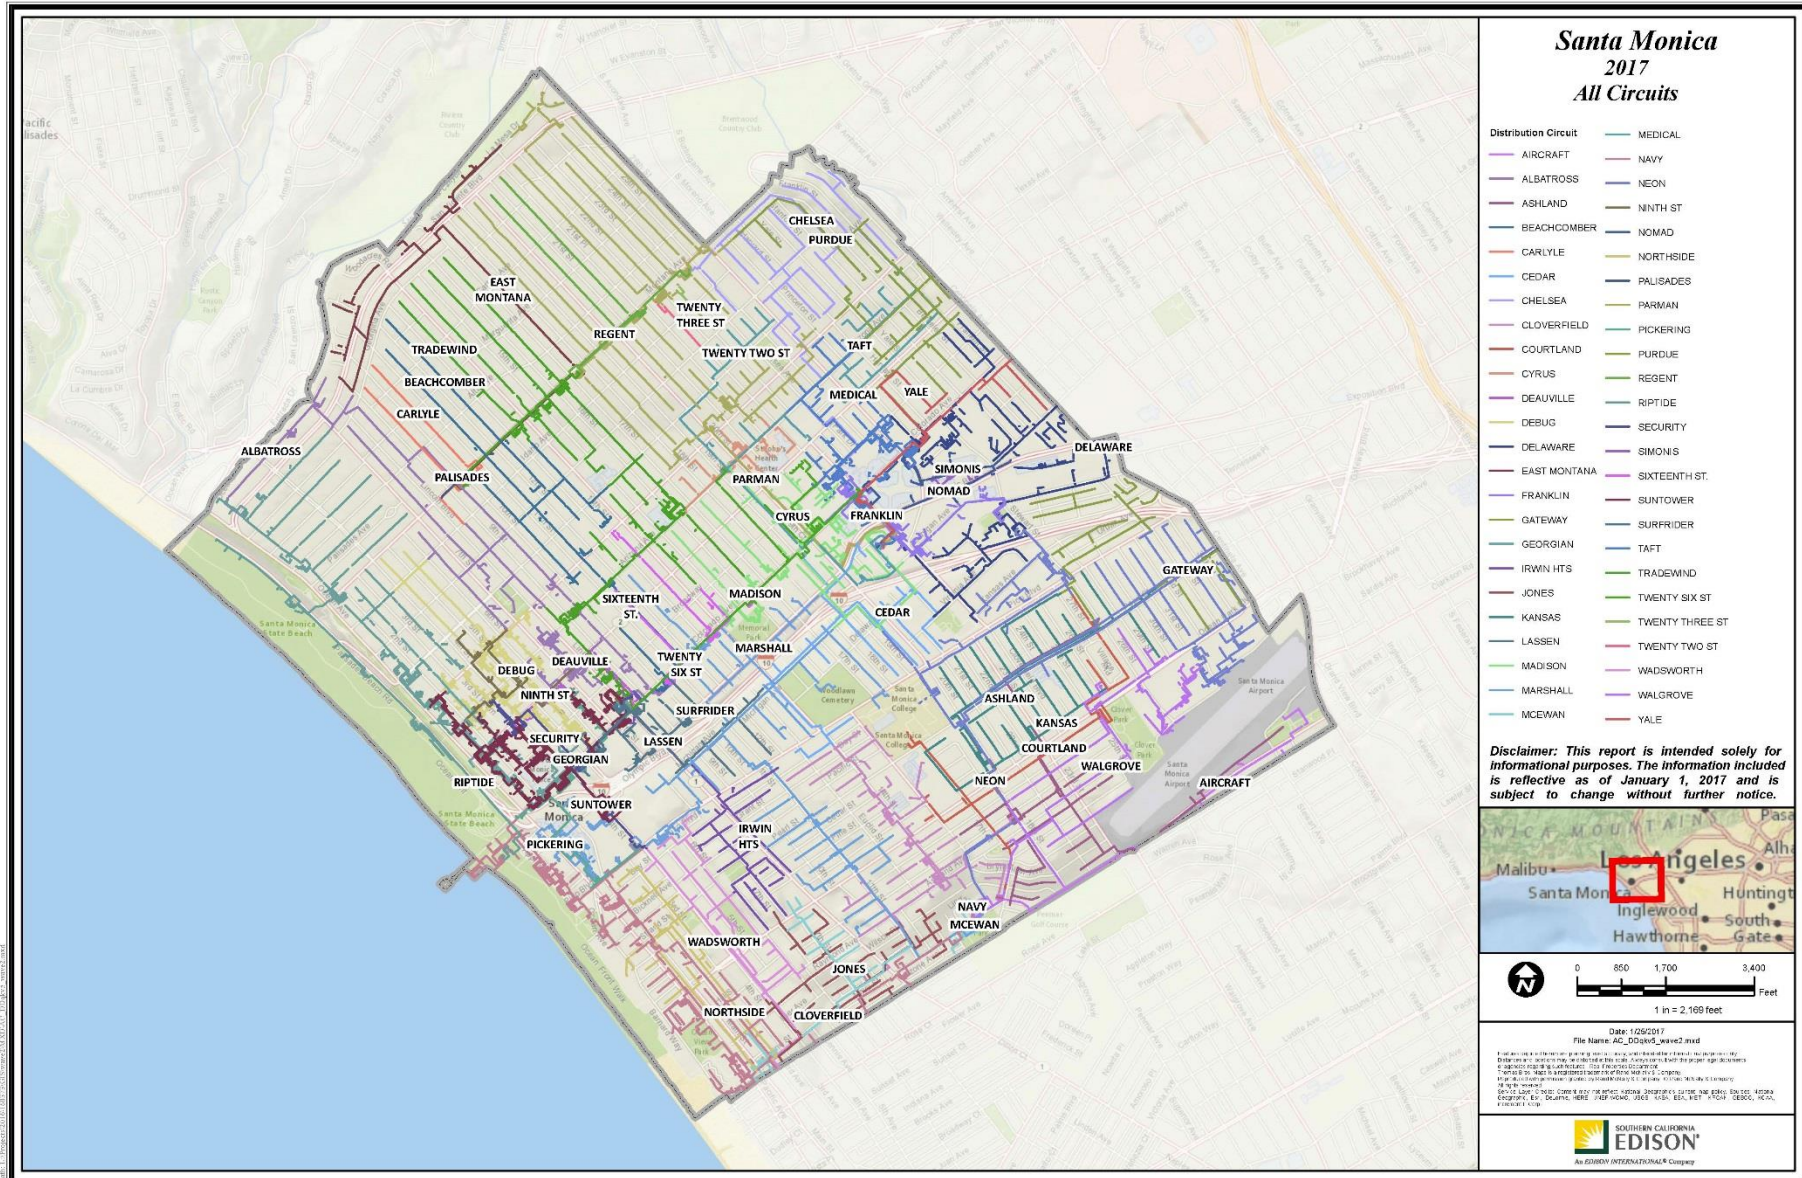

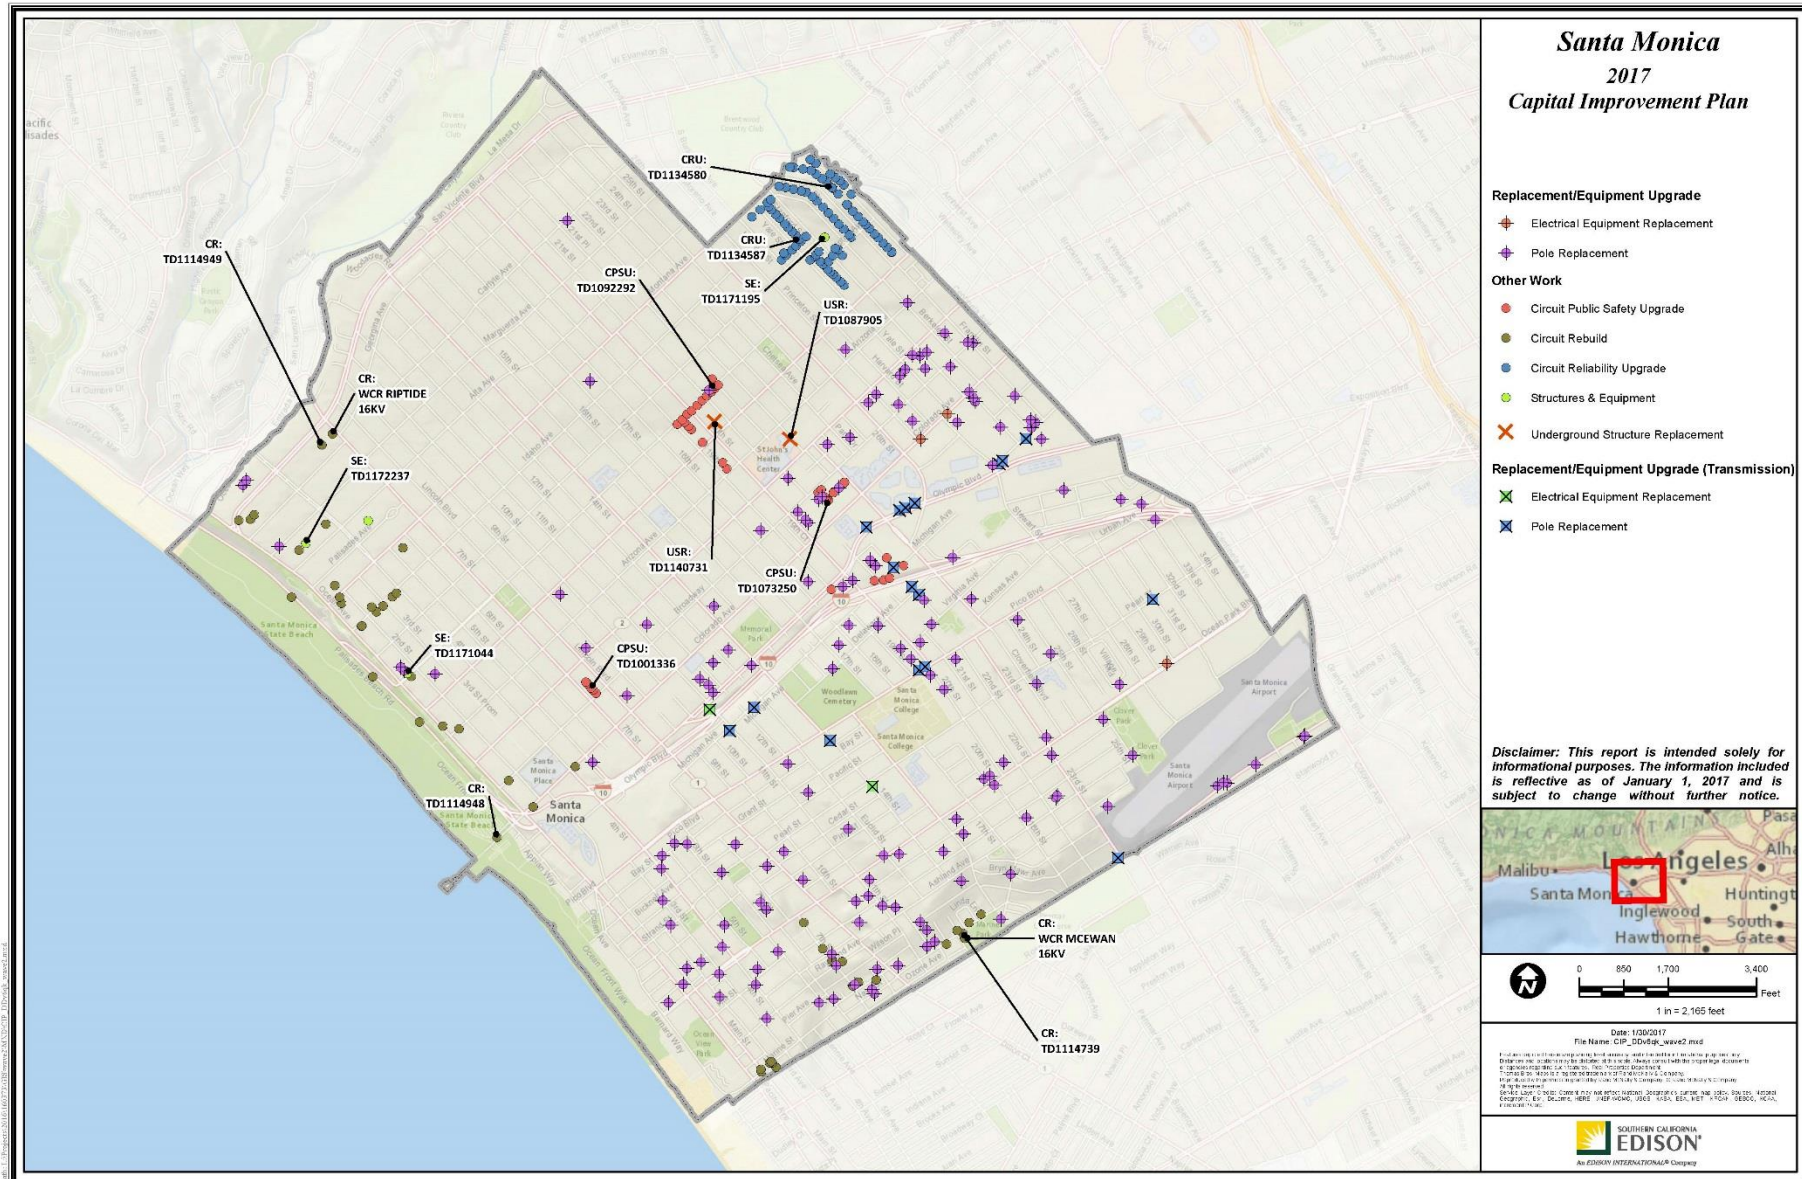

Back-up Slides

Reliability Histories of Circuits Serving Santa Monica

Updated through Year-End 2016

Average Reliability of 48 Circuits Serving Santa Monica

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
Santa Monica	103.8	1.1	1.0	79.8	1.1	0.7	43.9	0.4	1.1	13.4	0.2	0.5	20.4	0.2	0.2	9.4	0.3	0.4	32.7	0.4	0.5	75.9	1.1	1.6
3rd Party	5%	7%	13%	4%	7%	8%	2%	1%	23%	0%	0%	15%	73%	68%	61%	2%	1%	0%	24%	45%	0%	30%	30%	12%
Equipment Failure	35%	47%	31%	43%	28%	5%	41%	30%	37%	37%	44%	0%	12%	7%	10%	43%	6%	18%	69%	43%	36%	45%	25%	18%
Operation	14%	18%	1%	8%	5%	1%	30%	44%	0%	6%	3%	11%	14%	25%	0%	13%	24%	0%	1%	1%	0%	7%	13%	3%
Other	1%	1%	11%	4%	5%	29%	7%	10%	11%	43%	33%	40%	0%	0%	17%	10%	49%	30%	0%	0%	32%	9%	19%	32%
Vegetation/Animal	14%	17%	41%	33%	45%	23%	8%	4%	28%	13%	21%	9%	0%	0%	12%	31%	20%	52%	4%	9%	21%	8%	12%	23%
Weather/Fire/Earthquake	31%	10%	3%	9%	10%	35%	13%	11%	0%	1%	0%	25%	0%	0%	0%	0%	0%	0%	2%	2%	11%	1%	1%	11%
SCE Systemwide	102.6	0.9	1.2	112.0	1.0	1.4	114.8	0.9	1.4	40.5	0.3	0.4	34.8	0.3	0.4	29.4	0.2	0.3	29.8	0.3	0.4	134.5	1.1	1.6

Notes:

No outages are excluded from the metrics.

Outage Causes:

Other: e.g., patrolled but no cause could be found

Operations: e.g., urgent maintenance w/o 3-day notice to customers

3rd Party: e.g., balloons, car hit pole, dig-in

Vegetation/Animal: e.g., tree branch, rodent, or bird causing short circuit across conductors

SAIDI (minutes) = the cumulative amount of time the average customer is interrupted by "sustained" (longer than 5 minutes) outages.

SAIFI (interruptions) = the number of times the average customer is interrupted by "sustained" outages.

MAIFI (interruptions) = the number of times the average customer is interrupted by "momentary" (lasting 5 minutes or less) outages.

Reliability Histories for Individual Circuits Serving Santa Monica

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
AIRCRAFT(16KV) - Customers: 34	0.0	0.0	0.0	13.0	1.0	0.0	94.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
ALBATROSS(16KV) - Customers: 4,704	341.5	5.1	3.0	102.7	1.0	1.0	9.5	0.1	1.0	69.2	0.7	0.3	102.9	0.7	0.3	2.3	0.0	0.0	54.3	2.1	2.0	228.7	3.5	2.6
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	100%	100%	0%	11%	49%	0%	49%	50%	12%
Equipment Failure	67%	60%	34%	0%	0%	0%	36%	67%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	78%	49%	100%	19%	29%	76%
Operation	27%	20%	0%	0%	0%	0%	55%	13%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	9%	20%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	30%	19%	12%
Vegetation/Animal	6%	20%	66%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	11%	3%	0%	3%	2%	0%
ASHLAND(4.16KV) - Customers: 666	0.0	0.0	1.0	13.2	1.0	0.0	0.0	0.0	1.0	0.0	0.0	0.0	1.7	0.0	0.0	0.3	0.0	0.0	0.0	0.0	0.0	2.0	0.1	0.0
3rd Party	0%	0%	100%	0%	0%	0%	0%	0%	100%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	83%	46%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	17%	54%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
BEACHCOMBER(16KV) - Customers: 3,941	2.7	0.0	0.0	0.0	0.0	0.0	19.9	0.1	1.0	0.0	0.0	0.0	0.6	0.0	0.0	2.5	0.0	0.0	0.0	0.0	0.0	3.1	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	18%	5%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	82%	95%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Santa Monica

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
CARLYLE(4.16KV) - Customers: 423	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
CEDAR(4.16KV) - Customers: 1,243	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	8.1	1.0	0.0	0.1	0.0	0.0	8.2	1.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%	100%	100%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
CHELSEA(4.16KV) - Customers: 913	5.5	0.0	0.0	159.0	2.7	0.7	35.0	0.7	0.0	37.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	37.1	0.1	0.0
3rd Party	0%	0%	0%	9%	36%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Operation	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	91%	64%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
CLOVERFIELD(4.16KV) - Customers: 1,075	190.1	1.0	1.9	21.0	1.0	0.0	2.0	0.0	1.0	0.0	0.0	0.0	74.2	1.1	0.0	0.0	0.0	0.0	0.2	0.0	0.0	74.4	1.1	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	76%	94%	0%	0%	0%	0%	0%	0%	0%	75%	94%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	24%	6%	0%	0%	0%	0%	0%	0%	0%	24%	6%	0%
Operation	0%	0%	0%	38%	2%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%
Other	0%	0%	52%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	48%	62%	98%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Santa Monica

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
COURTLAND(16KV) - Customers: 529	0.0	0.0	0.0	13.0	1.0	1.0	0.0	0.0	1.0	0.0	0.0	0.0	62.7	0.2	0.0	0.0	0.0	1.0	0.0	0.0	0.0	62.7	0.2	1.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	100%
Vegetation/Animal	0%	0%	0%	100%	100%	100%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
CYRUS(16KV) - Customers: 289	40.5	0.5	1.8	4.5	0.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	92.6	0.8	0.8	6.0	1.0	0.0	0.0	0.0	0.0	98.6	1.8	0.8
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	94%	44%	100%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	6%	56%	0%
Vegetation/Animal	0%	0%	55%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	100%	100%	45%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
DEAUVILLE(4.16KV) - Customers: 38	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
DEBUG(16KV) - Customers: 2,720	0.0	0.0	0.0	3.5	0.0	0.0	0.0	0.0	0.0	1.5	0.0	0.0	131.3	2.0	0.0	0.0	0.0	0.0	4.8	0.0	0.0	137.6	2.1	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	71%	50%	0%	0%	0%	0%	0%	0%	0%	68%	49%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%	29%	50%	0%	0%	0%	0%	100%	100%	0%	32%	51%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Santa Monica

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
DELAWARE(16KV) - Customers: 1,424	181.8	2.6	4.7	0.0	0.0	0.0	10.2	0.0	1.0	2.8	0.0	0.0	63.6	0.4	0.6	10.5	1.1	1.9	0.0	0.0	0.0	77.0	1.5	2.5
3rd Party	30%	21%	9%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	70%	79%	70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	83%	26%	25%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	4%	1%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	48%	0%	0%	0%	14%	73%	36%
Vegetation/Animal	0%	0%	21%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	52%	0%	0%	0%	0%	0%	39%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
EAST MONTANA(4.16KV) - Customers: 247	108.3	2.0	0.0	0.0	0.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	38%	49%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	62%	51%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
FRANKLIN(16KV) - Customers: 99	0.0	0.0	1.0	253.3	0.4	0.0	31.1	0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	6.1	1.0	0.0	0.0	0.0	0.0	6.1	1.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	100%	100%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%
Vegetation/Animal	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
GATEWAY(4.16KV) - Customers: 864	0.0	0.0	0.0	13.0	1.0	0.0	24.6	0.3	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	0.0	0.0	0.0	1.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	100%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Santa Monica

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
GEORGIAN(4.16KV) - Customers: 285	73.8	1.3	0.0	10.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	19%	1%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	81%	99%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
IRWIN HTS(4.16KV) - Customers: 1,024	0.0	0.0	0.0	0.9	0.0	1.0	102.3	0.1	0.9	25.6	0.1	0.0	0.0	0.0	0.0	0.4	0.0	0.0	0.0	0.0	0.0	26.0	0.1	0.0
3rd Party	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%
Other	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
JONES(4.16KV) - Customers: 1,233	583.6	1.6	2.0	13.0	1.0	2.0	0.0	0.0	1.0	0.0	0.0	1.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	1.0	0.0	0.0	3.0
3rd Party	0%	0%	49%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	2%	1%	51%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	34%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	66%
Vegetation/Animal	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	98%	99%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
KANSAS(4.16KV) - Customers: 1,399	0.0	0.0	2.0	54.3	2.0	1.0	24.1	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	17%	3%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	18%	3%	0%	83%	97%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	59%	49%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	24%	48%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Santa Monica

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
LASSEN(4.16KV) - Customers: 590	21.2	0.1	0.0	0.0	0.0	0.0	132.2	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
MADISON(16KV) - Customers: 1,410	146.1	1.4	1.0	2.5	0.0	1.0	114.0	0.9	0.1	0.0	0.0	0.0	1.0	0.0	1.0	22.9	1.9	1.0	0.0	0.0	0.0	24.0	1.9	1.9
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	48%	28%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	75%	50%	0%	0%	0%	0%	72%	50%	0%
Other	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	25%	50%	0%	0%	0%	0%	24%	50%	0%
Vegetation/Animal	52%	72%	100%	0%	0%	0%	26%	9%	0%	0%	0%	0%	100%	100%	100%	0%	0%	100%	0%	0%	0%	4%	0%	100%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	74%	91%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
MARSHALL(16KV) - Customers: 3,295	176.6	1.0	0.0	125.2	2.6	3.4	3.2	0.0	0.0	30.9	0.6	0.4	0.0	0.0	0.0	0.0	0.0	0.0	6.5	0.0	1.0	37.4	0.7	1.4
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	3%	0%	0%	12%	2%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	84%	97%	0%	15%	3%	0%
Operation	3%	2%	0%	0%	0%	0%	88%	98%	0%	1%	3%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	3%	0%
Other	0%	0%	0%	0%	0%	30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	97%	98%	0%	13%	38%	0%	0%	0%	0%	99%	97%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	82%	94%	28%
Weather/Fire/Earthquake	0%	0%	0%	83%	61%	70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	16%	3%	100%	3%	0%	72%
MCEWAN(16KV) - Customers: 541	925.5	1.0	2.0	13.0	1.0	0.0	221.1	0.6	0.4	13.5	0.1	0.0	33.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	47.3	0.1	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Other	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	50%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Santa Monica

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016			
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	
MEDICAL(4.16KV) - Customers: 1,041	17.3	0.0	0.0	172.9	2.9	0.0	59.6	0.1	0.0	0.0	0.0	2.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	3.9	
3rd Party	0%	0%	0%	45%	43%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
Equipment Failure	100%	100%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
Operation	0%	0%	0%	55%	57%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	66%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	74%	
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	34%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	26%	
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
NAVY(16KV) - Customers: 3,181	161.9	2.0	0.0	201.6	2.7	1.0	22.3	1.0	1.0	3.6	0.0	2.0	1.0	0.0	0.0	0.0	0.0	0.0	1.0	267.2	1.0	0.0	271.8	1.0	3.0
3rd Party	42%	52%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
Equipment Failure	58%	48%	0%	84%	60%	0%	42%	2%	0%	42%	58%	0%	0%	0%	0%	0%	0%	100%	100%	0%	99%	99%	0%	0%	
Operation	0%	0%	0%	8%	2%	0%	58%	98%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	1%	0%	
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	67%	
Vegetation/Animal	0%	0%	0%	7%	38%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
Weather/Fire/Earthquake	0%	0%	0%	2%	0%	100%	1%	0%	0%	58%	42%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	33%	
NEON(16KV) - Customers: 1,712	20.2	0.1	1.9	152.0	2.0	0.0	67.3	1.5	3.2	0.0	0.0	0.0	0.0	0.0	0.0	27.2	0.2	1.7	0.0	0.0	1.0	27.2	0.2	2.7	
3rd Party	0%	0%	53%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
Equipment Failure	0%	0%	0%	81%	49%	0%	42%	79%	56%	0%	0%	0%	0%	0%	0%	72%	90%	100%	0%	0%	0%	72%	90%	63%	
Operation	38%	54%	0%	10%	2%	0%	3%	2%	0%	0%	0%	0%	0%	0%	0%	28%	10%	0%	0%	0%	0%	28%	10%	0%	
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	37%	
Vegetation/Animal	0%	0%	0%	9%	49%	0%	55%	19%	44%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
Weather/Fire/Earthquake	62%	46%	47%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
NINTH ST(4.16KV) - Customers: 150	0.0	0.0	2.0	83.9	1.0	1.0	0.0	0.0	3.0	0.0	0.0	0.0	38.3	1.0	0.0	9.8	0.0	0.0	0.0	0.0	0.0	48.0	1.0	0.0	
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
Equipment Failure	0%	0%	50%	100%	100%	100%	0%	0%	33%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	20%	2%	0%	
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	80%	98%	0%	
Other	0%	0%	50%	0%	0%	0%	0%	0%	34%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	

Reliability Histories for Individual Circuits Serving Santa Monica

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
NOMAD(16KV) - Customers: 42	0.0	0.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	6.0	1.0	0.0	0.0	0.0	0.0	6.0	1.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
NORTHSIDE(4.16KV) - Customers: 1,119	191.6	2.0	1.9	13.0	1.0	0.0	2.4	0.0	1.0	0.0	0.0	0.0	38.8	1.0	0.0	8.0	1.0	0.0	189.6	1.0	0.0	236.3	3.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	16%	33%	0%
Equipment Failure	2%	1%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	80%	34%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	3%	33%	0%
Other	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	24%	49%	50%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	74%	49%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
PALISADES(4.16KV) - Customers: 15	0.0	0.0	0.0	74.8	0.9	1.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	100%	100%	48%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	52%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
PARMAN(16KV) - Customers: 3,985	47.7	1.2	2.2	179.9	1.0	0.0	143.7	1.0	2.0	57.8	1.0	1.0	0.0	0.0	0.0	6.0	1.0	1.0	0.3	0.0	1.0	64.1	2.0	3.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	33%
Equipment Failure	1%	0%	45%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	90%	50%	0%
Operation	99%	100%	9%	0%	1%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	9%	50%	0%
Vegetation/Animal	0%	0%	46%	99%	99%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	100%	0%	0%	67%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Santa Monica

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
PICKERING(4.16KV) - Customers: 306	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
PURDUE(16KV) - Customers: 1,903	0.0	0.0	2.0	13.2	0.0	2.0	18.9	1.0	2.0	0.0	0.0	1.0	0.0	0.0	1.0	0.0	0.0	0.0	34.0	1.0	1.0	34.0	1.0	3.0
3rd Party	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	2%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	100%	100%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	50%	0%	0%	0%	98%	100%	0%	0%	0%	100%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	67%
Vegetation/Animal	0%	0%	50%	0%	0%	50%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	100%	100%	33%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
REGENT(4.16KV) - Customers: 228	102.7	0.7	0.0	182.3	2.0	2.1	50.6	1.0	0.0	6.9	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	6.9	0.1	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	31%	8%	0%	2%	2%	0%	44%	3%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	69%	92%	0%	98%	98%	50%	56%	97%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
RIPTIDE(16KV) - Customers: 4,716	93.9	1.8	0.0	241.7	2.0	0.0	4.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.0	0.2	0.0	0.0	90.6	1.0	1.0	90.8	1.0	2.0
3rd Party	0%	0%	0%	0%	0%	0%	48%	28%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	98%	99%	0%	98%	99%	50%
Equipment Failure	100%	100%	0%	98%	99%	0%	23%	28%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	29%	44%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	2%	1%	0%	2%	1%	0%
Other	0%	0%	0%	2%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	50%
Vegetation/Animal	0%	0%	0%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Santa Monica

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
SECURITY(4.16KV) - Customers: 95	0.0	0.0	0.0	0.0	0.0	0.0	38.2	0.3	0.0	5.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
SIXTEENTH ST.(4.16KV) - Customers: 737	0.0	0.0	0.0	63.8	1.0	0.8	151.8	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	100%	100%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
SUNTOWER(16KV) - Customers: 860	0.0	0.0	0.0	8.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
SURFRIDER(16KV) - Customers: 110	16.0	0.0	0.0	52.7	1.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	100%	100%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Santa Monica

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
TAFT(16KV) - Customers: 959	31.0	0.1	1.0	7.2	0.1	0.0	215.0	0.6	3.0	0.0	0.0	0.0	0.0	0.0	0.0	5.7	1.0	1.1	0.0	0.0	0.0	5.7	1.0	1.1
3rd Party	0%	0%	0%	0%	0%	0%	18%	19%	34%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	79%	78%	32%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	50%	17%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	50%	83%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%
Vegetation/Animal	0%	0%	100%	0%	0%	0%	0%	0%	34%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	100%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	3%	3%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
TRADEWIND(16KV) - Customers: 2,871	3.1	0.0	0.9	15.4	0.1	1.0	75.1	0.8	4.0	0.0	0.0	1.0	0.0	0.0	0.0	57.9	1.1	1.0	4.3	0.0	0.0	62.1	1.2	2.0
3rd Party	0%	0%	0%	0%	0%	0%	2%	0%	26%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	100%	21%	32%	0%	65%	91%	29%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	7%	3%	0%	0%	1%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	1%	1%	0%	0%	0%	50%
Other	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	71%	65%	0%	32%	8%	45%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	93%	98%	50%
Weather/Fire/Earthquake	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	99%	99%	0%	7%	2%	0%
TWENTY SIX ST(4.16KV) - Customers: 311	0.0	0.0	0.0	7.7	0.2	0.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	0.0	7.7	0.0	0.0	0.0	0.0	0.0	7.7	0.0	1.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
TWENTY THREE ST(4.16KV) - Customers: 52	54.5	1.0	0.0	151.5	1.0	0.0	153.7	1.0	1.0	65.7	1.0	1.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	1.0	65.7	1.0	3.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	33%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Operation	100%	100%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	100%	100%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	100%	0%	0%	67%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Santa Monica

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
TWENTY TWO ST(4.16KV) - Customers: 67	53.7	1.0	0.0	153.0	1.0	0.0	156.2	1.0	1.0	67.0	1.0	1.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	1.0	67.0	1.0	3.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	33%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Operation	100%	100%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	100%	100%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	100%	0%	0%	67%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
WADSWORTH(4.16KV) - Customers: 1,804	88.4	0.6	1.6	56.8	2.0	0.0	187.3	0.3	4.1	0.0	0.0	2.0	0.0	0.0	0.0	105.0	0.3	0.0	0.0	0.0	1.0	105.0	0.3	3.0
3rd Party	0%	0%	0%	77%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	100%	100%	76%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	38%	0%	0%	0%	0%	0%	24%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	33%
Vegetation/Animal	0%	0%	62%	23%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	67%
WALGROVE(16KV) - Customers: 588	0.0	0.0	0.0	26.2	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	3.7	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	3.7	0.1	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	44%	3%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	7%	1%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	50%	97%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
YALE(4.16KV) - Customers: 613	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	50%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	50%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%