



Circuit Reliability Review

Rancho Palos Verdes

January 2017

Providing Safe, Reliable, and Affordable Power

Southern California Edison is modernizing the power grid to meet the changing needs and expectations of our customers and to help California achieve its clean energy goals.

We are investing more than \$12 billion into our power grid between 2015 – 2017 with the goal of increasing power reliability through significant upgrades. These investments include:

- Updating thousands of transmission and distribution poles
- Replacing hundreds of miles of underground cables
- Replacing hundreds of underground structures such as vaults and manholes
- Upgrading critical distribution equipment; capacitor banks, switches, and circuit breakers
- Building new distribution circuits to serve electrical demands in our communities
- Inspecting and replacing overhead conductor and equipment to improve public safety

Our investments in local communities will help ensure that customers receive safe, reliable, and affordable electricity now and in the future.

Understanding Your Reliability Report

As your electric utility, we want you to always have power when you need it. To get there, we constantly track and monitor electric outages across our service territory, and we measure our “system reliability” from this data.

The two metrics we rely on are common in the electric utility industry: the System Average Interruption Duration Index (SAIDI) and the System Average Interruption Frequency Index (SAIFI). Both are described in more detail on the next page.

Replacing and upgrading our infrastructure will help SCE maintain or improve SAIDI and SAIFI measurements.

This report provides historical reliability data for the circuits that serve your jurisdiction and our proposed infrastructure upgrades for the current year.

To view other reliability reports, visit [sce.com>Outage Center>Maintaining Reliable Service](https://sce.com/Outage-Center/Maintaining-Reliable-Service)

Reliability Metrics

MOMENTARY OUTAGES:

OUTAGES LASTING 5 MINUTES OR LESS

MAIFI:

- The number of times the average customer is interrupted by Momentary outages each year.

SUSTAINED OUTAGES:

OUTAGES LASTING LONGER THAN 5 MINUTES

SAIFI:

- The number of times the average customer is interrupted by Sustained outages each year.

SAIDI:

- The cumulative amount of time the average customer is interrupted by Sustained outages each year.

Cities in the South Bay District

Alondra Park

Del Aire

El Segundo

Gardena

Hawthorne

Hermosa Beach

Inglewood

Ladera Heights

Lawndale

Lennox

Lomita

Los Angeles

Manhattan Beach

Palos Verdes Estates

Rancho Palos Verdes

Redondo Beach

Rolling Hills

Rolling Hills Estates

Torrance

View Park-Windsor Hills

West Athens

Westmont

Reliability by SCE District (No Exclusions)

District Name	2012				2013				2014				2015				2016			
	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking
ANTELOPE VALLEY	78.60	28	0.56	31	94.42	22	0.62	31	51.05	35	0.59	34	104.34	22	0.68	30	107.67	24	0.87	29
ARROWHEAD	129.58	13	1.31	7	180.59	7	1.39	8	193.25	5	1.59	5	362.61	4	3.97	1	659.46	3	2.85	5
BARSTOW	184.80	7	1.15	12	204.33	6	1.40	7	201.53	4	1.34	10	187.11	8	1.17	12	134.83	18	1.35	9
BIG CREEK	1184.25	1	4.52	1	176.51	8	3.08	1	920.25	1	1.34	11	422.77	2	3.42	2	1062.01	2	4.99	1
BISHOP	463.09	2	1.25	9	104.44	17	0.51	35	118.79	17	0.59	35	298.11	6	2.22	4	168.59	8	1.22	14
BLYTHE	225.88	6	1.53	3	483.13	1	1.38	9	707.54	2	2.42	2	427.00	1	1.52	7	396.38	5	2.71	6
CATALINA	78.46	30	0.72	29	105.94	16	2.97	2	97.02	24	4.17	1	42.56	35	2.25	3	65.01	35	3.66	3
COVINA	108.73	19	0.92	19	100.51	19	0.86	20	91.60	27	0.87	22	100.08	23	0.81	25	112.13	22	0.97	24
DOMINGUEZ HILLS	117.22	18	0.82	24	89.17	26	0.80	21	82.30	29	0.71	28	130.63	15	0.97	17	146.38	12	1.11	17
FOOTHILL	91.69	25	0.90	20	85.80	27	0.79	24	93.35	25	0.93	21	109.64	20	0.95	20	142.81	14	1.03	21
FULLERTON	68.99	33	0.42	35	90.57	25	0.79	22	82.23	30	0.72	27	76.59	29	0.67	31	92.72	30	0.76	34
HUNTINGTON BEACH	95.78	23	0.89	21	66.51	32	0.68	29	79.61	31	0.78	25	98.32	25	0.95	19	128.02	20	1.26	12
KERNVILLE	226.76	5	1.31	6	232.18	4	1.96	3	178.69	8	1.99	3	286.38	7	0.96	18	2421.32	1	3.67	2
LONG BEACH	75.83	31	0.55	33	75.11	30	0.70	28	66.33	34	0.61	32	164.46	9	0.89	23	135.16	17	0.86	31
MENIFEE	99.32	22	0.84	23	107.39	15	1.26	10	156.68	11	1.32	12	111.46	19	0.98	16	156.75	9	1.31	10
MONROVIA	108.11	20	1.13	15	99.12	20	1.02	16	133.32	14	1.16	16	96.68	26	0.88	24	116.57	21	0.84	32
MONTEBELLO	131.06	12	1.13	14	118.08	13	1.17	12	158.34	10	1.16	15	150.28	12	1.18	11	133.52	19	1.17	15
ONTARIO	93.09	24	0.87	22	77.39	29	0.79	23	97.91	23	1.00	19	94.04	27	0.74	27	105.07	27	0.93	27
PALM SPRINGS	175.92	8	1.27	8	112.80	14	0.77	25	107.04	20	0.71	29	99.54	24	0.80	26	107.58	25	1.07	19
REDLANDS	120.13	16	1.11	16	96.48	21	1.04	15	154.25	12	1.04	18	124.52	17	1.01	14	137.11	16	0.98	23
RIDGECREST	229.65	4	1.44	4	161.95	9	1.12	13	176.84	9	1.57	6	148.90	13	1.01	15	254.31	6	1.05	20
SADDLEBACK	83.01	27	0.73	27	70.69	31	0.53	34	99.07	22	0.74	26	46.03	34	0.39	35	65.99	34	0.65	35
SAN JOAQUIN	135.90	10	1.04	18	244.44	2	1.45	6	138.25	13	1.17	14	127.50	16	1.05	13	108.44	23	1.09	18
SANTA ANA	78.60	29	0.55	32	93.35	24	0.74	26	91.68	26	0.84	23	67.46	32	0.71	29	97.27	29	1.00	22
SANTA BARBARA	153.81	9	1.15	13	82.00	28	0.70	27	183.78	7	1.38	9	152.37	11	1.52	6	156.66	10	1.41	8
SANTA MONICA	101.69	21	0.79	25	122.78	12	1.00	17	110.76	19	0.99	20	75.41	30	0.62	32	91.08	31	0.95	26
SOUTH BAY	122.68	15	1.17	10	142.15	10	1.49	5	125.28	16	1.39	8	164.07	10	1.31	8	183.90	7	1.88	7
TEHACHAPI	117.96	17	1.43	5	232.67	3	1.12	14	130.70	15	1.29	13	298.96	5	1.21	9	97.29	28	1.13	16
THOUSAND OAKS	127.73	14	1.05	17	93.86	23	0.91	18	104.37	21	1.10	17	106.59	21	0.92	21	143.78	13	1.31	11
VALENCIA	62.01	35	0.46	34	51.04	34	0.53	33	79.23	32	0.61	33	72.27	31	0.61	33	105.09	26	0.97	25
VENTURA	134.81	11	1.15	11	100.52	18	1.21	11	183.79	6	1.65	4	148.85	14	1.19	10	150.41	11	1.24	13
VICTORVILLE	67.70	34	0.66	30	61.33	33	0.63	30	68.85	33	0.63	31	87.03	28	0.91	22	79.35	33	0.92	28
WHITTIER	72.60	32	0.74	26	135.04	11	0.86	19	87.60	28	0.70	30	114.52	18	0.73	28	137.34	15	0.81	33
WILDOMAR	88.54	26	0.72	28	40.51	35	0.56	32	118.49	18	0.81	24	52.70	33	0.60	34	84.01	32	0.87	30
YUCCA VALLEY	319.82	3	3.41	2	216.97	5	1.50	4	304.25	3	1.49	7	389.08	3	1.80	5	463.68	4	3.39	4
SCE SystemWide	108.13		0.89		102.61		0.91		112.00		0.96		114.83		0.92		134.48		1.10	

Exclusions are days which utilities are allowed to remove from their metrics because the outages on those days were caused by a severe acts of nature.

**In the columns showing "Rank," lower numbers indicate poorer performance.


Overview of Rancho Palos Verdes

There are 28 circuits that serve Rancho Palos Verdes

Circuit Type	Sum of Customers	Circuit Type	Sum of Customers	Circuit Type	Sum of Customers	Circuit Type	Sum of Customers
AMBERSKY(16KV)	1,835						
ARCTURUS(4.16KV)	603						
BACHELOR(16KV)	1,330						
BAUXITE(16KV)	2,339						
BLACKWATER(4.16KV)	111						
BRIDLE(4.16KV)	367						
CLIPPER(4.16KV)	161						
CODONA(4.16KV)	340						
COVEVIEW(16KV)	1,858						
DUHON(4.16KV)	343						
FELDSPAR(16KV)	1,173						
JUPITER(4.16KV)	726						
MICA(16KV)	770						
NANCY(4.16KV)	185						
PIMA(4.16KV)	365						
PLUTO(4.16KV)	617						
PORTUGUESE BEND(4.16KV)	54						
QUICKSILVER(16KV)	1,759						
SCIURBA(16KV)	2,761						
SHORELINE(16KV)	1,038						
SILICONE(16KV)	2,247						
STATLER(16KV)	1,674						
TANDEM(16KV)	1,496						
TYBURN(4.16KV)	181						
VANDERLIP(2.4KV)	49						
VENUS(4.16KV)	934						
ZINC(16KV)	2,630						
ZIRCON(16KV)	386						


Grand Total 28,332

Reliability History of Circuits Serving Rancho Palos Verdes (No Exclusions)

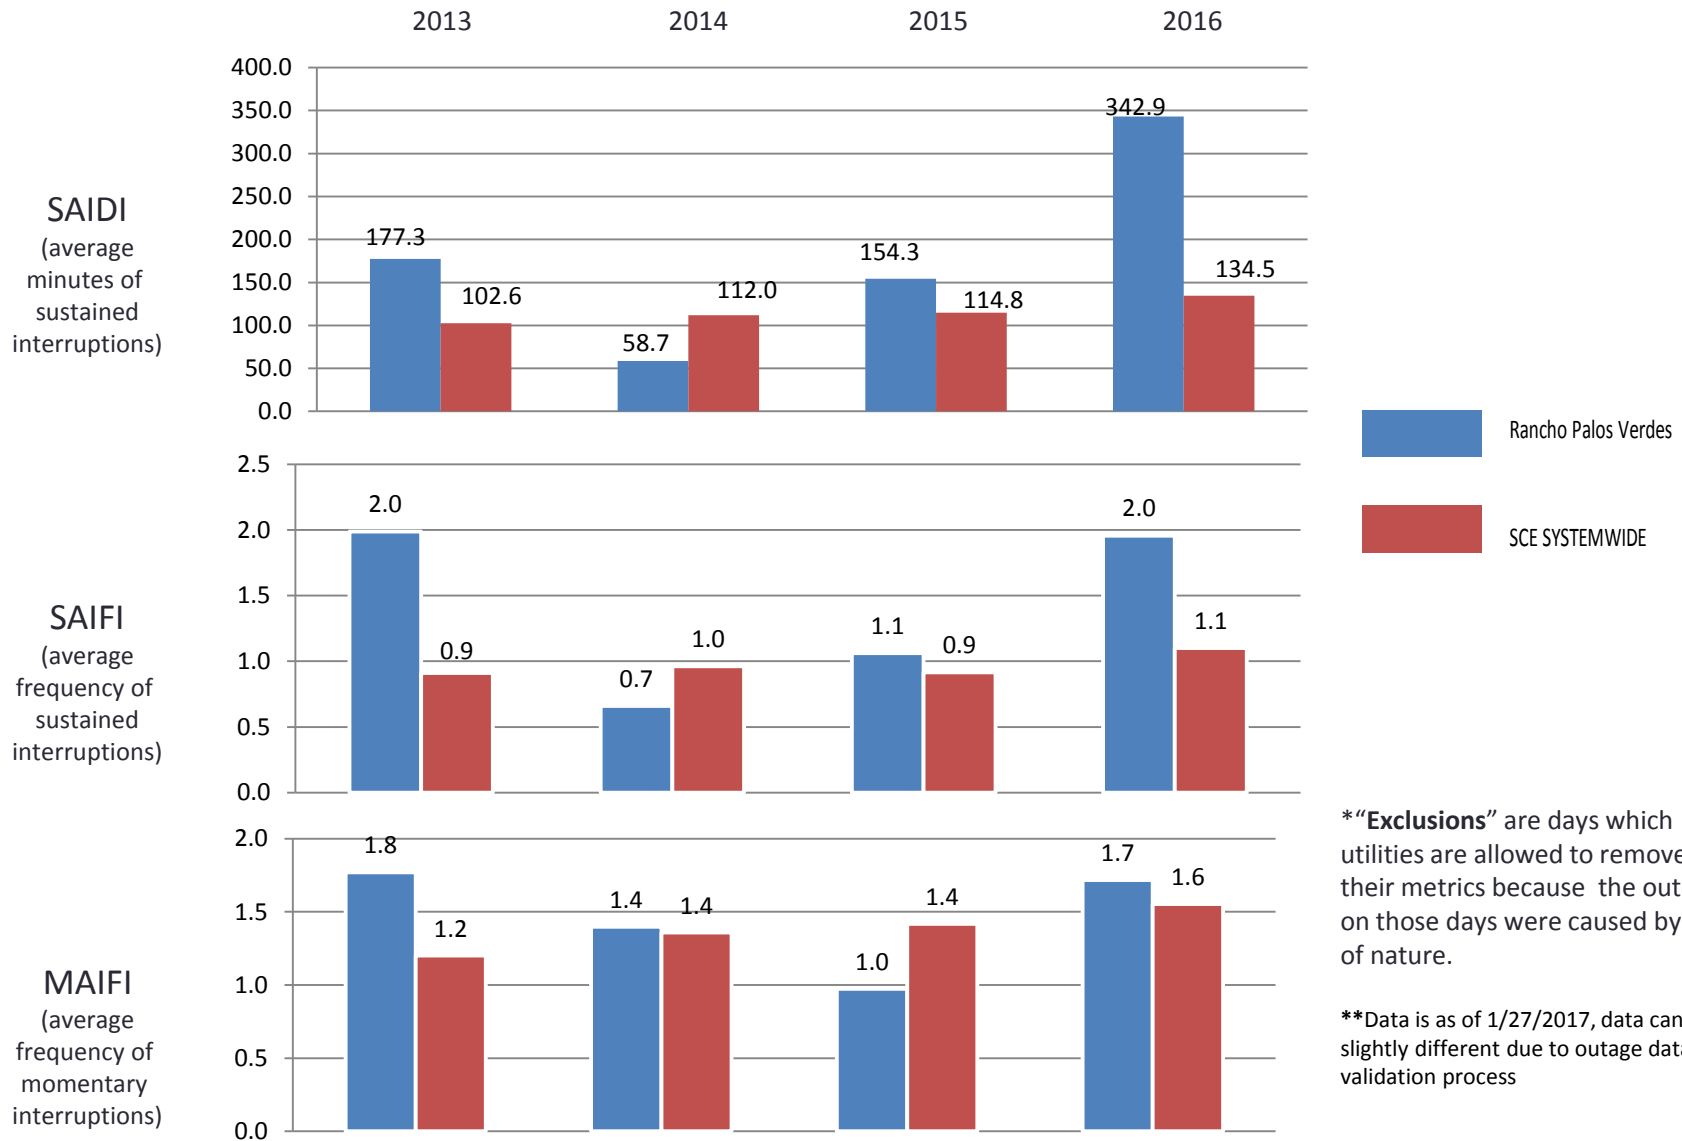

Causes of Repair Outages in Rancho Palos Verdes Circuits 2016 YTD


Contributions to SAIDI by Outage Cause

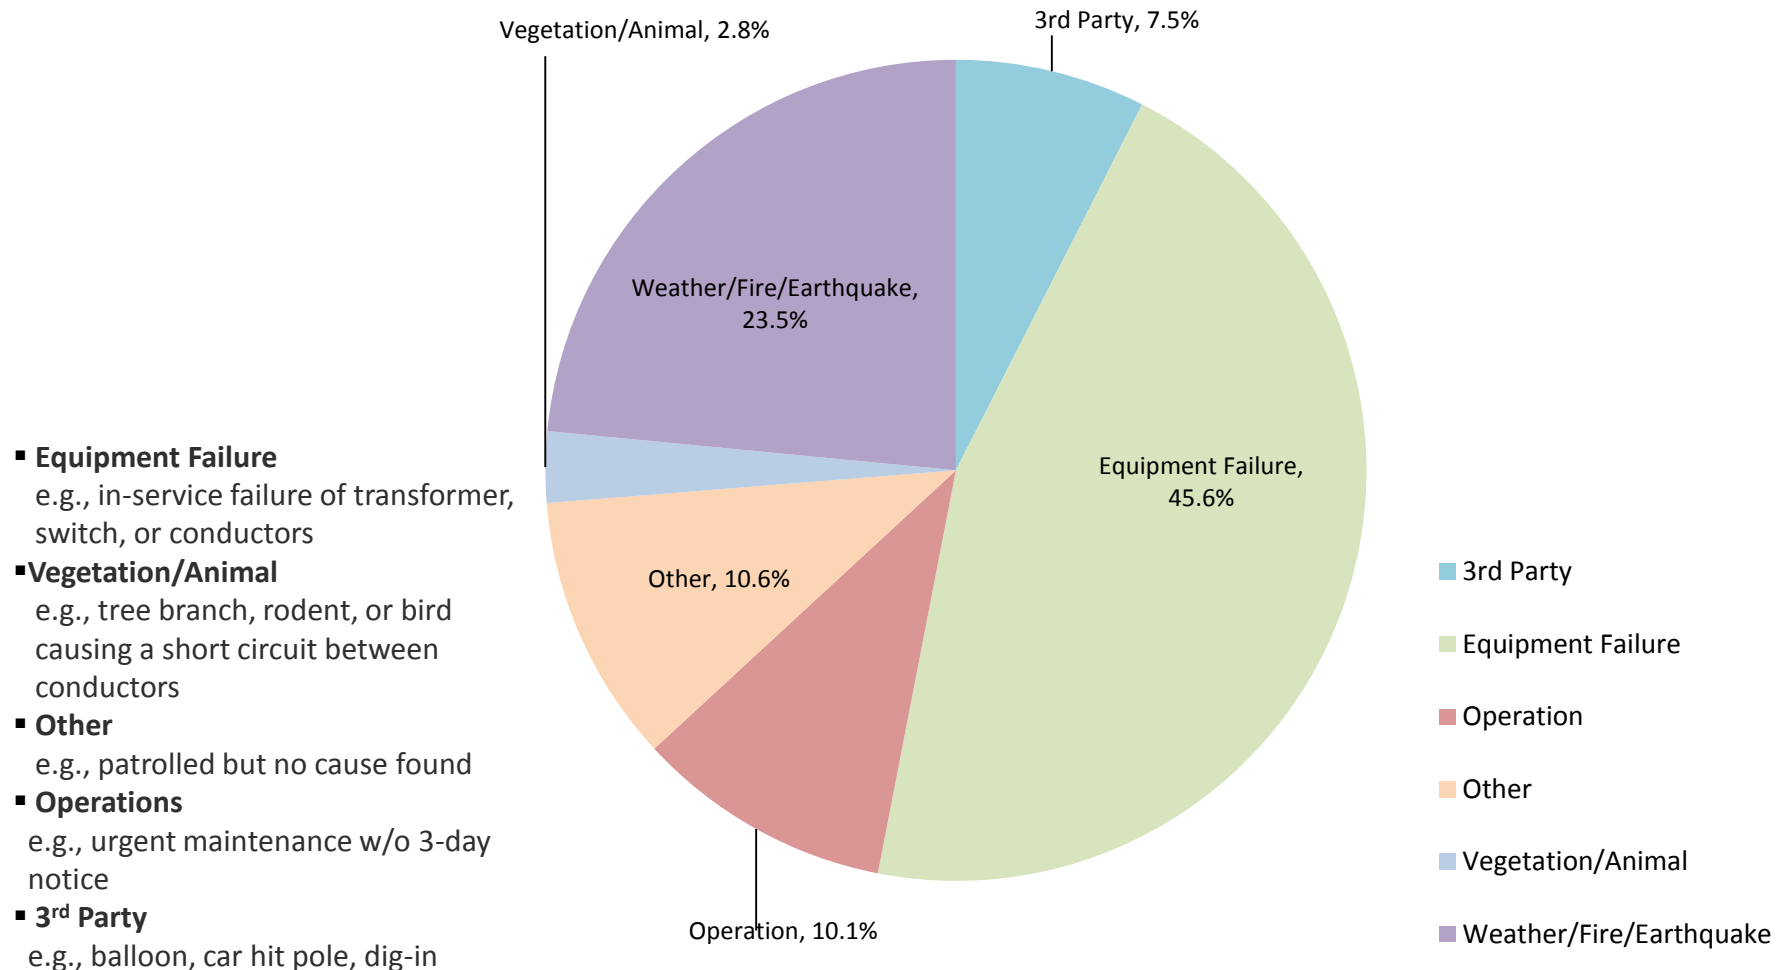

SAIDI = the cumulative amount of time the average customer is interrupted by “sustained” outages each year.

Causes of Repair Outages in Rancho Palos Verdes Circuits 2016 YTD

Contributions to SAIFI by Outage Cause

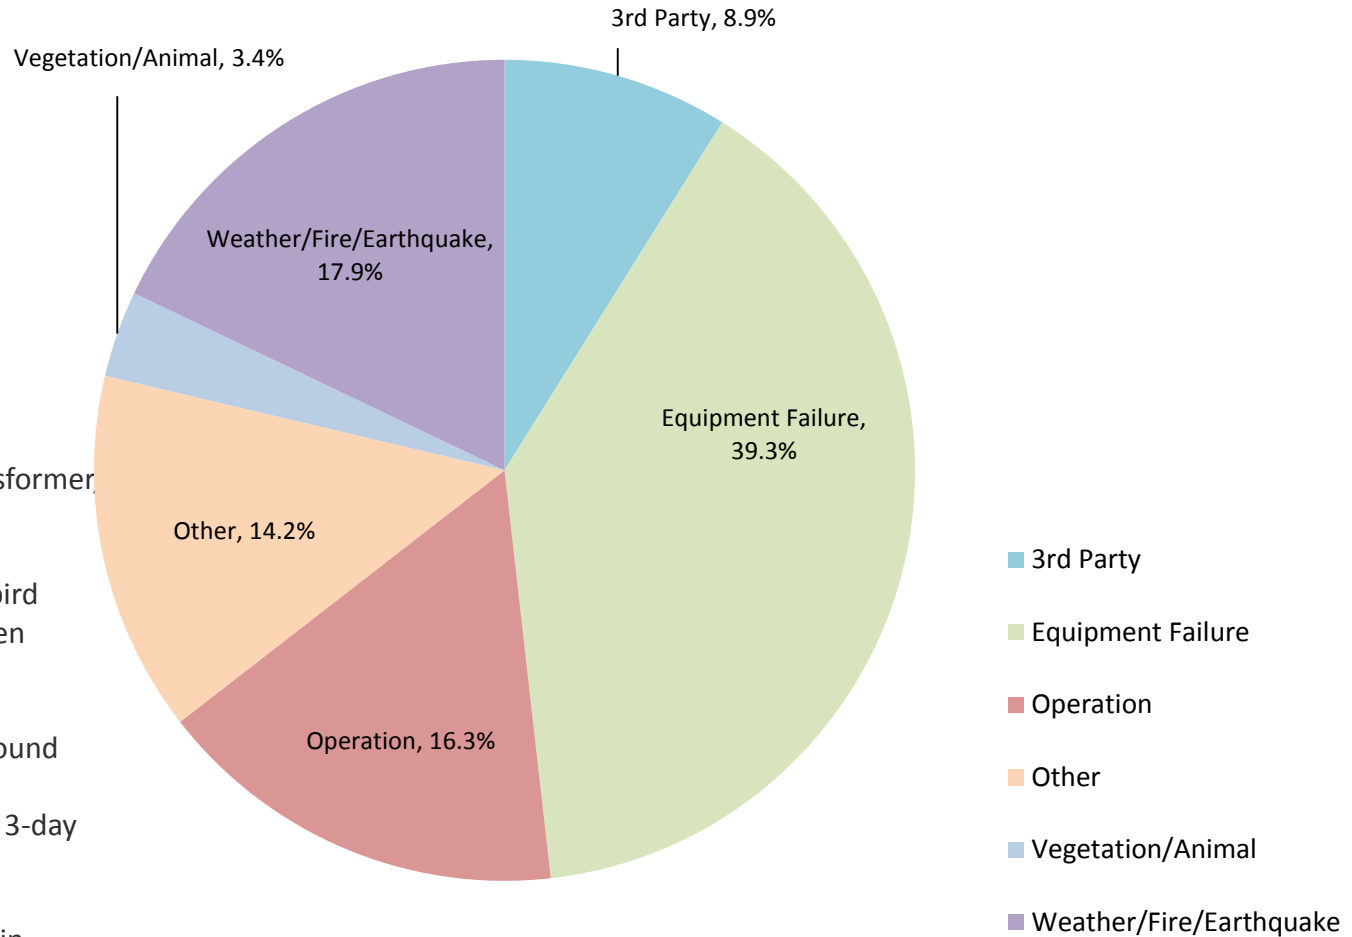

SAIFI = the number of times the average customer is interrupted by “sustained” outages each year.





Back-up Slides

Reliability Histories of Circuits Serving Rancho Palos Verdes

Updated through Year-End 2016

Average Reliability of 28 Circuits Serving Rancho Palos Verdes

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
Rancho Palos Verdes	177.3	2.0	1.8	58.7	0.7	1.4	154.3	1.1	1.0	133.6	0.6	0.5	40.3	0.4	0.4	91.7	0.6	0.2	77.3	0.4	0.7	342.9	2.0	1.7
3rd Party	16%	11%	23%	22%	32%	12%	4%	12%	16%	0%	0%	18%	10%	5%	11%	23%	28%	0%	0%	0%	7%	8%	9%	10%
Equipment Failure	69%	71%	32%	36%	21%	18%	55%	49%	48%	28%	30%	36%	50%	24%	50%	57%	62%	22%	60%	38%	11%	46%	39%	28%
Operation	8%	6%	0%	20%	24%	6%	7%	11%	14%	9%	5%	0%	16%	54%	4%	6%	7%	1%	14%	10%	9%	10%	16%	5%
Other	1%	5%	33%	12%	11%	33%	3%	2%	2%	12%	14%	9%	0%	0%	15%	0%	0%	31%	26%	52%	18%	11%	14%	17%
Vegetation/Animal	4%	4%	10%	4%	2%	26%	7%	15%	10%	0%	0%	0%	23%	17%	20%	0%	0%	46%	0%	0%	54%	3%	3%	31%
Weather/Fire/Earthquake	2%	3%	1%	6%	11%	5%	24%	11%	10%	51%	52%	36%	0%	0%	0%	13%	3%	0%	0%	0%	0%	23%	18%	9%
SCE Systemwide	102.6	0.9	1.2	112.0	1.0	1.4	114.8	0.9	1.4	40.5	0.3	0.4	34.8	0.3	0.4	29.4	0.2	0.3	29.8	0.3	0.4	134.5	1.1	1.6

Notes:

No outages are excluded from the metrics.

Outage Causes:

Other: e.g., patrolled but no cause could be found

Operations: e.g., urgent maintenance w/o 3-day notice to customers

3rd Party: e.g., balloons, car hit pole, dig-in

Vegetation/Animal: e.g., tree branch, rodent, or bird causing short circuit across conductors

SAIDI (minutes) = the cumulative amount of time the average customer is interrupted by "sustained" (longer than 5 minutes) outages.

SAIFI (interruptions) = the number of times the average customer is interrupted by "sustained" outages.

MAIFI (interruptions) = the number of times the average customer is interrupted by "momentary" (lasting 5 minutes or less) outages.

Reliability Histories for Individual Circuits Serving Rancho Palos Verdes

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
AMBERSKY(16KV) - Customers: 1,835	411.2	2.7	2.3	148.7	1.9	0.4	128.8	1.6	2.3	0.0	0.0	0.0	9.3	0.0	3.0	72.6	1.1	0.6	52.8	0.1	0.0	134.7	1.2	3.6
3rd Party	45%	37%	43%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	54%	62%	57%	8%	3%	0%	99%	98%	100%	0%	0%	0%	100%	100%	100%	96%	96%	100%	100%	100%	0%	98%	97%	100%
Operation	0%	1%	0%	22%	4%	0%	1%	2%	0%	0%	0%	0%	0%	0%	0%	4%	4%	0%	0%	0%	0%	2%	3%	0%
Other	0%	0%	0%	33%	37%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	37%	57%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
ARCTURUS(4.16KV) - Customers: 603	155.1	1.2	1.0	0.0	0.0	0.0	109.3	1.0	0.0	361.6	1.0	0.8	0.0	0.0	0.7	0.0	0.0	0.0	0.0	0.0	1.0	361.6	1.0	2.5
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	91%	89%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	1%	5%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	27%
Other	9%	6%	100%	0%	0%	0%	0%	0%	0%	81%	18%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%	81%	18%	73%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	19%	82%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	19%	82%	0%
BACHELOR(16KV) - Customers: 1,330	338.4	1.6	0.0	131.7	1.5	3.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	3.0	120.7	1.0	1.0	107.0	0.5	2.6	227.7	1.5	6.6
3rd Party	0%	0%	0%	63%	68%	0%	0%	0%	0%	0%	0%	0%	0%	0%	33%	99%	99%	0%	3%	1%	38%	54%	65%	30%
Equipment Failure	94%	92%	0%	37%	32%	42%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	80%	32%	0%	37%	11%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	1%	0%	0%	0%	0%	1%	1%	0%
Other	0%	0%	100%	0%	0%	29%	0%	0%	100%	0%	0%	0%	0%	0%	34%	0%	0%	0%	18%	67%	24%	8%	23%	25%
Vegetation/Animal	5%	8%	0%	0%	0%	29%	0%	0%	0%	0%	0%	0%	0%	0%	33%	0%	0%	100%	0%	0%	38%	0%	0%	45%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
BAUXITE(16KV) - Customers: 2,339	104.2	1.4	1.6	10.6	0.2	0.0	158.9	2.7	4.5	419.0	2.1	1.4	42.7	0.6	0.0	156.5	1.0	0.0	273.2	1.3	1.9	891.4	5.0	3.3
3rd Party	0%	0%	0%	58%	25%	0%	0%	0%	0%	0%	0%	70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	31%
Equipment Failure	100%	100%	39%	0%	0%	0%	28%	53%	78%	72%	51%	30%	100%	100%	0%	100%	100%	0%	68%	78%	46%	77%	74%	39%
Operation	0%	0%	0%	42%	75%	0%	40%	9%	22%	0%	0%	0%	0%	0%	0%	0%	0%	0%	32%	22%	0%	10%	6%	0%
Other	0%	0%	61%	0%	0%	0%	0%	0%	0%	28%	49%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	13%	20%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	24%	37%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	54%	0%	0%	30%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	7%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Rancho Palos Verdes

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
BLACKWATER(4.16KV) - Customers: 111	67.1	1.0	0.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
BRIDLE(4.16KV) - Customers: 367	358.0	2.0	0.0	0.0	0.0	2.0	46.7	0.2	1.0	0.0	0.0	0.0	317.9	1.0	1.8	1000.6	2.4	0.0	203.5	1.1	0.9	1522.0	4.4	2.7
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	50%	0%	1%	0%	100%	100%	0%	34%	46%	33%
Operation	0%	0%	0%	0%	0%	0%	1%	2%	100%	0%	0%	0%	0%	0%	0%	16%	46%	0%	0%	0%	0%	10%	25%	0%
Other	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	33%
Vegetation/Animal	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	33%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	99%	98%	0%	0%	0%	0%	0%	0%	0%	84%	53%	0%	0%	0%	0%	55%	29%	0%
CLIPPER(4.16KV) - Customers: 161	67.2	1.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
CODONA(4.16KV) - Customers: 340	523.5	4.0	1.9	31.2	0.2	3.0	25.7	0.2	1.0	0.0	0.0	0.0	258.8	1.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	258.8	1.2	0.0
3rd Party	60%	24%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Equipment Failure	8%	24%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	2%	0%	100%	100%	67%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	33%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	32%	49%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Rancho Palos Verdes

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
COVEVIEW(16KV) - Customers: 1,858	152.7	2.1	0.8	88.6	0.2	0.0	7.3	0.1	0.0	0.0	0.0	0.0	31.0	0.1	0.0	0.0	0.0	0.0	95.1	0.1	0.0	126.1	0.2	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	96%	95%	100%	100%	98%	0%	0%	0%	0%	0%	0%	0%	93%	83%	0%	0%	0%	0%	100%	100%	0%	98%	90%	0%
Operation	4%	5%	0%	0%	2%	0%	100%	100%	0%	0%	0%	0%	7%	17%	0%	0%	0%	0%	0%	0%	0%	2%	10%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
DUHON(4.16KV) - Customers: 343	200.8	5.0	4.0	46.1	1.0	3.0	45.8	0.2	0.0	0.0	0.0	1.0	24.2	1.0	0.0	88.3	1.0	0.0	0.0	0.0	0.0	112.5	2.0	1.0
3rd Party	0%	0%	0%	100%	100%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	78%	50%	0%
Equipment Failure	85%	60%	75%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	22%	50%	0%
Other	6%	20%	0%	0%	0%	33%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	25%	0%	0%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	9%	20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%
FELDSPAR(16KV) - Customers: 1,173	56.0	1.1	1.0	29.6	1.1	0.1	261.9	1.4	0.2	165.8	1.1	1.0	0.0	0.0	0.0	0.3	0.0	1.0	6.5	0.0	0.0	172.6	1.1	2.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	83%	95%	0%	67%	95%	100%	53%	19%	0%	25%	3%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	25%	3%	0%
Operation	17%	5%	0%	33%	5%	0%	4%	10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	4%	1%	0%
Other	0%	0%	100%	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	50%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	43%	71%	0%	75%	97%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	72%	96%	50%
JUPITER(4.16KV) - Customers: 726	322.8	2.9	1.0	0.0	0.0	1.0	0.0	0.0	0.0	87.3	1.0	0.0	22.2	0.1	0.0	1.5	0.0	1.0	0.7	0.0	0.0	111.7	1.2	1.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	97%	96%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	20%	12%	0%
Operation	3%	4%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%	2%	3%	0%
Other	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	78%	85%	0%

Reliability Histories for Individual Circuits Serving Rancho Palos Verdes

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
MICA(16KV) - Customers: 770	99.6	1.1	1.0	21.7	0.1	0.0	139.4	0.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	98%	95%	0%	100%	100%	0%	73%	27%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	2%	5%	0%	0%	0%	0%	27%	73%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
NANCY(4.16KV) - Customers: 185	196.5	3.0	1.0	178.6	0.9	2.8	168.1	1.3	2.0	0.0	0.0	0.0	30.4	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.7	30.4	0.1	0.7
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	21%	33%	0%	95%	87%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	48%	34%	0%	0%	0%	0%	8%	15%	50%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Other	0%	0%	0%	4%	11%	64%	33%	7%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	36%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	100%
Weather/Fire/Earthquake	30%	33%	100%	1%	2%	0%	59%	78%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
PIMA(4.16KV) - Customers: 365	67.1	1.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	86.0	1.1	0.0	86.0	1.1	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
PLUTO(4.16KV) - Customers: 617	42.1	1.0	2.0	176.7	1.0	3.0	0.0	0.0	0.0	452.3	2.0	0.0	0.0	0.0	0.0	4.8	0.0	0.0	0.0	0.0	0.0	457.0	2.0	0.0
3rd Party	0%	0%	50%	0%	0%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	21%	10%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	1%	2%	0%	0%	0%	0%	0%	1%	0%	0%	0%	0%	79%	90%	0%	0%	0%	0%	1%	1%	0%
Other	0%	0%	50%	99%	98%	67%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	99%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	99%	99%	0%

Reliability Histories for Individual Circuits Serving Rancho Palos Verdes

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
PORTUGUESE BEND(4.16KV) - Customers: 54	41.6	1.0	0.0	0.0	0.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	15.8	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	15.8	0.1	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
QUICKSILVER(16KV) - Customers: 1,759	192.7	2.3	4.2	85.6	1.5	0.8	225.7	4.8	1.4	387.1	1.9	0.0	145.4	1.0	0.0	0.2	0.0	0.0	0.9	0.0	1.0	533.6	2.9	1.0
3rd Party	36%	44%	0%	30%	65%	0%	40%	43%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	56%	52%	47%	8%	3%	0%	45%	53%	31%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	24%	19%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	100%	100%	0%	0%	99%
Other	0%	0%	24%	0%	0%	0%	10%	2%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%
Vegetation/Animal	1%	0%	29%	38%	12%	100%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	27%	34%	0%
Weather/Fire/Earthquake	7%	4%	0%	0%	0%	0%	5%	1%	69%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	73%	65%	0%
SCIURBA(16KV) - Customers: 2,761	130.8	2.9	1.7	42.5	0.5	3.0	11.4	0.0	0.0	44.7	0.0	1.0	36.0	1.1	0.0	158.8	1.0	0.0	2.6	0.0	1.0	242.0	2.2	2.0
3rd Party	0%	0%	0%	48%	84%	34%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	66%	47%	0%
Equipment Failure	84%	55%	42%	23%	3%	0%	100%	100%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	18%	2%	0%
Operation	2%	1%	0%	29%	13%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%	16%	51%	0%
Other	10%	34%	0%	0%	0%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	58%	0%	0%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	52%
Weather/Fire/Earthquake	4%	10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	48%
SHORELINE(16KV) - Customers: 1,038	219.7	1.3	0.0	0.0	0.0	1.0	2.6	0.0	0.0	0.6	0.0	0.0	8.7	0.1	0.9	53.3	0.1	0.0	0.0	0.0	0.0	62.5	0.2	0.9
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	69%	85%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	97%	50%	0%	0%	0%	0%	84%	21%	0%
Operation	12%	8%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	15%	31%	0%	3%	50%	0%	0%	0%	0%	5%	39%	0%
Other	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	85%	69%	100%	0%	0%	0%	0%	0%	0%	12%	40%	100%
Weather/Fire/Earthquake	19%	6%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Rancho Palos Verdes

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
SILICONE(16KV) - Customers: 2,247	107.9	1.2	3.3	61.0	0.7	2.3	75.2	0.2	1.0	26.2	1.1	1.1	87.3	0.2	0.0	54.4	0.9	0.0	346.3	2.1	0.8	514.2	4.3	1.9
3rd Party	0%	0%	30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	98%	90%	40%	37%	20%	38%	62%	46%	0%	60%	97%	100%	100%	100%	0%	100%	100%	0%	39%	10%	0%	57%	54%	57%
Operation	2%	10%	0%	63%	80%	24%	33%	49%	0%	35%	3%	0%	0%	0%	0%	0%	0%	0%	1%	4%	0%	3%	3%	0%
Other	0%	0%	30%	0%	0%	0%	4%	5%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	60%	86%	100%	40%	43%	43%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	1%	1%	100%	5%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	38%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
STATLER(16KV) - Customers: 1,674	60.1	1.0	0.2	176.4	1.3	4.1	627.6	2.2	0.5	616.7	1.4	0.8	2.5	0.0	0.0	0.0	0.0	0.0	1.7	0.0	1.1	620.9	1.5	1.9
3rd Party	0%	0%	0%	59%	84%	23%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	98%	99%	0%	39%	12%	0%	2%	7%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	1%	0%
Operation	2%	1%	0%	1%	4%	0%	1%	1%	91%	32%	36%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	32%	36%	0%
Other	0%	0%	50%	0%	0%	30%	0%	0%	0%	0%	0%	57%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	1%	24%
Vegetation/Animal	0%	0%	50%	0%	0%	47%	16%	48%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	58%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	81%	44%	9%	68%	64%	43%	0%	0%	0%	0%	0%	0%	0%	0%	0%	67%	63%	18%
TANDEM(16KV) - Customers: 1,496	442.7	4.5	4.0	0.7	0.0	3.0	19.5	1.2	1.0	0.0	0.0	0.8	6.4	0.1	0.0	1.7	0.0	0.0	56.5	0.1	1.2	64.6	0.2	2.0
3rd Party	12%	24%	50%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	16%	24%	25%	0%	0%	0%	36%	1%	0%	0%	0%	100%	83%	46%	0%	100%	100%	0%	0%	0%	0%	11%	29%	41%
Operation	52%	29%	0%	0%	0%	0%	64%	99%	0%	0%	0%	0%	17%	54%	0%	0%	0%	0%	100%	100%	0%	89%	71%	0%
Other	0%	0%	25%	0%	0%	67%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	19%	23%	0%	100%	100%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	59%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
TYBURN(4.16KV) - Customers: 181	540.2	5.0	1.0	124.6	0.5	0.0	271.6	2.2	0.0	89.6	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	89.6	0.1	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	100%	0%	0%	0%	44%	46%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Operation	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	56%	54%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Rancho Palos Verdes

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
VANDERLIP(2.4KV) - Customers: 49	41.5	1.0	0.0	0.0	0.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
VENUS(4.16KV) - Customers: 934	144.5	2.2	1.9	18.7	1.0	0.0	1210.8	1.8	3.9	87.8	1.0	0.0	2.1	0.0	0.0	19.7	0.0	1.0	78.3	0.2	0.0	187.9	1.3	1.0
3rd Party	42%	6%	46%	0%	0%	0%	0%	0%	77%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	58%	94%	0%	0%	0%	0%	91%	93%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%	100%	100%	0%	53%	20%	0%
Operation	0%	0%	0%	100%	100%	0%	0%	2%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	54%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	9%	5%	23%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	47%	80%	0%
ZINC(16KV) - Customers: 2,630	52.8	1.1	2.0	20.1	0.4	0.9	147.7	0.5	0.0	51.2	0.0	0.0	35.8	1.0	0.0	307.6	1.3	0.0	0.0	0.0	0.0	394.6	2.3	0.0
3rd Party	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	72%	45%	100%	97%	83%	0%	100%	100%	0%	26%	3%	0%	90%	86%	0%	0%	0%	0%	86%	50%	0%
Operation	0%	0%	0%	28%	55%	0%	3%	17%	0%	0%	0%	0%	74%	97%	0%	10%	14%	100%	0%	0%	0%	14%	50%	100%
Other	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
ZIRCON(16KV) - Customers: 386	61.4	1.7	0.9	23.2	0.1	0.0	38.0	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	117.0	0.7	0.4	0.0	0.0	0.0	117.0	0.7	0.4
3rd Party	41%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	59%	50%	0%	30%	65%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	96%	90%	100%	0%	0%	0%	96%	90%	100%
Operation	0%	0%	0%	70%	35%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	4%	10%	0%	0%	0%	0%	4%	10%	0%
Other	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%