



Circuit Reliability Review

Arcadia

January 2017

Providing Safe, Reliable, and Affordable Power

Southern California Edison is modernizing the power grid to meet the changing needs and expectations of our customers and to help California achieve its clean energy goals.

We are investing more than \$12 billion into our power grid between 2015 – 2017 with the goal of increasing power reliability through significant upgrades. These investments include:

- Updating thousands of transmission and distribution poles
- Replacing hundreds of miles of underground cables
- Replacing hundreds of underground structures such as vaults and manholes
- Upgrading critical distribution equipment; capacitor banks, switches, and circuit breakers
- Building new distribution circuits to serve electrical demands in our communities
- Inspecting and replacing overhead conductor and equipment to improve public safety

Our investments in local communities will help ensure that customers receive safe, reliable, and affordable electricity now and in the future.

Understanding Your Reliability Report

As your electric utility, we want you to always have power when you need it. To get there, we constantly track and monitor electric outages across our service territory, and we measure our “system reliability” from this data.

The two metrics we rely on are common in the electric utility industry: the System Average Interruption Duration Index (SAIDI) and the System Average Interruption Frequency Index (SAIFI). Both are described in more detail on the next page.

Replacing and upgrading our infrastructure will help SCE maintain or improve SAIDI and SAIFI measurements.

This report provides historical reliability data for the circuits that serve your jurisdiction and our proposed infrastructure upgrades for the current year.

To view other reliability reports, visit [sce.com>Outage Center>Maintaining Reliable Service](https://sce.com/OutageCenter/MaintainingReliableService)

Reliability Metrics

MOMENTARY OUTAGES:

OUTAGES LASTING 5 MINUTES OR LESS

MAIFI:

- The number of times the average customer is interrupted by Momentary outages each year.

SUSTAINED OUTAGES:

OUTAGES LASTING LONGER THAN 5 MINUTES

SAIFI:

- The number of times the average customer is interrupted by Sustained outages each year.

SAIDI:

- The cumulative amount of time the average customer is interrupted by Sustained outages each year.

Cities in the Monrovia District

Altadena

Arcadia

Azusa

Baldwin Park

Bradbury

Duarte

East Pasadena

East San Gabriel

Glendale

Irwindale

La Canada Flintridge

La Crescenta-Montrose

Los Angeles

Mayflower Village

Monrovia

Pasadena

San Gabriel

San Marino

Sierra Madre

South Pasadena

Temple City

Vincent

West Puente Valley

Reliability by SCE District (No Exclusions)

District Name	2012				2013				2014				2015				2016			
	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking
ANTELOPE VALLEY	78.60	28	0.56	31	94.42	22	0.62	31	51.05	35	0.59	34	104.34	22	0.68	30	107.67	24	0.87	29
ARROWHEAD	129.58	13	1.31	7	180.59	7	1.39	8	193.25	5	1.59	5	362.61	4	3.97	1	659.46	3	2.85	5
BARSTOW	184.80	7	1.15	12	204.33	6	1.40	7	201.53	4	1.34	10	187.11	8	1.17	12	134.83	18	1.35	9
BIG CREEK	1184.25	1	4.52	1	176.51	8	3.08	1	920.25	1	1.34	11	422.77	2	3.42	2	1062.01	2	4.99	1
BISHOP	463.09	2	1.25	9	104.44	17	0.51	35	118.79	17	0.59	35	298.11	6	2.22	4	168.59	8	1.22	14
BLYTHE	225.88	6	1.53	3	483.13	1	1.38	9	707.54	2	2.42	2	427.00	1	1.52	7	396.38	5	2.71	6
CATALINA	78.46	30	0.72	29	105.94	16	2.97	2	97.02	24	4.17	1	42.56	35	2.25	3	65.01	35	3.66	3
COVINA	108.73	19	0.92	19	100.51	19	0.86	20	91.60	27	0.87	22	100.08	23	0.81	25	112.13	22	0.97	24
DOMINGUEZ HILLS	117.22	18	0.82	24	89.17	26	0.80	21	82.30	29	0.71	28	130.63	15	0.97	17	146.38	12	1.11	17
FOOTHILL	91.69	25	0.90	20	85.80	27	0.79	24	93.35	25	0.93	21	109.64	20	0.95	20	142.81	14	1.03	21
FULLERTON	68.99	33	0.42	35	90.57	25	0.79	22	82.23	30	0.72	27	76.59	29	0.67	31	92.72	30	0.76	34
HUNTINGTON BEACH	95.78	23	0.89	21	66.51	32	0.68	29	79.61	31	0.78	25	98.32	25	0.95	19	128.02	20	1.26	12
KERNVILLE	226.76	5	1.31	6	232.18	4	1.96	3	178.69	8	1.99	3	286.38	7	0.96	18	2421.32	1	3.67	2
LONG BEACH	75.83	31	0.55	33	75.11	30	0.70	28	66.33	34	0.61	32	164.46	9	0.89	23	135.16	17	0.86	31
MENIFEE	99.32	22	0.84	23	107.39	15	1.26	10	156.68	11	1.32	12	111.46	19	0.98	16	156.75	9	1.31	10
MONROVIA	108.11	20	1.13	15	99.12	20	1.02	16	133.32	14	1.16	16	96.68	26	0.88	24	116.57	21	0.84	32
MONTEBELLO	131.06	12	1.13	14	118.08	13	1.17	12	158.34	10	1.16	15	150.28	12	1.18	11	133.52	19	1.17	15
ONTARIO	93.09	24	0.87	22	77.39	29	0.79	23	97.91	23	1.00	19	94.04	27	0.74	27	105.07	27	0.93	27
PALM SPRINGS	175.92	8	1.27	8	112.80	14	0.77	25	107.04	20	0.71	29	99.54	24	0.80	26	107.58	25	1.07	19
REDLANDS	120.13	16	1.11	16	96.48	21	1.04	15	154.25	12	1.04	18	124.52	17	1.01	14	137.11	16	0.98	23
RIDGECREST	229.65	4	1.44	4	161.95	9	1.12	13	176.84	9	1.57	6	148.90	13	1.01	15	254.31	6	1.05	20
SADDLEBACK	83.01	27	0.73	27	70.69	31	0.53	34	99.07	22	0.74	26	46.03	34	0.39	35	65.99	34	0.65	35
SAN JOAQUIN	135.90	10	1.04	18	244.44	2	1.45	6	138.25	13	1.17	14	127.50	16	1.05	13	108.44	23	1.09	18
SANTA ANA	78.60	29	0.55	32	93.35	24	0.74	26	91.68	26	0.84	23	67.46	32	0.71	29	97.27	29	1.00	22
SANTA BARBARA	153.81	9	1.15	13	82.00	28	0.70	27	183.78	7	1.38	9	152.37	11	1.52	6	156.66	10	1.41	8
SANTA MONICA	101.69	21	0.79	25	122.78	12	1.00	17	110.76	19	0.99	20	75.41	30	0.62	32	91.08	31	0.95	26
SOUTH BAY	122.68	15	1.17	10	142.15	10	1.49	5	125.28	16	1.39	8	164.07	10	1.31	8	183.90	7	1.88	7
TEHACHAPI	117.96	17	1.43	5	232.67	3	1.12	14	130.70	15	1.29	13	298.96	5	1.21	9	97.29	28	1.13	16
THOUSAND OAKS	127.73	14	1.05	17	93.86	23	0.91	18	104.37	21	1.10	17	106.59	21	0.92	21	143.78	13	1.31	11
VALENCIA	62.01	35	0.46	34	51.04	34	0.53	33	79.23	32	0.61	33	72.27	31	0.61	33	105.09	26	0.97	25
VENTURA	134.81	11	1.15	11	100.52	18	1.21	11	183.79	6	1.65	4	148.85	14	1.19	10	150.41	11	1.24	13
VICTORVILLE	67.70	34	0.66	30	61.33	33	0.63	30	68.85	33	0.63	31	87.03	28	0.91	22	79.35	33	0.92	28
WHITTIER	72.60	32	0.74	26	135.04	11	0.86	19	87.60	28	0.70	30	114.52	18	0.73	28	137.34	15	0.81	33
WILDOMAR	88.54	26	0.72	28	40.51	35	0.56	32	118.49	18	0.81	24	52.70	33	0.60	34	84.01	32	0.87	30
YUCCA VALLEY	319.82	3	3.41	2	216.97	5	1.50	4	304.25	3	1.49	7	389.08	3	1.80	5	463.68	4	3.39	4
SCE SystemWide	108.13		0.89		102.61		0.91		112.00		0.96		114.83		0.92		134.48		1.10	

Exclusions are days which utilities are allowed to remove from their metrics because the outages on those days were caused by a severe acts of nature.


**In the columns showing "Rank," lower numbers indicate poorer performance.

Overview of Arcadia

There are 51 circuits that serve Arcadia


Circuit Type	Sum of Customers	Circuit Type	Sum of Customers	Circuit Type	Sum of Customers	Circuit Type	Sum of Customers
ACORN(4.16KV)	422	MARENDALE(16KV)	627				
ALSTER(4.16KV)	445	MERIDIAN(16KV)	1,674				
ALTA(4.16KV)	686	MOHAWK(4.16KV)	483				
ALTURA(4.16KV)	459	NADINE(4.16KV)	686				
ARBORETUM(16KV)	1,210	OAKWOOD(4.16KV)	409				
ASHMONT(4.16KV)	457	PADDOCK(16KV)	2,157				
BALDWIN(16KV)	2,845	PILGRIM(16KV)	194				
CAMELLIA(16KV)	2,044	POWDER(16KV)	1,389				
CHANNTRY(16KV)	2,803	ROBBIE(16KV)	2,049				
CHAPMAN(4.16KV)	186	ROWLAND(4.16KV)	636				
COLE(4.16KV)	548	SAINT JO(16KV)	1,789				
COMMERCIAL(4.16KV)	833	SHIRLEY(4.16KV)	500				
DIAMOND(4.16KV)	603	SHOEMAKER(16KV)	1,567				
ELMER(16KV)	1,638	STANDISH(4.16KV)	585				
GAINSBOROUGH(16KV)	1,990	TIMES(4.16KV)	129				
GARDEA(16KV)	3,550	TRACK(4.16KV)	628				
GARIBALDI(16KV)	2,259	TURF(4.16KV)	306				
GLORIA(16KV)	969	VALNETT(4.16KV)	364				
GOLDENWEST(4.16KV)	566	WASH(16KV)	4,476				
GRAYDON(16KV)	2,328	WISTARIA(4.16KV)	454				
HAVEN(4.16KV)	420	WOOLLEY(4.16KV)	557				
HINSHAW(16KV)	1,361						
HOLLY(4.16KV)	311						
JOYCE(4.16KV)	1,058						
KAUFFMAN(4.16KV)	299						
KIEWAY(16KV)	1,072						
LA PORTE(16KV)	2,468						
LOCKSLEY(16KV)	4,241						
LOWELL(4.16KV)	684						
MANOR(4.16KV)	616						
Grand Total	61,030						

Reliability History of Circuits Serving Arcadia (No Exclusions)

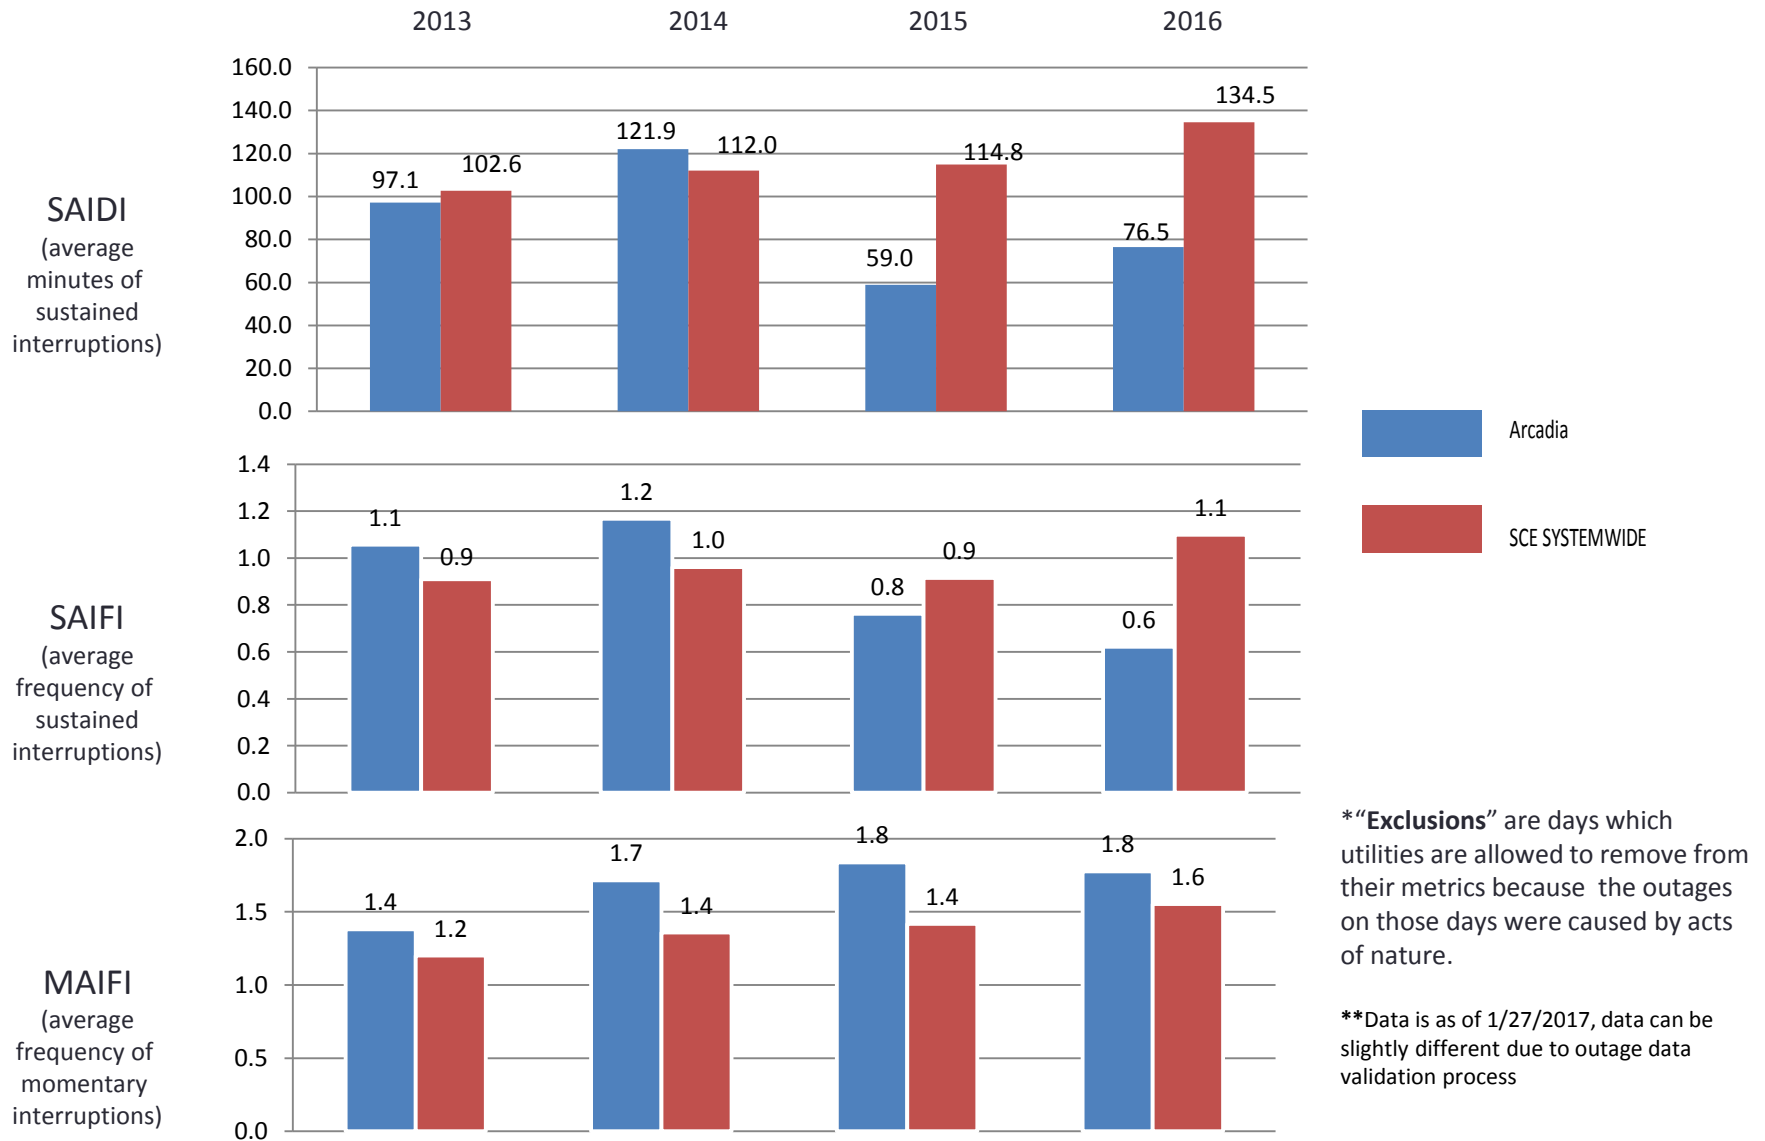

Causes of Repair Outages in Arcadia Circuits 2016 YTD


Contributions to SAIDI by Outage Cause

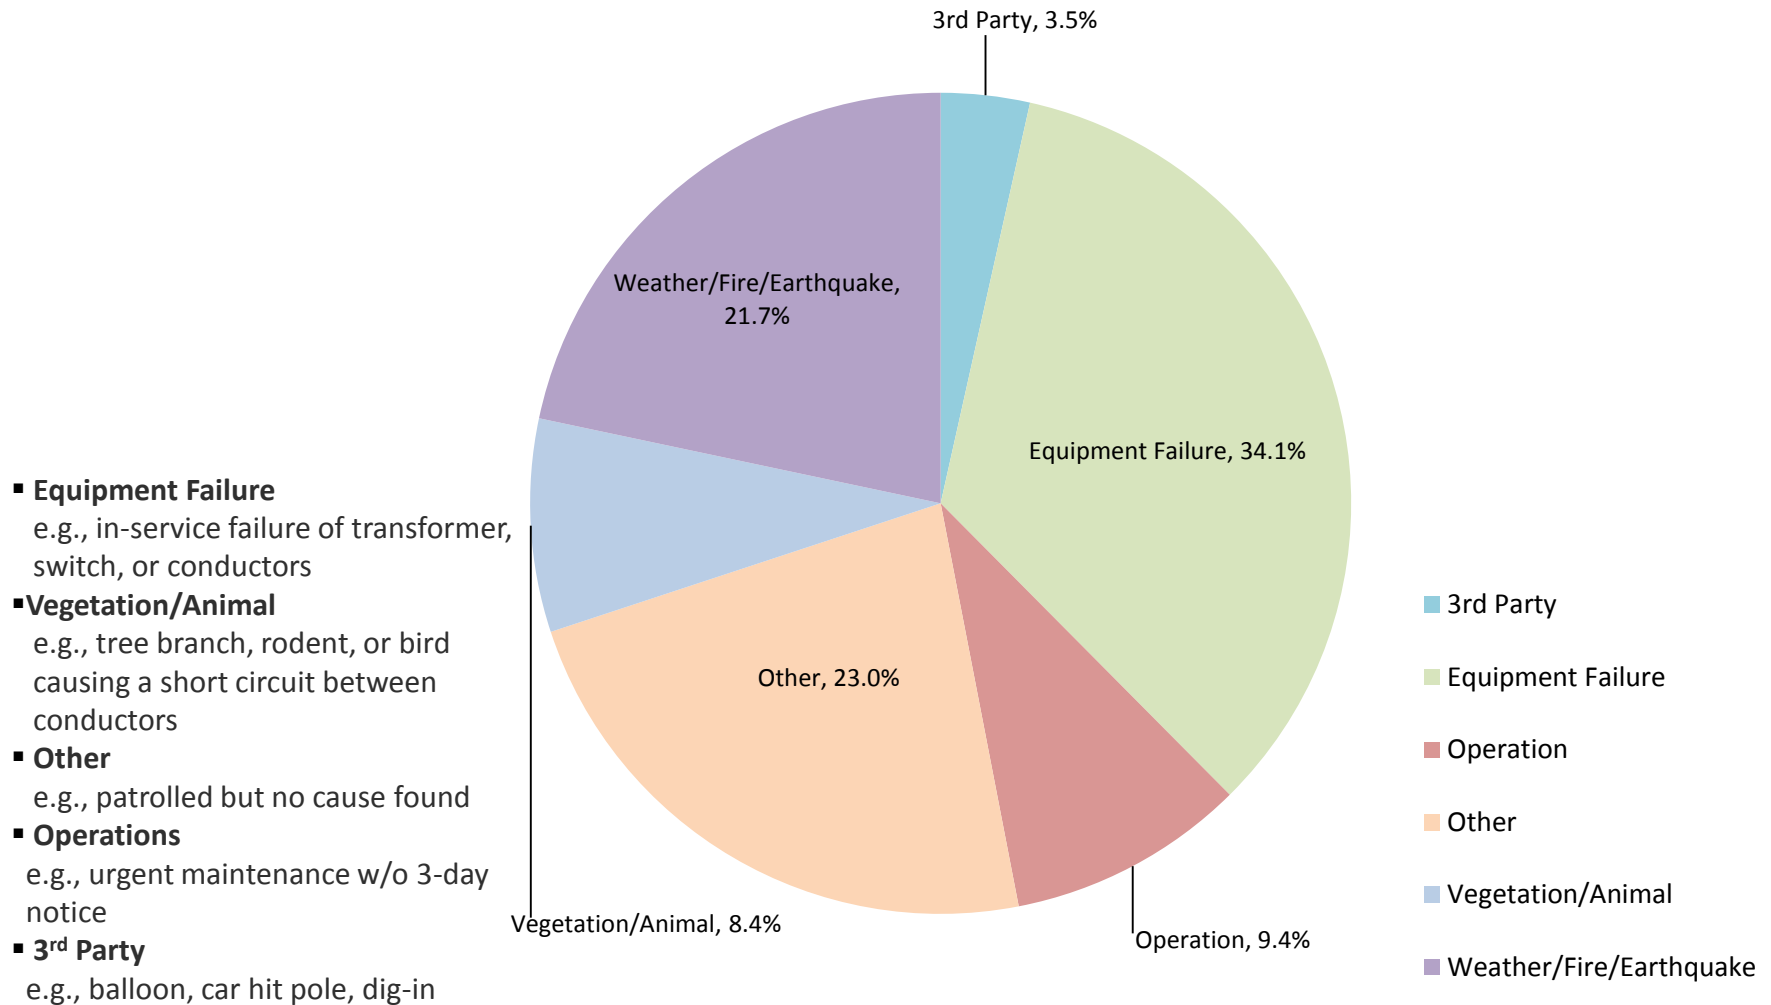


SAIDI = the cumulative amount of time the average customer is interrupted by “sustained” outages each year.


Causes of Repair Outages in Arcadia Circuits 2016 YTD

Contributions to SAIFI by Outage Cause

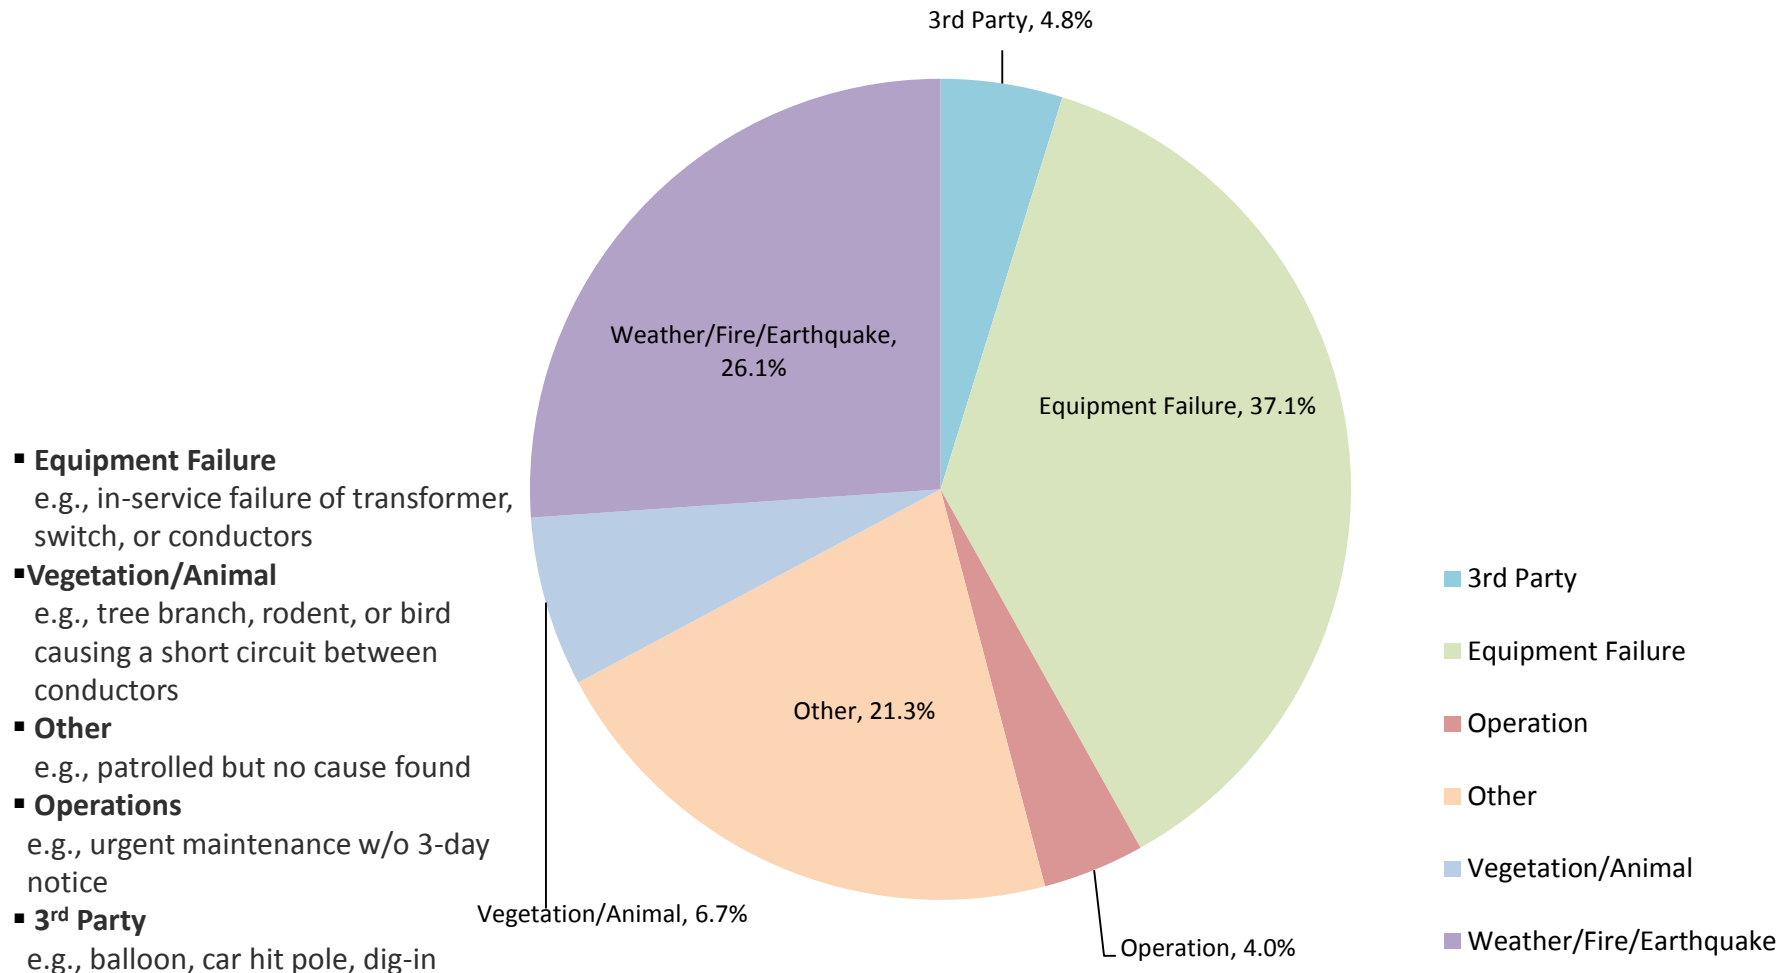

SAIFI = the number of times the average customer is interrupted by “sustained” outages each year.

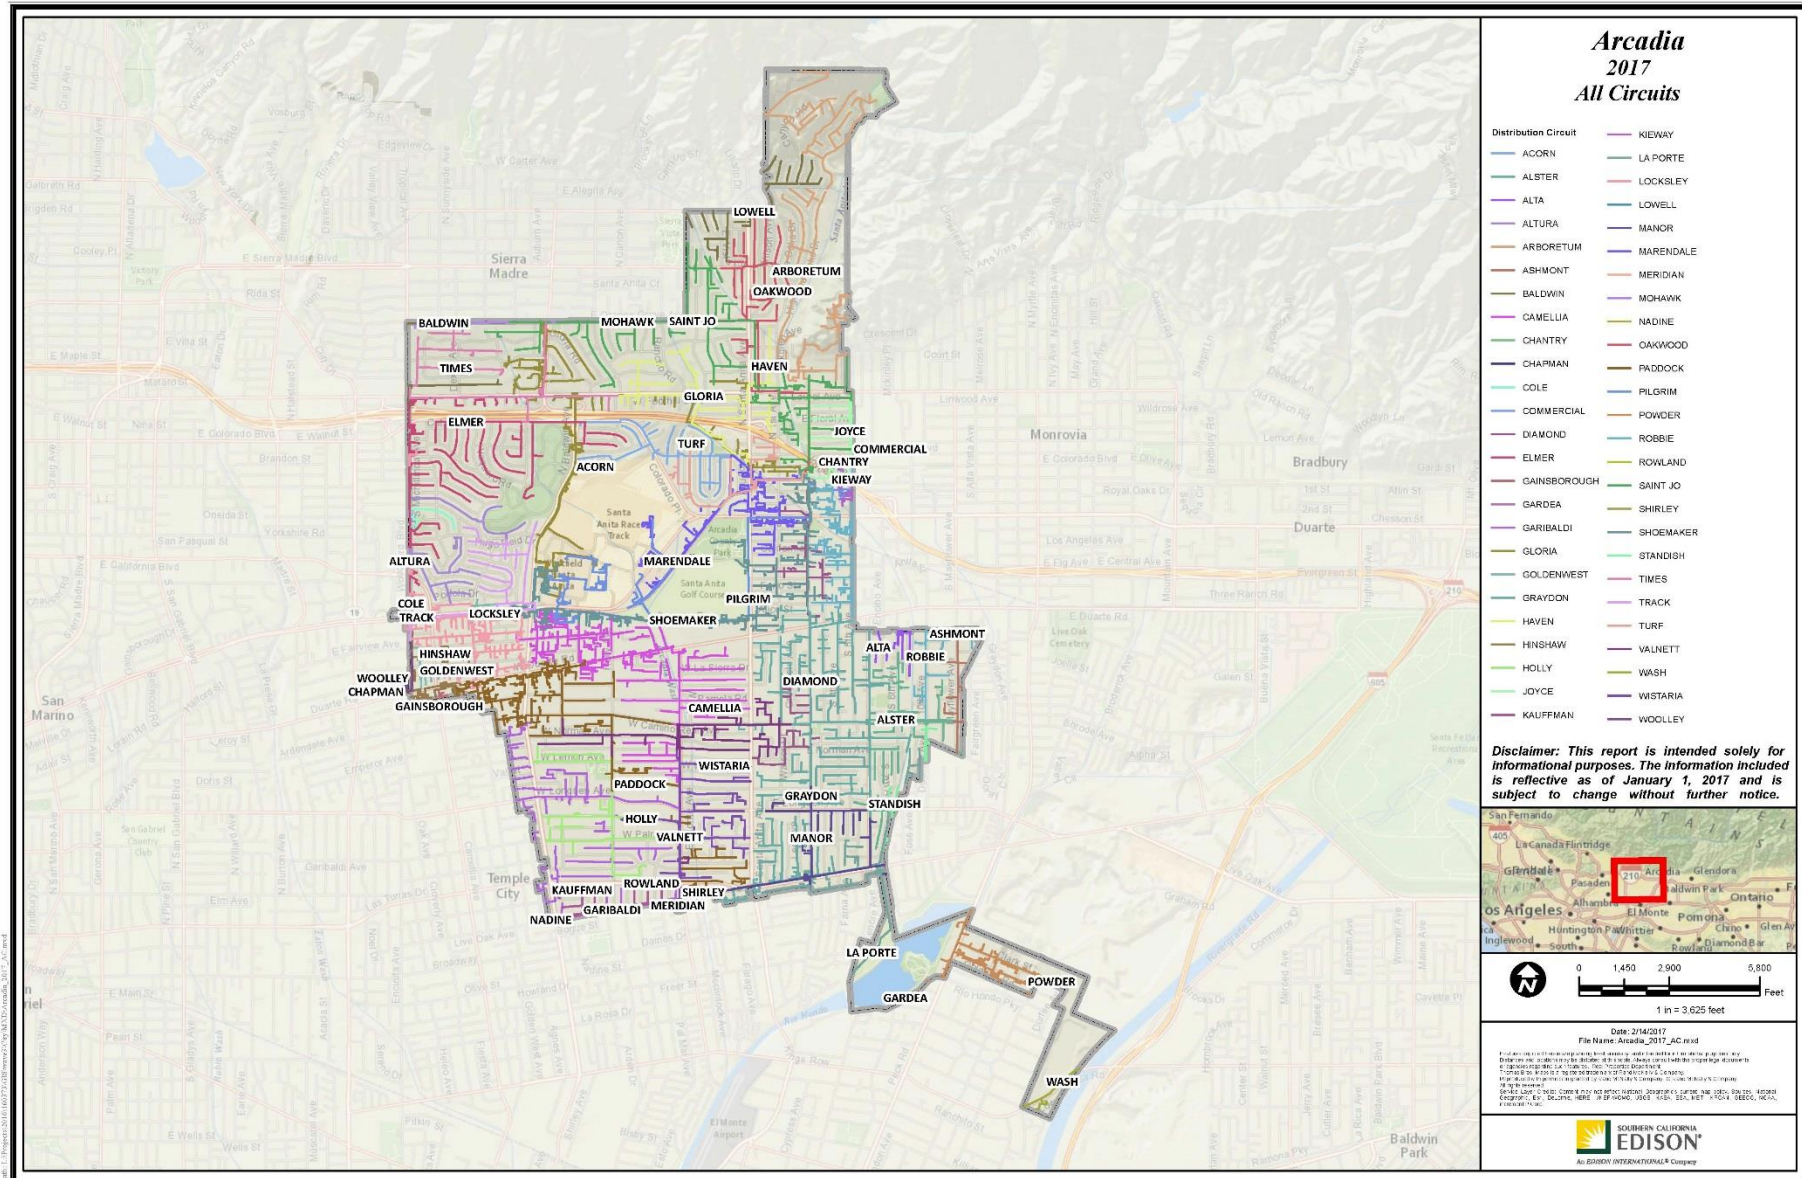

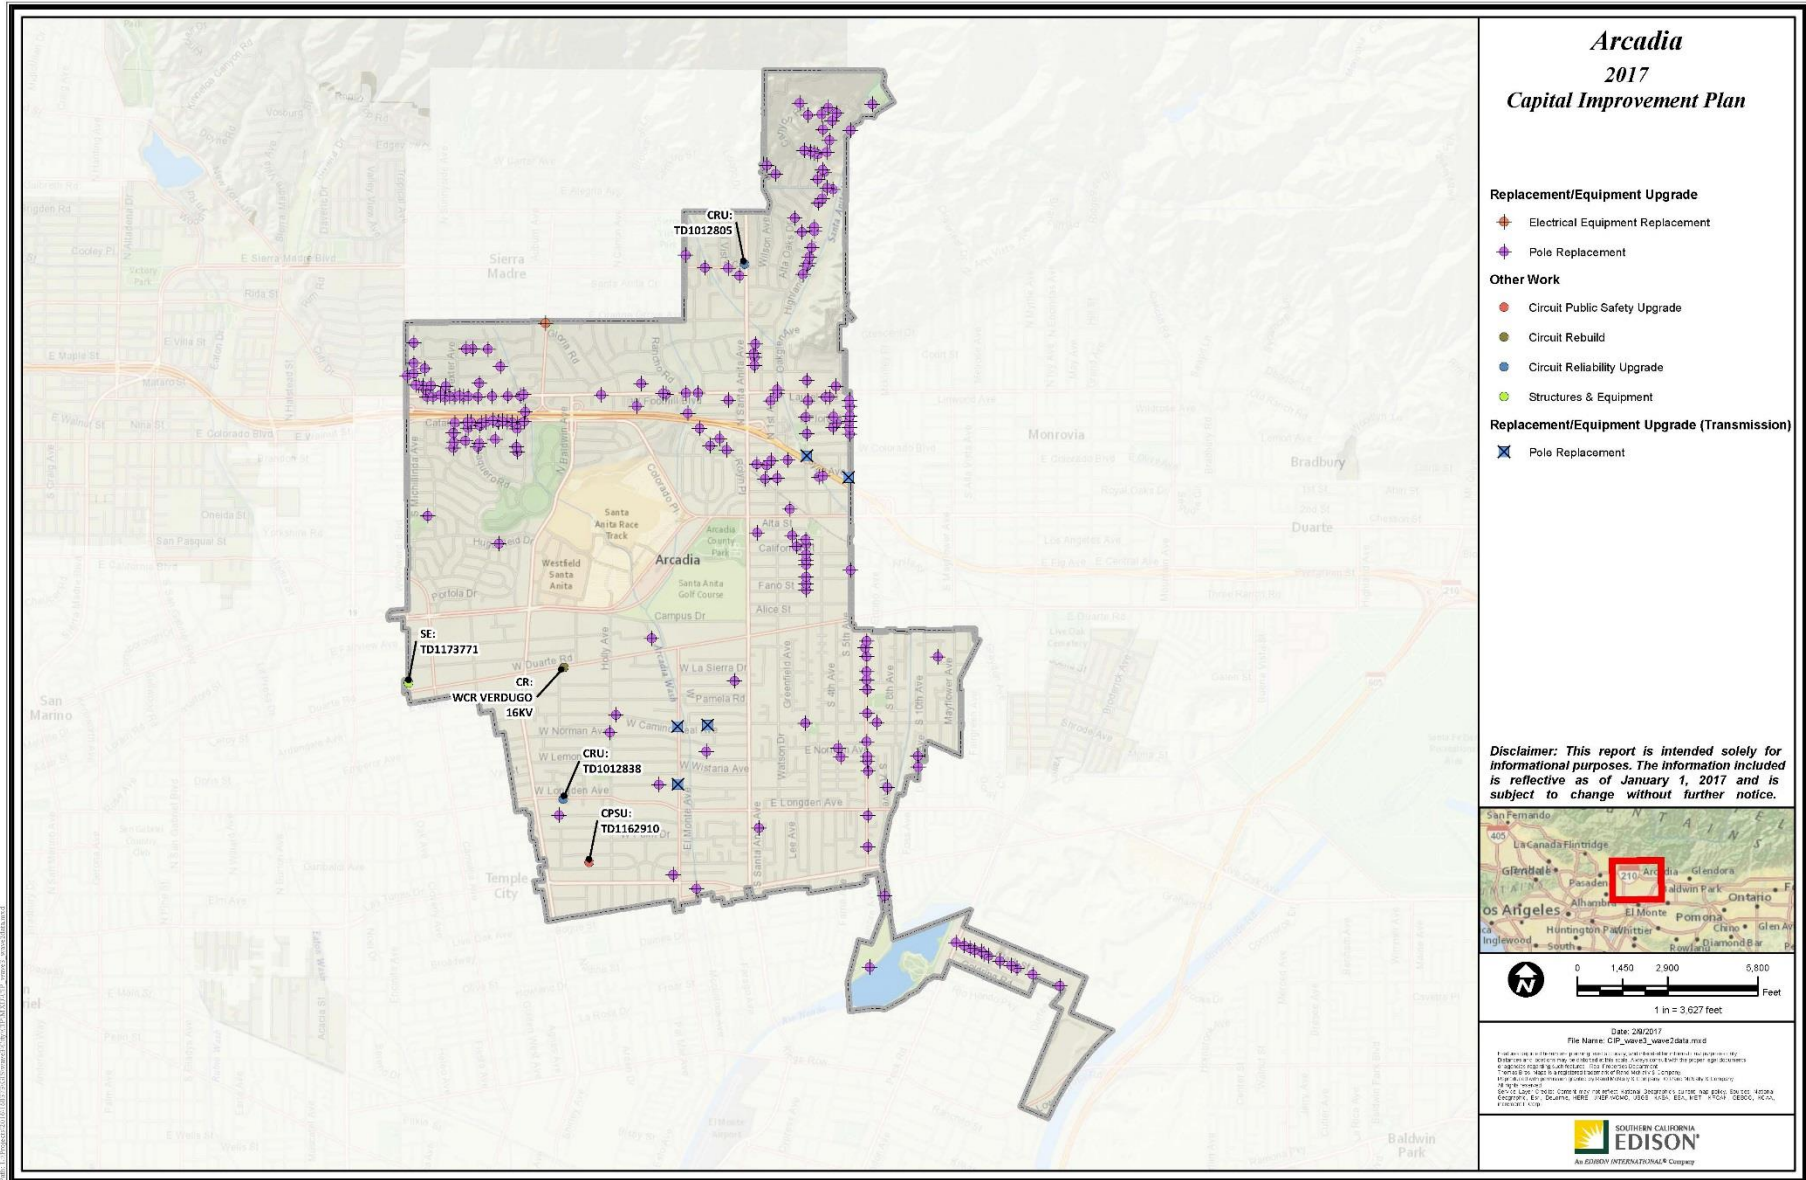

Back-up Slides

Reliability Histories of Circuits Serving Arcadia

Updated through Year-End 2016

Average Reliability of 51 Circuits Serving Arcadia

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
Arcadia	97.1	1.1	1.4	121.9	1.2	1.7	59.0	0.8	1.8	14.6	0.1	0.3	33.9	0.2	0.6	9.1	0.1	0.7	18.8	0.2	0.1	76.5	0.6	1.8
3rd Party	15%	12%	19%	2%	2%	39%	5%	1%	18%	0%	0%	11%	7%	12%	24%	0%	0%	10%	1%	0%	3%	4%	5%	14%
Equipment Failure	44%	46%	16%	58%	54%	27%	59%	47%	9%	28%	41%	0%	15%	13%	0%	82%	82%	34%	49%	49%	31%	34%	37%	16%
Operation	13%	12%	1%	4%	5%	2%	12%	16%	4%	38%	9%	8%	2%	1%	4%	4%	6%	0%	3%	5%	0%	9%	4%	3%
Other	7%	11%	16%	11%	9%	18%	12%	8%	30%	7%	3%	44%	44%	51%	15%	12%	8%	14%	4%	1%	0%	23%	21%	19%
Vegetation/Animal	8%	10%	32%	13%	12%	14%	7%	22%	36%	4%	2%	29%	11%	4%	27%	3%	4%	41%	10%	12%	17%	8%	7%	32%
Weather/Fire/Earthquake	13%	9%	16%	13%	19%	1%	7%	6%	3%	23%	45%	9%	21%	18%	30%	0%	0%	0%	32%	33%	49%	22%	26%	15%
SCE Systemwide	102.6	0.9	1.2	112.0	1.0	1.4	114.8	0.9	1.4	40.5	0.3	0.4	34.8	0.3	0.4	29.4	0.2	0.3	29.8	0.3	0.4	134.5	1.1	1.6

Notes:

No outages are excluded from the metrics.

Outage Causes:

Other: e.g., patrolled but no cause could be found

Operations: e.g., urgent maintenance w/o 3-day notice to customers

3rd Party: e.g., balloons, car hit pole, dig-in

Vegetation/Animal: e.g., tree branch, rodent, or bird causing short circuit across conductors

SAIDI (minutes) = the cumulative amount of time the average customer is interrupted by "sustained" (longer than 5 minutes) outages.

SAIFI (interruptions) = the number of times the average customer is interrupted by "sustained" outages.

MAIFI (interruptions) = the number of times the average customer is interrupted by "momentary" (lasting 5 minutes or less) outages.

Reliability Histories for Individual Circuits Serving Arcadia

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
ACORN(4.16KV) - Customers: 422	299.1	2.5	0.0	0.0	0.0	1.0	37.2	0.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	6%	2%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	94%	98%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
ALSTER(4.16KV) - Customers: 445	0.0	0.0	0.0	0.0	0.0	1.0	10.0	0.1	0.1	0.0	0.0	0.0	108.1	1.1	1.0	133.4	1.0	0.0	0.0	0.0	0.0	241.5	2.1	1.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	95%	16%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	55%	48%	0%
Operation	0%	0%	0%	0%	0%	100%	5%	84%	100%	0%	0%	0%	4%	8%	0%	0%	0%	0%	0%	0%	0%	2%	4%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	96%	92%	0%	0%	0%	0%	0%	0%	0%	43%	48%	0%
ALTA(4.16KV) - Customers: 686	5.1	0.0	1.0	266.0	6.0	0.0	72.2	1.0	0.0	0.0	0.0	0.0	98.2	1.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	98.2	1.0	1.0
3rd Party	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	100%	100%	100%
Equipment Failure	0%	0%	0%	0%	0%	0%	6%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	49%	34%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	51%	66%	0%	94%	99%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
ALTURA(4.16KV) - Customers: 459	140.0	1.0	0.0	111.0	0.2	2.0	4.4	0.1	0.0	0.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	100%	100%	48%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	52%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Arcadia

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
ARBORETUM(16KV) - Customers: 1,210	226.2	2.0	2.0	9.5	0.0	1.0	214.0	1.7	0.8	4.5	0.0	0.0	0.0	0.0	0.0	3.7	0.0	0.0	2.3	0.1	0.0	10.5	0.1	0.0
3rd Party	0%	0%	0%	0%	0%	100%	7%	2%	78%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	91%	98%	49%	45%	14%	0%	63%	59%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	21%	5%	0%	5%	3%	0%
Operation	9%	2%	0%	0%	0%	0%	3%	1%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	79%	95%	0%	60%	73%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	35%	23%	0%
Vegetation/Animal	0%	0%	51%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	55%	86%	0%	27%	37%	22%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
ASHMONT(4.16KV) - Customers: 457	77.7	1.0	0.0	114.2	1.1	1.0	5.2	0.2	1.1	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.0
3rd Party	0%	0%	0%	88%	96%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	1%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	12%	4%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	100%	100%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
BALDWIN(16KV) - Customers: 2,845	251.1	1.9	5.3	87.4	0.8	1.4	33.1	0.9	3.0	3.7	0.0	0.0	2.9	0.0	0.0	0.0	0.0	0.0	133.7	1.3	1.7	140.3	1.4	1.7
3rd Party	1%	0%	19%	5%	3%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	29%	53%	0%	3%	1%	0%	0%	0%	0%	55%	20%	0%	34%	89%	0%	0%	0%	0%	53%	49%	21%	52%	50%	21%
Operation	4%	3%	0%	4%	12%	0%	61%	97%	0%	1%	3%	0%	66%	11%	0%	0%	0%	0%	0%	0%	0%	1%	0%	0%
Other	0%	0%	18%	0%	0%	74%	35%	3%	100%	0%	0%	0%	0%	0%	100%	0%	0%	0%	10%	2%	0%	9%	2%	1%
Vegetation/Animal	20%	10%	56%	0%	0%	0%	4%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	47%	34%	7%	89%	83%	26%	0%	0%	0%	45%	78%	0%	0%	0%	0%	0%	0%	0%	37%	49%	79%	37%	48%	78%
CAMELLIA(16KV) - Customers: 2,044	229.8	2.1	1.0	40.7	0.1	2.0	163.7	1.2	2.0	6.3	0.1	0.0	3.7	0.0	0.0	27.8	0.1	1.0	9.0	0.0	0.0	46.8	0.2	1.0
3rd Party	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	74%	49%	0%	90%	50%	0%	81%	96%	0%	10%	11%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	3%	0%
Operation	4%	1%	0%	7%	27%	0%	19%	4%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	19%	4%	0%
Other	3%	2%	100%	0%	0%	0%	0%	0%	0%	90%	89%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	71%	82%	0%
Vegetation/Animal	19%	49%	0%	3%	22%	50%	0%	0%	100%	0%	0%	0%	100%	100%	0%	0%	0%	100%	0%	0%	0%	8%	10%	100%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Arcadia

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
CHANTRY(16KV) - Customers: 2,803	33.5	0.4	4.6	269.7	2.7	2.3	27.5	0.4	2.7	0.7	0.0	0.0	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.1	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	38%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	9%	13%	28%	6%	0%	38%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	63%	47%	0%
Operation	56%	7%	0%	2%	0%	0%	3%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	22%	38%	13%	72%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	37%	53%	0%
Vegetation/Animal	44%	93%	14%	37%	37%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	64%	15%	37%	0%	91%	99%	24%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
CHAPMAN(4.16KV) - Customers: 186	0.0	0.0	0.0	10.6	0.4	1.0	38.8	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
COLE(4.16KV) - Customers: 548	1.2	0.0	0.9	352.6	2.0	1.0	9.5	1.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	13%	48%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	100%	1%	3%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	86%	49%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
COMMERCIAL(4.16KV) - Customers: 833	11.2	0.0	0.0	193.0	5.9	0.0	9.0	1.0	0.0	23.0	0.1	2.0	90.7	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	113.7	1.1	2.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	46%	50%	0%	0%	0%	0%	100%	100%	100%	100%	100%	0%	4%	2%	0%	0%	0%	0%	0%	0%	0%	23%	7%	0%
Other	0%	0%	0%	31%	34%	0%	0%	0%	0%	0%	0%	0%	96%	98%	0%	0%	0%	0%	0%	0%	0%	77%	93%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	54%	50%	0%	69%	66%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Arcadia

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
DIAMOND(4.16KV) - Customers: 603	161.3	2.0	0.0	1.3	0.0	0.0	0.0	0.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	45%	50%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	55%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
ELMER(16KV) - Customers: 1,638	39.6	0.1	1.0	506.7	4.9	2.8	23.3	0.1	2.0	0.0	0.0	1.0	115.6	1.0	1.0	0.0	0.0	1.0	72.5	1.0	0.0	188.1	2.0	3.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	28%	40%	68%	27%	12%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	12%	19%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	33%
Other	0%	0%	100%	43%	20%	32%	39%	58%	50%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	34%
Vegetation/Animal	100%	100%	0%	17%	21%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	38%	50%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	34%	29%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	61%	50%	33%
GAINSBOROUGH(16KV) - Customers: 1,990	10.7	0.1	0.0	15.5	0.3	0.0	11.8	0.6	0.5	1.8	0.1	2.0	0.0	0.0	0.0	13.1	0.0	0.0	6.5	0.5	0.5	21.4	0.6	2.5
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	22%	16%	0%	0%	0%	0%	58%	6%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	100%	100%	92%	90%	19%
Operation	0%	0%	0%	31%	93%	0%	2%	1%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	8%	10%	0%
Other	41%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	81%
Vegetation/Animal	0%	0%	0%	69%	7%	0%	39%	93%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	37%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
GARDEA(16KV) - Customers: 3,550	34.2	1.0	2.0	39.3	0.0	4.0	34.4	0.2	2.1	1.3	0.0	1.0	53.9	0.1	0.0	4.0	0.0	1.0	35.4	1.0	0.0	94.7	1.1	2.0
3rd Party	0%	0%	51%	0%	0%	50%	96%	97%	52%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	96%	100%	49%	100%	100%	0%	0%	0%	0%	100%	100%	0%	39%	16%	0%	78%	33%	0%	100%	100%	0%	65%	94%	0%
Operation	4%	0%	0%	0%	0%	0%	3%	3%	0%	0%	0%	0%	0%	0%	0%	2%	9%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	48%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	49%
Vegetation/Animal	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	20%	58%	100%	0%	0%	0%	1%	1%	51%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	61%	84%	0%	0%	0%	0%	0%	0%	0%	35%	5%	0%

Reliability Histories for Individual Circuits Serving Arcadia

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
GARIBALDI(16KV) - Customers: 2,259	0.6	0.0	0.0	4.3	0.0	1.0	10.8	0.0	2.3	96.5	1.0	0.0	2.0	0.0	0.0	0.0	0.0	1.0	22.9	0.0	0.0	121.4	1.1	1.0
3rd Party	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	100%	100%	0%	99%	81%	0%	100%	100%	0%	100%	100%	0%	0%	0%	0%	91%	83%	0%	98%	99%	0%
Operation	0%	0%	0%	0%	0%	0%	1%	19%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	9%	17%	0%	2%	1%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	100%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
GLORIA(16KV) - Customers: 969	86.0	0.9	1.8	220.2	3.2	0.8	107.8	1.1	1.0	20.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	31.6	0.0	0.0	51.8	0.1	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	81%	69%	45%	94%	98%	100%	63%	90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	61%	51%	0%
Operation	14%	28%	0%	5%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	1%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	55%	0%	0%	0%	2%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	39%	49%	0%
Weather/Fire/Earthquake	5%	3%	0%	0%	0%	0%	35%	9%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
GOLDENWEST(4.16KV) - Customers: 566	0.0	0.0	0.0	43.6	1.0	1.0	32.1	0.9	0.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	89%	99%	100%	83%	96%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	11%	1%	0%	17%	4%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
GRAYDON(16KV) - Customers: 2,328	114.3	1.0	1.1	87.6	1.0	1.0	55.0	1.0	5.0	0.0	0.0	0.0	2.3	0.0	1.0	14.3	0.0	1.0	0.0	0.0	0.0	16.7	0.0	2.0
3rd Party	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	50%
Equipment Failure	100%	100%	100%	84%	97%	0%	14%	1%	20%	0%	0%	0%	100%	100%	0%	92%	63%	0%	0%	0%	0%	93%	64%	0%
Operation	0%	0%	0%	16%	3%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	4%	31%	0%	0%	0%	0%	4%	30%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	4%	6%	0%	0%	0%	0%	3%	6%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	86%	99%	80%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	50%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Arcadia

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
HAVEN(4.16KV) - Customers: 420	43.5	0.2	0.0	0.0	0.0	0.0	72.7	1.2	1.9	78.4	1.0	1.0	0.0	0.0	0.0	3.7	0.1	0.0	0.0	0.0	0.0	82.1	1.1	1.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	37%	44%	0%	0%	0%	0%	87%	14%	43%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	63%	56%	0%	0%	0%	0%	13%	86%	5%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	5%	9%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	52%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	95%	91%	100%
HINSHAW(16KV) - Customers: 1,361	0.0	0.0	0.0	10.7	0.0	1.0	23.0	0.0	0.0	0.0	0.0	0.0	150.6	0.4	0.6	0.3	0.0	0.0	0.0	0.0	0.0	150.9	0.4	0.6
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	39%	72%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	61%	28%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	5%	0%
Other	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	93%	88%	100%	0%	0%	0%	0%	0%	0%	93%	84%	100%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	7%	12%	0%	0%	0%	0%	0%	0%	0%	7%	11%	0%
HOLLY(4.16KV) - Customers: 311	5.5	0.1	0.0	0.0	0.0	1.0	6.4	0.2	0.1	0.0	0.0	0.0	1.0	0.0	0.0	0.4	0.0	0.0	0.0	0.0	0.0	1.3	0.0	1.0
3rd Party	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	100%
Equipment Failure	0%	0%	0%	0%	0%	0%	77%	18%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	100%	100%	0%	0%	0%	0%	23%	82%	100%	0%	0%	0%	100%	100%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
JOYCE(4.16KV) - Customers: 1,058	0.0	0.0	0.0	10.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	420.4	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	420.4	1.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Arcadia

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
KAUFFMAN(4.16KV) - Customers: 299	0.0	0.0	0.0	0.0	0.0	2.0	0.0	0.0	0.0	0.0	0.0	0.0	58.3	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	58.3	1.0	0.0
3rd Party	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
KIEWAY(16KV) - Customers: 1,072	145.8	1.1	0.0	329.0	2.3	1.7	223.5	2.5	1.0	0.0	0.0	0.0	80.3	1.0	0.9	14.9	0.0	0.0	0.0	0.0	0.0	95.2	1.1	0.9
3rd Party	0%	0%	0%	0%	0%	57%	0%	0%	0%	0%	0%	0%	98%	100%	100%	0%	0%	0%	0%	0%	0%	82%	96%	100%
Equipment Failure	88%	91%	0%	35%	45%	0%	93%	99%	0%	0%	0%	0%	2%	0%	0%	0%	0%	0%	0%	0%	0%	2%	0%	0%
Operation	12%	9%	0%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	16%	4%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	64%	55%	43%	7%	1%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
LA PORTE(16KV) - Customers: 2,468	149.7	1.8	1.6	0.0	0.0	1.0	193.2	1.7	4.3	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.9	18.3	0.0	0.0	18.4	0.0	0.9
3rd Party	51%	39%	20%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	20%	3%	0%	0%	0%	0%	48%	39%	7%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	99%	0%
Operation	0%	0%	0%	0%	0%	0%	7%	2%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	45%	59%	46%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	27%	57%	19%	0%	0%	0%	0%	0%	46%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	1%	100%
Weather/Fire/Earthquake	1%	0%	61%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
LOCKSLEY(16KV) - Customers: 4,241	116.3	1.6	1.0	236.4	2.3	2.8	31.3	1.6	2.8	1.1	0.0	1.0	4.2	0.0	2.0	9.5	0.0	4.0	0.5	0.0	0.0	15.3	0.1	7.0
3rd Party	0%	0%	0%	2%	2%	0%	0%	0%	0%	0%	0%	0%	0%	0%	51%	0%	0%	0%	0%	0%	0%	0%	0%	14%
Equipment Failure	4%	1%	0%	90%	96%	100%	37%	15%	36%	0%	0%	0%	0%	0%	0%	70%	47%	75%	0%	0%	0%	43%	31%	43%
Operation	96%	99%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	3%	5%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	36%	0%	0%	0%	100%	100%	0%	0%	0%	25%	0%	0%	0%	28%	27%	14%
Vegetation/Animal	0%	0%	100%	8%	1%	0%	63%	85%	28%	100%	100%	100%	0%	0%	49%	30%	53%	0%	0%	0%	0%	26%	37%	28%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Arcadia

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
LOWELL(4.16KV) - Customers: 684	167.6	1.0	1.0	134.7	1.0	0.0	49.9	2.0	0.0	0.0	0.0	0.0	132.0	0.7	1.3	0.0	0.0	0.0	0.0	0.0	0.0	132.0	0.7	1.3
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	5%	1%	0%	82%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	100%	100%	100%
Vegetation/Animal	0%	0%	100%	0%	0%	0%	18%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	95%	99%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
MANOR(4.16KV) - Customers: 616	0.0	0.0	0.0	0.5	0.0	0.0	13.5	0.9	1.0	0.0	0.0	1.0	0.0	0.0	2.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	3.1
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	100%	100%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	100%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
MARENDALE(16KV) - Customers: 627	221.9	1.0	2.3	150.6	2.0	0.0	62.6	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	14.8	0.0	0.0	14.8	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	16%	100%	100%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%
Vegetation/Animal	0%	0%	84%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
MERIDIAN(16KV) - Customers: 1,674	26.0	0.0	1.0	0.0	0.0	1.0	100.9	1.0	2.9	36.9	0.0	0.0	1.5	0.0	2.7	0.0	0.0	1.2	0.0	0.0	0.0	38.5	0.0	3.9
3rd Party	98%	96%	100%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	2%	0%	0%	0%	0%	0%	7%	50%	0%	0%	0%	0%	0%	0%	0%	0%	2%	0%
Operation	2%	4%	0%	0%	0%	0%	97%	100%	32%	100%	100%	0%	93%	50%	33%	0%	0%	0%	0%	0%	0%	100%	98%	23%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	68%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	30%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	67%	0%	0%	0%	0%	0%	0%	0%	0%	47%

Reliability Histories for Individual Circuits Serving Arcadia

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
MOHAWK(4.16KV) - Customers: 483	158.8	1.0	1.0	0.5	0.0	1.0	50.0	2.0	0.0	111.9	1.0	1.0	87.8	1.0	0.0	0.0	0.0	0.0	162.1	1.8	1.0	361.8	3.8	2.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	0%	0%	0%	82%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	24%	26%	0%
Vegetation/Animal	0%	0%	100%	0%	0%	0%	18%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	100%	100%	100%	76%	74%	100%
NADINE(4.16KV) - Customers: 686	0.0	0.0	0.0	50.0	1.0	0.0	59.1	0.6	3.0	0.0	0.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	2.0
3rd Party	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	50%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	67%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	50%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
OAKWOOD(4.16KV) - Customers: 409	95.2	1.8	0.0	85.2	1.0	1.0	14.2	0.1	0.0	0.0	0.0	0.0	8.4	0.0	0.0	0.0	0.0	1.0	0.0	0.0	0.0	8.4	0.0	1.0
3rd Party	93%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	100%	100%	100%	60%	12%	0%	0%	0%	0%	81%	69%	0%	0%	0%	0%	0%	0%	0%	81%	69%	0%
Operation	7%	50%	0%	0%	0%	0%	40%	88%	100%	0%	0%	0%	19%	31%	0%	0%	0%	0%	0%	0%	0%	19%	31%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
PADDOCK(16KV) - Customers: 2,157	154.1	1.8	0.9	46.1	0.7	3.3	44.5	1.1	2.8	0.0	0.0	0.0	0.4	0.0	0.0	135.5	1.0	2.1	4.8	0.0	0.0	140.6	1.1	2.1
3rd Party	0%	0%	0%	0%	0%	30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	3%	1%	0%
Equipment Failure	100%	100%	100%	100%	100%	9%	99%	100%	0%	0%	0%	0%	0%	0%	0%	99%	98%	53%	0%	0%	0%	96%	96%	53%
Operation	0%	0%	0%	0%	0%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	1%	2%	0%	0%	0%	0%	1%	2%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	61%	0%	0%	100%	0%	0%	0%	100%	100%	0%	0%	0%	47%	0%	0%	0%	0%	0%	47%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Arcadia

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
PILGRIM(16KV) - Customers: 194	39.3	0.5	0.0	96.8	1.0	0.0	220.4	2.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
POWDER(16KV) - Customers: 1,389	57.4	1.2	1.0	0.0	0.0	0.0	1.2	0.0	1.0	0.0	0.0	0.0	14.1	0.0	4.0	0.0	0.0	0.0	0.0	0.0	0.0	14.1	0.0	4.0
3rd Party	93%	86%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	7%	14%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	25%	0%	0%	0%	0%	0%	0%	0%	0%	25%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	53%	79%	50%	0%	0%	0%	0%	0%	0%	53%	79%	50%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	47%	21%	25%	0%	0%	0%	0%	0%	0%	47%	21%	25%
ROBBIE(16KV) - Customers: 2,049	1.5	0.0	0.0	108.4	1.0	0.0	0.0	0.0	0.0	1.8	0.0	1.0	9.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	11.5	0.0	1.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	6%	2%	0%	0%	0%	0%	0%	0%	0%	87%	32%	0%	0%	0%	0%	0%	0%	0%	73%	25%	0%
Operation	0%	0%	0%	2%	1%	0%	0%	0%	0%	0%	0%	0%	4%	18%	0%	0%	0%	0%	0%	0%	0%	4%	14%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	100%	100%	0%	92%	97%	0%	0%	0%	0%	100%	100%	100%	9%	50%	0%	0%	0%	0%	0%	0%	0%	23%	61%	100%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
ROWLAND(4.16KV) - Customers: 636	5.0	0.1	0.0	0.0	0.0	0.0	156.6	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	5%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	95%	99%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Arcadia

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
SAINT JO(16KV) - Customers: 1,789	317.3	3.2	3.2	32.5	0.1	4.0	81.9	1.4	1.0	102.4	1.1	0.6	115.7	1.0	0.0	0.0	0.0	1.0	80.3	1.0	0.0	298.5	3.1	1.6
3rd Party	37%	31%	0%	0%	0%	25%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	33%	31%	29%	26%	10%	25%	75%	92%	0%	2%	0%	0%	96%	96%	0%	0%	0%	0%	0%	0%	0%	38%	32%	0%
Operation	2%	1%	0%	53%	51%	0%	9%	3%	0%	6%	4%	0%	0%	0%	0%	0%	0%	0%	0%	1%	0%	2%	1%	0%
Other	16%	5%	0%	0%	0%	25%	11%	3%	0%	25%	4%	0%	4%	4%	0%	0%	0%	0%	0%	0%	0%	10%	3%	0%
Vegetation/Animal	1%	1%	41%	21%	39%	25%	5%	2%	0%	6%	4%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	2%	1%	63%
Weather/Fire/Earthquake	12%	31%	29%	0%	0%	0%	0%	0%	0%	61%	89%	100%	0%	0%	0%	0%	0%	0%	100%	99%	0%	48%	62%	37%
SHIRLEY(4.16KV) - Customers: 500	6.3	0.0	0.0	30.1	0.1	1.0	0.0	0.0	0.0	477.4	0.4	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	477.4	0.4	1.0
3rd Party	0%	0%	0%	94%	83%	100%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Equipment Failure	0%	0%	0%	6%	17%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	100%	100%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
SHOEMAKER(16KV) - Customers: 1,567	166.9	4.7	0.8	339.6	5.7	2.9	77.8	1.0	0.0	0.0	0.0	0.0	0.5	0.0	0.0	0.0	0.0	0.0	0.4	0.0	1.0	0.9	0.0	1.0
3rd Party	0%	0%	0%	0%	0%	34%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	100%	100%	100%	66%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	58%	89%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	42%	11%	100%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
STANDISH(4.16KV) - Customers: 585	588.0	3.0	1.0	40.0	0.1	1.0	12.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.0
3rd Party	54%	67%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	100%	100%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Weather/Fire/Earthquake	46%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Arcadia

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
TIMES(4.16KV) - Customers: 129	128.6	1.1	1.0	38.3	1.0	0.0	133.6	3.4	0.0	42.1	0.2	1.0	0.0	0.0	0.0	0.0	0.0	0.0	192.7	0.3	0.8	234.8	0.5	1.8
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	29%	5%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	5%	2%	55%
Equipment Failure	94%	92%	0%	0%	0%	0%	82%	58%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	98%	50%	100%	80%	33%	45%
Operation	6%	8%	0%	100%	100%	0%	12%	12%	0%	71%	95%	0%	0%	0%	0%	0%	0%	0%	2%	50%	0%	14%	66%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	100%	0%	0%	0%	7%	29%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
TRACK(4.16KV) - Customers: 628	3.2	0.0	0.0	1278.7	1.1	0.0	59.7	1.2	0.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	100%	100%	0%	62%	90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	38%	10%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
TURF(4.16KV) - Customers: 306	0.0	0.0	0.0	59.2	1.0	0.9	0.0	0.0	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
VALNETT(4.16KV) - Customers: 364	4.3	0.0	0.0	132.2	0.2	0.0	126.7	0.6	0.0	0.0	0.0	0.0	11.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	11.6	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Operation	100%	100%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Arcadia

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
WASH(16KV) - Customers: 4,476	82.5	1.3	3.0	171.3	1.1	5.0	85.2	0.1	4.0	3.6	0.0	0.0	67.6	1.0	1.0	3.2	0.0	1.0	18.0	0.0	0.0	92.3	1.1	2.0
3rd Party	25%	3%	33%	1%	1%	60%	8%	8%	50%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	50%
Equipment Failure	1%	0%	0%	98%	98%	20%	89%	87%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%	96%	57%	0%	26%	4%	0%
Operation	0%	0%	0%	1%	0%	0%	1%	4%	0%	0%	0%	0%	9%	1%	0%	0%	0%	0%	4%	43%	0%	7%	1%	0%
Other	74%	97%	34%	0%	0%	20%	0%	0%	50%	0%	0%	0%	74%	98%	0%	0%	0%	0%	0%	0%	0%	54%	93%	0%
Vegetation/Animal	0%	0%	34%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	2%	1%	0%	0%	0%	0%	17%	1%	100%	0%	0%	0%	0%	0%	0%	12%	1%	50%
WISTARIA(4.16KV) - Customers: 454	7.4	0.0	0.0	62.7	1.0	0.0	0.3	0.0	1.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	0.0	12.0	1.0	0.0	12.0	1.0	1.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	85%	45%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	15%	55%	0%	100%	100%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
WOOLLEY(4.16KV) - Customers: 557	186.6	0.5	2.5	178.1	1.0	0.0	36.1	1.0	1.1	0.0	0.0	0.0	0.0	0.0	1.0	0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	1.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	1%	3%	80%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	99%	97%	20%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%