



Circuit Reliability Review

Inyo District 5

January 2017

Providing Safe, Reliable, and Affordable Power

Southern California Edison is modernizing the power grid to meet the changing needs and expectations of our customers and to help California achieve its clean energy goals.

We are investing more than \$12 billion into our power grid between 2015 – 2017 with the goal of increasing power reliability through significant upgrades. These investments include:

- Updating thousands of transmission and distribution poles
- Replacing hundreds of miles of underground cables
- Replacing hundreds of underground structures such as vaults and manholes
- Upgrading critical distribution equipment; capacitor banks, switches, and circuit breakers
- Building new distribution circuits to serve electrical demands in our communities
- Inspecting and replacing overhead conductor and equipment to improve public safety

Our investments in local communities will help ensure that customers receive safe, reliable, and affordable electricity now and in the future.

Understanding Your Reliability Report

As your electric utility, we want you to always have power when you need it. To get there, we constantly track and monitor electric outages across our service territory, and we measure our “system reliability” from this data.

The two metrics we rely on are common in the electric utility industry: the System Average Interruption Duration Index (SAIDI) and the System Average Interruption Frequency Index (SAIFI). Both are described in more detail on the next page.

Replacing and upgrading our infrastructure will help SCE maintain or improve SAIDI and SAIFI measurements.

This report provides historical reliability data for the circuits that serve your jurisdiction and our proposed infrastructure upgrades for the current year.

To view other reliability reports, visit [sce.com>Outage Center>Maintaining Reliable Service](https://www.sce.com/Outage-Center/Maintaining-Reliable-Service)

Reliability Metrics

MOMENTARY OUTAGES:

OUTAGES LASTING 5 MINUTES OR LESS

MAIFI:

- The number of times the average customer is interrupted by Momentary outages each year.

SUSTAINED OUTAGES:

OUTAGES LASTING LONGER THAN 5 MINUTES

SAIFI:

- The number of times the average customer is interrupted by Sustained outages each year.

SAIDI:

- The cumulative amount of time the average customer is interrupted by Sustained outages each year.

Cities in the Bishop/Mammoth District

Big Pine

Bishop

Darwin

Dixon Lane-Meadow Creek

Inyo County

Keeler

Mammoth Lakes

Mesa

Round Valley

West Bishop

Wilkerson

Reliability by SCE District (No Exclusions)

District Name	2012				2013				2014				2015				2016			
	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking
ANTELOPE VALLEY	78.60	28	0.56	31	94.42	22	0.62	31	51.05	35	0.59	34	104.34	22	0.68	30	107.67	24	0.87	29
ARROWHEAD	129.58	13	1.31	7	180.59	7	1.39	8	193.25	5	1.59	5	362.61	4	3.97	1	659.46	3	2.85	5
BARSTOW	184.80	7	1.15	12	204.33	6	1.40	7	201.53	4	1.34	10	187.11	8	1.17	12	134.83	18	1.35	9
BIG CREEK	1184.25	1	4.52	1	176.51	8	3.08	1	920.25	1	1.34	11	422.77	2	3.42	2	1062.01	2	4.99	1
BISHOP	463.09	2	1.25	9	104.44	17	0.51	35	118.79	17	0.59	35	298.11	6	2.22	4	168.59	8	1.22	14
BLYTHE	225.88	6	1.53	3	483.13	1	1.38	9	707.54	2	2.42	2	427.00	1	1.52	7	396.38	5	2.71	6
CATALINA	78.46	30	0.72	29	105.94	16	2.97	2	97.02	24	4.17	1	42.56	35	2.25	3	65.01	35	3.66	3
COVINA	108.73	19	0.92	19	100.51	19	0.86	20	91.60	27	0.87	22	100.08	23	0.81	25	112.13	22	0.97	24
DOMINGUEZ HILLS	117.22	18	0.82	24	89.17	26	0.80	21	82.30	29	0.71	28	130.63	15	0.97	17	146.38	12	1.11	17
FOOTHILL	91.69	25	0.90	20	85.80	27	0.79	24	93.35	25	0.93	21	109.64	20	0.95	20	142.81	14	1.03	21
FULLERTON	68.99	33	0.42	35	90.57	25	0.79	22	82.23	30	0.72	27	76.59	29	0.67	31	92.72	30	0.76	34
HUNTINGTON BEACH	95.78	23	0.89	21	66.51	32	0.68	29	79.61	31	0.78	25	98.32	25	0.95	19	128.02	20	1.26	12
KERNVILLE	226.76	5	1.31	6	232.18	4	1.96	3	178.69	8	1.99	3	286.38	7	0.96	18	2421.32	1	3.67	2
LONG BEACH	75.83	31	0.55	33	75.11	30	0.70	28	66.33	34	0.61	32	164.46	9	0.89	23	135.16	17	0.86	31
MENIFEE	99.32	22	0.84	23	107.39	15	1.26	10	156.68	11	1.32	12	111.46	19	0.98	16	156.75	9	1.31	10
MONROVIA	108.11	20	1.13	15	99.12	20	1.02	16	133.32	14	1.16	16	96.68	26	0.88	24	116.57	21	0.84	32
MONTEBELLO	131.06	12	1.13	14	118.08	13	1.17	12	158.34	10	1.16	15	150.28	12	1.18	11	133.52	19	1.17	15
ONTARIO	93.09	24	0.87	22	77.39	29	0.79	23	97.91	23	1.00	19	94.04	27	0.74	27	105.07	27	0.93	27
PALM SPRINGS	175.92	8	1.27	8	112.80	14	0.77	25	107.04	20	0.71	29	99.54	24	0.80	26	107.58	25	1.07	19
REDLANDS	120.13	16	1.11	16	96.48	21	1.04	15	154.25	12	1.04	18	124.52	17	1.01	14	137.11	16	0.98	23
RIDGECREST	229.65	4	1.44	4	161.95	9	1.12	13	176.84	9	1.57	6	148.90	13	1.01	15	254.31	6	1.05	20
SADDLEBACK	83.01	27	0.73	27	70.69	31	0.53	34	99.07	22	0.74	26	46.03	34	0.39	35	65.99	34	0.65	35
SAN JOAQUIN	135.90	10	1.04	18	244.44	2	1.45	6	138.25	13	1.17	14	127.50	16	1.05	13	108.44	23	1.09	18
SANTA ANA	78.60	29	0.55	32	93.35	24	0.74	26	91.68	26	0.84	23	67.46	32	0.71	29	97.27	29	1.00	22
SANTA BARBARA	153.81	9	1.15	13	82.00	28	0.70	27	183.78	7	1.38	9	152.37	11	1.52	6	156.66	10	1.41	8
SANTA MONICA	101.69	21	0.79	25	122.78	12	1.00	17	110.76	19	0.99	20	75.41	30	0.62	32	91.08	31	0.95	26
SOUTH BAY	122.68	15	1.17	10	142.15	10	1.49	5	125.28	16	1.39	8	164.07	10	1.31	8	183.90	7	1.88	7
TEHACHAPI	117.96	17	1.43	5	232.67	3	1.12	14	130.70	15	1.29	13	298.96	5	1.21	9	97.29	28	1.13	16
THOUSAND OAKS	127.73	14	1.05	17	93.86	23	0.91	18	104.37	21	1.10	17	106.59	21	0.92	21	143.78	13	1.31	11
VALENCIA	62.01	35	0.46	34	51.04	34	0.53	33	79.23	32	0.61	33	72.27	31	0.61	33	105.09	26	0.97	25
VENTURA	134.81	11	1.15	11	100.52	18	1.21	11	183.79	6	1.65	4	148.85	14	1.19	10	150.41	11	1.24	13
VICTORVILLE	67.70	34	0.66	30	61.33	33	0.63	30	68.85	33	0.63	31	87.03	28	0.91	22	79.35	33	0.92	28
WHITTIER	72.60	32	0.74	26	135.04	11	0.86	19	87.60	28	0.70	30	114.52	18	0.73	28	137.34	15	0.81	33
WILDOMAR	88.54	26	0.72	28	40.51	35	0.56	32	118.49	18	0.81	24	52.70	33	0.60	34	84.01	32	0.87	30
YUCCA VALLEY	319.82	3	3.41	2	216.97	5	1.50	4	304.25	3	1.49	7	389.08	3	1.80	5	463.68	4	3.39	4
SCE SystemWide	108.13		0.89		102.61		0.91		112.00		0.96		114.83		0.92		134.48		1.10	

Exclusions are days which utilities are allowed to remove from their metrics because the outages on those days were caused by a severe acts of nature.

**In the columns showing "Rank," lower numbers indicate poorer performance.


Overview of Inyo District 5

There are 21 circuits that serve Inyo District 5

Circuit Type	Sum of Customers	Circuit Type	Sum of Customers	Circuit Type	Sum of Customers	Circuit Type	Sum of Customers
BADWATER(12KV)	117						
BALLARAT(12KV)	2						
BROWN(4.16KV)	53						
CHINA RANCH(2.4KV)	9						
CINDER(12KV)	38						
EMIGRANT(12KV)	21						
ETTALEE(4.16KV)	16						
FURNACE CREEK(33KV)	35						
GRAPEVINE(12KV)	13						
GRIMSHAW(2.4KV)	79						
HACKMAN(33KV)	9						
HIGHWAY SIX(12KV)	1,251						
HOMEWOOD(4.8KV)	43						
HOT WATER(12KV)	46						
PAHRUMP(25KV)	24						
POINT OF ROCKS(12KV)	605						
SAWMILL(33KV)	10						
SHOSHONE(33KV)	19						
SIERRA TALC(33KV)	1						
STEWVAL(25KV)	12						
TOWNSITE(2.4KV)	66						


Grand Total 2,469

Reliability History of Circuits Serving Inyo District 5 (No Exclusions)

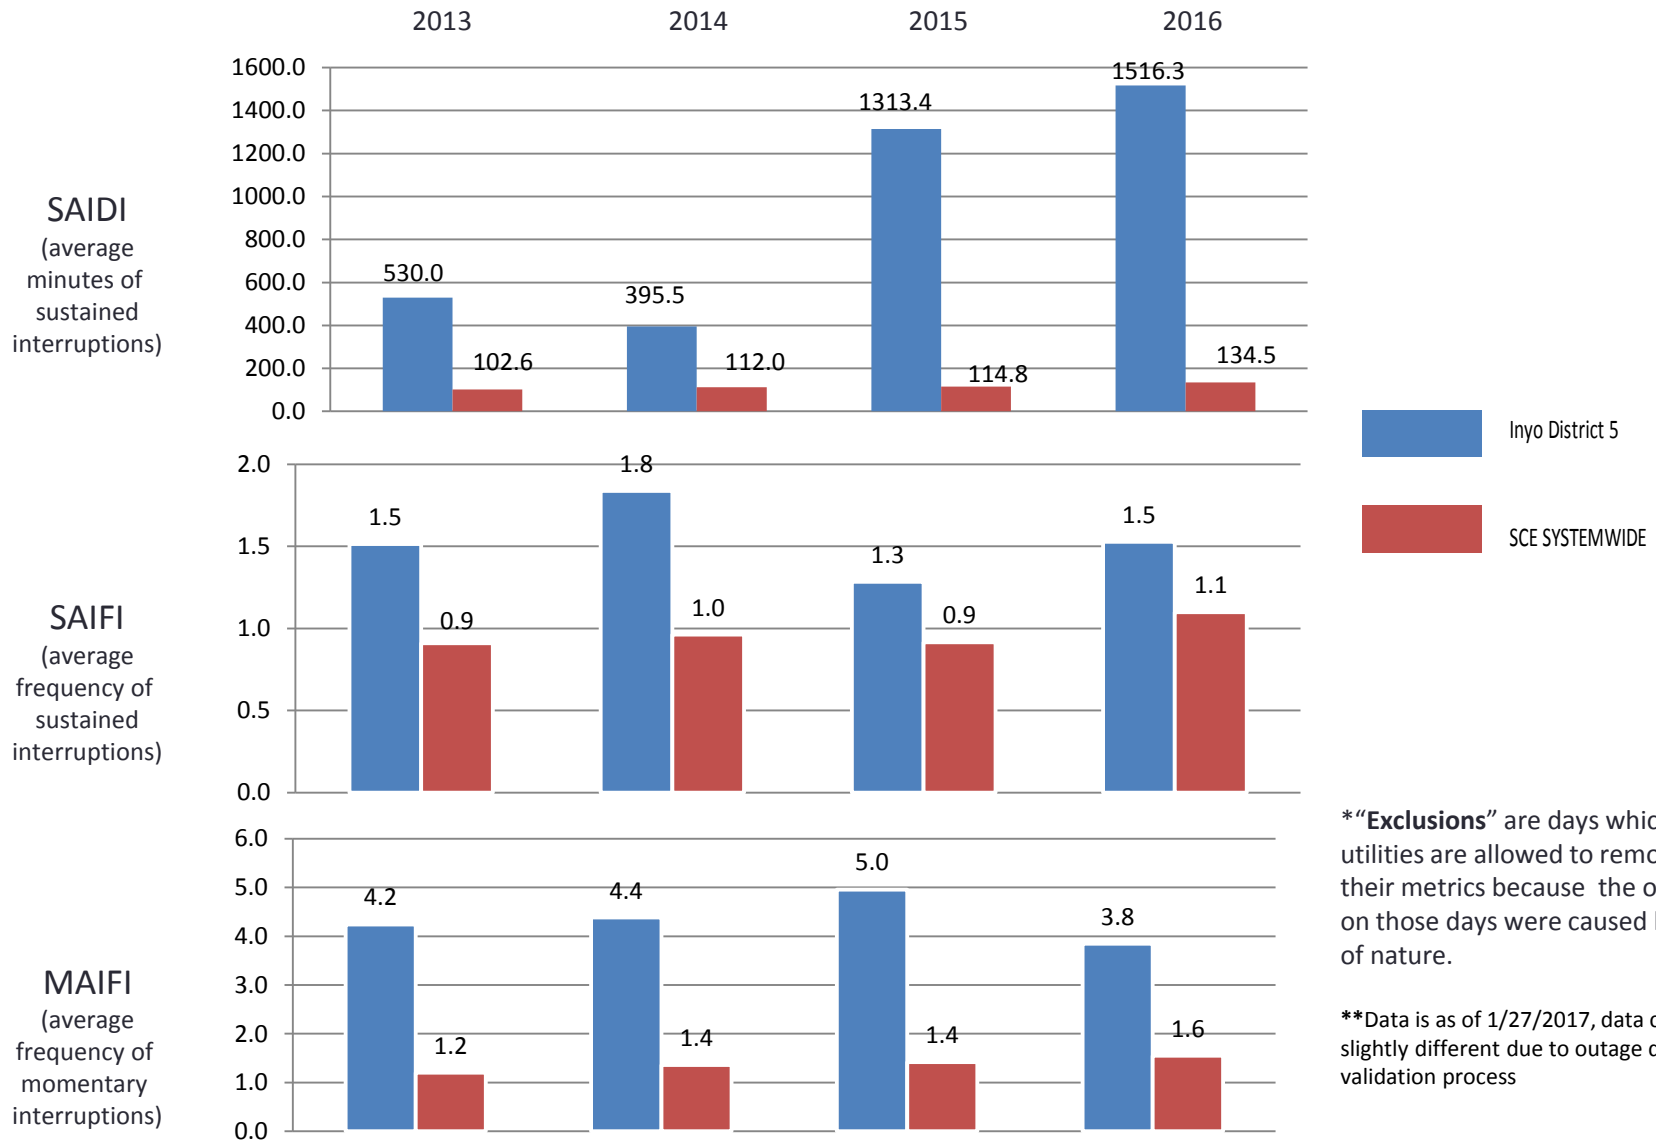

Causes of Repair Outages in Inyo District 5 Circuits 2016 YTD

Contributions to SAIDI by Outage Cause

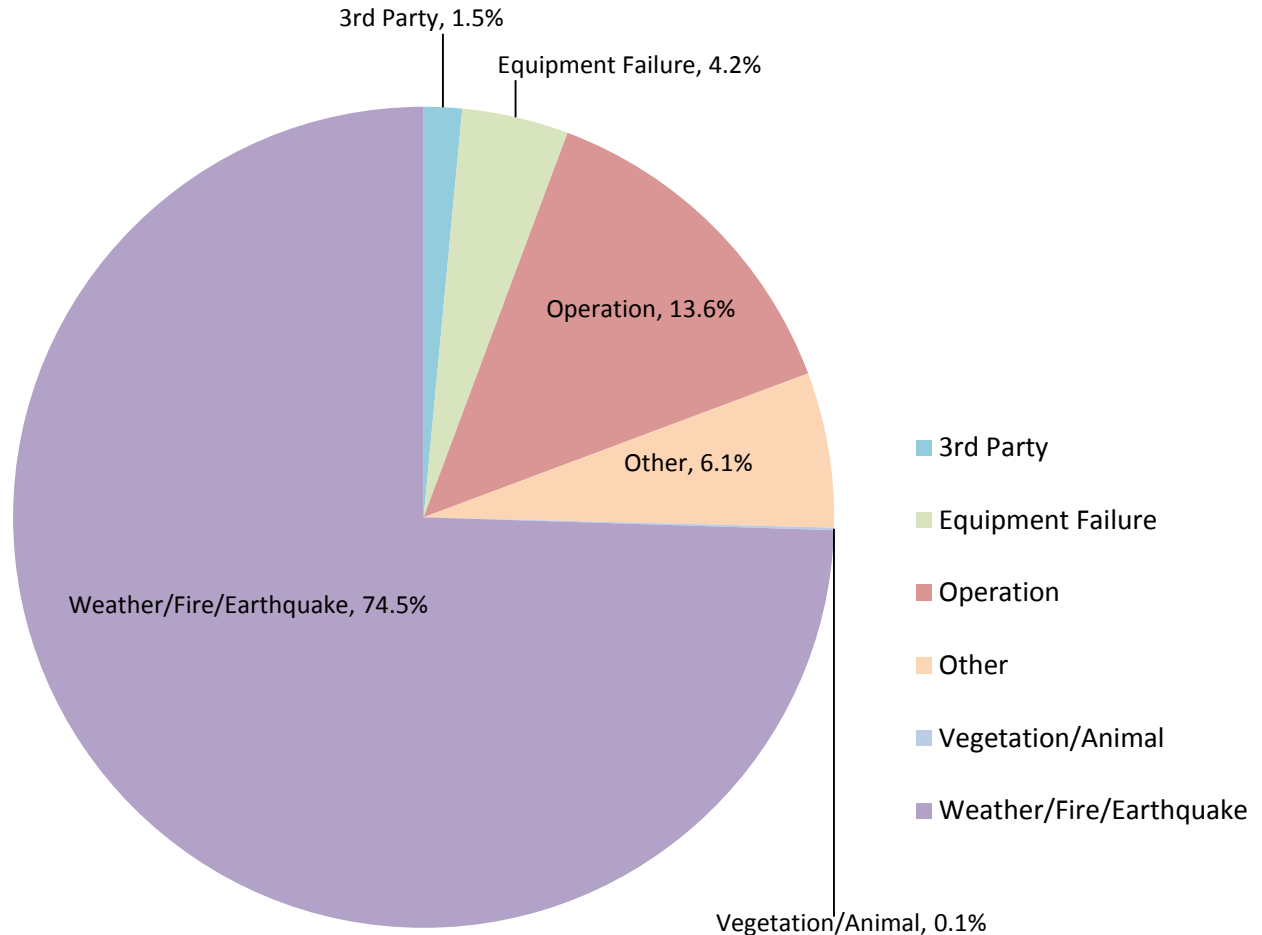


- **Equipment Failure**
e.g., in-service failure of transformer, switch, or conductors
- **Vegetation/Animal**
e.g., tree branch, rodent, or bird causing a short circuit between conductors
- **Other**
e.g., patrolled but no cause found
- **Operations**
e.g., urgent maintenance w/o 3-day notice
- **3rd Party**
e.g., balloon, car hit pole, dig-in

SAIDI = the cumulative amount of time the average customer is interrupted by “sustained” outages each year.

Causes of Repair Outages in Inyo District 5 Circuits 2016 YTD

Contributions to SAIFI by Outage Cause

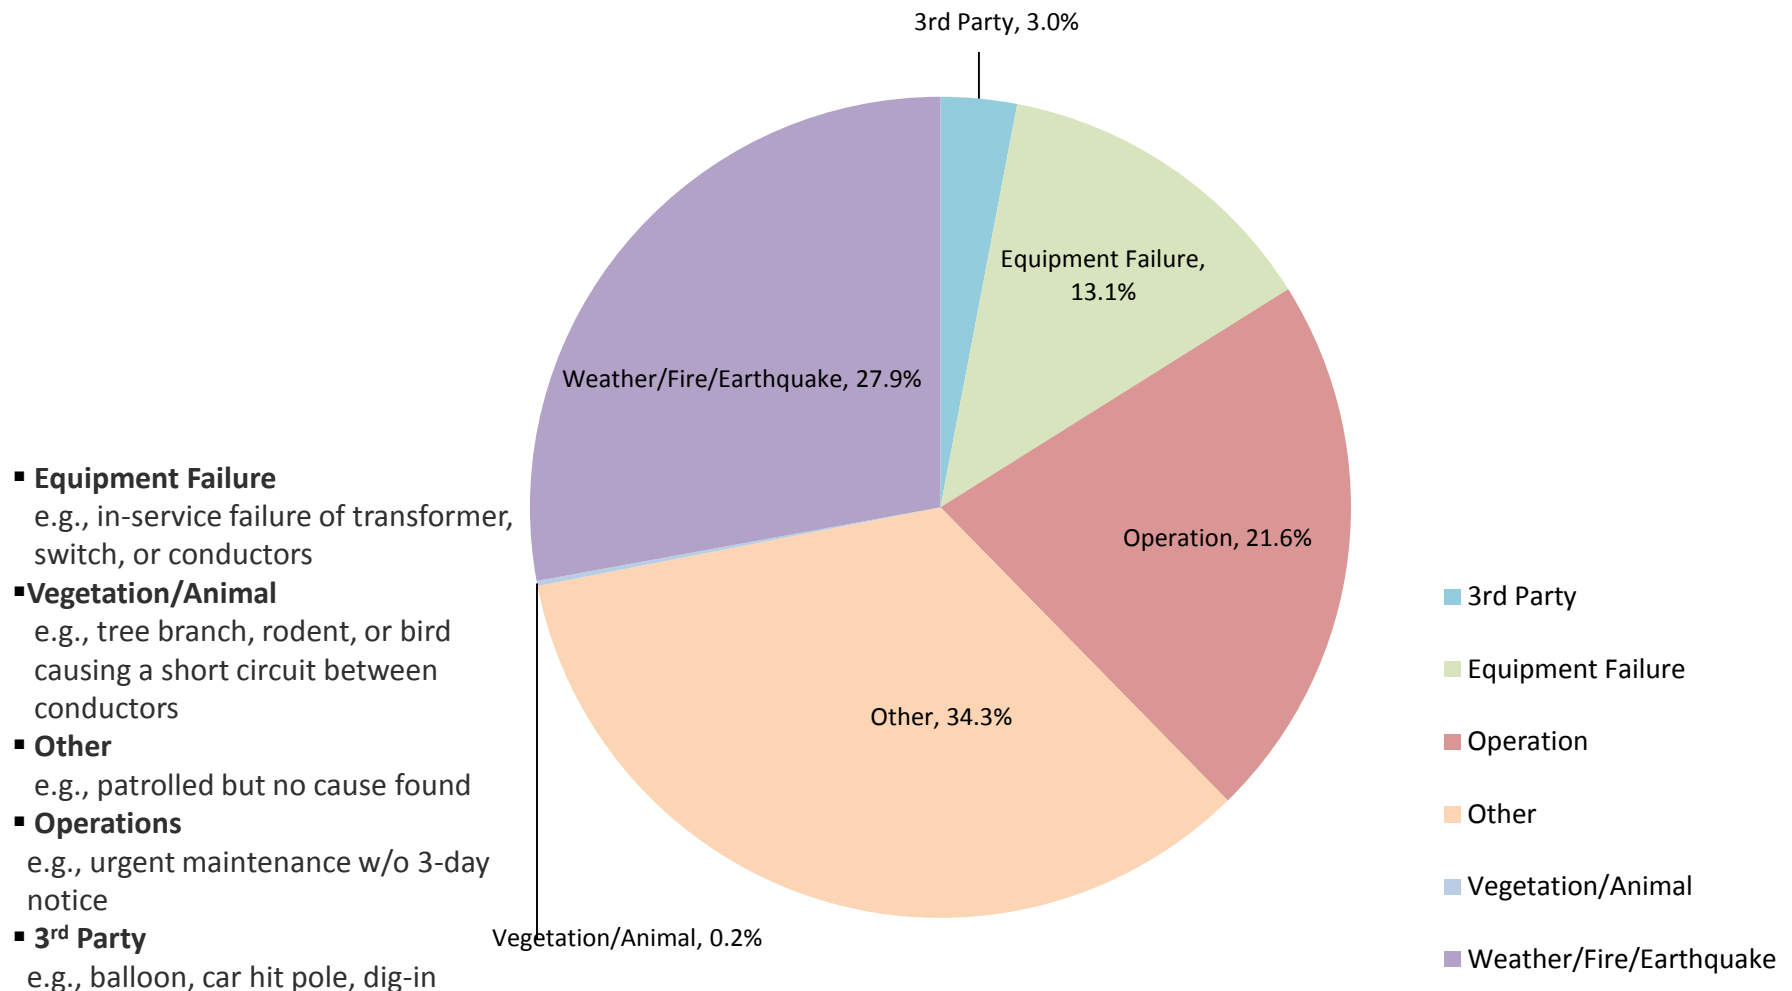

SAIFI = the number of times the average customer is interrupted by “sustained” outages each year.

Inyo County District 5 Unincorporated Areas 2017 Capital Improvement Plan

Unincorporated Community

Unincorporated County Area

Supervisory District



Replacement/Equipment Upgrade

• Pole Replacement

Other Work

• Circuit Rebuild

Disclaimer: This report is intended solely for informational purposes. The information included is reflective as of January 1, 2017 and is subject to change without further notice.

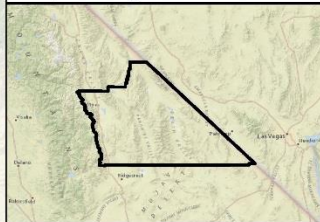

Date: 2/22/2017
File Name: Inyo_Districts_2017_CIP.mxd

Files created herein are sharing, not accuracy, are intended for informational purposes only. Data used and accuracy may be distorted at its scale. Always consult with the proper legal documents or agencies regarding such matters. All data is provided as is. Southern California Edison does not warrant the accuracy or completeness of the information. Southern California Edison is not responsible for any errors or omissions. Southern California Edison is not responsible for any damages or losses resulting from the use of this information. Southern California Edison is not responsible for any damages or losses resulting from the use of this information. Southern California Edison is not responsible for any damages or losses resulting from the use of this information.



Back-up Slides

Reliability Histories of Circuits Serving Inyo District 5

Updated through Year-End 2016

Average Reliability of 21 Circuits Serving Inyo District 5

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
Inyo District 5	530.0	1.5	4.2	395.5	1.8	4.4	1313.4	1.3	5.0	1007.6	0.3	0.9	189.3	0.4	1.0	289.0	0.6	0.9	30.4	0.2	1.0	1516.3	1.5	3.8
3rd Party	0%	0%	4%	0%	0%	0%	1%	1%	0%	2%	15%	0%	0%	0%	26%	0%	0%	0%	0%	0%	0%	2%	3%	7%
Equipment Failure	32%	21%	13%	42%	35%	9%	3%	17%	17%	1%	4%	6%	9%	16%	1%	14%	21%	32%	3%	1%	0%	4%	13%	9%
Operation	0%	0%	0%	1%	8%	0%	0%	5%	2%	0%	0%	0%	78%	68%	0%	20%	10%	0%	0%	1%	0%	14%	22%	0%
Other	53%	77%	80%	54%	56%	90%	10%	56%	78%	5%	74%	93%	13%	17%	73%	4%	28%	52%	19%	30%	82%	6%	34%	75%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	1%	2%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	3%	0%	0%	1%
Weather/Fire/Earthquake	14%	1%	2%	4%	1%	0%	86%	19%	1%	92%	6%	1%	0%	0%	0%	61%	41%	16%	78%	68%	15%	74%	28%	8%
SCE Systemwide	102.6	0.9	1.2	112.0	1.0	1.4	114.8	0.9	1.4	40.5	0.3	0.4	34.8	0.3	0.4	29.4	0.2	0.3	29.8	0.3	0.4	134.5	1.1	1.6

Notes:

No outages are excluded from the metrics.

Outage Causes:

Other: e.g., patrolled but no cause could be found

Operations: e.g., urgent maintenance w/o 3-day notice to customers

3rd Party: e.g., balloons, car hit pole, dig-in

Vegetation/Animal: e.g., tree branch, rodent, or bird causing short circuit across conductors

SAIDI (minutes) = the cumulative amount of time the average customer is interrupted by "sustained" (longer than 5 minutes) outages.

SAIFI (interruptions) = the number of times the average customer is interrupted by "sustained" outages.

MAIFI (interruptions) = the number of times the average customer is interrupted by "momentary" (lasting 5 minutes or less) outages.

Reliability Histories for Individual Circuits Serving Inyo District 5

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
BADWATER(12KV) - Customers: 117	3410.9	2.9	16.0	753.5	5.0	36.0	184.6	1.0	8.0	0.0	0.0	1.0	0.0	0.0	2.0	3737.3	4.0	4.9	0.0	0.0	6.0	3737.3	4.0	13.9
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	20%	31%	0%	0%	0%	11%	0%	0%	0%	0%	0%	0%	0%	0%	0%	20%	49%	59%	0%	0%	0%	20%	49%	21%
Operation	0%	0%	0%	8%	20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	28%	26%	0%	0%	0%	0%	28%	26%	0%
Other	80%	69%	100%	92%	80%	89%	100%	100%	100%	0%	0%	100%	0%	0%	100%	0%	0%	0%	0%	0%	100%	0%	0%	65%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	52%	25%	41%	0%	0%	0%	52%	25%	14%
BALLARAT(12KV) - Customers: 2	0.0	0.0	1.0	3017.0	8.0	6.0	840.0	2.0	6.0	1379.0	1.0	2.0	556.0	1.0	1.0	0.0	0.0	0.0	194.0	1.0	0.0	2129.0	3.0	3.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	33%
Equipment Failure	0%	0%	0%	55%	50%	17%	59%	50%	17%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	9%	33%	0%
Operation	0%	0%	0%	1%	25%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	26%	33%	0%
Other	0%	0%	0%	38%	13%	0%	0%	0%	67%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	65%	33%	67%
Vegetation/Animal	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	6%	13%	83%	41%	50%	17%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
BROWN(4.16KV) - Customers: 53	992.4	3.0	15.9	675.0	2.4	16.0	3900.8	5.0	24.6	556.5	1.1	3.7	968.2	2.1	1.6	75.8	2.0	4.0	0.0	0.0	0.0	1600.5	5.1	9.2
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	95%	33%	0%	0%	0%	6%	0%	0%	0%	0%	0%	0%	3%	20%	0%	0%	0%	0%	0%	0%	0%	2%	8%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	5%	67%	94%	8%	85%	94%	12%	60%	93%	54%	67%	82%	97%	80%	100%	100%	100%	100%	0%	0%	0%	82%	85%	93%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	4%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	6%	92%	15%	0%	88%	40%	3%	46%	33%	18%	0%	0%	0%	0%	0%	0%	0%	0%	0%	16%	7%	7%
CHINA RANCH(2.4KV) - Customers: 9	1188.0	4.0	20.0	386.2	3.0	17.5	4791.0	5.0	25.9	0.0	0.0	4.0	0.0	0.0	3.0	183.0	2.0	5.0	0.0	0.0	5.0	183.0	2.0	17.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	79%	25%	5%	0%	0%	6%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	9%	25%	0%	4%	31%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	13%	50%	90%	96%	69%	94%	10%	60%	96%	0%	0%	100%	0%	0%	100%	100%	100%	100%	0%	0%	100%	100%	100%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	4%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	5%	0%	0%	0%	90%	40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Inyo District 5

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
CINDER(12KV) - Customers: 38	0.0	0.0	2.0	23.7	0.0	7.7	5.9	1.0	12.1	398.9	0.6	3.6	104.2	2.0	2.5	0.0	0.0	2.0	261.4	2.5	2.5	764.5	5.1	10.5
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	100%	100%	0%	0%	0%	0%	65%	79%	15%	100%	100%	20%	0%	0%	0%	0%	0%	0%	48%	49%	10%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	8%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	100%	0%	0%	100%	100%	100%	92%	35%	21%	85%	0%	0%	80%	0%	0%	100%	11%	40%	80%	22%	22%	85%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	89%	60%	20%	31%	29%	5%
EMIGRANT(12KV) - Customers: 21	1192.0	3.0	17.0	4260.6	5.0	37.0	186.0	1.0	10.0	0.0	0.0	1.0	0.0	0.0	3.0	3035.1	2.0	3.0	0.0	0.0	6.1	3035.1	2.0	13.1
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	87%	40%	14%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	35%	50%	0%	0%	0%	0%	35%	50%	0%
Other	100%	100%	100%	13%	60%	86%	100%	100%	100%	0%	0%	100%	0%	0%	100%	0%	0%	33%	0%	0%	100%	0%	0%	85%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	65%	50%	67%	0%	0%	0%	65%	50%	15%
ETTALÉE(4.16KV) - Customers: 16	45.0	1.0	11.0	49.0	1.0	0.0	186.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	100%	100%	100%	100%	100%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
FURNACE CREEK(33KV) - Customers: 35	221.9	2.1	17.1	1280.5	5.4	36.2	185.5	1.0	9.5	3.4	0.1	3.0	176.4	0.5	2.9	1952.8	1.0	2.9	0.0	0.0	6.0	2132.6	1.6	14.7
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	11%	3%	0%	57%	45%	16%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	8%	33%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	4%	0%
Other	89%	97%	100%	43%	55%	84%	100%	100%	100%	0%	0%	100%	0%	0%	100%	0%	0%	30%	0%	0%	100%	0%	0%	86%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	70%	0%	0%	0%	92%	64%	14%

Reliability Histories for Individual Circuits Serving Inyo District 5

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
GRAPEVINE(12KV) - Customers: 13	10831.3	3.1	3.9	341.0	4.0	4.0	107113.0	3.0	0.0	155697.4	1.3	0.0	0.0	0.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	155697.4	1.3	1.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	2%	65%	100%	100%	100%	100%	0%	67%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	98%	35%	0%	0%	0%	0%	100%	33%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
GRIMSHAW(2.4KV) - Customers: 79	1076.5	3.0	19.9	393.2	3.1	17.0	4748.8	6.0	27.0	0.0	0.0	4.0	0.0	0.0	2.9	175.6	1.9	4.8	0.0	0.0	3.9	175.6	1.9	15.7
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	86%	33%	5%	6%	2%	6%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	4%	33%	0%	0%	17%	4%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	14%	67%	90%	90%	65%	94%	10%	50%	93%	0%	0%	100%	0%	0%	100%	100%	100%	100%	0%	0%	100%	100%	100%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	4%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	5%	0%	0%	0%	90%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
HACKMAN(33KV) - Customers: 9	0.0	0.0	0.9	2775.0	7.4	5.3	746.6	1.8	5.3	480.3	0.8	1.6	505.4	1.1	1.0	0.0	0.0	0.0	190.0	1.3	0.0	1175.8	3.2	2.6
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	39%
Equipment Failure	0%	0%	0%	59%	48%	17%	59%	50%	21%	0%	0%	0%	0%	0%	0%	0%	0%	0%	90%	58%	0%	15%	24%	0%
Operation	0%	0%	0%	1%	36%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	10%	42%	0%	45%	52%	0%
Other	0%	0%	0%	38%	13%	0%	0%	0%	63%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	41%	24%	61%
Vegetation/Animal	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	1%	3%	83%	41%	50%	17%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
HIGHWAY SIX(12KV) - Customers: 1,251	331.8	1.7	1.7	41.9	0.3	0.0	152.9	0.6	1.6	111.4	0.4	0.7	12.3	0.0	0.3	88.5	0.4	0.3	42.5	0.3	0.3	254.6	1.1	1.6
3rd Party	0%	0%	20%	0%	0%	0%	0%	0%	0%	40%	22%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	18%	8%	0%
Equipment Failure	31%	21%	60%	7%	2%	0%	17%	19%	60%	0%	0%	12%	65%	41%	0%	9%	9%	100%	0%	0%	0%	6%	4%	23%
Operation	0%	0%	0%	0%	1%	0%	1%	0%	0%	0%	0%	0%	12%	28%	0%	0%	0%	0%	0%	0%	0%	1%	1%	0%
Other	69%	79%	20%	93%	98%	0%	72%	64%	40%	60%	78%	88%	22%	31%	100%	0%	0%	0%	6%	3%	0%	28%	30%	59%
Vegetation/Animal	0%	1%	0%	0%	0%	0%	1%	3%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	1%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	9%	14%	0%	0%	0%	0%	0%	0%	0%	91%	91%	0%	94%	97%	100%	47%	57%	18%

Reliability Histories for Individual Circuits Serving Inyo District 5

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
HOMEWOOD(4.8KV) - Customers: 43	0.0	0.0	1.0	2683.3	6.0	1.0	829.4	2.0	2.0	0.0	0.0	0.0	545.2	1.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	545.2	1.0	1.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Equipment Failure	0%	0%	0%	56%	50%	100%	59%	50%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	1%	34%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Other	0%	0%	0%	43%	16%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	41%	50%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
HOT WATER(12KV) - Customers: 46	1097.2	3.0	19.9	412.6	2.9	18.2	4818.6	5.0	26.9	0.0	0.0	4.0	0.0	0.0	3.0	183.0	2.0	5.0	0.0	0.0	5.0	183.0	2.0	17.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	86%	33%	5%	2%	1%	6%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	3%	30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	14%	67%	90%	95%	69%	94%	10%	60%	96%	0%	0%	100%	0%	0%	100%	100%	100%	100%	0%	0%	100%	100%	100%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	4%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	5%	0%	0%	0%	90%	40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
PAHRUMP(25KV) - Customers: 24	285.7	1.1	0.0	1931.4	4.1	0.0	933.0	1.1	0.0	82.1	1.0	1.0	39.8	0.1	1.0	0.0	0.0	0.0	0.0	0.0	0.0	121.9	1.1	2.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	23%	12%	0%	12%	3%	0%	10%	10%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	33%	7%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	77%	88%	0%	88%	97%	0%	0%	0%	0%	100%	100%	100%	0%	0%	100%	0%	0%	0%	0%	0%	0%	67%	93%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	90%	90%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
POINT OF ROCKS(12KV) - Customers: 6	4.9	0.0	0.0	559.2	3.0	0.0	57.7	0.5	2.4	5.3	0.0	0.0	589.5	1.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	594.8	1.0	1.0
3rd Party	0%	0%	0%	0%	0%	0%	59%	8%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Equipment Failure	100%	100%	0%	51%	66%	0%	41%	91%	58%	0%	0%	0%	5%	4%	0%	0%	0%	0%	0%	0%	0%	5%	3%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	1%	0%	0%	0%	0%	95%	96%	0%	0%	0%	0%	0%	0%	0%	94%	96%	0%
Other	0%	0%	0%	48%	33%	0%	0%	0%	42%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	1%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Inyo District 5

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
SAWMILL(33KV) - Customers: 10	1730.2	2.1	1.0	459.0	2.0	0.0	24.7	0.2	1.9	13.1	0.1	0.0	0.0	0.0	0.0	279.2	1.0	1.0	0.0	0.0	0.0	292.3	1.1	1.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	20%	52%	0%	80%	50%	0%	32%	50%	47%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	4%	9%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	80%	48%	100%	0%	0%	0%	0%	0%	53%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	20%	50%	0%	68%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	96%	91%	100%
SHOSHONE(33KV) - Customers: 19	1836.6	4.2	16.2	1296.9	4.7	16.0	5068.0	6.2	24.6	767.4	0.7	4.4	34.4	0.1	2.5	126.3	2.1	3.8	0.0	0.0	2.3	928.1	2.8	13.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	78%	33%	0%	4%	1%	6%	8%	3%	0%	20%	54%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	20%	15%	0%
Operation	5%	9%	0%	1%	13%	0%	1%	6%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	14%	54%	95%	88%	81%	94%	12%	52%	96%	51%	23%	100%	0%	0%	100%	100%	100%	100%	0%	0%	100%	56%	80%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	5%	7%	2%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	4%	4%	5%	7%	4%	0%	74%	33%	2%	28%	23%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	24%	6%	0%
SIERRA TALC(33KV) - Customers: 1	0.0	0.0	0.0	0.0	0.0	0.0	268.0	4.0	20.0	41.0	1.0	2.0	83.0	1.0	6.0	0.0	0.0	1.0	148.0	2.0	6.0	272.0	4.0	15.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	100%	100%	90%	100%	100%	100%	100%	100%	100%	0%	0%	100%	100%	100%	83%	100%	100%	93%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	17%	0%	0%	7%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
STEWVAL(25KV) - Customers: 12	0.0	0.0	0.0	0.0	0.0	0.0	365.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Inyo District 5

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
TOWNSITE(2.4KV) - Customers: 66	269.1	4.0	17.9	689.9	4.0	11.9	709.9	8.1	21.1	40.9	1.0	2.0	81.7	1.0	6.0	81.2	0.5	1.0	145.6	2.0	5.9	349.4	4.5	14.9
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	75%	22%	0%	30%	12%	5%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	23%	12%	0%
Operation	0%	0%	0%	0%	0%	0%	13%	13%	9%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	100%	100%	100%	25%	78%	100%	57%	74%	85%	100%	100%	100%	100%	100%	100%	0%	0%	100%	100%	100%	83%	77%	88%	93%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	17%	0%	0%	7%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%