



Circuit Reliability Review

Fullerton

January 2017

Providing Safe, Reliable, and Affordable Power

Southern California Edison is modernizing the power grid to meet the changing needs and expectations of our customers and to help California achieve its clean energy goals.

We are investing more than \$12 billion into our power grid between 2015 – 2017 with the goal of increasing power reliability through significant upgrades. These investments include:

- Updating thousands of transmission and distribution poles
- Replacing hundreds of miles of underground cables
- Replacing hundreds of underground structures such as vaults and manholes
- Upgrading critical distribution equipment; capacitor banks, switches, and circuit breakers
- Building new distribution circuits to serve electrical demands in our communities
- Inspecting and replacing overhead conductor and equipment to improve public safety

Our investments in local communities will help ensure that customers receive safe, reliable, and affordable electricity now and in the future.

Understanding Your Reliability Report

As your electric utility, we want you to always have power when you need it. To get there, we constantly track and monitor electric outages across our service territory, and we measure our “system reliability” from this data.

The two metrics we rely on are common in the electric utility industry: the System Average Interruption Duration Index (SAIDI) and the System Average Interruption Frequency Index (SAIFI). Both are described in more detail on the next page.

Replacing and upgrading our infrastructure will help SCE maintain or improve SAIDI and SAIFI measurements.

This report provides historical reliability data for the circuits that serve your jurisdiction and our proposed infrastructure upgrades for the current year.

To view other reliability reports, visit [sce.com>Outage Center>Maintaining Reliable Service](https://sce.com/Outage-Center/Maintaining-Reliable-Service)

Reliability Metrics

MOMENTARY OUTAGES:

OUTAGES LASTING 5 MINUTES OR LESS

MAIFI:

- The number of times the average customer is interrupted by Momentary outages each year.

SUSTAINED OUTAGES:

OUTAGES LASTING LONGER THAN 5 MINUTES

SAIFI:

- The number of times the average customer is interrupted by Sustained outages each year.

SAIDI:

- The cumulative amount of time the average customer is interrupted by Sustained outages each year.

Cities in the Fullerton District

Anaheim

Brea

Buena Park

Cypress

East La Mirada

Fullerton

Hacienda Heights

La Habra

La Habra Heights

La Mirada

La Palma

Placentia

Rowland Heights

Stanton

Yorba Linda

Reliability by SCE District (No Exclusions)

District Name	2012				2013				2014				2015				2016			
	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking
ANTELOPE VALLEY	78.60	28	0.56	31	94.42	22	0.62	31	51.05	35	0.59	34	104.34	22	0.68	30	107.67	24	0.87	29
ARROWHEAD	129.58	13	1.31	7	180.59	7	1.39	8	193.25	5	1.59	5	362.61	4	3.97	1	659.46	3	2.85	5
BARSTOW	184.80	7	1.15	12	204.33	6	1.40	7	201.53	4	1.34	10	187.11	8	1.17	12	134.83	18	1.35	9
BIG CREEK	1184.25	1	4.52	1	176.51	8	3.08	1	920.25	1	1.34	11	422.77	2	3.42	2	1062.01	2	4.99	1
BISHOP	463.09	2	1.25	9	104.44	17	0.51	35	118.79	17	0.59	35	298.11	6	2.22	4	168.59	8	1.22	14
BLYTHE	225.88	6	1.53	3	483.13	1	1.38	9	707.54	2	2.42	2	427.00	1	1.52	7	396.38	5	2.71	6
CATALINA	78.46	30	0.72	29	105.94	16	2.97	2	97.02	24	4.17	1	42.56	35	2.25	3	65.01	35	3.66	3
COVINA	108.73	19	0.92	19	100.51	19	0.86	20	91.60	27	0.87	22	100.08	23	0.81	25	112.13	22	0.97	24
DOMINGUEZ HILLS	117.22	18	0.82	24	89.17	26	0.80	21	82.30	29	0.71	28	130.63	15	0.97	17	146.38	12	1.11	17
FOOTHILL	91.69	25	0.90	20	85.80	27	0.79	24	93.35	25	0.93	21	109.64	20	0.95	20	142.81	14	1.03	21
FULLERTON	68.99	33	0.42	35	90.57	25	0.79	22	82.23	30	0.72	27	76.59	29	0.67	31	92.72	30	0.76	34
HUNTINGTON BEACH	95.78	23	0.89	21	66.51	32	0.68	29	79.61	31	0.78	25	98.32	25	0.95	19	128.02	20	1.26	12
KERNVILLE	226.76	5	1.31	6	232.18	4	1.96	3	178.69	8	1.99	3	286.38	7	0.96	18	2421.32	1	3.67	2
LONG BEACH	75.83	31	0.55	33	75.11	30	0.70	28	66.33	34	0.61	32	164.46	9	0.89	23	135.16	17	0.86	31
MENIFEE	99.32	22	0.84	23	107.39	15	1.26	10	156.68	11	1.32	12	111.46	19	0.98	16	156.75	9	1.31	10
MONROVIA	108.11	20	1.13	15	99.12	20	1.02	16	133.32	14	1.16	16	96.68	26	0.88	24	116.57	21	0.84	32
MONTEBELLO	131.06	12	1.13	14	118.08	13	1.17	12	158.34	10	1.16	15	150.28	12	1.18	11	133.52	19	1.17	15
ONTARIO	93.09	24	0.87	22	77.39	29	0.79	23	97.91	23	1.00	19	94.04	27	0.74	27	105.07	27	0.93	27
PALM SPRINGS	175.92	8	1.27	8	112.80	14	0.77	25	107.04	20	0.71	29	99.54	24	0.80	26	107.58	25	1.07	19
REDLANDS	120.13	16	1.11	16	96.48	21	1.04	15	154.25	12	1.04	18	124.52	17	1.01	14	137.11	16	0.98	23
RIDGECREST	229.65	4	1.44	4	161.95	9	1.12	13	176.84	9	1.57	6	148.90	13	1.01	15	254.31	6	1.05	20
SADDLEBACK	83.01	27	0.73	27	70.69	31	0.53	34	99.07	22	0.74	26	46.03	34	0.39	35	65.99	34	0.65	35
SAN JOAQUIN	135.90	10	1.04	18	244.44	2	1.45	6	138.25	13	1.17	14	127.50	16	1.05	13	108.44	23	1.09	18
SANTA ANA	78.60	29	0.55	32	93.35	24	0.74	26	91.68	26	0.84	23	67.46	32	0.71	29	97.27	29	1.00	22
SANTA BARBARA	153.81	9	1.15	13	82.00	28	0.70	27	183.78	7	1.38	9	152.37	11	1.52	6	156.66	10	1.41	8
SANTA MONICA	101.69	21	0.79	25	122.78	12	1.00	17	110.76	19	0.99	20	75.41	30	0.62	32	91.08	31	0.95	26
SOUTH BAY	122.68	15	1.17	10	142.15	10	1.49	5	125.28	16	1.39	8	164.07	10	1.31	8	183.90	7	1.88	7
TEHACHAPI	117.96	17	1.43	5	232.67	3	1.12	14	130.70	15	1.29	13	298.96	5	1.21	9	97.29	28	1.13	16
THOUSAND OAKS	127.73	14	1.05	17	93.86	23	0.91	18	104.37	21	1.10	17	106.59	21	0.92	21	143.78	13	1.31	11
VALENCIA	62.01	35	0.46	34	51.04	34	0.53	33	79.23	32	0.61	33	72.27	31	0.61	33	105.09	26	0.97	25
VENTURA	134.81	11	1.15	11	100.52	18	1.21	11	183.79	6	1.65	4	148.85	14	1.19	10	150.41	11	1.24	13
VICTORVILLE	67.70	34	0.66	30	61.33	33	0.63	30	68.85	33	0.63	31	87.03	28	0.91	22	79.35	33	0.92	28
WHITTIER	72.60	32	0.74	26	135.04	11	0.86	19	87.60	28	0.70	30	114.52	18	0.73	28	137.34	15	0.81	33
WILDOMAR	88.54	26	0.72	28	40.51	35	0.56	32	118.49	18	0.81	24	52.70	33	0.60	34	84.01	32	0.87	30
YUCCA VALLEY	319.82	3	3.41	2	216.97	5	1.50	4	304.25	3	1.49	7	389.08	3	1.80	5	463.68	4	3.39	4
SCE SystemWide	108.13		0.89		102.61		0.91		112.00		0.96		114.83		0.92		134.48		1.10	

Exclusions are days which utilities are allowed to remove from their metrics because the outages on those days were caused by a severe acts of nature.


**In the columns showing "Rank," lower numbers indicate poorer performance.

Overview of Fullerton

There are 67 circuits that serve Fullerton


Circuit Type	Sum of Customers	Circuit Type	Sum of Customers	Circuit Type	Sum of Customers	Circuit Type	Sum of Customers
ASH(4.16KV)	1,186	LAWRENCE(12KV)	872	TOURNEY(12KV)	1,698		
BERLIN(12KV)	1,306	MADRONE(4.16KV)	782	TUITION(12KV)	2,491		
BRASHEARS(12KV)	964	MARYLAND(12KV)	1,103	VERMONT(12KV)	1,880		
BRIDE(12KV)	472	MASHIE(12KV)	329	VONI(4.16KV)	18		
CADDY(12KV)	2,557	MASSACHUSETTS(12KV)	2,463	WEALTH(4.16KV)	596		
CART(12KV)	1,192	MATLOCK(12KV)	1,111	WISCONSIN(12KV)	1,446		
CHIPPER(12KV)	1,656	MEMORY(12KV)	901	WYOMING(12KV)	2,788		
COACH(12KV)	2,040	MINNESOTA(12KV)	23				
COMPLEX(12KV)	1,430	OKLAHOMA(12KV)	1,361				
CONNECTICUT(12KV)	1,527	PAPER 1(4.16KV)	1				
COURSE(12KV)	643	PHOENIX(12KV)	1,171				
DAKOTA(12KV)	91	PUTTER(12KV)	1,638				
DELCO(12KV)	1,578	PYRUS(12KV)	1,485				
DEODARA(12KV)	511	QUARTER(12KV)	729				
DITWOOD(12KV)	1	RAYBESTOS(12KV)	376				
DIVOT(12KV)	1,296	RHODE ISLAND(12KV)	282				
FLORIDA(12KV)	1,267	RICHMAN(4.16KV)	613				
GASTON(12KV)	1,761	ROMA(12KV)	2,292				
GILLIS(12KV)	1,205	RONWOOD(12KV)	235				
GRACE(12KV)	1,507	ROUGH(12KV)	13				
GRADUATE(12KV)	1,197	ROYER(12KV)	641				
GUM(12KV)	2,995	SCIENCE(12KV)	478				
HARVARD(4.16KV)	629	SEMESTER(12KV)	296				
HAVENHURST(12KV)	985	SHADOW(12KV)	2,459				
HOLLOWAY(4.16KV)	630	SHANK(12KV)	1,936				
HOOK(12KV)	378	SLICE(12KV)	2,118				
HUNT(12KV)	1,875	STUDENT(12KV)	2,226				
JAYMAC(4.16KV)	680	TEACHER(12KV)	583				
JOCLYN(4.16KV)	16	TEE(12KV)	1,768				
KENTUCKY(12KV)	1,030	TERM(12KV)	2,472				
Grand Total	78,279						

Reliability History of Circuits Serving Fullerton (No Exclusions)

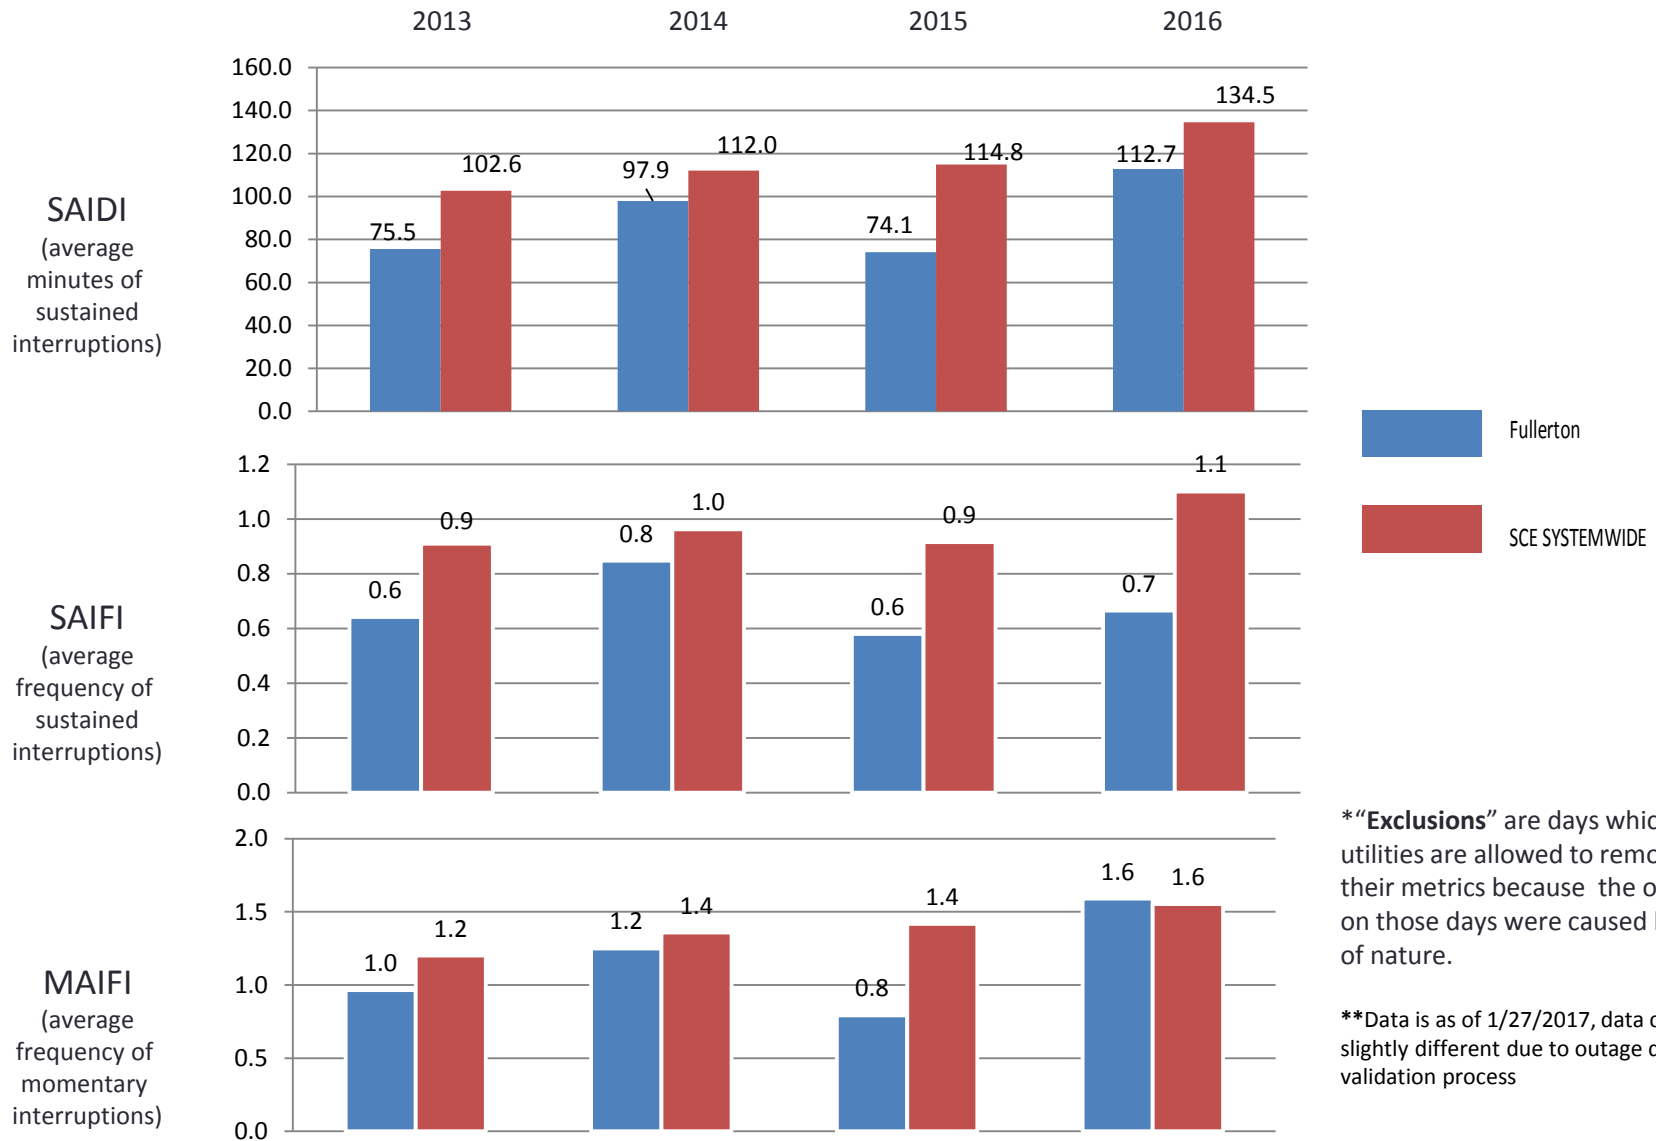

Causes of Repair Outages in Fullerton Circuits 2016 YTD


Contributions to SAIDI by Outage Cause

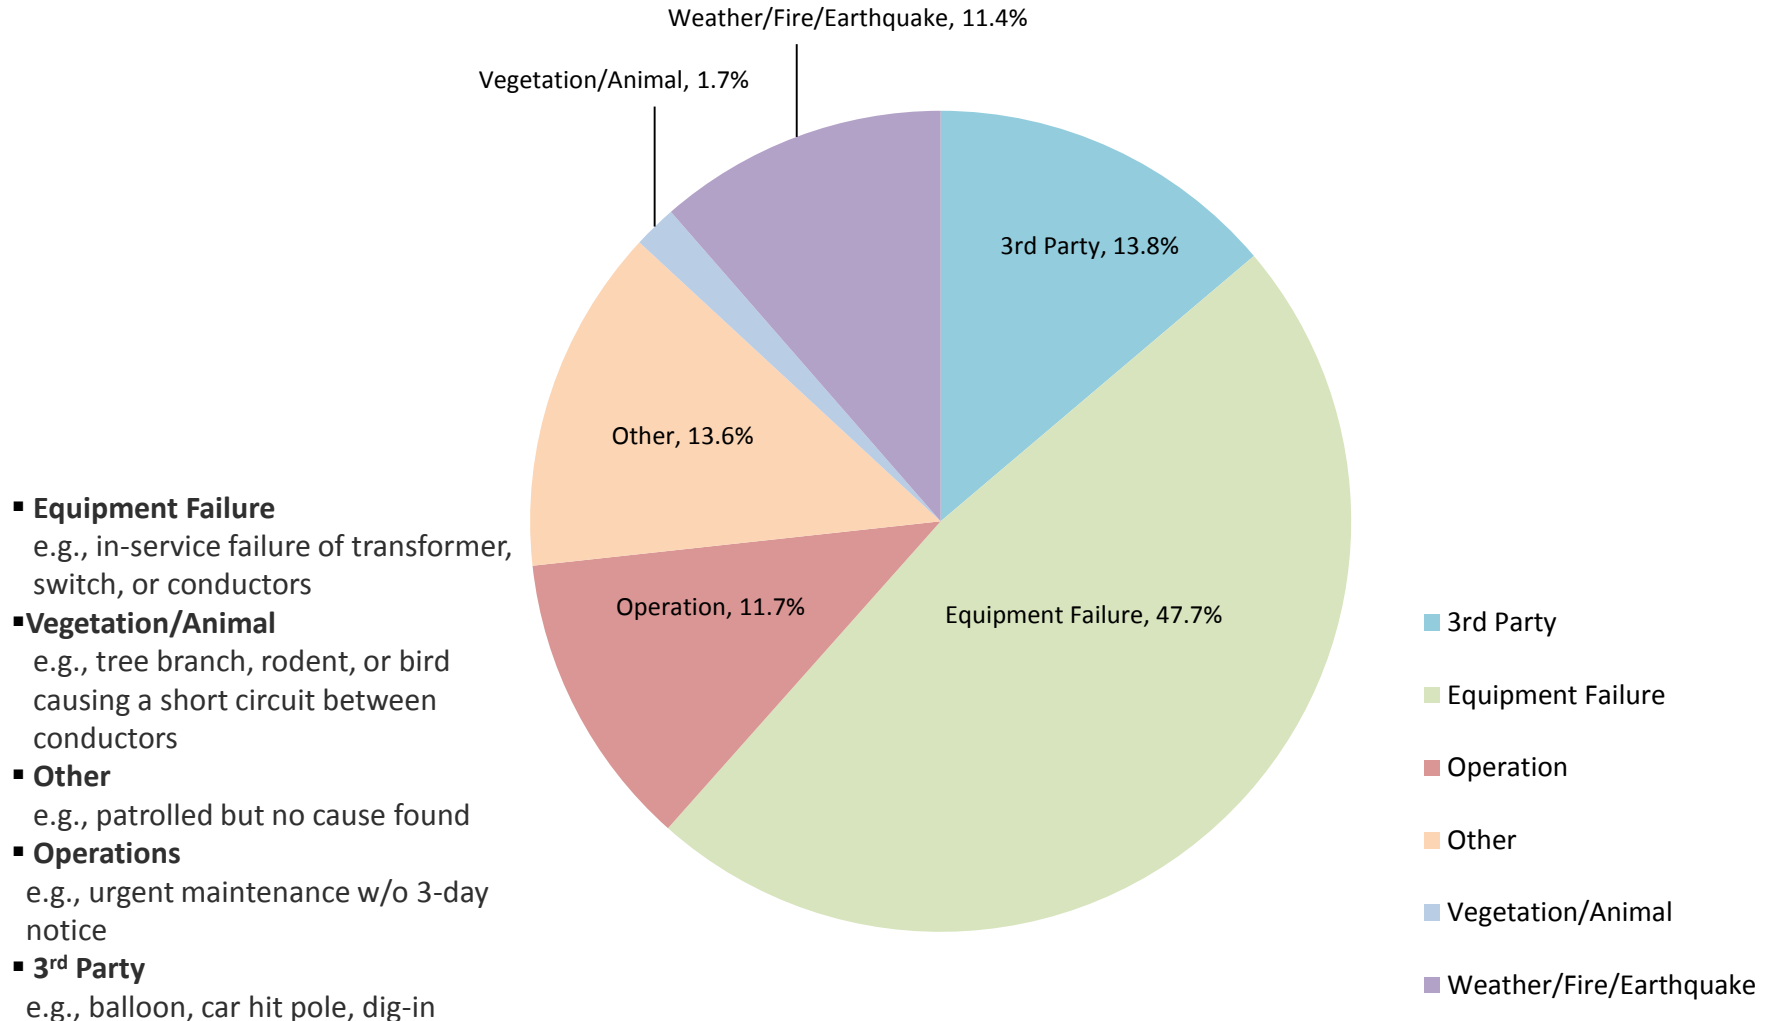


SAIDI = the cumulative amount of time the average customer is interrupted by “sustained” outages each year.

Causes of Repair Outages in Fullerton Circuits 2016 YTD

Contributions to SAIFI by Outage Cause

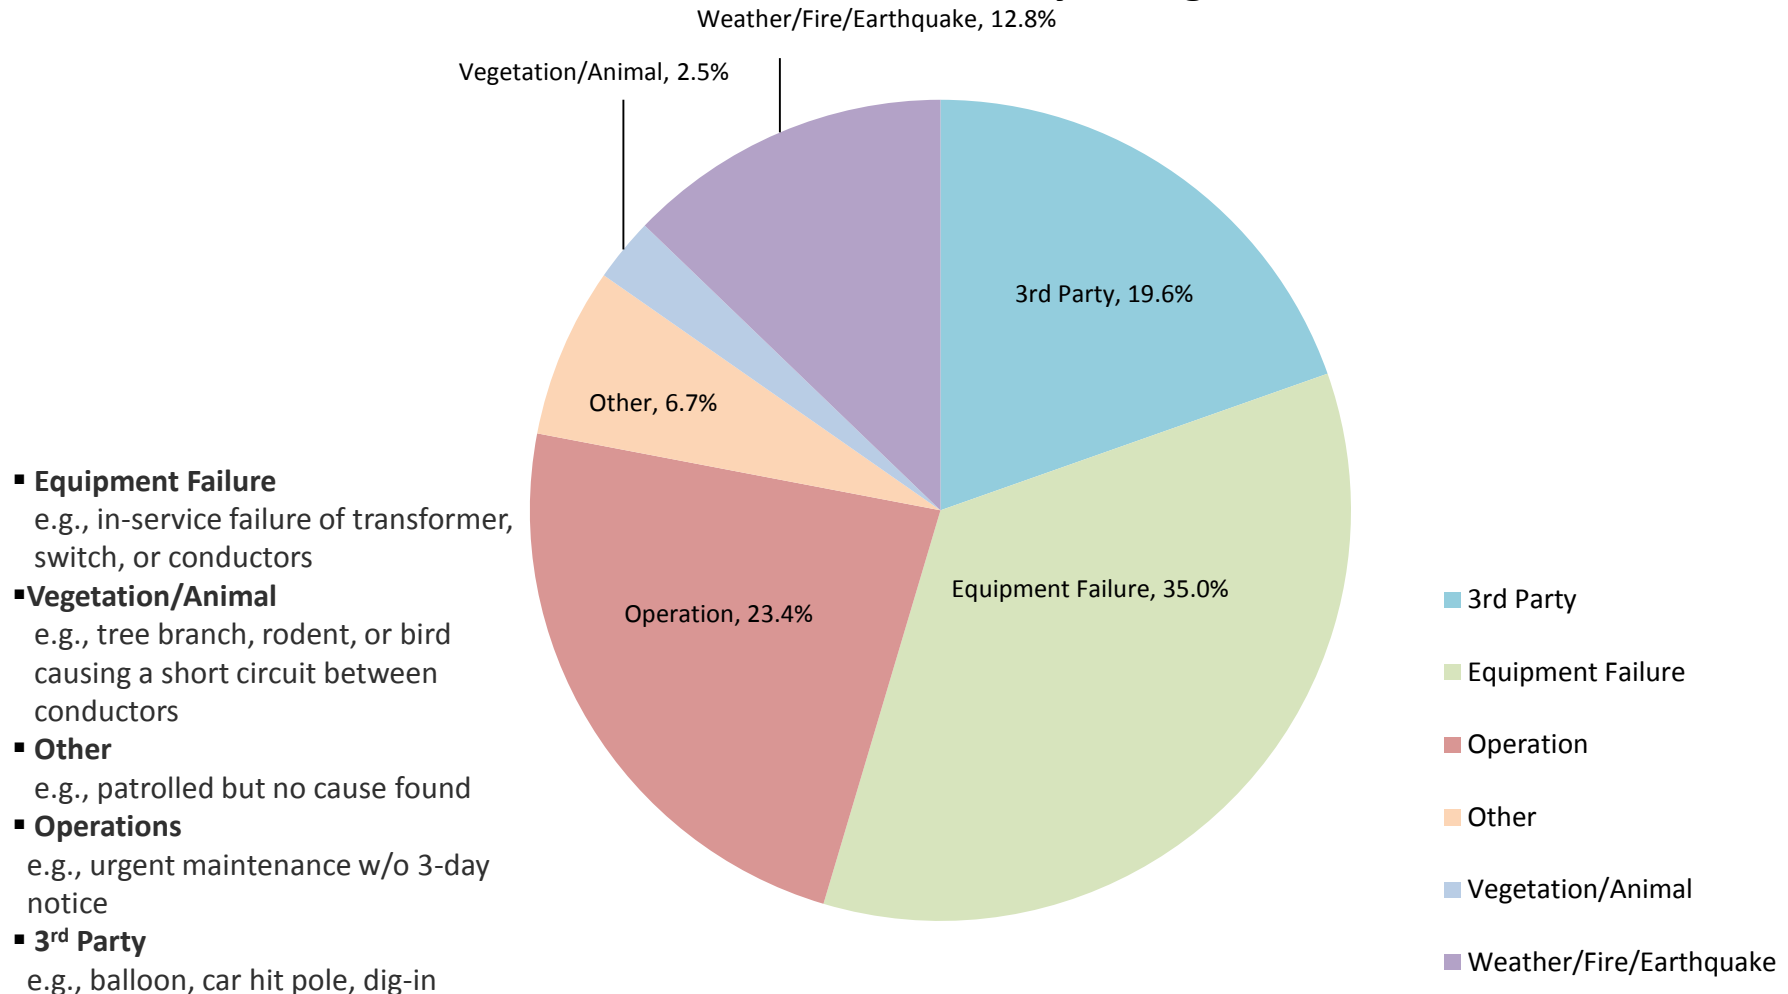

SAIFI = the number of times the average customer is interrupted by “sustained” outages each year.

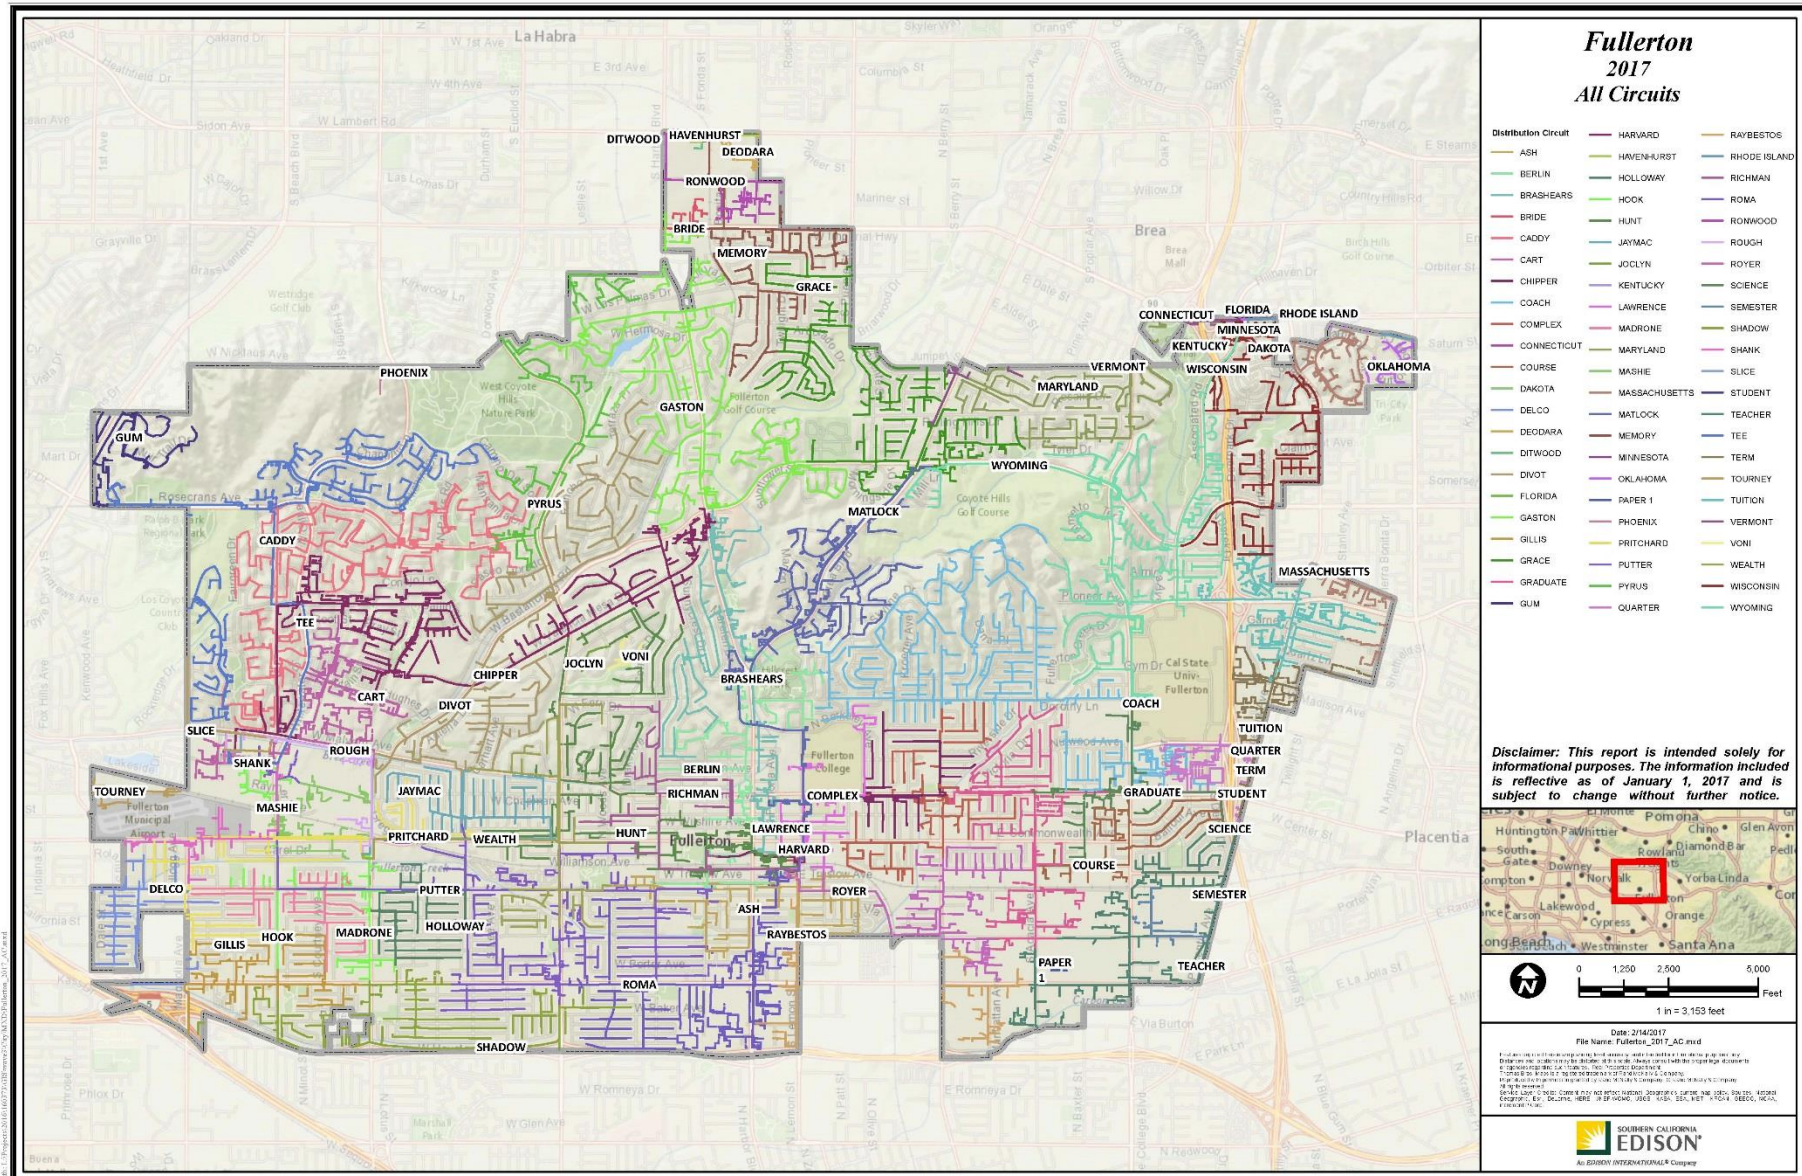

Fullerton 2017 Capital Improvement Plan

Replacement/Equipment Upgrade

- Electrical Equipment Replacement
- Pole Replacement

Other Work

- Circuit Public Safety Upgrade
- Circuit Rebuild
- Circuit Reliability Upgrade
- Structures & Equipment
- Underground Structure Replacement


Replacement/Equipment Upgrade (Transmission)

- Electrical Equipment Replacement
- Pole Replacement

Other Work (Transmission)

- Circuit Reliability Upgrade


Disclaimer: This report is intended solely for informational purposes. The information included is reflective as of January 1, 2017 and is subject to change without further notice.

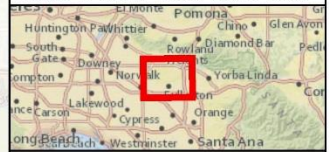

0 1,250 2,500 5,000
Feet
1 in = 3,153 feet

Date: 2/6/2017
File Name: CIP_2017_02062017.mxd

Fullerton is located within the Orange, Los Angeles, and San Diego counties. The map shows the city of Fullerton and its surrounding areas. The map is a map of the city of Fullerton, California, showing the city's boundaries and major roads. The map is a map of the city of Fullerton, California, showing the city's boundaries and major roads. The map is a map of the city of Fullerton, California, showing the city's boundaries and major roads.

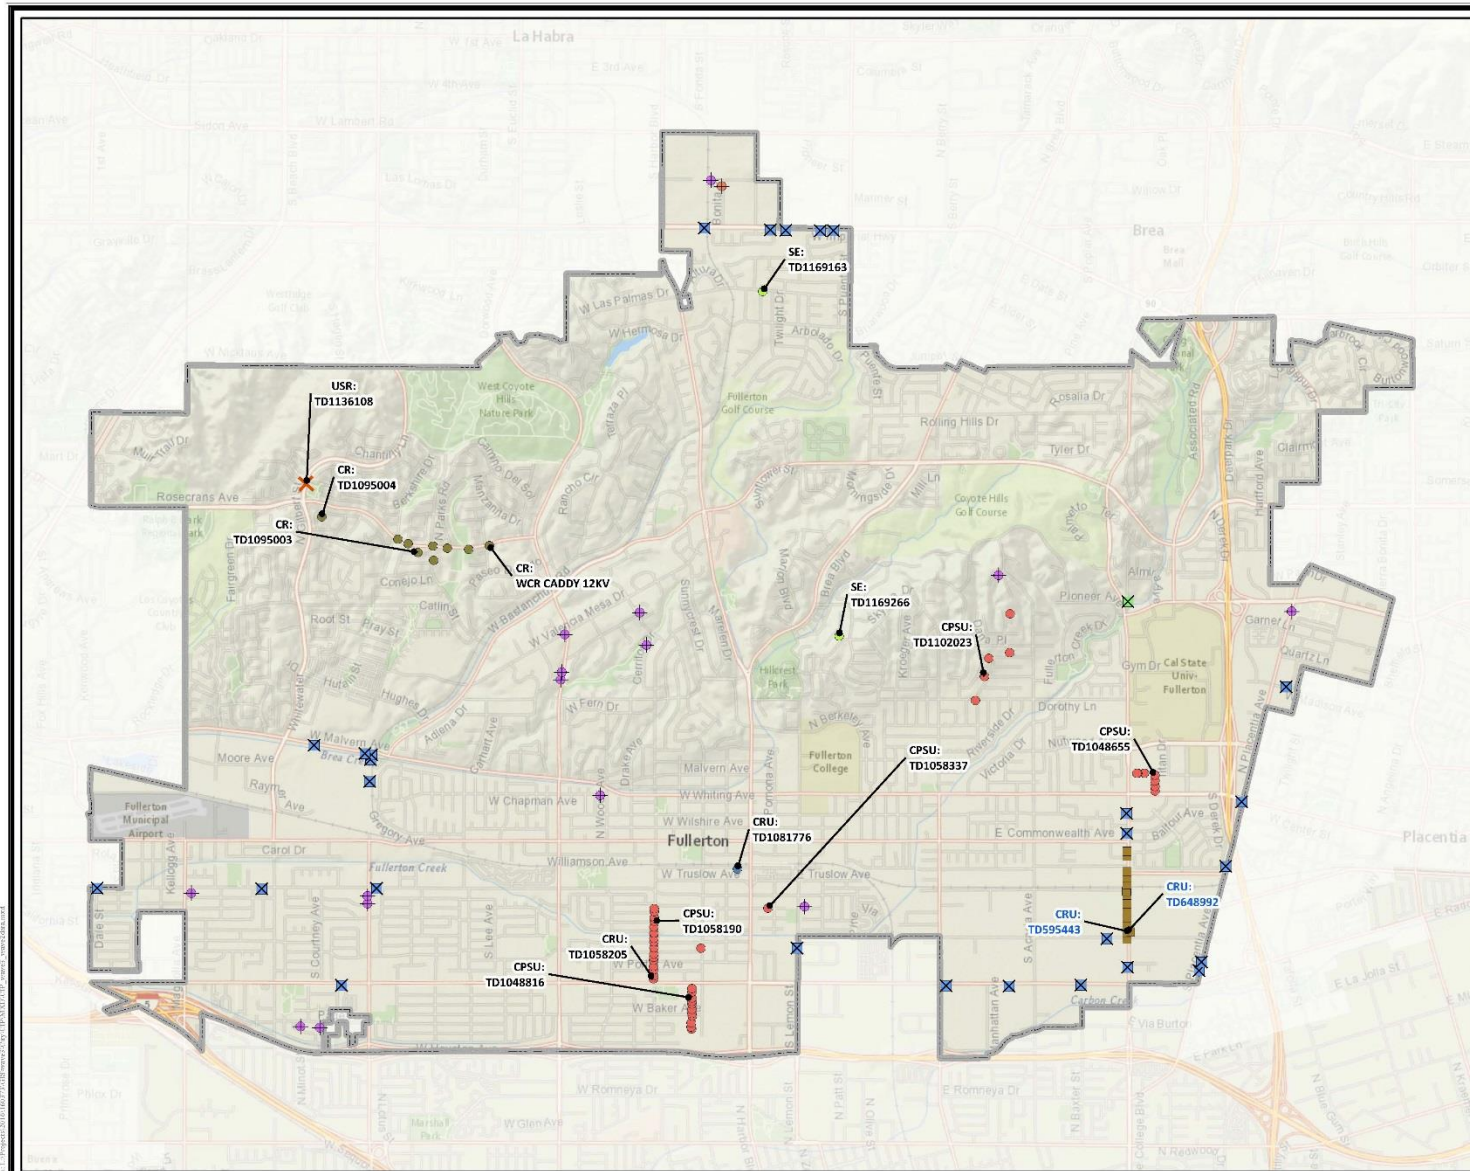

Back-up Slides

Reliability Histories of Circuits Serving Fullerton

Updated through Year-End 2016

Average Reliability of 67 Circuits Serving Fullerton

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
Fullerton	75.5	0.6	1.0	97.9	0.8	1.2	74.1	0.6	0.8	35.9	0.2	0.5	39.2	0.2	0.5	23.7	0.1	0.2	13.9	0.1	0.3	112.7	0.7	1.6
3rd Party	19%	26%	14%	19%	19%	9%	32%	35%	40%	20%	19%	16%	21%	41%	8%	2%	14%	55%	0%	0%	6%	14%	20%	16%
Equipment Failure	46%	41%	9%	43%	35%	12%	49%	48%	10%	12%	15%	5%	68%	47%	67%	71%	46%	10%	45%	48%	14%	48%	35%	29%
Operation	5%	4%	7%	13%	32%	14%	15%	14%	4%	6%	23%	7%	7%	4%	1%	25%	36%	3%	16%	37%	9%	12%	23%	5%
Other	4%	4%	35%	4%	2%	6%	0%	0%	22%	42%	17%	21%	0%	0%	3%	1%	1%	2%	0%	0%	4%	14%	7%	9%
Vegetation/Animal	12%	13%	28%	2%	2%	47%	3%	4%	24%	0%	0%	27%	4%	7%	21%	0%	0%	31%	3%	4%	57%	2%	2%	32%
Weather/Fire/Earthquake	14%	12%	7%	19%	11%	11%	0%	0%	0%	21%	26%	24%	1%	1%	0%	1%	2%	0%	35%	11%	9%	11%	13%	10%
SCE Systemwide	102.6	0.9	1.2	112.0	1.0	1.4	114.8	0.9	1.4	40.5	0.3	0.4	34.8	0.3	0.4	29.4	0.2	0.3	29.8	0.3	0.4	134.5	1.1	1.6

Notes:

No outages are excluded from the metrics.

Outage Causes:

Other: e.g., patrolled but no cause could be found

Operations: e.g., urgent maintenance w/o 3-day notice to customers

3rd Party: e.g., balloons, car hit pole, dig-in

Vegetation/Animal: e.g., tree branch, rodent, or bird causing short circuit across conductors

SAIDI (minutes) = the cumulative amount of time the average customer is interrupted by "sustained" (longer than 5 minutes) outages.

SAIFI (interruptions) = the number of times the average customer is interrupted by "sustained" outages.

MAIFI (interruptions) = the number of times the average customer is interrupted by "momentary" (lasting 5 minutes or less) outages.

Reliability Histories for Individual Circuits Serving Fullerton

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
ASH(4.16KV) - Customers: 1,186	0.0	0.0	2.0	120.4	2.0	1.0	326.8	1.0	3.0	0.0	0.0	2.0	0.0	0.0	0.0	0.0	0.0	1.0	3.1	0.2	0.0	3.1	0.2	3.0
3rd Party	0%	0%	100%	0%	0%	100%	95%	96%	67%	0%	0%	50%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	67%
Equipment Failure	0%	0%	0%	0%	0%	0%	5%	4%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	33%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	33%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
BERLIN(12KV) - Customers: 1,306	6.4	0.2	4.8	198.9	1.7	1.8	1.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	10.7	0.1	1.0	10.7	0.1	1.0
3rd Party	0%	0%	21%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	45%	63%	46%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	100%	100%	17%	4%	30%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	100%	100%	100%
Other	0%	0%	21%	48%	5%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	21%	3%	2%	54%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	21%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
BRASHEARS(12KV) - Customers: 964	54.1	0.8	2.3	824.5	2.1	0.0	0.0	0.0	0.0	21.3	0.1	0.0	382.7	0.5	0.0	0.0	0.0	0.0	0.7	0.0	0.0	404.7	0.5	0.0
3rd Party	7%	7%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	77%	85%	14%	2%	4%	0%	0%	0%	0%	100%	100%	0%	100%	97%	0%	0%	0%	0%	0%	0%	0%	100%	96%	0%
Operation	8%	2%	0%	1%	47%	100%	0%	0%	0%	0%	0%	0%	0%	3%	0%	0%	0%	0%	100%	100%	0%	0%	4%	0%
Other	0%	0%	43%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	9%	6%	43%	2%	6%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	95%	43%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
BRIDE(12KV) - Customers: 472	0.0	0.0	1.0	237.7	0.2	0.0	162.7	0.5	0.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.0
3rd Party	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Equipment Failure	0%	0%	0%	0%	0%	0%	66%	83%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	100%	100%	0%	34%	17%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Fullerton

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
CADDY(12KV) - Customers: 2,557	77.5	1.0	0.0	188.1	3.6	2.2	42.4	0.2	0.0	3.9	0.0	0.0	0.0	0.0	0.0	46.8	0.0	0.0	0.0	0.0	0.0	50.7	0.0	0.0
3rd Party	97%	97%	0%	5%	28%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	91%	44%	54%	46%	34%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%
Operation	0%	0%	0%	4%	29%	0%	54%	66%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	46%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	3%	3%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
CART(12KV) - Customers: 1,192	145.4	1.0	0.0	0.0	0.0	0.0	15.0	0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	22.8	0.1	0.0	0.0	0.0	0.0	22.8	0.1	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
CHIPPER(12KV) - Customers: 1,656	1.1	0.0	2.0	248.5	2.2	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	1.0	32.6	0.5	1.0	32.6	0.5	3.0
3rd Party	0%	0%	50%	79%	92%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	33%
Equipment Failure	0%	0%	0%	15%	2%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%
Operation	100%	100%	0%	7%	6%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	100%	0%	0%	67%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
COACH(12KV) - Customers: 2,040	0.0	0.0	0.0	0.3	0.0	1.0	103.9	1.7	1.5	22.8	0.6	0.4	25.6	0.2	2.0	0.0	0.0	0.0	2.9	0.1	1.0	51.3	0.9	3.4
3rd Party	0%	0%	0%	0%	0%	0%	30%	63%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	100%	100%	100%	70%	37%	30%	0%	0%	0%	0%	0%	100%	0%	0%	0%	76%	88%	0%	4%	11%	59%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	55%	41%	0%	0%	0%	0%	24%	12%	0%	73%	77%	12%
Other	0%	0%	0%	0%	0%	0%	0%	0%	70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	45%	59%	0%	0%	0%	0%	0%	0%	100%	23%	11%	29%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Fullerton

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
COMPLEX(12KV) - Customers: 1,430	0.2	0.0	3.0	248.1	3.0	0.5	103.1	0.3	1.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.8	0.0	0.0	1.8	0.0	0.0
3rd Party	0%	0%	0%	72%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	25%	34%	0%	90%	83%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%
Operation	0%	0%	0%	3%	33%	100%	2%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	67%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	100%	100%	33%	0%	0%	0%	0%	0%	67%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	8%	16%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
CONNECTICUT(12KV) - Customers: 1,527	0.0	0.0	1.0	0.1	0.0	3.0	34.0	0.0	2.0	0.0	0.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.0
3rd Party	0%	0%	100%	0%	0%	0%	100%	100%	49%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	100%	100%	34%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	66%	0%	0%	51%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
COURSE(12KV) - Customers: 643	43.5	1.3	0.0	0.0	0.0	0.0	4.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	3.0
3rd Party	100%	100%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	67%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	33%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
DAKOTA(12KV) - Customers: 91	0.0	0.0	1.0	0.0	0.0	2.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	49.8	1.0	1.0	0.0	0.0	0.0	49.8	1.0	1.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	100%	100%	100%
Operation	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Fullerton

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
DELCO(12KV) - Customers: 1,578	73.5	2.0	1.0	21.0	0.2	1.0	221.8	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	47%	50%	0%	52%	91%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	53%	50%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	48%	9%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
DEODARA(12KV) - Customers: 511	130.7	1.1	1.0	19.3	0.0	0.0	9.7	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	6.4	0.0	0.0	6.4	0.0	0.0
3rd Party	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	82%	64%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	18%	36%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
DITWOOD(12KV) - Customers: 1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
DIVOT(12KV) - Customers: 1,296	20.8	0.1	0.0	0.9	0.0	0.0	63.2	0.4	0.7	55.1	1.0	1.0	7.8	0.0	0.0	23.7	0.4	1.6	0.0	0.0	0.0	86.6	1.4	2.6
3rd Party	0%	0%	0%	0%	0%	0%	83%	96%	100%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	27%	30%	61%
Equipment Failure	4%	2%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	9%	1%	0%
Operation	87%	66%	0%	100%	100%	0%	17%	4%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	9%	32%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	64%	69%	39%

Reliability Histories for Individual Circuits Serving Fullerton

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
FLORIDA(12KV) - Customers: 1,267	182.0	1.0	2.0	184.8	1.3	1.9	170.5	1.2	0.0	67.4	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	67.4	0.1	0.0
3rd Party	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	73%	76%	1%	87%	88%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Operation	0%	0%	0%	27%	24%	46%	13%	12%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	53%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	100%	100%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
GASTON(12KV) - Customers: 1,761	32.5	0.6	1.5	27.2	0.1	0.0	20.6	0.5	0.5	59.8	0.1	0.0	36.5	1.1	0.0	4.7	0.0	0.0	27.5	0.1	1.0	128.6	1.3	1.0
3rd Party	0%	0%	0%	0%	0%	0%	93%	95%	100%	0%	0%	0%	74%	91%	0%	0%	0%	0%	0%	0%	100%	21%	76%	100%
Equipment Failure	82%	96%	35%	3%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	6%	17%	0%	3%	2%	0%	1%	0%	0%
Operation	18%	4%	0%	12%	25%	0%	7%	5%	0%	0%	0%	0%	0%	0%	0%	94%	83%	0%	0%	5%	0%	4%	1%	0%
Other	0%	0%	65%	85%	75%	0%	0%	0%	0%	97%	89%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	45%	7%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	3%	11%	0%	26%	9%	0%	0%	0%	0%	97%	92%	0%	29%	16%	0%
GILLIS(12KV) - Customers: 1,205	39.3	0.9	0.0	170.3	1.3	1.0	115.7	0.2	1.8	202.7	1.0	0.7	18.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	220.9	1.0	0.7
3rd Party	0%	0%	0%	85%	94%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	92%	97%	100%
Equipment Failure	100%	100%	0%	8%	3%	0%	100%	100%	43%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	8%	3%	0%
Operation	0%	0%	0%	0%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	57%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	6%	2%	99%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
GRACE(12KV) - Customers: 1,507	4.4	0.0	0.0	18.2	0.1	0.9	6.5	0.1	0.0	77.0	1.3	1.1	0.0	0.0	1.0	25.0	0.3	0.0	0.1	0.0	1.0	102.2	1.6	3.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	35%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	70%	83%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	53%	68%	0%
Operation	100%	100%	0%	0%	0%	0%	0%	0%	0%	30%	17%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%	47%	32%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	32%
Weather/Fire/Earthquake	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	32%

Reliability Histories for Individual Circuits Serving Fullerton

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
GRADUATE(12KV) - Customers: 1,197	31.2	1.1	0.0	25.7	0.6	2.2	8.3	0.1	2.9	0.3	0.0	0.0	16.6	1.0	1.0	134.4	1.1	0.4	145.6	2.7	4.0	296.9	4.9	5.3
3rd Party	0%	0%	0%	0%	0%	45%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	34%	12%	0%	99%	99%	55%	0%	0%	34%	0%	0%	0%	100%	100%	100%	0%	0%	0%	24%	52%	50%	18%	50%	56%
Operation	0%	0%	0%	1%	1%	0%	100%	100%	32%	100%	100%	0%	0%	0%	0%	93%	90%	100%	76%	48%	25%	79%	48%	25%
Other	0%	0%	0%	0%	0%	0%	0%	0%	34%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	25%	0%	0%	19%
Vegetation/Animal	56%	86%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	9%	2%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	7%	10%	0%	0%	0%	0%	3%	2%	0%
GUM(12KV) - Customers: 2,995	28.8	0.0	1.0	200.0	1.6	1.7	0.4	0.0	1.0	2.1	0.0	1.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	0.0	2.1	0.0	2.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	50%
Equipment Failure	0%	0%	0%	32%	39%	25%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Operation	100%	100%	100%	18%	6%	1%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	50%
Weather/Fire/Earthquake	0%	0%	0%	50%	55%	74%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
HARVARD(4.16KV) - Customers: 629	0.0	0.0	0.0	34.3	1.0	0.0	87.9	0.1	0.9	67.2	1.0	4.9	6.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	73.9	1.0	4.9
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	9%	2%	0%
Operation	0%	0%	0%	100%	100%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	80%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	91%	98%	20%
HAVENHURST(12KV) - Customers: 985	0.0	0.0	0.0	0.0	0.0	0.0	11.7	0.1	0.9	78.4	1.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	78.4	1.0	1.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Fullerton

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
HOLLOWAY(4.16KV) - Customers: 630	215.3	2.1	1.0	0.0	0.0	2.9	269.8	3.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	95%	52%	100%	0%	0%	0%	38%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	5%	48%	0%	0%	0%	0%	62%	67%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
HOOK(12KV) - Customers: 378	197.5	1.9	1.0	0.0	0.0	0.0	0.0	0.0	2.0	3.1	0.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	6.0	1.0	0.0	9.1	1.0	1.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	100%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	34%	1%	100%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	66%	99%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
HUNT(12KV) - Customers: 1,875	220.9	1.7	2.9	80.9	2.0	0.0	84.7	1.6	0.0	0.0	0.0	0.0	310.5	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	310.5	1.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	4%	1%	0%	92%	50%	0%	11%	1%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	100%	100%	100%
Operation	0%	0%	0%	8%	50%	0%	89%	99%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	34%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	2%	2%	34%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	94%	97%	32%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
JAYMAC(4.16KV) - Customers: 680	115.4	0.2	2.5	0.8	0.0	0.0	34.1	0.1	1.9	0.0	0.0	0.0	67.0	0.2	1.8	1.9	0.0	0.0	0.0	0.0	0.0	68.9	0.2	1.8
3rd Party	0%	0%	0%	0%	0%	0%	84%	62%	100%	0%	0%	0%	0%	0%	55%	0%	0%	0%	0%	0%	0%	0%	0%	55%
Equipment Failure	100%	100%	61%	100%	100%	0%	16%	38%	0%	0%	0%	0%	7%	8%	0%	100%	100%	0%	0%	0%	0%	10%	13%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	93%	92%	45%	0%	0%	0%	0%	0%	0%	90%	87%	45%
Other	0%	0%	39%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Fullerton

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
JOCLYN(4.16KV) - Customers: 16	1055.0	3.0	2.0	58.0	1.0	0.0	47.0	1.0	0.0	0.0	0.0	0.0	117.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	117.0	1.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Operation	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	100%	100%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
KENTUCKY(12KV) - Customers: 1,030	278.8	1.2	0.1	105.7	1.1	3.0	37.1	0.2	1.0	0.0	0.0	1.0	95.4	0.2	0.0	190.6	0.1	0.0	54.5	0.1	0.9	340.5	0.4	1.9
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	16%	10%	100%	27%	8%	0%	91%	85%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%	100%	100%	100%	100%	100%	48%
Operation	15%	10%	0%	73%	92%	34%	9%	15%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	69%	80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	66%	0%	0%	100%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	52%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
LAWRENCE(12KV) - Customers: 872	41.1	0.1	2.0	4.7	0.1	0.0	3.7	0.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	50%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
MADRONE(4.16KV) - Customers: 782	112.5	1.0	1.0	124.2	2.0	1.0	98.3	0.7	3.3	0.0	0.0	1.0	48.2	0.5	0.5	0.0	0.0	0.0	0.0	0.0	0.0	48.2	0.5	1.5
3rd Party	0%	0%	0%	0%	0%	100%	54%	30%	84%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	100%	100%	35%
Equipment Failure	11%	4%	100%	0%	0%	0%	45%	59%	16%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	65%
Operation	0%	0%	0%	48%	50%	0%	1%	11%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	52%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	89%	96%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Fullerton

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
MARYLAND(12KV) - Customers: 1,103	69.7	0.8	0.0	7.0	0.1	2.0	185.8	2.1	1.0	0.0	0.0	0.0	386.5	1.0	0.0	156.4	1.0	0.0	0.0	0.0	0.0	542.9	2.0	0.0
3rd Party	95%	99%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	71%	50%	0%
Equipment Failure	5%	1%	0%	0%	0%	0%	97%	98%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	3%	8%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	29%	50%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	97%	92%	100%	3%	2%	99%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
MASHIE(12KV) - Customers: 329	336.9	1.2	0.8	0.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	0.0	0.0	0.0	1.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	69%	82%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	100%
Vegetation/Animal	31%	18%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
MASSACHUSETTS(12KV) - Customers: 2,463	71.0	1.0	0.0	50.8	1.0	2.0	0.0	0.0	1.0	5.5	0.0	1.0	35.4	0.1	0.0	109.0	0.7	1.9	22.3	0.1	0.0	172.2	0.9	2.9
3rd Party	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	17%	100%	0%	0%	0%	1%	12%	65%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	76%	40%	0%	99%	83%	0%	79%	41%	0%	88%	69%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	3%	0%	0%	0%	0%	0%	0%	0%	3%	6%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	100%	0%	0%	100%	0%	0%	100%	24%	57%	0%	0%	0%	0%	21%	59%	0%	8%	13%	35%
Weather/Fire/Earthquake	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
MATLOCK(12KV) - Customers: 1,111	42.4	1.4	2.0	148.1	0.4	1.5	12.0	0.1	0.0	0.0	0.0	0.0	29.7	0.1	0.0	1.5	0.0	0.0	14.8	0.3	0.0	46.0	0.4	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	97%	79%	100%	6%	15%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%	0%	0%	0%	68%	23%	0%
Operation	9%	18%	0%	3%	21%	0%	90%	75%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	32%	77%	0%
Other	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	91%	82%	50%	0%	0%	0%	4%	10%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Fullerton

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
MEMORY(12KV) - Customers: 901	137.0	2.8	2.0	0.0	0.0	1.0	10.0	0.1	0.0	0.0	0.0	1.8	0.0	0.0	0.0	0.0	0.0	0.0	304.2	1.0	1.0	304.2	1.0	2.8
3rd Party	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	40%	61%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	1%	2%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	63%
Vegetation/Animal	59%	38%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	100%	100%	37%
MINNESOTA(12KV) - Customers: 23	0.0	0.0	0.0	0.0	0.0	2.0	0.0	0.0	0.0	0.0	0.0	0.0	201.0	0.7	1.0	0.0	0.0	0.0	0.0	0.0	0.0	201.0	0.7	1.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	100%	100%	100%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
OKLAHOMA(12KV) - Customers: 1,361	74.4	1.0	0.0	103.7	0.3	5.0	27.2	0.1	0.0	1.5	0.1	0.0	0.0	0.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	1.5	0.1	1.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	33%	16%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	33%	16%	0%
Equipment Failure	100%	99%	0%	99%	84%	0%	96%	88%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	1%	0%	1%	16%	40%	3%	11%	0%	67%	84%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	67%	84%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	60%	1%	1%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
PAPER 1(4.16KV) - Customers: 1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Fullerton

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
PHOENIX(12KV) - Customers: 1,171	0.5	0.0	0.0	0.0	0.0	0.0	17.7	0.1	0.0	0.0	0.0	0.0	37.0	0.2	0.0	73.1	0.2	0.0	0.0	0.0	0.0	110.0	0.3	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	81%	77%	0%	0%	0%	0%	100%	100%	0%	84%	48%	0%	0%	0%	0%	90%	72%	0%
Operation	100%	100%	0%	0%	0%	0%	19%	23%	0%	0%	0%	0%	0%	0%	0%	3%	5%	0%	0%	0%	0%	2%	3%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	13%	48%	0%	0%	0%	0%	8%	25%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
PUTTER(12KV) - Customers: 1,638	1.6	0.0	0.0	49.6	0.3	0.0	54.3	1.1	0.0	177.5	1.3	0.0	0.0	0.0	0.0	3.3	0.0	0.0	5.5	0.9	0.0	186.3	2.2	0.0
3rd Party	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	85%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	2%	0%	0%
Operation	15%	50%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	3%	42%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	95%	58%	0%
PYRUS(12KV) - Customers: 1,485	232.1	1.5	1.6	67.0	0.2	3.0	107.8	2.2	1.4	4.1	0.2	0.0	0.0	0.0	0.0	6.0	0.0	0.0	0.0	0.0	0.0	10.1	0.2	0.0
3rd Party	0%	0%	0%	0%	0%	35%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	7%	4%	0%	62%	52%	1%	78%	93%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	9%	3%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	40%	93%	0%
Other	13%	28%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	80%	68%	0%	0%	0%	65%	14%	4%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	38%	48%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	60%	7%	0%
QUARTER(12KV) - Customers: 729	49.0	0.2	0.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	0.0	0.0	0.0	2.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	3.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	67%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	33%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Fullerton

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
RAYBESTOS(12KV) - Customers: 376	0.0	0.0	3.0	4.0	0.0	0.0	0.0	0.0	1.0	1.3	0.0	0.0	32.1	0.1	0.1	6.6	1.1	1.1	0.0	0.0	0.0	40.0	1.2	1.2
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	98%	99%	100%	0%	0%	0%	16%	90%	93%
Equipment Failure	0%	0%	0%	88%	50%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	3%	1%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	2%	1%	0%	0%	0%	0%	81%	10%	7%
Other	0%	0%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	67%	12%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
RHODE ISLAND(12KV) - Customers: 282	0.0	0.0	0.0	4.4	0.1	3.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	93.5	1.0	0.0	93.5	1.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%
Operation	0%	0%	0%	100%	100%	34%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	66%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
RICHMAN(4.16KV) - Customers: 613	0.0	0.0	0.0	105.7	3.0	3.9	64.8	1.0	2.0	97.2	1.0	0.0	951.3	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1048.5	2.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	87%	99%	51%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	9%	50%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	13%	1%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	91%	50%	0%
Operation	0%	0%	0%	100%	100%	23%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	51%	0%	0%	49%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	26%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
ROMA(12KV) - Customers: 2,292	0.0	0.0	2.0	6.0	1.0	0.0	350.4	3.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	0.3	0.0	1.0	1.2	0.0	1.0
3rd Party	0%	0%	0%	0%	0%	0%	73%	33%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	79%	78%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	27%	67%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	21%	22%	0%
Operation	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	100%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Fullerton

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
RONWOOD(12KV) - Customers: 235	63.0	1.0	0.0	241.8	2.0	1.7	5.0	0.0	3.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	19.0	0.1	0.9	19.0	0.1	0.9
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	47%	50%	58%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	53%	50%	42%	100%	100%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	100%	100%	100%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
ROUGH(12KV) - Customers: 13	0.0	0.0	0.0	386.0	1.0	0.0	0.0	0.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
ROYER(12KV) - Customers: 641	66.7	1.0	2.0	126.2	2.4	2.7	10.8	0.0	0.0	19.8	0.8	0.0	0.0	0.0	0.0	4.3	0.0	0.0	0.0	0.0	0.0	24.0	0.8	0.0
3rd Party	0%	0%	0%	6%	17%	58%	99%	95%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	89%	42%	5%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	5%	42%	36%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	82%	98%	0%
Other	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	18%	2%	0%
Vegetation/Animal	0%	0%	50%	0%	0%	0%	1%	5%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
SCIENCE(12KV) - Customers: 478	0.0	0.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.3	0.0	2.0	0.0	0.0	0.0	0.0	0.0	1.0	1.3	0.0	3.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	67%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	33%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Fullerton

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
SEMESTER(12KV) - Customers: 296	0.0	0.0	1.0	0.0	0.0	0.0	6.2	0.1	0.0	0.0	0.0	0.0	0.0	0.0	2.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	3.0
3rd Party	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	67%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	33%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
SHADOW(12KV) - Customers: 2,459	97.5	1.1	0.0	16.7	0.2	0.0	5.7	0.0	1.0	133.5	1.7	1.6	17.1	0.1	0.0	13.2	0.1	0.0	0.0	0.0	0.0	163.9	1.9	1.6
3rd Party	2%	2%	0%	0%	0%	0%	0%	0%	100%	81%	49%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	66%	44%	0%
Equipment Failure	98%	98%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	68%	43%	0%	0%	0%	0%	5%	1%	0%
Operation	0%	0%	0%	3%	3%	0%	100%	100%	0%	12%	49%	51%	0%	0%	0%	32%	57%	0%	0%	0%	0%	12%	45%	51%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	10%	8%	0%
Weather/Fire/Earthquake	0%	0%	0%	97%	97%	0%	0%	0%	0%	7%	2%	49%	0%	0%	0%	0%	0%	0%	0%	0%	0%	6%	2%	49%
SHANK(12KV) - Customers: 1,936	0.0	0.0	1.0	4.1	0.0	1.0	236.2	2.3	1.1	0.0	0.0	0.0	28.6	0.1	1.0	0.0	0.0	0.0	0.0	0.0	0.0	28.6	0.1	1.0
3rd Party	0%	0%	0%	0%	0%	100%	3%	46%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	63%	48%	0%	0%	0%	0%	47%	27%	0%	0%	0%	0%	0%	0%	0%	47%	27%	0%
Operation	0%	0%	0%	0%	0%	0%	34%	6%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	53%	73%	100%	0%	0%	0%	0%	0%	0%	53%	73%	100%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
SLICE(12KV) - Customers: 2,118	123.0	0.1	0.0	344.8	1.2	0.0	57.7	0.4	0.0	5.3	0.0	0.0	145.9	1.1	0.0	67.9	0.1	0.0	13.9	0.1	0.0	233.0	1.3	0.0
3rd Party	1%	16%	0%	77%	88%	0%	17%	20%	0%	0%	0%	0%	40%	90%	0%	0%	0%	0%	0%	0%	0%	25%	74%	0%
Equipment Failure	99%	84%	0%	12%	4%	0%	82%	78%	100%	100%	100%	0%	13%	5%	0%	52%	64%	0%	100%	100%	0%	32%	18%	0%
Operation	0%	0%	0%	8%	6%	0%	1%	2%	0%	0%	0%	0%	47%	5%	0%	48%	36%	0%	0%	0%	0%	43%	8%	0%
Other	0%	0%	0%	2%	2%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Fullerton

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
STUDENT(12KV) - Customers: 2,226	78.2	0.9	0.9	148.7	1.1	0.0	22.6	0.1	2.0	0.9	0.0	0.0	0.0	0.0	3.0	38.7	0.0	0.0	5.4	0.0	0.9	44.9	0.1	3.9
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	89%	94%	0%	100%	100%	0%	86%	57%	0%	0%	0%	0%	0%	69%	100%	100%	0%	100%	100%	0%	98%	93%	52%	
Operation	9%	3%	0%	0%	0%	0%	14%	43%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	2%	7%	0%	
Other	1%	2%	0%	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
Vegetation/Animal	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	31%	0%	0%	0%	0%	0%	100%	0%	0%	48%	
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
TEACHER(12KV) - Customers: 583	108.4	0.2	0.5	192.8	0.5	0.6	90.0	0.5	1.4	183.8	0.6	0.7	117.7	1.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	301.6	1.6	1.7
3rd Party	0%	0%	100%	0%	0%	0%	86%	97%	42%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
Equipment Failure	100%	100%	0%	0%	0%	0%	14%	3%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	39%	62%	57%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	17%	
Other	0%	0%	0%	0%	0%	0%	0%	0%	58%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
Weather/Fire/Earthquake	0%	0%	0%	100%	100%	100%	0%	0%	0%	100%	100%	60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	61%	38%	26%
TEE(12KV) - Customers: 1,768	615.3	1.6	0.8	186.9	0.6	0.0	172.7	0.2	0.0	0.0	0.0	0.0	3.0	0.0	0.0	60.5	0.1	0.0	0.1	0.0	0.0	63.5	0.1	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
Equipment Failure	100%	100%	100%	85%	69%	0%	26%	42%	0%	0%	0%	0%	64%	14%	0%	100%	100%	0%	0%	0%	0%	98%	74%	0%
Operation	0%	0%	0%	15%	31%	0%	74%	58%	0%	0%	0%	0%	36%	86%	0%	0%	0%	0%	100%	100%	0%	2%	26%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
TERM(12KV) - Customers: 2,472	23.9	0.1	1.0	79.8	0.4	3.5	14.5	0.1	0.0	400.9	1.2	1.2	40.2	0.2	3.0	7.3	0.0	0.0	0.0	0.0	0.9	448.4	1.4	5.1
3rd Party	0%	0%	0%	21%	8%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	
Equipment Failure	53%	36%	0%	55%	16%	0%	54%	38%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	9%	12%	59%
Operation	0%	0%	0%	4%	3%	0%	46%	62%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	2%	3%	0%
Other	0%	0%	100%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	89%	85%	23%
Vegetation/Animal	30%	33%	0%	19%	73%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	18%	
Weather/Fire/Earthquake	17%	31%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	

Reliability Histories for Individual Circuits Serving Fullerton

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
TOURNEY(12KV) - Customers: 1,698	293.9	2.0	0.0	0.0	0.0	0.0	9.2	0.0	0.0	0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	90.3	1.0	0.4	91.0	1.0	0.4
3rd Party	84%	93%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	16%	7%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	100%	100%	100%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
TUITION(12KV) - Customers: 2,491	17.2	0.1	0.0	86.4	0.1	0.0	84.3	0.5	2.0	0.0	0.0	2.3	0.0	0.0	2.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	5.3
3rd Party	0%	0%	0%	0%	0%	0%	97%	99%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	100%	100%	0%	3%	1%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	38%
Operation	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	19%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	44%
VERMONT(12KV) - Customers: 1,880	0.0	0.0	0.0	0.0	0.0	3.0	88.8	0.8	1.4	0.0	0.0	1.0	0.5	0.0	1.0	0.0	0.0	0.0	38.3	0.1	0.0	38.8	0.1	2.0
3rd Party	0%	0%	0%	0%	0%	0%	97%	98%	27%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	2%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	33%	1%	1%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	1%	4%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	67%	0%	0%	73%	0%	0%	100%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	99%	96%	0%
VONI(4.16KV) - Customers: 18	1055.0	3.0	2.0	1163.7	3.0	0.0	47.0	1.0	0.0	0.0	0.0	0.0	114.8	1.0	0.0	742.4	1.0	0.0	0.0	0.0	0.0	857.1	2.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	5%	33%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%
Operation	0%	0%	0%	1%	33%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	100%	100%	50%	95%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Reliability Histories for Individual Circuits Serving Fullerton

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
WEALTH(4.16KV) - Customers: 596	39.9	1.0	2.0	35.0	1.0	1.0	68.1	1.0	4.0	47.2	0.9	0.0	0.0	0.0	2.0	0.4	0.0	0.0	0.0	0.0	0.0	47.6	0.9	2.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	94%	98%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	100%	100%	0%	6%	2%	0%	100%	100%	25%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	1%	1%	0%
Other	0%	0%	50%	0%	0%	0%	0%	0%	25%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Vegetation/Animal	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	100%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	99%	99%	0%
WISCONSIN(12KV) - Customers: 1,446	122.8	1.2	1.4	115.2	1.2	3.0	185.1	1.3	1.0	27.7	0.1	1.0	0.0	0.0	0.0	225.9	1.1	0.9	2.7	0.0	0.0	256.4	1.2	1.9
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	100%	90%	86%	0%	51%	11%	0%	100%	100%	0%	0%	0%	0%	99%	99%	100%	0%	0%	0%	98%	99%	49%
Operation	0%	0%	0%	10%	14%	0%	3%	9%	0%	0%	0%	0%	0%	0%	0%	1%	1%	0%	0%	0%	0%	1%	1%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	67%	46%	80%	100%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	51%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	1%	1%	0%
WYOMING(12KV) - Customers: 2,788	63.7	0.5	1.4	59.4	0.2	3.0	72.3	0.2	1.0	1.6	0.0	1.0	0.0	0.0	0.0	0.0	0.0	0.0	29.1	0.1	0.0	30.7	0.2	1.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	94%	95%	0%	65%	17%	0%	79%	72%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	78%	38%	0%	74%	35%	0%
Operation	6%	5%	0%	2%	14%	33%	21%	27%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	5%	9%	0%
Other	0%	0%	0%	8%	14%	0%	1%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	100%	24%	55%	67%	0%	0%	100%	0%	0%	100%	0%	0%	0%	0%	0%	0%	22%	62%	0%	21%	56%	100%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%