



# Circuit Reliability Review

## **Norwalk**

---

January 2017

# Providing Safe, Reliable, and Affordable Power

Southern California Edison is modernizing the power grid to meet the changing needs and expectations of our customers and to help California achieve its clean energy goals.

We are investing more than \$12 billion into our power grid between 2015 – 2017 with the goal of increasing power reliability through significant upgrades. These investments include:

- Updating thousands of transmission and distribution poles
- Replacing hundreds of miles of underground cables
- Replacing hundreds of underground structures such as vaults and manholes
- Upgrading critical distribution equipment; capacitor banks, switches, and circuit breakers
- Building new distribution circuits to serve electrical demands in our communities
- Inspecting and replacing overhead conductor and equipment to improve public safety

Our investments in local communities will help ensure that customers receive safe, reliable, and affordable electricity now and in the future.

# Understanding Your Reliability Report

As your electric utility, we want you to always have power when you need it. To get there, we constantly track and monitor electric outages across our service territory, and we measure our “system reliability” from this data.

The two metrics we rely on are common in the electric utility industry: the System Average Interruption Duration Index (SAIDI) and the System Average Interruption Frequency Index (SAIFI). Both are described in more detail on the next page.

Replacing and upgrading our infrastructure will help SCE maintain or improve SAIDI and SAIFI measurements.

This report provides historical reliability data for the circuits that serve your jurisdiction and our proposed infrastructure upgrades for the current year.

To view other reliability reports, visit [sce.com>Outage Center>Maintaining Reliable Service](https://www.sce.com/Outage-Center/Maintaining-Reliable-Service)

# Reliability Metrics

## MOMENTARY OUTAGES:

OUTAGES LASTING 5 MINUTES OR LESS

### MAIFI:

- The number of times the average customer is interrupted by Momentary outages each year.

## SUSTAINED OUTAGES:

OUTAGES LASTING LONGER THAN 5 MINUTES

### SAIFI:

- The number of times the average customer is interrupted by Sustained outages each year.

### SAIDI:

- The cumulative amount of time the average customer is interrupted by Sustained outages each year.

# Cities in the Whittier District

Downey

Hacienda Heights

**Norwalk**

Santa Fe Springs

South Whittier

West Whittier-Los Nietos

Whittier

# Reliability by SCE District (No Exclusions)

District Name	2012				2013				2014				2015				2016			
	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking	District SAIDI	SAIDI RANKING	District SAIFI	SAIFI Ranking
ANTELOPE VALLEY	78.60	28	0.56	31	94.42	22	0.62	31	51.05	35	0.59	34	104.34	22	0.68	30	107.67	24	0.87	29
ARROWHEAD	129.58	13	1.31	7	180.59	7	1.39	8	193.25	5	1.59	5	362.61	4	3.97	1	659.46	3	2.85	5
BARSTOW	184.80	7	1.15	12	204.33	6	1.40	7	201.53	4	1.34	10	187.11	8	1.17	12	134.83	18	1.35	9
BIG CREEK	1184.25	1	4.52	1	176.51	8	3.08	1	920.25	1	1.34	11	422.77	2	3.42	2	1062.01	2	4.99	1
BISHOP	463.09	2	1.25	9	104.44	17	0.51	35	118.79	17	0.59	35	298.11	6	2.22	4	168.59	8	1.22	14
BLYTHE	225.88	6	1.53	3	483.13	1	1.38	9	707.54	2	2.42	2	427.00	1	1.52	7	396.38	5	2.71	6
CATALINA	78.46	30	0.72	29	105.94	16	2.97	2	97.02	24	4.17	1	42.56	35	2.25	3	65.01	35	3.66	3
COVINA	108.73	19	0.92	19	100.51	19	0.86	20	91.60	27	0.87	22	100.08	23	0.81	25	112.13	22	0.97	24
DOMINGUEZ HILLS	117.22	18	0.82	24	89.17	26	0.80	21	82.30	29	0.71	28	130.63	15	0.97	17	146.38	12	1.11	17
FOOTHILL	91.69	25	0.90	20	85.80	27	0.79	24	93.35	25	0.93	21	109.64	20	0.95	20	142.81	14	1.03	21
FULLERTON	68.99	33	0.42	35	90.57	25	0.79	22	82.23	30	0.72	27	76.59	29	0.67	31	92.72	30	0.76	34
HUNTINGTON BEACH	95.78	23	0.89	21	66.51	32	0.68	29	79.61	31	0.78	25	98.32	25	0.95	19	128.02	20	1.26	12
KERNVILLE	226.76	5	1.31	6	232.18	4	1.96	3	178.69	8	1.99	3	286.38	7	0.96	18	2421.32	1	3.67	2
LONG BEACH	75.83	31	0.55	33	75.11	30	0.70	28	66.33	34	0.61	32	164.46	9	0.89	23	135.16	17	0.86	31
MENIFEE	99.32	22	0.84	23	107.39	15	1.26	10	156.68	11	1.32	12	111.46	19	0.98	16	156.75	9	1.31	10
MONROVIA	108.11	20	1.13	15	99.12	20	1.02	16	133.32	14	1.16	16	96.68	26	0.88	24	116.57	21	0.84	32
MONTEBELLO	131.06	12	1.13	14	118.08	13	1.17	12	158.34	10	1.16	15	150.28	12	1.18	11	133.52	19	1.17	15
ONTARIO	93.09	24	0.87	22	77.39	29	0.79	23	97.91	23	1.00	19	94.04	27	0.74	27	105.07	27	0.93	27
PALM SPRINGS	175.92	8	1.27	8	112.80	14	0.77	25	107.04	20	0.71	29	99.54	24	0.80	26	107.58	25	1.07	19
REDLANDS	120.13	16	1.11	16	96.48	21	1.04	15	154.25	12	1.04	18	124.52	17	1.01	14	137.11	16	0.98	23
RIDGECREST	229.65	4	1.44	4	161.95	9	1.12	13	176.84	9	1.57	6	148.90	13	1.01	15	254.31	6	1.05	20
SADDLEBACK	83.01	27	0.73	27	70.69	31	0.53	34	99.07	22	0.74	26	46.03	34	0.39	35	65.99	34	0.65	35
SAN JOAQUIN	135.90	10	1.04	18	244.44	2	1.45	6	138.25	13	1.17	14	127.50	16	1.05	13	108.44	23	1.09	18
SANTA ANA	78.60	29	0.55	32	93.35	24	0.74	26	91.68	26	0.84	23	67.46	32	0.71	29	97.27	29	1.00	22
SANTA BARBARA	153.81	9	1.15	13	82.00	28	0.70	27	183.78	7	1.38	9	152.37	11	1.52	6	156.66	10	1.41	8
SANTA MONICA	101.69	21	0.79	25	122.78	12	1.00	17	110.76	19	0.99	20	75.41	30	0.62	32	91.08	31	0.95	26
SOUTH BAY	122.68	15	1.17	10	142.15	10	1.49	5	125.28	16	1.39	8	164.07	10	1.31	8	183.90	7	1.88	7
TEHACHAPI	117.96	17	1.43	5	232.67	3	1.12	14	130.70	15	1.29	13	298.96	5	1.21	9	97.29	28	1.13	16
THOUSAND OAKS	127.73	14	1.05	17	93.86	23	0.91	18	104.37	21	1.10	17	106.59	21	0.92	21	143.78	13	1.31	11
VALENCIA	62.01	35	0.46	34	51.04	34	0.53	33	79.23	32	0.61	33	72.27	31	0.61	33	105.09	26	0.97	25
VENTURA	134.81	11	1.15	11	100.52	18	1.21	11	183.79	6	1.65	4	148.85	14	1.19	10	150.41	11	1.24	13
VICTORVILLE	67.70	34	0.66	30	61.33	33	0.63	30	68.85	33	0.63	31	87.03	28	0.91	22	79.35	33	0.92	28
WHITTIER	72.60	32	0.74	26	135.04	11	0.86	19	87.60	28	0.70	30	114.52	18	0.73	28	137.34	15	0.81	33
WILDOMAR	88.54	26	0.72	28	40.51	35	0.56	32	118.49	18	0.81	24	52.70	33	0.60	34	84.01	32	0.87	30
YUCCA VALLEY	319.82	3	3.41	2	216.97	5	1.50	4	304.25	3	1.49	7	389.08	3	1.80	5	463.68	4	3.39	4
<b>SCE SystemWide</b>	<b>108.13</b>		<b>0.89</b>		<b>102.61</b>		<b>0.91</b>		<b>112.00</b>		<b>0.96</b>		<b>114.83</b>		<b>0.92</b>		<b>134.48</b>		<b>1.10</b>	

\*\*Exclusions\*\* are days which utilities are allowed to remove from their metrics because the outages on those days were caused by a severe acts of nature.


\*\*In the columns showing "Rank," lower numbers indicate poorer performance.

# Overview of Norwalk

## There are 45 circuits that serve Norwalk

Circuit Type	Sum of Customers	Circuit Type	Sum of Customers	Circuit Type	Sum of Customers	Circuit Type	Sum of Customers
ABANA(12KV)	161	PELLET(12KV)	1,035				
ALMA(4.16KV)	1,020	PIUMA(4.16KV)	1,049				
ALORA(12KV)	606	RED FLAG(12KV)	695				
BLANKET(12KV)	197	REDSKIN(12KV)	421				
BOWIE(12KV)	936	RIFLE(12KV)	1,055				
BOXER(12KV)	1,289	SEMORA(12KV)	1,158				
BUFFALO(12KV)	448	SETTLER(12KV)	2,108				
BUTLER(12KV)	157	SHOTGUN(12KV)	2,580				
CARAVEL(12KV)	553	SPLENDORA(12KV)	2,495				
CLERK(12KV)	2,314	STAGE(12KV)	120				
CODY(12KV)	1,550	STUDEBAKER(12KV)	2,216				
CRUSADE(12KV)	1,577	TATTOO(12KV)	909				
DECOY(12KV)	1,295	TEXAS(12KV)	763				
DOHN(4.16KV)	876	TIGER(12KV)	1,321				
DORNES(12KV)	2,368	TRAPPER(12KV)	1,578				
EXCELSIOR(4.16KV)	848						
FALLON(12KV)	2,424						
FERINA(4.16KV)	953						
GARD(12KV)	605						
HARDHAT(12KV)	316						
HOUGHTON(4.16KV)	410						
JANAE(12KV)	1,566						
KENNEY(4.16KV)	819						
LEMONT(12KV)	105						
MAPES(12KV)	3,653						
MIRA(12KV)	93						
MOODY(12KV)	392						
MUSKET(12KV)	2,943						
NORTON(12KV)	335						
PAPOOSE(12KV)	735						
<b>Grand Total</b>	<b>51,047</b>						


# Reliability History of Circuits Serving Norwalk (No Exclusions)

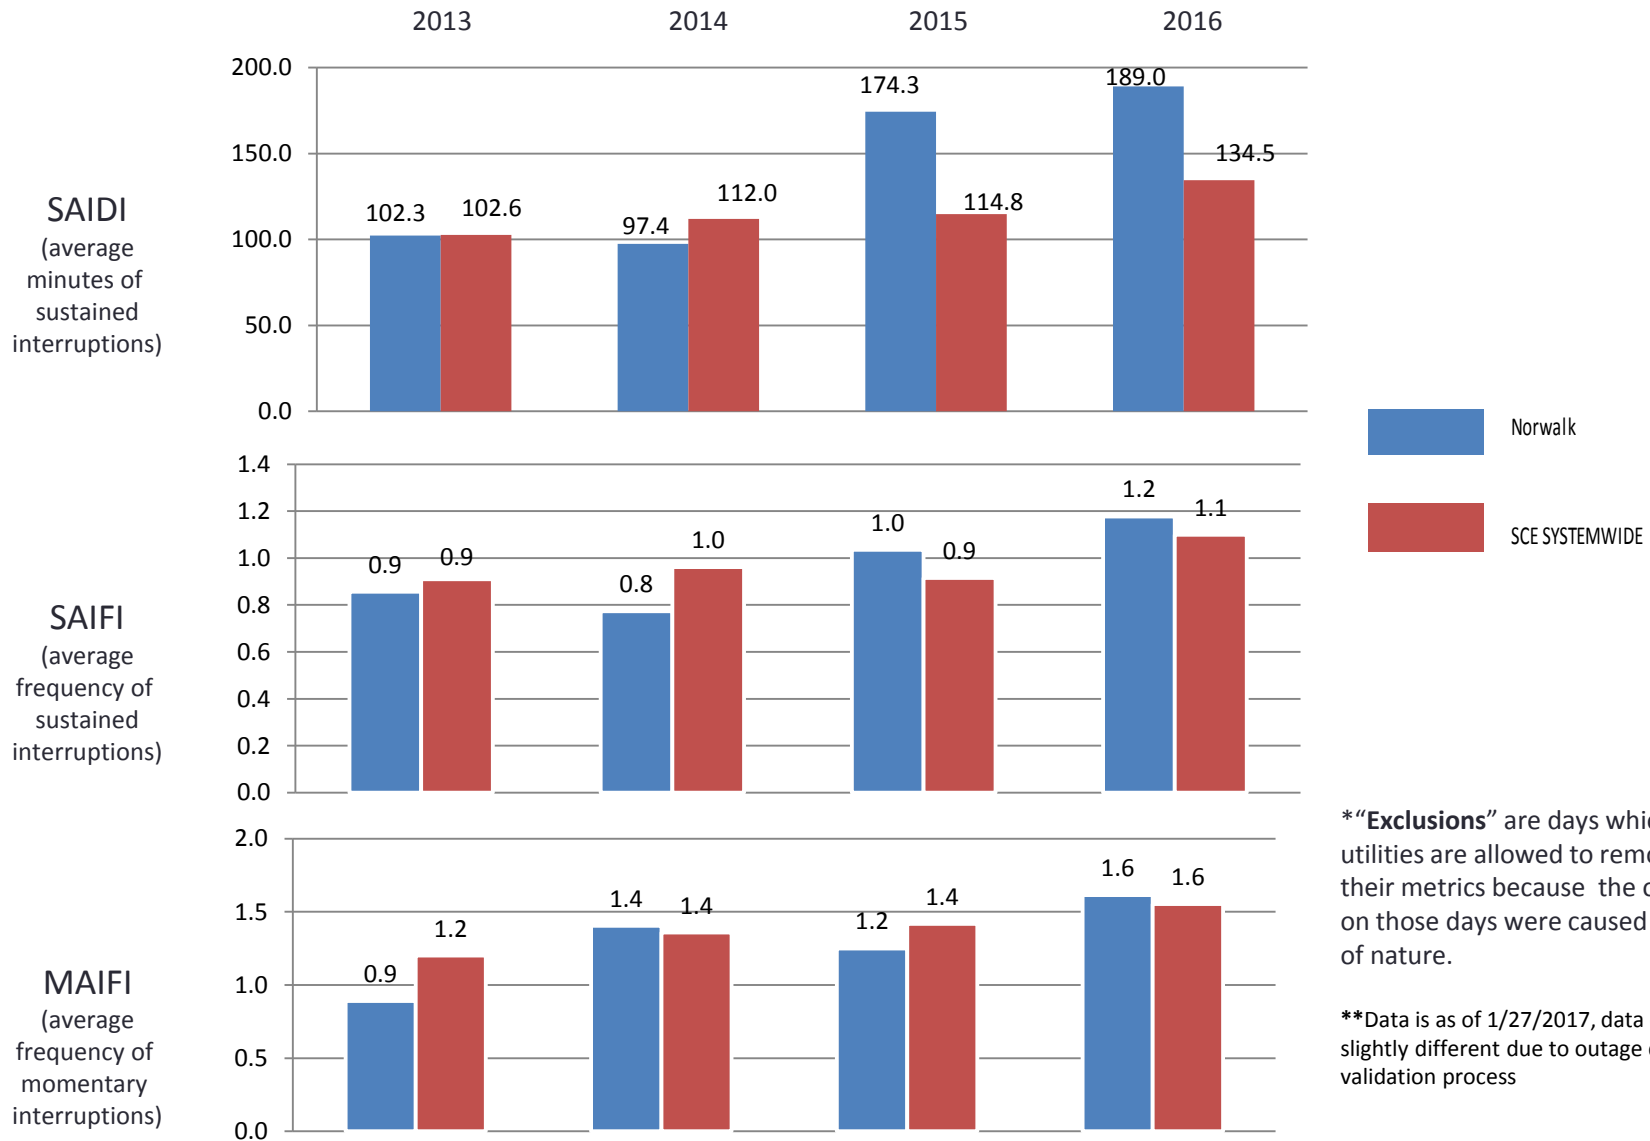



# Causes of Repair Outages in Norwalk Circuits 2016 YTD


## Contributions to SAIDI by Outage Cause

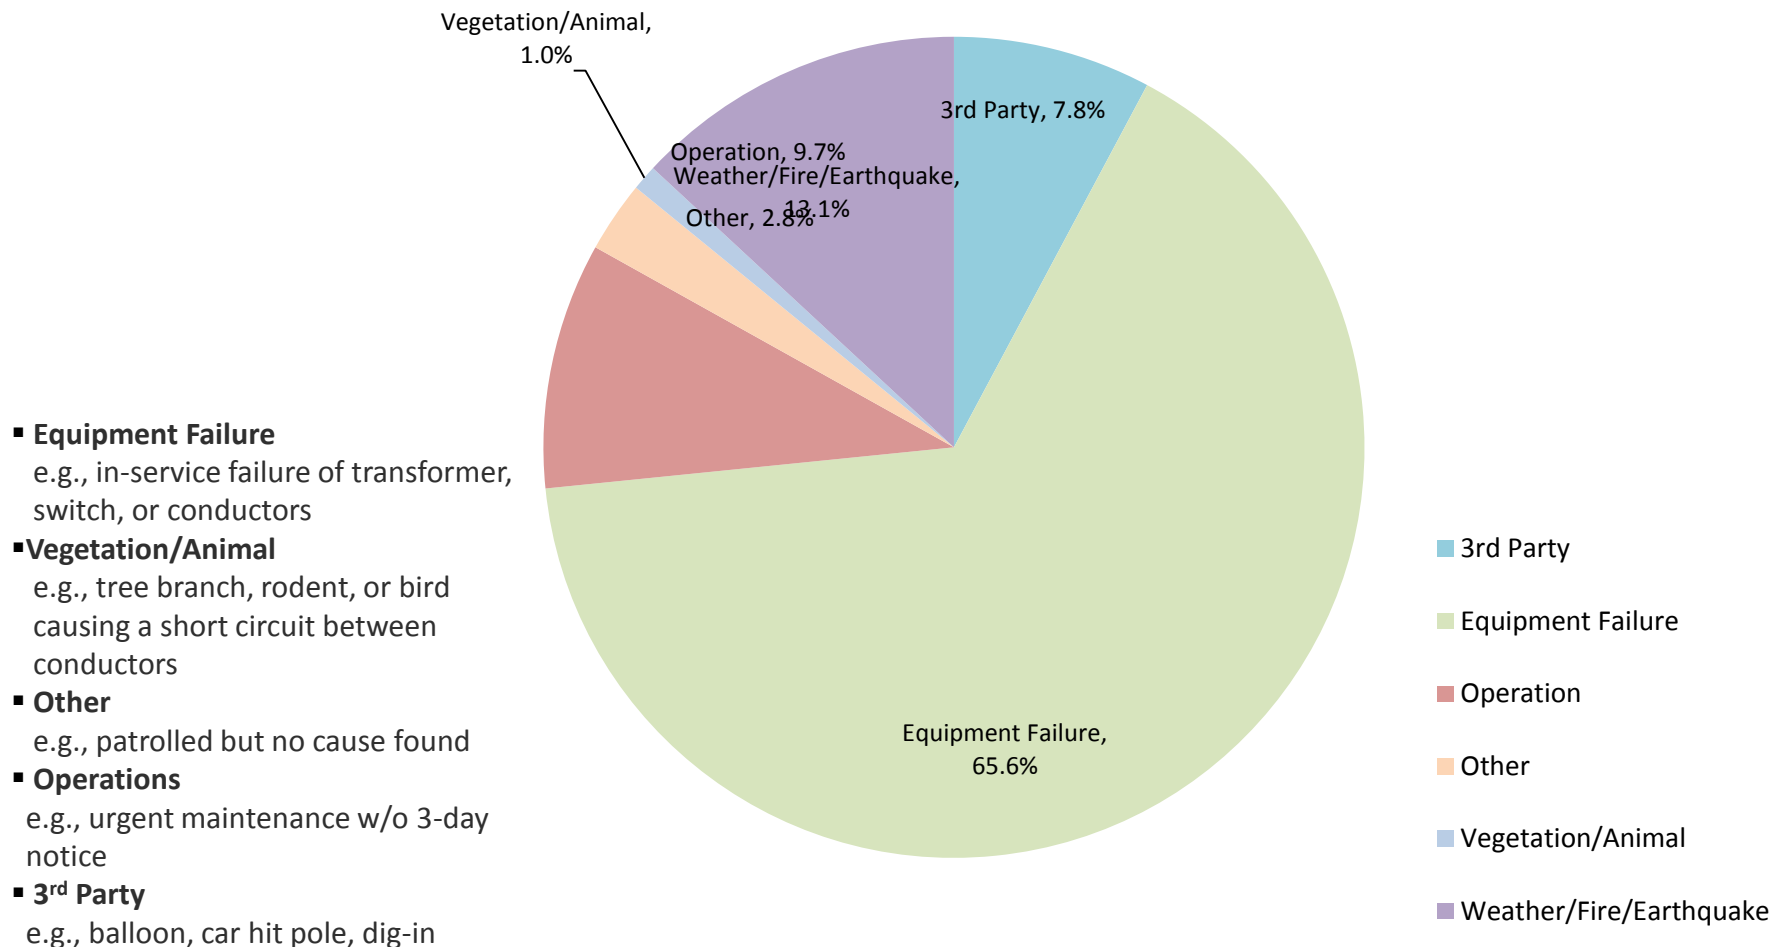


**SAIDI** = the cumulative amount of time the average customer is interrupted by “sustained” outages each year.

# Causes of Repair Outages in Norwalk Circuits 2016 YTD


## Contributions to SAIFI by Outage Cause

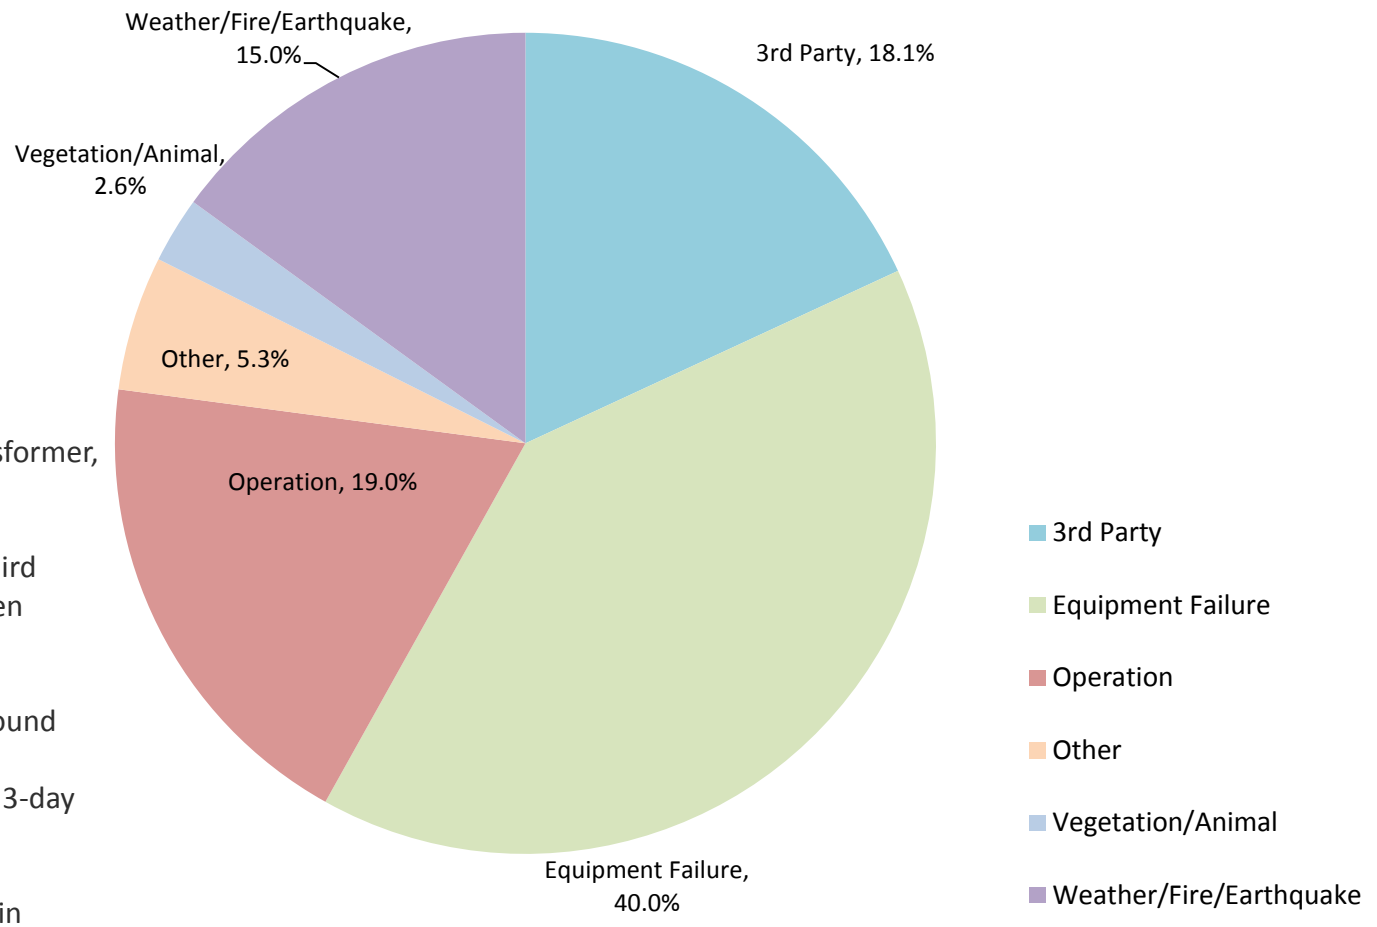

**SAIFI** = the number of times the average customer is interrupted by “sustained” outages each year.

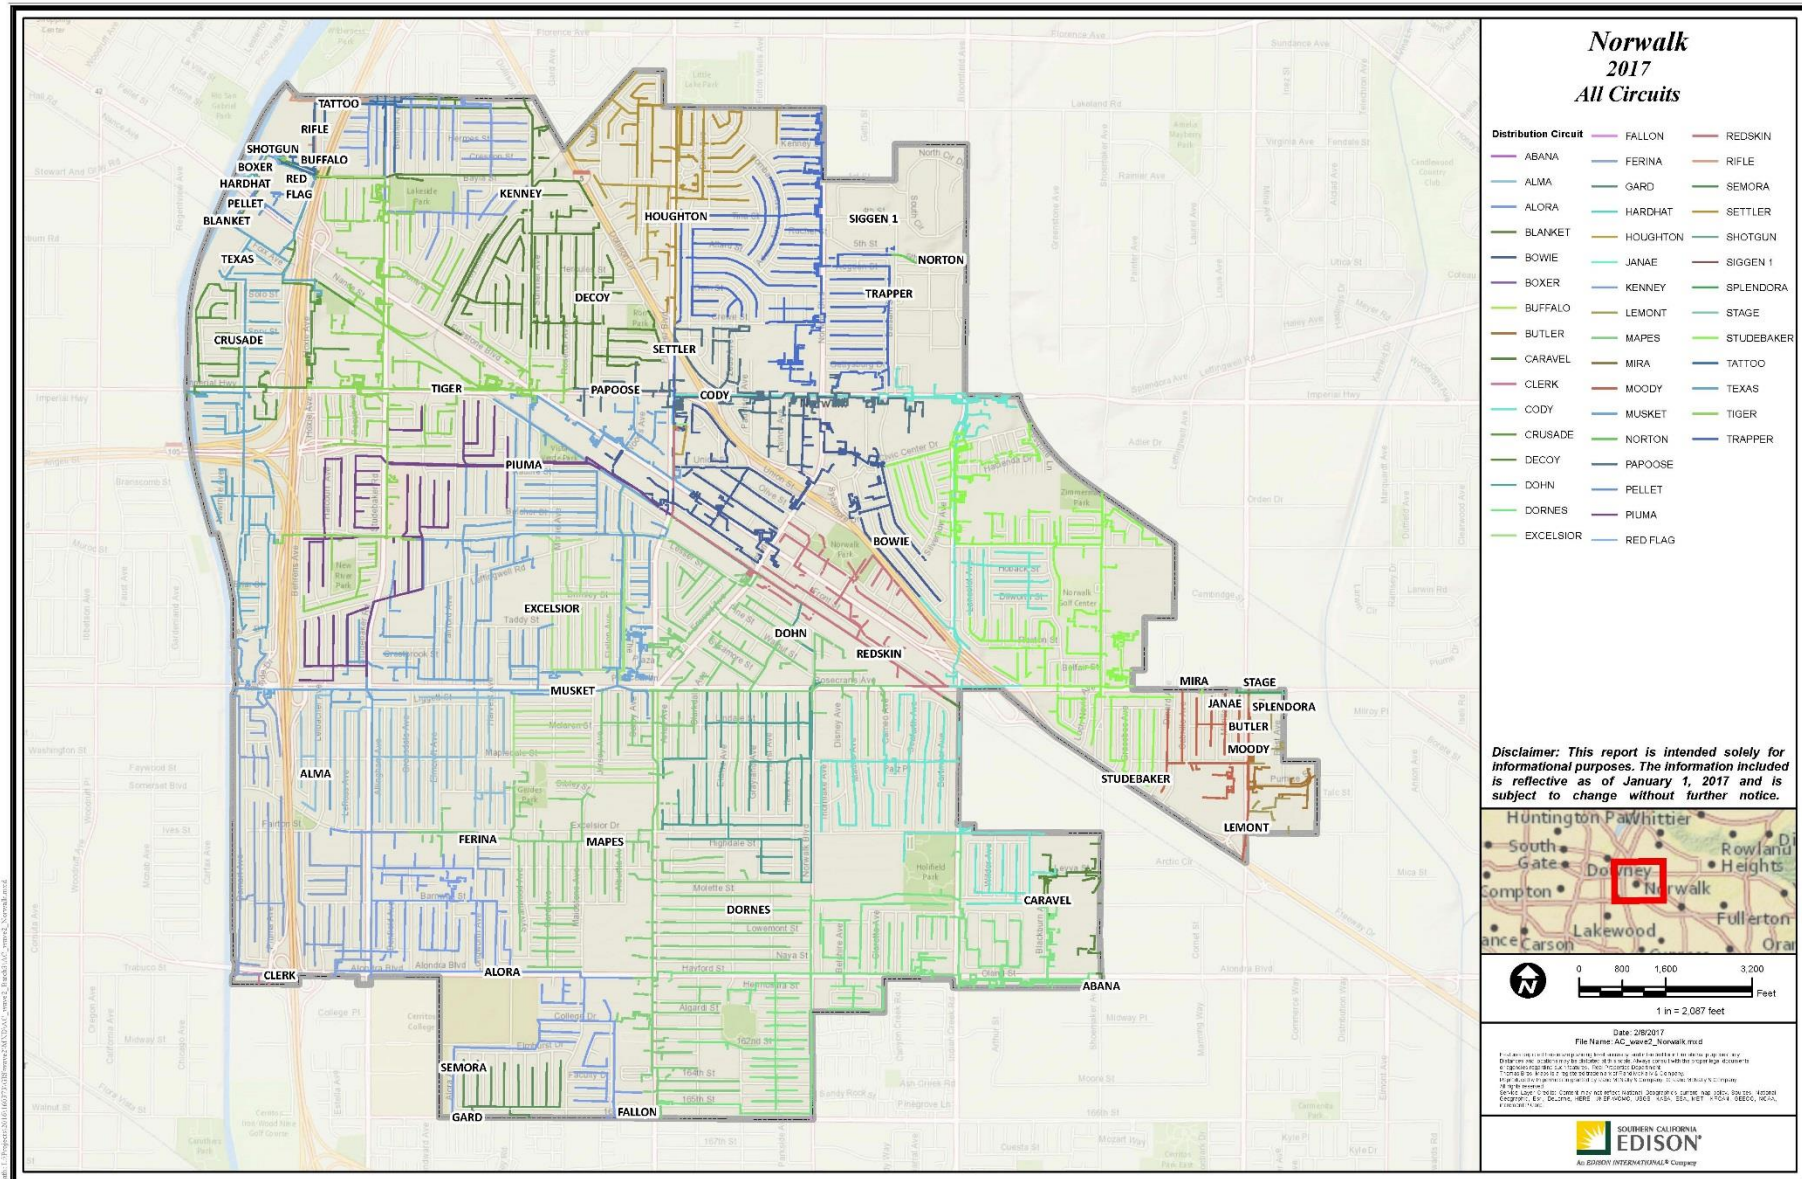



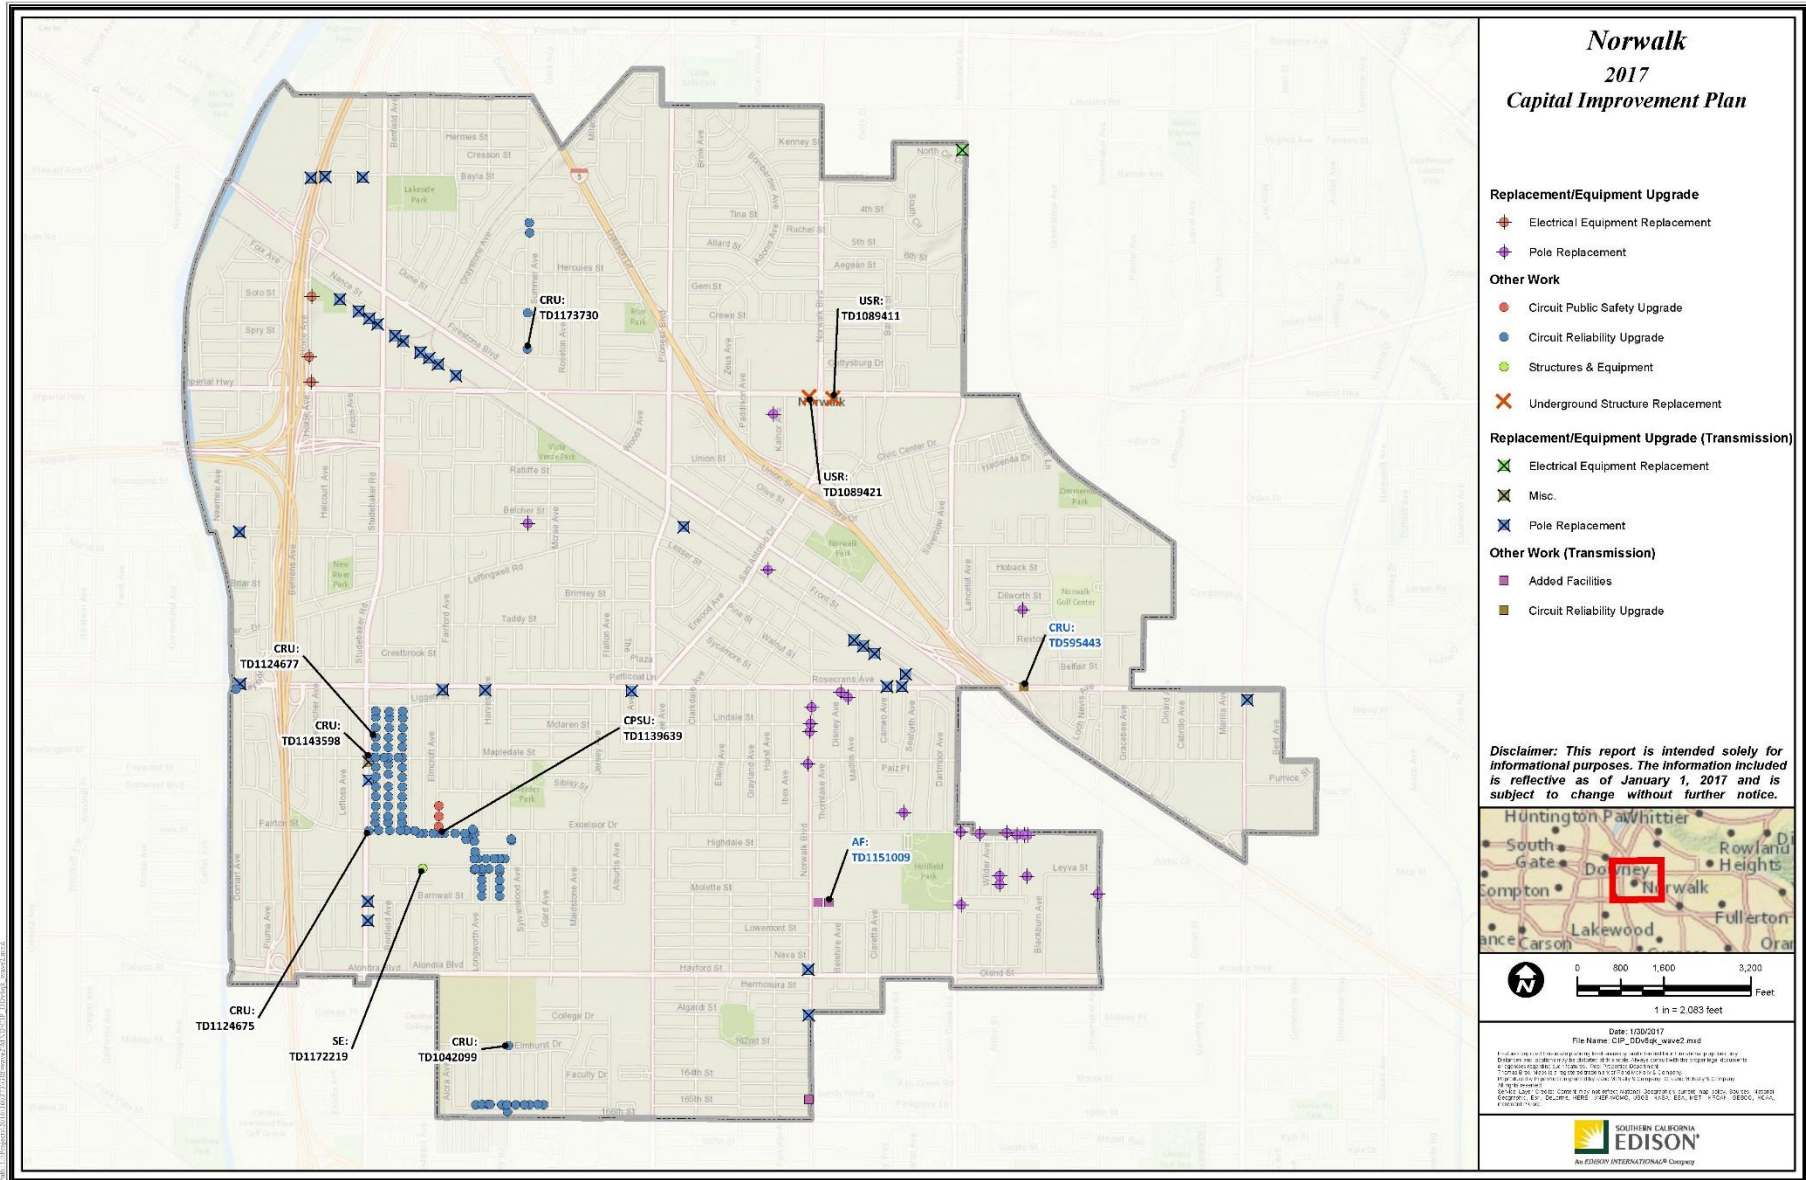

# Back-up Slides

**Reliability Histories of Circuits Serving Norwalk**

**Updated through Year-End 2016**

# Average Reliability of 45 Circuits Serving Norwalk

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>Norwalk</b>	<b>102.3</b>	<b>0.9</b>	<b>0.9</b>	<b>97.4</b>	<b>0.8</b>	<b>1.4</b>	<b>174.3</b>	<b>1.0</b>	<b>1.2</b>	<b>25.6</b>	<b>0.2</b>	<b>0.2</b>	<b>119.3</b>	<b>0.5</b>	<b>0.4</b>	<b>31.4</b>	<b>0.3</b>	<b>0.5</b>	<b>12.6</b>	<b>0.1</b>	<b>0.5</b>	<b>189.0</b>	<b>1.2</b>	<b>1.6</b>
3rd Party	15%	14%	22%	22%	20%	27%	14%	23%	24%	14%	17%	76%	3%	19%	47%	12%	2%	21%	27%	52%	18%	8%	18%	34%
Equipment Failure	55%	64%	20%	46%	43%	32%	30%	28%	23%	4%	2%	1%	87%	67%	12%	37%	31%	20%	56%	37%	21%	66%	40%	16%
Operation	6%	5%	0%	17%	17%	11%	10%	19%	15%	3%	21%	0%	5%	3%	7%	33%	49%	26%	9%	6%	2%	10%	19%	11%
Other	20%	17%	33%	6%	8%	18%	35%	11%	24%	13%	18%	15%	0%	1%	19%	3%	2%	4%	6%	5%	55%	3%	5%	25%
Vegetation/Animal	1%	0%	21%	2%	6%	3%	7%	14%	5%	0%	0%	0%	0%	0%	14%	4%	9%	28%	1%	1%	5%	1%	3%	14%
Weather/Fire/Earthquake	2%	1%	3%	7%	7%	9%	5%	5%	9%	66%	43%	8%	3%	10%	0%	12%	7%	0%	0%	0%	0%	13%	15%	1%
<b>SCE Systemwide</b>	<b>102.6</b>	<b>0.9</b>	<b>1.2</b>	<b>112.0</b>	<b>1.0</b>	<b>1.4</b>	<b>114.8</b>	<b>0.9</b>	<b>1.4</b>	<b>40.5</b>	<b>0.3</b>	<b>0.4</b>	<b>34.8</b>	<b>0.3</b>	<b>0.4</b>	<b>29.4</b>	<b>0.2</b>	<b>0.3</b>	<b>29.8</b>	<b>0.3</b>	<b>0.4</b>	<b>134.5</b>	<b>1.1</b>	<b>1.6</b>

## Notes:

No outages are excluded from the metrics.

## Outage Causes:

Other: e.g., patrolled but no cause could be found

Operations: e.g., urgent maintenance w/o 3-day notice to customers

3<sup>rd</sup> Party: e.g., balloons, car hit pole, dig-in

Vegetation/Animal: e.g., tree branch, rodent, or bird causing short circuit across conductors

SAIDI (minutes) = the cumulative amount of time the average customer is interrupted by "sustained" (longer than 5 minutes) outages.

SAIFI (interruptions) = the number of times the average customer is interrupted by "sustained" outages.

MAIFI (interruptions) = the number of times the average customer is interrupted by "momentary" (lasting 5 minutes or less) outages.

# Reliability Histories for Individual Circuits Serving Norwalk

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>ABANA(12KV) - Customers: 161</b>	<b>388.0</b>	<b>5.7</b>	<b>0.8</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>145.0</b>	<b>0.4</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	73%	64%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	27%	36%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>ALMA(4.16KV) - Customers: 1,020</b>	<b>84.3</b>	<b>1.0</b>	<b>3.0</b>	<b>0.0</b>	<b>0.0</b>	<b>2.0</b>	<b>1783.9</b>	<b>1.9</b>	<b>4.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>94.5</b>	<b>1.6</b>	<b>0.0</b>	<b>0.6</b>	<b>0.0</b>	<b>1.0</b>	<b>95.1</b>	<b>1.6</b>	<b>1.0</b>
3rd Party	0%	0%	33%	0%	0%	0%	2%	53%	43%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	7%	1%	0%	0%	0%	0%	1%	1%	0%	0%	0%	0%	0%	0%	0%	72%	63%	0%	0%	0%	0%	72%	62%	0%
Operation	93%	99%	0%	0%	0%	50%	0%	0%	25%	0%	0%	0%	0%	0%	0%	28%	37%	0%	100%	100%	0%	28%	38%	0%
Other	0%	0%	33%	0%	0%	50%	97%	46%	7%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	100%
Vegetation/Animal	0%	0%	33%	0%	0%	0%	0%	0%	25%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>ALORA(12KV) - Customers: 606</b>	<b>184.5</b>	<b>2.0</b>	<b>0.0</b>	<b>200.0</b>	<b>1.1</b>	<b>0.4</b>	<b>14.1</b>	<b>1.4</b>	<b>1.4</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>67.4</b>	<b>0.2</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>40.0</b>	<b>0.1</b>	<b>0.0</b>	<b>107.4</b>	<b>0.3</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	78%	99%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	43%	50%	0%	35%	7%	6%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	2%	2%	0%	22%	1%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%
Other	57%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	63%	91%	94%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>BLANKET(12KV) - Customers: 197</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>52.5</b>	<b>1.1</b>	<b>0.0</b>	<b>51.2</b>	<b>1.2</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>152.6</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>9.9</b>	<b>0.0</b>	<b>1.0</b>	<b>162.5</b>	<b>1.0</b>	<b>1.0</b>
3rd Party	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	6%	1%	100%
Equipment Failure	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	94%	99%	0%
Operation	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

# Reliability Histories for Individual Circuits Serving Norwalk

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>BOWIE(12KV) - Customers: 936</b>	<b>261.4</b>	<b>2.1</b>	<b>0.1</b>	<b>3.7</b>	<b>0.0</b>	<b>0.0</b>	<b>105.5</b>	<b>0.5</b>	<b>1.5</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>5.0</b>	<b>0.0</b>	<b>0.0</b>	<b>5.0</b>	<b>0.0</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	84%	96%	100%	100%	100%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%
Operation	16%	4%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>BOXER(12KV) - Customers: 1,289</b>	<b>0.2</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>2.4</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>158.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>3.5</b>	<b>0.0</b>	<b>1.0</b>	<b>161.5</b>	<b>1.0</b>	<b>1.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	98%	99%	0%
Operation	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	2%	1%	100%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>BUFFALO(12KV) - Customers: 448</b>	<b>50.1</b>	<b>1.2</b>	<b>0.0</b>	<b>549.5</b>	<b>0.5</b>	<b>0.0</b>	<b>151.6</b>	<b>1.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>159.1</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>159.1</b>	<b>1.0</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	62%	14%	0%	100%	100%	0%	100%	100%	100%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	38%	86%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>BUTLER(12KV) - Customers: 157</b>	<b>41.9</b>	<b>1.0</b>	<b>0.0</b>	<b>75.9</b>	<b>1.0</b>	<b>4.0</b>	<b>89.5</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>70.1</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>70.1</b>	<b>1.0</b>	<b>1.0</b>
3rd Party	0%	0%	0%	14%	1%	25%	100%	100%	0%	0%	0%	0%	96%	99%	0%	0%	0%	0%	0%	0%	0%	96%	99%	0%
Equipment Failure	86%	97%	0%	86%	99%	0%	0%	0%	0%	0%	0%	0%	4%	1%	0%	0%	0%	0%	0%	0%	0%	4%	1%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	100%
Vegetation/Animal	14%	3%	0%	0%	0%	25%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%



# Reliability Histories for Individual Circuits Serving Norwalk

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>CARAVEL(12KV) - Customers: 553</b>	<b>39.0</b>	<b>1.0</b>	<b>1.0</b>	<b>114.1</b>	<b>1.2</b>	<b>0.0</b>	<b>182.0</b>	<b>2.1</b>	<b>4.7</b>	<b>5.2</b>	<b>0.1</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>11.7</b>	<b>0.1</b>	<b>0.9</b>	<b>16.9</b>	<b>0.2</b>	<b>0.9</b>
3rd Party	0%	0%	0%	0%	0%	0%	34%	4%	40%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	46%	11%	0%	66%	95%	60%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	31%	55%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	65%	94%	100%	45%	43%	100%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	54%	89%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	35%	6%	0%	25%	3%	0%
<b>CLERK(12KV) - Customers: 2,314</b>	<b>35.8</b>	<b>1.0</b>	<b>5.0</b>	<b>5.5</b>	<b>0.0</b>	<b>3.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>
3rd Party	0%	0%	20%	0%	0%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	20%	29%	14%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	71%	86%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	67%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	60%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>CODY(12KV) - Customers: 1,550</b>	<b>0.3</b>	<b>0.0</b>	<b>2.0</b>	<b>116.0</b>	<b>0.3</b>	<b>1.9</b>	<b>81.4</b>	<b>1.0</b>	<b>1.0</b>	<b>6.8</b>	<b>0.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>4.3</b>	<b>0.1</b>	<b>0.0</b>	<b>11.1</b>	<b>0.1</b>	<b>2.0</b>
3rd Party	0%	0%	50%	18%	52%	53%	0%	0%	0%	4%	20%	100%	0%	0%	0%	0%	0%	100%	0%	0%	0%	2%	2%	100%
Equipment Failure	100%	100%	0%	13%	2%	0%	93%	95%	0%	96%	80%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	59%	7%	0%
Operation	0%	0%	0%	4%	9%	0%	7%	5%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	39%	92%	0%
Other	0%	0%	50%	65%	37%	47%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>CRUSADE(12KV) - Customers: 1,577</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>181.9</b>	<b>2.2</b>	<b>2.7</b>	<b>1.8</b>	<b>0.0</b>	<b>2.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>701.1</b>	<b>1.0</b>	<b>1.0</b>	<b>124.3</b>	<b>0.2</b>	<b>0.8</b>	<b>20.8</b>	<b>0.0</b>	<b>0.0</b>	<b>846.2</b>	<b>1.2</b>	<b>1.8</b>
3rd Party	0%	0%	0%	2%	2%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	100%	0%	0%	0%	15%	17%	100%
Equipment Failure	0%	0%	0%	75%	46%	26%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	99%	98%	0%	85%	83%	0%
Operation	0%	0%	0%	23%	52%	36%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	3%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	38%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

# Reliability Histories for Individual Circuits Serving Norwalk

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>DECOY(12KV) - Customers: 1,295</b>	<b>3.8</b>	<b>0.0</b>	<b>0.0</b>	<b>551.0</b>	<b>1.4</b>	<b>1.0</b>	<b>384.8</b>	<b>2.7</b>	<b>1.1</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>301.4</b>	<b>0.9</b>	<b>0.0</b>	<b>28.8</b>	<b>0.3</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>330.2</b>	<b>1.1</b>	<b>0.0</b>
3rd Party	0%	0%	0%	92%	79%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	8%	21%	0%	56%	50%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	91%	77%	0%
Operation	100%	100%	0%	0%	0%	0%	32%	41%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	12%	8%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	9%	23%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>DOHN(4.16KV) - Customers: 876</b>	<b>3.5</b>	<b>0.0</b>	<b>0.0</b>	<b>143.3</b>	<b>1.6</b>	<b>1.6</b>	<b>29.6</b>	<b>1.1</b>	<b>1.0</b>	<b>84.9</b>	<b>1.4</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>84.9</b>	<b>1.4</b>	<b>1.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	100%	99%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	99%	100%	100%
Equipment Failure	100%	100%	0%	4%	1%	0%	88%	96%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	1%	1%	0%	12%	4%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	1%	0%	0%
Other	0%	0%	0%	76%	86%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	19%	12%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>DORNES(12KV) - Customers: 2,368</b>	<b>323.3</b>	<b>1.7</b>	<b>2.4</b>	<b>157.5</b>	<b>2.5</b>	<b>6.6</b>	<b>151.8</b>	<b>0.9</b>	<b>2.3</b>	<b>264.1</b>	<b>1.8</b>	<b>0.0</b>	<b>105.7</b>	<b>1.1</b>	<b>1.0</b>	<b>48.1</b>	<b>0.1</b>	<b>1.0</b>	<b>41.8</b>	<b>0.4</b>	<b>0.6</b>	<b>459.6</b>	<b>3.4</b>	<b>2.6</b>
3rd Party	50%	12%	34%	0%	0%	15%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	37%	77%	66%	94%	99%	55%	71%	47%	29%	0%	0%	0%	12%	3%	100%	59%	44%	0%	100%	100%	100%	18%	15%	62%
Operation	5%	4%	0%	1%	1%	0%	15%	46%	71%	0%	0%	0%	0%	0%	0%	41%	56%	100%	0%	0%	0%	4%	2%	38%
Other	0%	0%	0%	0%	0%	0%	10%	3%	0%	5%	19%	0%	8%	7%	0%	0%	0%	0%	0%	0%	0%	5%	12%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	9%	7%	0%	4%	1%	30%	5%	3%	0%	95%	81%	0%	81%	90%	0%	0%	0%	0%	0%	0%	0%	73%	71%	0%
<b>EXCELSIOR(4.16KV) - Customers: 848</b>	<b>4.3</b>	<b>0.0</b>	<b>1.0</b>	<b>5.8</b>	<b>0.1</b>	<b>2.0</b>	<b>259.5</b>	<b>2.8</b>	<b>2.0</b>	<b>116.0</b>	<b>1.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>116.0</b>	<b>1.0</b>	<b>1.0</b>
3rd Party	0%	0%	0%	0%	0%	50%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%
Equipment Failure	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	100%	100%	0%	15%	36%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	100%	0%	0%	50%	85%	64%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

# Reliability Histories for Individual Circuits Serving Norwalk

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
FALLON(12KV) - Customers: 2,424	106.6	1.0	0.0	6.3	0.0	0.0	10.2	0.1	0.0	49.3	0.6	0.3	0.0	0.0	0.0	36.0	0.1	0.0	0.0	0.0	0.0	85.3	0.7	0.3
3rd Party	0%	0%	0%	0%	0%	0%	7%	4%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	0%	0%	0%	13%	18%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	100%	100%	0%	80%	78%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	42%	14%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	58%	86%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
FERINA(4.16KV) - Customers: 953	0.0	0.0	3.0	102.2	1.0	3.0	323.2	1.0	3.0	258.5	2.0	2.0	0.0	0.0	0.0	39.0	2.0	0.0	0.0	0.0	0.0	297.5	4.0	2.0
3rd Party	0%	0%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	33%	0%	0%	34%	2%	1%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	14%	50%	0%
Other	0%	0%	33%	100%	100%	67%	100%	100%	34%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	50%
Vegetation/Animal	0%	0%	33%	0%	0%	0%	0%	0%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	98%	99%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	86%	50%	50%
GARD(12KV) - Customers: 605	79.9	1.0	0.0	161.0	1.1	0.0	0.0	0.0	0.0	2.9	0.1	0.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	0.0	0.0	2.9	0.1	1.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	96%	11%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	100%	100%	100%
Other	0%	0%	0%	4%	89%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
HARDHAT(12KV) - Customers: 316	9.0	0.0	0.0	0.0	0.0	0.0	5.1	0.0	0.0	0.0	0.0	0.0	156.2	1.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	156.2	1.0	0.0
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Operation	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

# Reliability Histories for Individual Circuits Serving Norwalk

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>HOUGHTON(4.16KV) - Customers: 410</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1393.8</b>	<b>3.5</b>	<b>2.5</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	100%
Equipment Failure	0%	0%	0%	0%	0%	0%	89%	93%	70%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	11%	7%	30%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>JANAE(12KV) - Customers: 1,566</b>	<b>115.3</b>	<b>1.0</b>	<b>2.0</b>	<b>6.4</b>	<b>0.0</b>	<b>0.0</b>	<b>448.9</b>	<b>1.7</b>	<b>1.1</b>	<b>11.4</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>26.3</b>	<b>0.2</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>37.7</b>	<b>0.2</b>	<b>1.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	96%	99%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	70%	85%	0%
Other	0%	0%	50%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	30%	15%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	4%	1%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>KENNEY(4.16KV) - Customers: 819</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>68.9</b>	<b>0.1</b>	<b>2.0</b>	<b>433.9</b>	<b>2.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>193.2</b>	<b>1.0</b>	<b>1.8</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>193.2</b>	<b>1.0</b>	<b>1.8</b>
3rd Party	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	96%	78%	0%	30%	50%	0%	0%	0%	0%	98%	96%	0%	0%	0%	0%	0%	0%	0%	98%	96%	0%
Operation	0%	0%	0%	4%	22%	0%	70%	50%	0%	0%	0%	0%	2%	4%	100%	0%	0%	0%	0%	0%	0%	2%	4%	100%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>LEMONT(12KV) - Customers: 105</b>	<b>163.2</b>	<b>2.1</b>	<b>3.0</b>	<b>0.0</b>	<b>0.0</b>	<b>4.2</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	78%	53%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	22%	47%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	67%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

# Reliability Histories for Individual Circuits Serving Norwalk

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>MAPES(12KV) - Customers: 3,653</b>	<b>327.5</b>	<b>2.7</b>	<b>1.3</b>	<b>69.2</b>	<b>0.7</b>	<b>1.3</b>	<b>144.7</b>	<b>2.7</b>	<b>0.6</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>22.6</b>	<b>0.7</b>	<b>0.3</b>	<b>66.1</b>	<b>1.0</b>	<b>0.9</b>	<b>49.2</b>	<b>0.9</b>	<b>0.9</b>	<b>137.8</b>	<b>2.7</b>	<b>3.1</b>
3rd Party	18%	25%	24%	95%	95%	100%	17%	25%	51%	0%	0%	100%	100%	100%	100%	0%	0%	0%	82%	92%	0%	46%	58%	45%
Equipment Failure	29%	37%	0%	0%	0%	0%	20%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	28%
Operation	0%	0%	0%	5%	5%	0%	19%	37%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	48%	39%	28%
Other	53%	38%	76%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	18%	8%	0%	6%	3%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	44%	37%	49%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>MIRA(12KV) - Customers: 93</b>	<b>37.0</b>	<b>1.0</b>	<b>0.0</b>	<b>183.1</b>	<b>2.2</b>	<b>0.0</b>	<b>67.3</b>	<b>1.0</b>	<b>1.3</b>	<b>354.9</b>	<b>1.2</b>	<b>1.6</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1.3</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1.9</b>	<b>356.2</b>	<b>1.2</b>	<b>3.5</b>
3rd Party	0%	0%	0%	21%	45%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	0%	0%	0%	100%	100%	100%	88%	96%	100%	0%	0%	0%	100%	100%	0%	0%	0%	0%	88%	96%	44%
Operation	0%	0%	0%	20%	9%	0%	0%	0%	0%	12%	4%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	12%	4%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	56%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	59%	46%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>MOODY(12KV) - Customers: 392</b>	<b>46.4</b>	<b>1.0</b>	<b>1.0</b>	<b>20.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>229.2</b>	<b>0.3</b>	<b>1.0</b>	<b>229.2</b>	<b>0.3</b>	<b>1.0</b>
3rd Party	5%	2%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	95%	98%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>MUSKET(12KV) - Customers: 2,943</b>	<b>40.9</b>	<b>0.1</b>	<b>0.0</b>	<b>46.6</b>	<b>1.0</b>	<b>1.0</b>	<b>318.2</b>	<b>3.1</b>	<b>4.4</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>11.6</b>	<b>0.0</b>	<b>1.0</b>	<b>127.8</b>	<b>0.9</b>	<b>4.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>139.4</b>	<b>1.0</b>	<b>6.0</b>
3rd Party	0%	0%	0%	97%	99%	100%	20%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	17%
Equipment Failure	21%	41%	0%	0%	0%	0%	31%	15%	54%	0%	0%	0%	36%	12%	0%	83%	50%	37%	0%	0%	0%	80%	49%	24%
Operation	79%	59%	0%	3%	1%	0%	3%	2%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	6%	15%	24%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	35%	34%	0%	0%	0%	0%	64%	88%	100%	17%	50%	63%	0%	0%	0%	20%	51%	58%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	4%	0%	22%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

# Reliability Histories for Individual Circuits Serving Norwalk

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>NORTON(12KV) - Customers: 335</b>	<b>109.4</b>	<b>0.4</b>	<b>0.0</b>	<b>1.3</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>34.9</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>34.9</b>	<b>0.0</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%
Operation	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>PAPOOSE(12KV) - Customers: 735</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>250.4</b>	<b>3.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	1%	3%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	99%	97%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>PELLET(12KV) - Customers: 1,035</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>45.9</b>	<b>0.9</b>	<b>0.0</b>	<b>55.5</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>226.8</b>	<b>2.0</b>	<b>2.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>226.8</b>	<b>2.0</b>	<b>2.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	50%
Equipment Failure	0%	0%	0%	100%	100%	0%	91%	99%	0%	0%	0%	0%	99%	98%	0%	0%	0%	0%	0%	0%	0%	99%	98%	0%
Operation	0%	0%	0%	0%	0%	0%	9%	1%	0%	0%	0%	0%	1%	2%	0%	100%	100%	0%	0%	0%	0%	1%	2%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	50%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>PIUMA(4.16KV) - Customers: 1,049</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>323.9</b>	<b>2.0</b>	<b>1.3</b>	<b>13.3</b>	<b>0.1</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.9</b>	<b>0.0</b>	<b>0.0</b>	<b>0.9</b>	<b>0.0</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	40%	51%	25%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	60%	49%	75%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%
Other	0%	0%	100%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

# Reliability Histories for Individual Circuits Serving Norwalk

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>RED FLAG(12KV) - Customers: 695</b>	<b>35.8</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>3.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>159.7</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>159.7</b>	<b>1.0</b>	<b>0.0</b>
3rd Party	95%	99%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	5%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	94%	96%	0%	0%	0%	0%	0%	0%	0%	94%	96%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	6%	5%	0%	0%	0%	0%	0%	0%	0%	6%	5%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	100%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>REDSKIN(12KV) - Customers: 421</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>105.4</b>	<b>0.6</b>	<b>0.0</b>	<b>25.3</b>	<b>0.3</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>803.3</b>	<b>1.4</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>10.4</b>	<b>0.0</b>	<b>1.0</b>	<b>813.7</b>	<b>1.4</b>	<b>1.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	100%
Equipment Failure	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	36%	48%	0%	0%	0%	0%	0%	0%	0%	35%	46%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	64%	52%	0%	0%	0%	0%	100%	100%	0%	65%	54%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>RIFLE(12KV) - Customers: 1,055</b>	<b>9.6</b>	<b>0.0</b>	<b>0.0</b>	<b>0.4</b>	<b>0.0</b>	<b>0.0</b>	<b>2.2</b>	<b>0.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>160.2</b>	<b>1.0</b>	<b>0.0</b>	<b>190.6</b>	<b>1.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>350.8</b>	<b>2.0</b>	<b>1.0</b>
3rd Party	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	44%	55%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	6%	3%	0%	0%	0%	0%	49%	51%	0%
Operation	56%	45%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	94%	97%	0%	0%	0%	0%	51%	49%	0%
<b>SEMORA(12KV) - Customers: 1,158</b>	<b>324.1</b>	<b>2.1</b>	<b>1.7</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>5.4</b>	<b>0.0</b>	<b>1.3</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>2.5</b>	<b>0.0</b>	<b>0.0</b>	<b>2.5</b>	<b>0.0</b>	<b>0.0</b>
3rd Party	1%	3%	0%	0%	0%	0%	84%	50%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	80%	86%	42%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	100%	100%	0%
Operation	0%	0%	0%	0%	0%	0%	16%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	7%	8%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	12%	4%	58%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

# Reliability Histories for Individual Circuits Serving Norwalk

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>SETTLER(12KV) - Customers: 2,108</b>	<b>33.1</b>	<b>0.0</b>	<b>3.0</b>	<b>258.3</b>	<b>1.9</b>	<b>4.0</b>	<b>248.7</b>	<b>1.2</b>	<b>1.9</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>5.2</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>5.0</b>	<b>0.1</b>	<b>2.0</b>	<b>10.2</b>	<b>0.1</b>	<b>3.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	53%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	33%
Equipment Failure	100%	100%	0%	62%	22%	58%	39%	10%	47%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Operation	0%	0%	0%	22%	23%	42%	12%	4%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	57%	58%	0%	79%	69%	0%
Other	0%	0%	33%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	67%
Vegetation/Animal	0%	0%	67%	16%	55%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	43%	42%	0%	21%	31%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	49%	86%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>SHOTGUN(12KV) - Customers: 2,580</b>	<b>47.9</b>	<b>0.7</b>	<b>1.0</b>	<b>82.3</b>	<b>0.2</b>	<b>0.0</b>	<b>64.7</b>	<b>0.1</b>	<b>0.0</b>	<b>11.3</b>	<b>1.0</b>	<b>0.0</b>	<b>357.2</b>	<b>1.0</b>	<b>1.0</b>	<b>0.2</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>368.7</b>	<b>2.0</b>	<b>1.0</b>
3rd Party	93%	99%	100%	0%	0%	0%	52%	46%	0%	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	7%	1%	0%	81%	71%	0%	47%	43%	0%	2%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	97%	52%	0%
Operation	0%	0%	0%	0%	0%	0%	1%	11%	0%	96%	100%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	3%	48%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	19%	29%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>SPLENDORA(12KV) - Customers: 2,495</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>143.2</b>	<b>1.1</b>	<b>0.0</b>	<b>3.2</b>	<b>0.0</b>	<b>0.0</b>	<b>5.4</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>0.0</b>	<b>1.0</b>	<b>1.2</b>	<b>0.0</b>	<b>0.3</b>	<b>0.0</b>	<b>0.0</b>	<b>1.0</b>	<b>7.7</b>	<b>0.0</b>	<b>2.3</b>
3rd Party	0%	0%	0%	0%	0%	0%	83%	91%	0%	100%	100%	0%	94%	67%	100%	0%	0%	0%	0%	0%	0%	83%	74%	43%
Equipment Failure	0%	0%	0%	50%	94%	0%	7%	1%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	16%	23%	13%
Operation	0%	0%	0%	50%	6%	100%	10%	8%	0%	0%	0%	0%	6%	33%	0%	0%	0%	0%	0%	0%	0%	1%	3%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	44%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>STAGE(12KV) - Customers: 120</b>	<b>101.7</b>	<b>1.0</b>	<b>0.0</b>	<b>71.7</b>	<b>0.1</b>	<b>1.0</b>	<b>9.3</b>	<b>0.1</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>96.0</b>	<b>0.1</b>	<b>0.0</b>	<b>0.8</b>	<b>0.0</b>	<b>0.0</b>	<b>24.6</b>	<b>0.1</b>	<b>1.0</b>	<b>121.4</b>	<b>0.2</b>	<b>1.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	100%	92%	0%	99%	85%	0%
Operation	0%	0%	0%	100%	100%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	100%	100%	0%	0%	8%	0%	1%	15%	0%
Other	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	100%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%



# Reliability Histories for Individual Circuits Serving Norwalk

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>STUDEBAKER(12KV) - Customers: 2,216</b>	<b>204.0</b>	<b>2.0</b>	<b>1.0</b>	<b>9.9</b>	<b>0.0</b>	<b>3.9</b>	<b>334.3</b>	<b>0.3</b>	<b>2.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>325.8</b>	<b>0.3</b>	<b>0.0</b>	<b>50.8</b>	<b>1.0</b>	<b>1.0</b>	<b>1.0</b>	<b>0.0</b>	<b>1.0</b>	<b>377.6</b>	<b>1.3</b>	<b>2.0</b>
3rd Party	2%	0%	0%	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	50%
Equipment Failure	98%	100%	100%	100%	100%	75%	7%	8%	0%	0%	0%	0%	100%	100%	0%	98%	99%	0%	0%	0%	0%	100%	99%	0%
Operation	0%	0%	0%	0%	0%	0%	3%	8%	0%	0%	0%	0%	0%	0%	0%	2%	1%	0%	100%	100%	0%	0%	1%	0%
Other	0%	0%	0%	0%	0%	25%	90%	84%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	50%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>TATTOO(12KV) - Customers: 909</b>	<b>0.1</b>	<b>0.0</b>	<b>0.0</b>	<b>12.6</b>	<b>0.0</b>	<b>2.0</b>	<b>224.4</b>	<b>1.7</b>	<b>0.2</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>216.5</b>	<b>1.3</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>216.5</b>	<b>1.3</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	0%	0%	0%	100%	100%	0%	97%	100%	100%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Operation	100%	100%	0%	0%	0%	0%	3%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	50%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>TEXAS(12KV) - Customers: 763</b>	<b>15.5</b>	<b>0.1</b>	<b>0.0</b>	<b>7.4</b>	<b>0.0</b>	<b>1.0</b>	<b>170.2</b>	<b>1.1</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>723.9</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>723.9</b>	<b>1.0</b>	<b>0.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Equipment Failure	100%	100%	0%	53%	56%	100%	69%	88%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	0%	0%	0%	100%	100%	0%
Operation	0%	0%	0%	47%	44%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	0%	0%	0%	0%	0%	0%	13%	9%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	18%	3%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
<b>TIGER(12KV) - Customers: 1,321</b>	<b>87.0</b>	<b>1.0</b>	<b>0.6</b>	<b>75.5</b>	<b>1.3</b>	<b>1.0</b>	<b>9.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>187.7</b>	<b>1.1</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>99.9</b>	<b>1.0</b>	<b>1.0</b>	<b>287.6</b>	<b>2.1</b>	<b>2.0</b>
3rd Party	0%	0%	0%	0%	0%	100%	40%	76%	0%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	50%
Equipment Failure	99%	100%	100%	100%	100%	0%	60%	24%	0%	0%	0%	0%	85%	94%	0%	0%	0%	0%	94%	97%	0%	88%	96%	0%
Operation	1%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	15%	6%	0%	0%	0%	0%	6%	3%	0%	12%	4%	0%
Other	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	0%	0%	50%
Vegetation/Animal	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%

# Reliability Histories for Individual Circuits Serving Norwalk

	2013			2014			2015			1st Qtr 2016			2nd Qtr 2016			3rd Qtr 2016			4th Qtr 2016			2016		
	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI	SAIDI	SAIFI	MAIFI
<b>TRAPPER(12KV) - Customers: 1,578</b>	<b>45.1</b>	<b>0.1</b>	<b>0.9</b>	<b>0.5</b>	<b>0.0</b>	<b>0.0</b>	<b>11.6</b>	<b>0.0</b>	<b>1.0</b>	<b>6.0</b>	<b>0.0</b>	<b>0.0</b>	<b>54.8</b>	<b>1.0</b>	<b>1.0</b>	<b>3.9</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>64.7</b>	<b>1.0</b>	<b>1.0</b>
3rd Party	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	100%	100%	100%	0%	0%	0%	0%	0%	0%	85%	99%	100%
Equipment Failure	23%	28%	0%	100%	100%	0%	100%	100%	0%	100%	100%	0%	0%	0%	0%	100%	100%	0%	0%	0%	0%	15%	1%	0%
Operation	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Other	77%	72%	100%	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Vegetation/Animal	0%	0%	0%	0%	0%	100%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%
Weather/Fire/Earthquake	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%	0%