




Raw Subsequences



Motif in TS

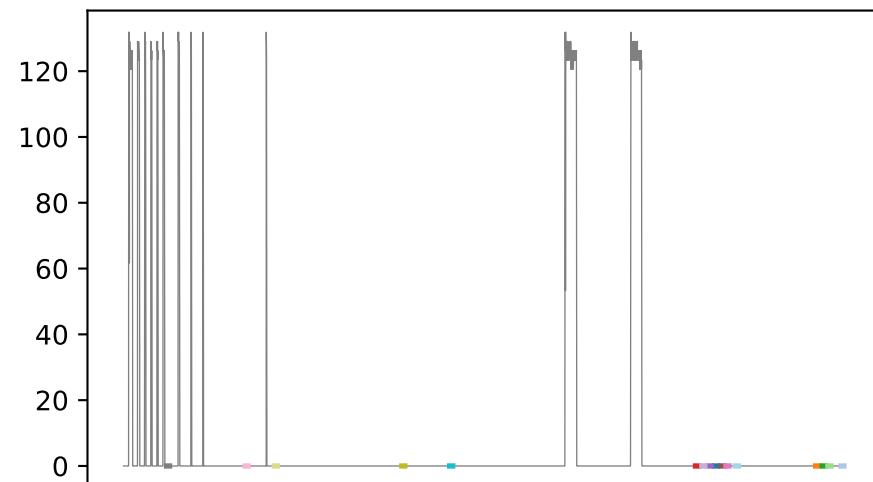

water_monitoring_outlet

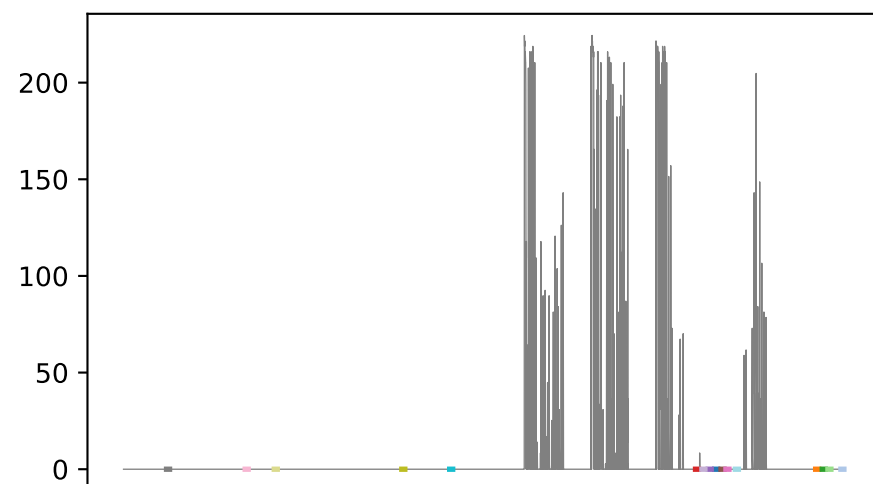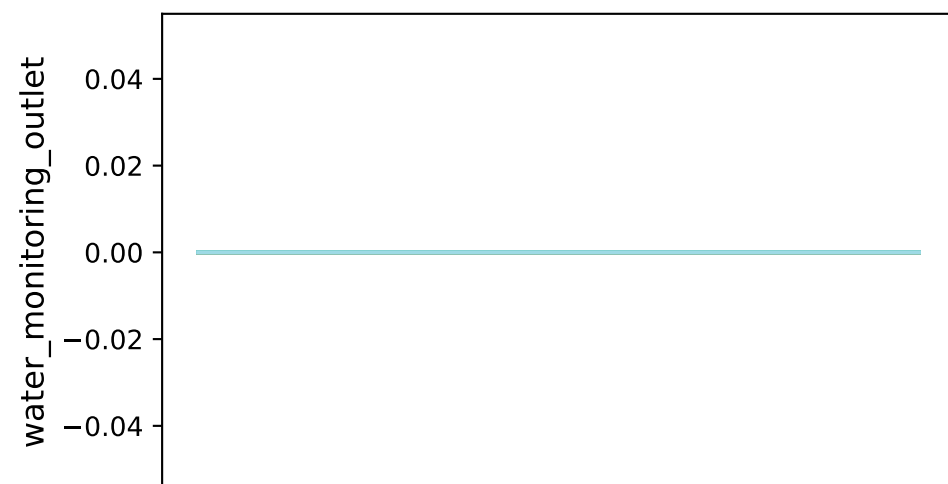

current

