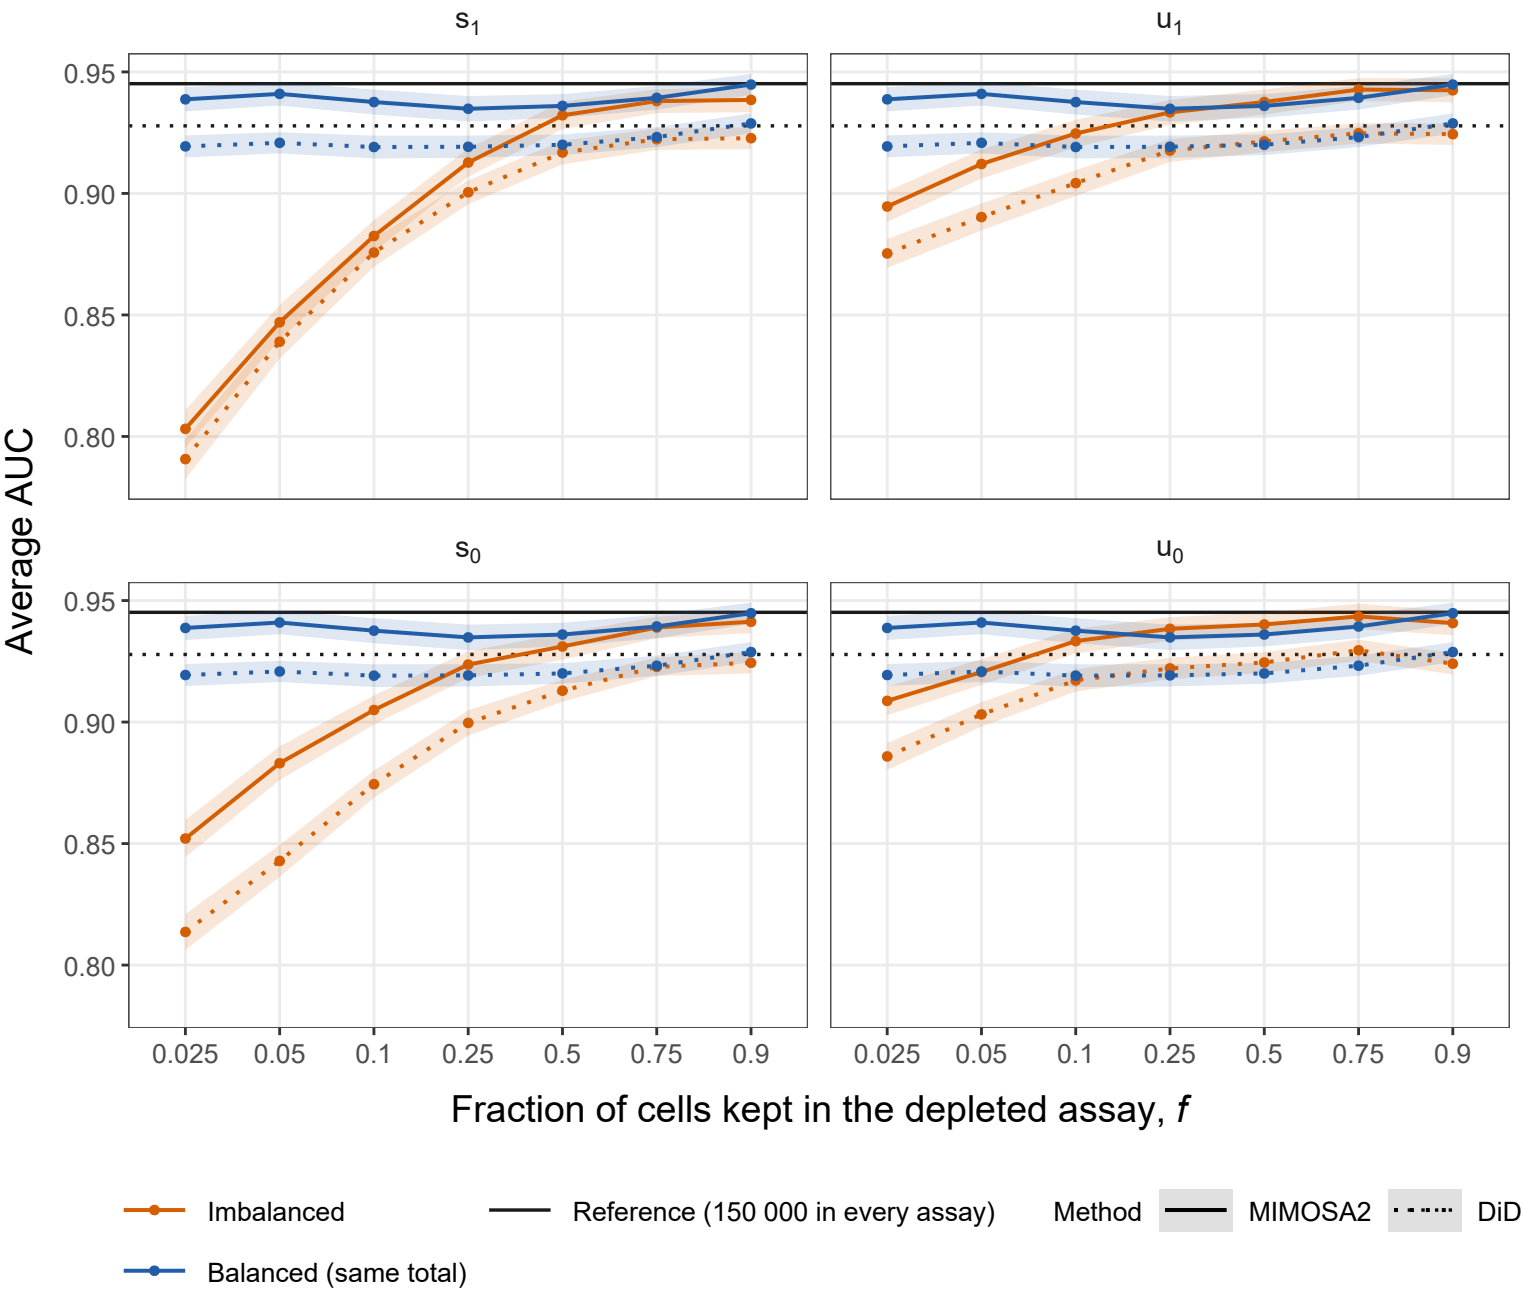
s_1
u_1
s_0
u_0
Average AUC
0.95
0.90
0.85
0.80
0.025
0.05
0.1
0.25
0.5
0.75
0.9
Fraction of cells kept in the depleted assay, *f*
Imbalanced
Balanced (same total)
Reference (150 000 in every assay)
Method
MIMOSA2
DiD