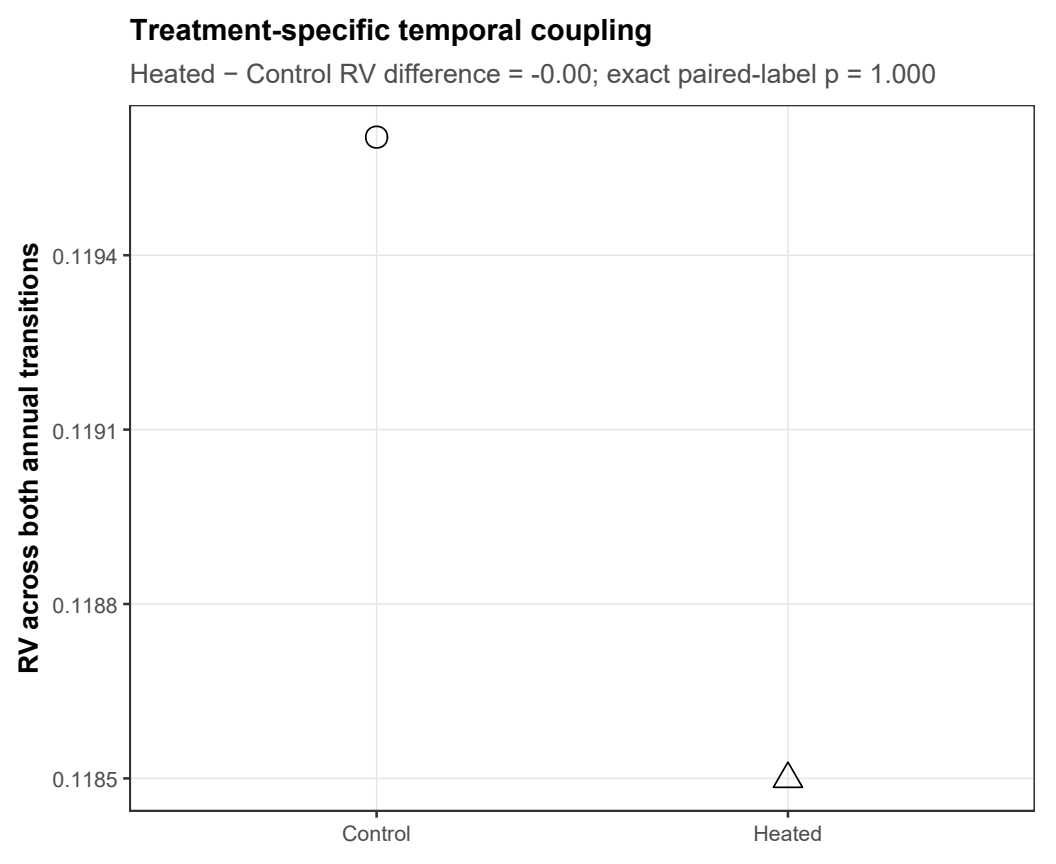
Treatment-specific temporal coupling
Heated − Control RV difference = -0.00; exact paired-label p = 1.000
RV across both annual transitions
0.1194
0.1191
0.1188
0.1185
Control
Heated