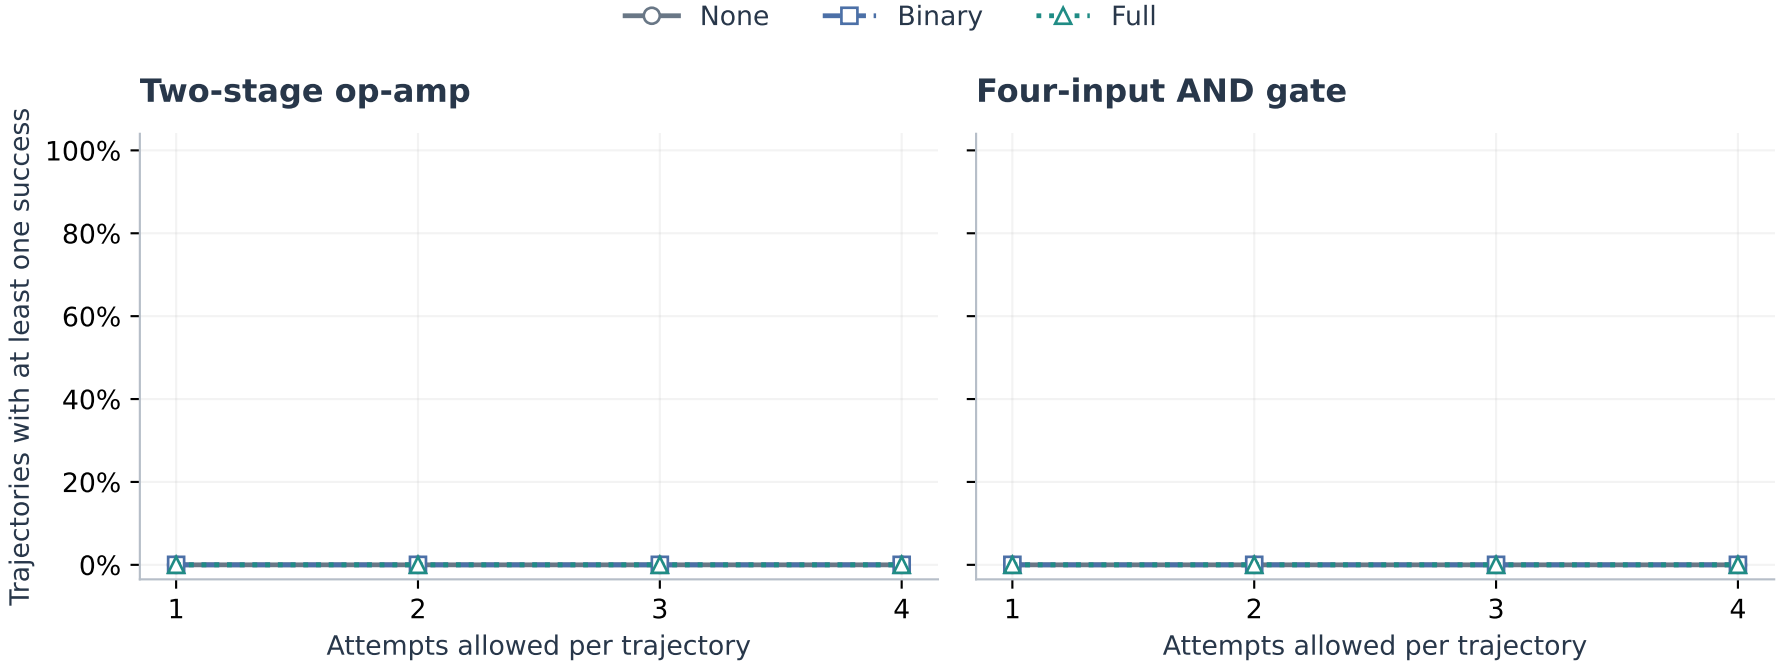

5 independent starts per circuit. Round 1 is shared across arms. Success requires physical validity and a negative detector verdict.