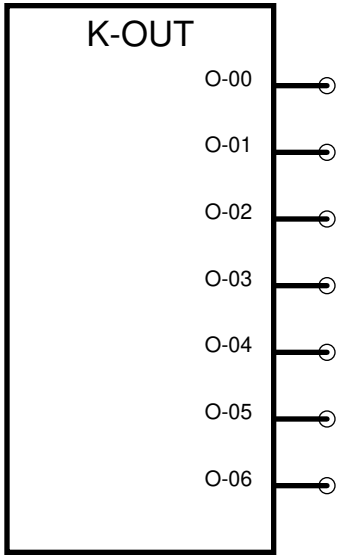
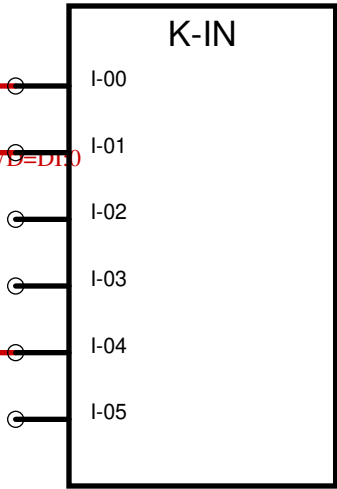



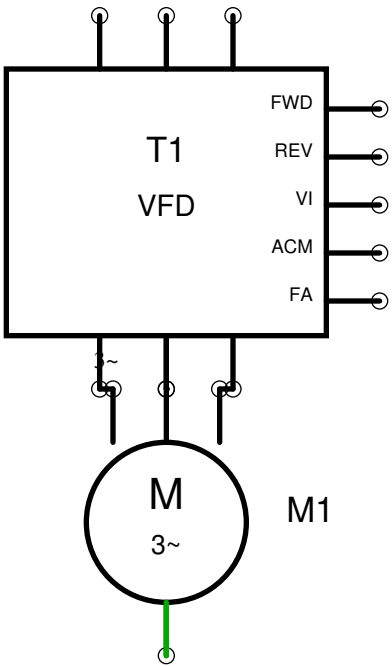


Notes:

1. DRIVE UNDERSIZED: GS11N-20P2 0.25HP/1.8A out vs motor 1HP/3.8A FLA -> overcurrent ceiling ~1.8A (drive), not 3.8A.
2. SUPPLY: 1-phase 200-240V per GS10 nameplate (DC bus ~320V). R/S/T landing + contactor NOT photographed.
3. CONFIRMED (not drawn - no RJ45 symbol): RS-485 Modbus RTU - Micro820 D+/D-/G <-> GS10 RJ45 (purple).
4. GAP: PLC outputs O-00..O-06 loads UNVERIFIED - no photo maps outputs to loads.
5. GAP: GS10 power terminals R/S/T (in) & U/V/W (out) UNVERIFIED - covered by caution label.
6. GAP: E-STOP dual-channel -> PLC inputs (I-02/I-03?) NOT label-confirmed - shown unwired.
7. GAP: Photo-eye PE-101 -> I-05 PROPOSED, not confirmed - shown unwired.

— control — power

CV-101 Garage Conveyor - Wiring Print (DRAFT)

FLM-WD-CV101 Rev A | IEC | 2026-07-02

MIRA (cited bench photos 2026-07-02)