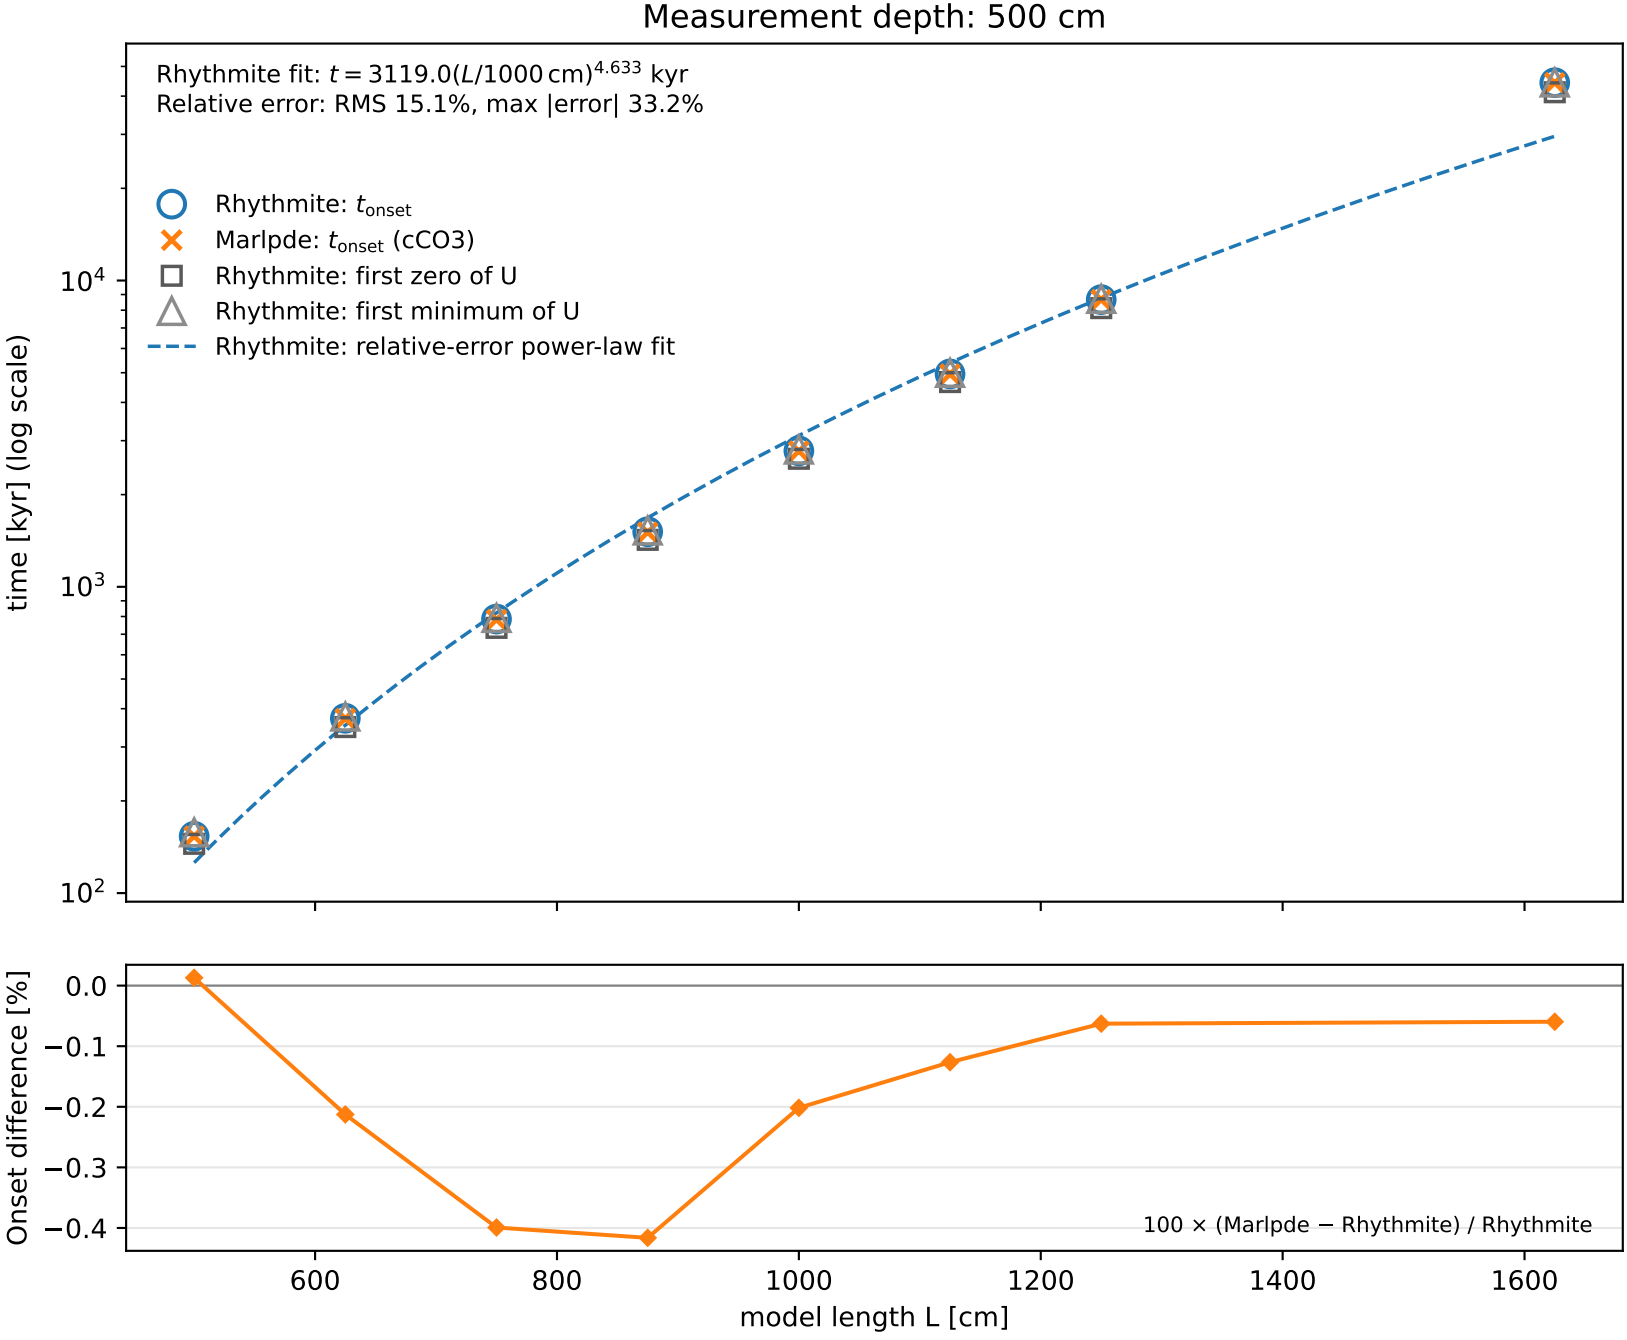
Measurement depth: 500 cm
Rhythmite fit: $t = 3119.0(L/1000\,\mathrm{cm})^{4.633}$ kyr
Relative error: RMS 15.1%, max |error| 33.2%
Rhythmite: t_{onset}
Marlpde: t_{onset} (cCO3)
Rhythmite: first zero of U
Rhythmite: first minimum of U
Rhythmite: relative-error power-law fit
time [kyr] (log scale)
10^4
10^3
10^2
Onset difference [%]
0.0
−0.1
−0.2
−0.3
−0.4
100 × (Marlpde − Rhythmite) / Rhythmite
600
800
1000
1200
1400
1600
model length L [cm]