

Operational effects of a mobile robot system for cleaning ventilation ducts

Wootae Jeong
Korea Railroad Research Institute
176 Railroad Museum road
Uiwang-si, Gyeonggi-do, Korea
+82-31-460-5817
wjeong@krri.re.kr

Seung-Woo Jeon
University of Science and Technology
Department of Virtual Engineering
Daejeon, Korea
+82-31-460-5267
swjeon@krri.re.kr

Duckshin Park
Korea Railroad Research Institute
176 Railroad Museum road
Uiwang-si, Gyeonggi-do, Korea
+82-31-460-5367
dspark@krri.re.kr

ABSTRACT

Eliminating various contaminants and particular matters accumulated inside the ventilation system of the confined space such as subway stations becomes key issue for conserving high air quality and green indoor environment. Accumulated various pollutants at inner duct surface can cause secondary air contamination and injure subway passengers' respiratory system and health. In fact, periodic duct cleaning works can improve indoor air quality, but cleaning entire ventilation system takes high cost and manpower. This study addresses the effectiveness of duct cleaning based on the developed autonomous duct cleaning robot. In particular, the new duct cleaning robot equipped with compliance rolling brushes enables to operate robot in a constant cleaning force to the target duct surface. Control method with the compliant device has also been analyzed. The proposed design of autonomous duct cleaning robot is expected to save the operating cost of subway ventilation system and sustain clean indoor air quality by providing easier and faster cleaning tools.

Categories and Subject Descriptors

I.2.9 [Artificial Intelligent]: Robotics – *autonomous vehicles, commercial robots and applications, kinematics and dynamics.*

General Terms

Algorithms, Measurement, Performance, Design, Experimentation.

Keywords

Compliance Device, Service Robot, Air Duct Cleaning, Air Quality, Force Control.

1. INTRODUCTION

The main purpose of the ventilation system and air duct is to supply fresh air into closed spaces such as buildings and subway stations where people work and spend most of their daily hours. The air duct and ventilation system controls various air flows, i.e., outdoor air, supply air, return air, and exhaust air as depicted in Figure 1. The ventilation system also consists of mechanical

components such as dampers, fans, filters, and duct terminals. Various particulate matters are initially filtrated with particle filters installed at the side of the supply air duct. The filters commonly used, however, are insufficient to prevent the entrance of all the particulate matters from outdoor air into the duct. Therefore, transported dust and other impurities are accumulated at the duct surface inside the ventilation system. Accumulated dust inside air duct may also originate from the facility construction phase or from ventilation duct installation [1].

To provide fresh and clean supply air through the ventilation system into the closed space such as subway stations, eliminating source for the pollutants and contaminants is the most cost effective than cleaning and replacement of the air duct. However, duct cleaning is essential for maintenance after completion of the ventilation system installation. Many countries have existing regulation and guideline for ventilation system cleaning intervals and specific guidelines of ventilation system cleanliness [2]. A few countries do not still provide legal regulation, which makes air quality from the ventilation system severely contaminated.

In this paper, various duct cleaning technologies are introduced and types of contaminants are analyzed. Based on the mechanical brushing technology, a new autonomous air duct cleaning robot has been designed to improve the cleaning efficiency and overcome restrictions of manual duct cleaning. In particular, in order to control constant brush pressure on the duct surface, a simple force compliance device is designed and installed at the brushing arm, which enables consistent cleaning operation despite of irregular duct surface quality.

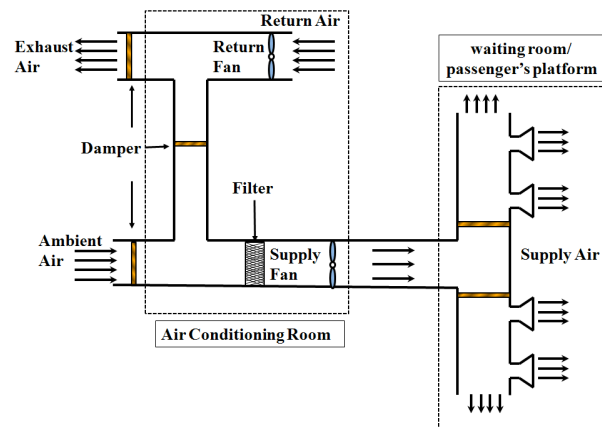


Figure 1. Air duct and ventilation system

Permission to make digital or hard copies of part or all of this work for personal or classroom use is granted without fee provided that copies are not made or distributed for profit or commercial advantage and that copies bear this notice and the full citation on the first page. Copyrights for third-party components of this work must be honored. For all other uses, contact the Owner/Author.

Copyright is held by the owner/author(s).

PETRA '13, May 29-31 2013, Island of Rhodes, Greece

ACM 978-1-4503-1973-7/13/05.

<http://dx.doi.org/10.1145/2504335.2504392>

2. CLEANING TECHNOLOGY

The ventilation system can be contaminated and acted as another source of pollutants, such as microbe, chemical compounds or odors, particulate matters. Accumulated dust and particulate matters inside duct can stick to the inner surface of duct and scatter by air stream of the air duct. Several cleaning technologies can be used to remove the dust and other contaminants effectively from the duct surface.

2.1 Contamination of duct

The estimated annual accumulation rate for dust in commercial supply air ducting is normally set at 1g/m^2 . However, an average accumulation level in supply air ducts of building occupied less than a year was 5.1 g/m^2 [1] while dust level in new constructions was measured as high as 4.9 g/m^2 [3,4]. In general, if dust accumulation on an inner duct surface exceeds $2\text{g}\sim 5\text{g/m}^2$ upon the class of ventilation system the duct has to be cleaned. Amount of dust accumulated inside duct is related to the types of facility, complexity of duct and its components and age of building. In addition, dust concentration is affected by factors that interrupt air flow of duct such as surface roughness, air velocity, humidity, number of dampers and diffusers installed.

Accumulation of dust also provides suitable conditions that microbes, bacteria and other microorganism can propagate. In fact, it has been reported that 400 times of penicillium and 9.5 times of aspergillus exists within 1 micro particulate matter [5]. In addition, amount of fungi in contaminated indoor air is 10 times higher than that of outdoor air. Many other particulate matters accumulated at a duct terminal may cause secondary infection or contamination of indoor air through the air supply duct.

Table 1: Summary of duct cleaning techniques

Cleaning Techniques		Description
Dry method	Mechanical brushing	A brushing or mechanical action is used to dislodge dust from surfaces and transferred to a vacuum collector. The most commonly used method.
	Compressed air cleaning	Dust is dislodged from surfaces using airflow movement and collected using a vacuum collector.
	Vacuuming	Suction and brushing using a brush head to transfer dirt to a collection point.
Wet method	Hand washing	Cleaning components surfaces by hand using tools such as brushes, sponges and a source of water with a cleaning agent.
	Water jet spray	Liquid solutions are sprayed or wet-fogged to adhere, bond, or fiber-fixed particles that were not removed mechanically.
	Chemical disinfection	The use of biocides and sealants to coat and encapsulate duct surfaces.

2.2 Cleaning technologies

The air duct cleaning methods can be either dry or wet [6]. The most commonly used dry duct cleaning methods are mechanical brushing, compressed air cleaning and vacuuming. Dry cleaning methods use a rotating brush, a powerful air jet or a suction force to detach the dust from the duct surface mechanically. The loose dust is carried out of duct by airflow. Wet cleaning methods include water jet or chemically sterilizing process to eliminate microorganism and bacteria. However, wet cleaning methods are seldom used to clean air ducts because the ductworks are not normally watertight. To remove accumulated dust and oil in duct, mechanical brushing is faster and more effective than compressed air cleaning. Cleaning methods are summarized in Table 1.

In this study, we have focused on mechanical brushing method with autonomous cleaning robot to improve cleaning efficiency for all types of contaminants. As illustrated in Figure 2, the air duct cleaning robot system also utilizes the push-pull technique; the rotating brush removes dust and debris from the inner surface of the duct. The dust is then drawn into a negative collector. Compressed air is often used to push the dust and debris.

3. DESIGN OF A DUCT CLEANING ROBOT

Increased interests in air duct cleaning technology stimulate development of various duct cleaning robots. Most of duct cleaning robots is based on the dry cleaning method with mechanical brush.

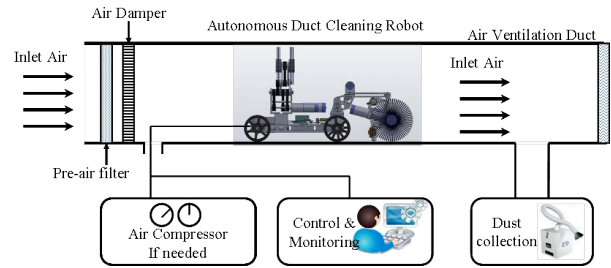


Figure 2. Duct cleaning system

As an example, the Articulated Nimble Adaptable Trunk (ANAT) robot has been developed to clean and inspect HVAC ducts. The ANATROLLER ARI-100 duct cleaning robot rolls on tracks or wheels and will continue to operate even if flipped upside down. It is composed of two modules containing the air jet, lighting and camera rotates through 180 degrees, which allows the robot to change its shape to get around or over obstacles [7]. However, the ARI-100 still needs manpower to operate.

The XPW-series duct cleaning robot is of height adjustable rotary brush and rotating camera for inspection and remote control. Its rotary brush mounted at machine bed is oscillatable within a prescribed angle range in a vertical direction [8].

Recently developed cleaning robots can be fitted with spinning brushes, directional air nozzles and whips, sampling devices, and spraying attachments for spraying sanitizing solutions for various coatings.

In this research, the duct cleaning robot designed will be unique in its functionality and usability. Based on the initial prototype model [9], the robot used in this research has been recently upgraded in its brushes, cleaning power and working mechanism. In addition, three force compliance device with 1 DOF(degree of freedom) were newly installed at the end effector of the robot brush arm. Since the compact compliance device can recognize the pressure between brush and duct surface, the robot brushes can clean up the surface as a constant pressure even if the cleaning surface is of irregularity.

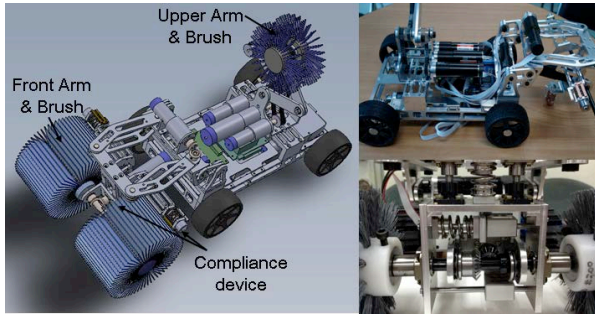


Figure 2: Duct cleaning robot with rotary brush arms

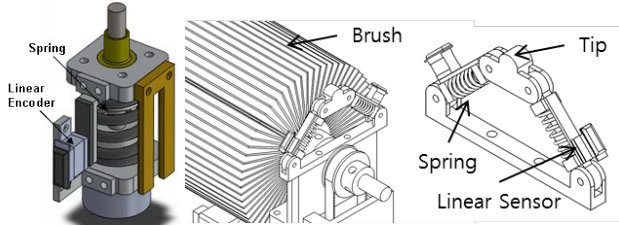


Figure 3: Single DOF and two DOF compliance device

3.1 Autonomous mobile duct cleaning robot

A recently upgraded duct cleaning robot is depicted in Figure 3. The robot consists of a base body, four rubber tire wheels, a camera module, LED light and two brush arms; front and low arm. Seven motors have been used to provide proper torques for ductworks. The continuous tracked wheels of previous model have been exchanged to four tires by considering various obstacles such as screws or pins on duct surface, but also to reduce weight of the robot platform [10].

The lower brush arm is attached at the front of platform body and the upper brush is located at the end effector of the upper arm. The upper arm with R-R-P joints is height adjustable for handling various duct sizes.

The compact force compliance device is installed between two cylindrical rotary brushes at the end of the upper arm. The compliance device consists of two springs and linear sensors to read deflection of the spring. The two springs are connected each other at the end point to read two directional force. The brush and compliance device are depicted in Figure 4.

3.2 Brush force control

The compliance device attached at the end of the upper arm enable robot arm to detect force between brush and surface of duct, which make it possible to control the constant pressure. Figure 5 presents a model of force compliance brush illustrated in Figure 4. Figure 5(a) represent a model when the brush is contacting only with the upper surface of duct, and Figure 5(b) shows that the brush is contacting at two points, i.e., upper and side surface of duct. During the brush is under pressure, normal force and tangential force are acting on the compliance device.

The force acting on the compliance device can be simply calculated by using spring constant K , which is given by

$$F_a = K_a \cdot \Delta x_a, \quad (1)$$

$$F_b = K_b \cdot \Delta x_b \quad (2)$$

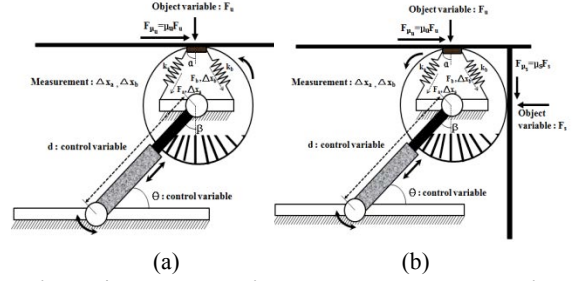


Figure 4: Force compliance brush models; one point contacting model(a) and two points contacting model(b).

where Δx is a spring deformation and K is a spring constant. The two spring constants are identical when same spring is used. It should be noted that the deformation of spring (Δx) is a nonlinear because the stiffness of brush is, in general, empirically derived and deflection of brush is also affected by many factors such as bristle modulus, the number of tufts, and the trim length of bristles [11]. Therefore, value of the Δx has to be found by calculating the stiffness of brush empirically.

Assuming that 2α is the angle between two springs each other, the forces acting on the brush are calculated as

$$F_u = F_a \cos \alpha + F_b \cos \alpha = (F_a + F_b) \cos \alpha, \quad (3)$$

$$F_{\mu_u} = F_b \sin \alpha - F_a \sin \alpha = (F_b - F_a) \sin \alpha \quad (4)$$

where F_{μ_u} is a normal force action on the brush from the upper surface. The friction force can be written as $F_{\mu_u} = \mu_u F_u$

When the rotary brush is contacting at two surfaces as shown in Figure 5(b), the force equilibrium equation from Eq.(3) and (4) can be rewritten as

$$\text{Horizontal: } \mu_u F_u - F_s = (F_b - F_a) \sin \alpha, \quad (5)$$

$$\text{Vertical: } F_u + \mu_s F_s = (F_a + F_b) \cos \alpha, \quad (6)$$

where F_s is a normal force between the brush and side surface and μ_s is a dynamic friction coefficient at side surface of duct. Finally, the cleaning forces acting on the surfaces can be controlled with the designed compliant devices.

3.3 Control scheme of robot system

In addition to control the cleaning pressure of the upper arm brush, it is required to control the driving motion of the mobile platform. The mobile platform can be either controlled by joystick or automatically by using ultrasonic sensors to adjust position and orientation of the robot platform. The overall control scheme is shown in Figure 6.

The CCD camera and LED light enables operators to monitor and control the system manually if needed. Thus, the duct cleaning robot can be controlled automatically or manually through the user interface system.

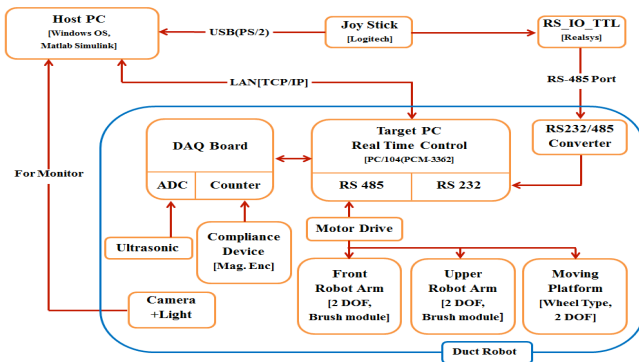


Figure 6. Control scheme of the duct cleaning robot

3.4 Experimental results

The duct cleaning process has been conducted with test-bed ventilation duct system. Deposit thickness test(DTT) and vacuum test(VT) have been used to measure the thickness and weight of dust before and after cleaning with the developed robot system.

The thickness of dust has reduced about 50% after cleaning the duct surface. Since the thickness of accumulated dust in this experiment was very thin (< micrometer), the measured thickness was relatively dependent on the measured location of the inner duct surface. Table 2 shows results of dust weight before cleaning and Table 3 summarized the VT results after cleaning with the designed cleaning robot.

Table 2. Vacuum test results of a sampled railway station

Location	N	Vacuum Test (g/m^2)			p-Value
		Mean	SD	Range	
HVAC Room	10	4.59	1.41	1.90-6.81	0.478
Waiting Room	10	5.43	2.57	2.66-11.06	
Platform	8	4.45	1.28	2.94-6.09	

Table 3. Vacuum Test (VT) results

	1 st point Measure			2 nd point measure		
	Before	After	Rate(%)	Before	After	Rate(%)
Weight(mg)	27.2	2.3	91.5%	25.1	0.1	99.6%
Weight(g/m^2)	2.72	0.23	91.5%	2.51	0.01	99.6%

4. CONCLUSIONS

Duct cleaning works has been conducted manually by human. Converting it to automatic cleaning device requires very sophisticated design of the cleaning device and control.

In this study, a new type of duct cleaning robot has been designed and prototyped. In particular, the robot has tested on the test-bed duct facility without manual cleaning process. For more dedicated control of brush pressure, the stiffness of brush should be empirically achieved. The adjustable arm brush can make it possible to use in different size of ducts.

However, there exists more room for improvement, especially on the autonomous cleaning process under real harsh duct system. In a real ductwork, there are many components at the inner duct such as dampers, fans, joints and curves that make it difficult to operate the robot consistently and autonomously. Use of sensors is also very limited to the closed space of metal-based duct frame. Therefore, more intelligent operating system has to be implemented to improve the cleaning process effectively. The developed prototype robot will be continuously upgraded and tested at the test-bed of air duct terminal.

5. ACKNOWLEDGMENTS

This research was carried out as a part of the subway air duct cleaning robot project (Eco-Innovation, No. E211-40002-0003-0) funded by the Ministry of Environment and the subway air quality improvement project from the Ministry of Land, Infrastructure and Transport in Korea.

6. REFERENCES

- [1] Pasanen, P. 1998. Emissions from the filters and hygiene of air ducts in the ventilation systems of office buildings. Doctoral dissertation, Department of Environmental Sciences, University of Kuopio, Kuopio, Finland.
- [2] Finnish Society of Indoor Air Quality and Climate (FiSIAQ). 2001. Classification of indoor climate 2000, Espoo, Finland.
- [3] Holopainen, R., Tuomainen, M., Asikainen, V., Pasanen, P., Säteri, J. and Seppänen, O. 2002. The effect of cleanliness control during installation work on the amount of accumulated dust in ducts of new HVAC installations, *Indoor Air*, 12, 191-197.
- [4] Holopainen, R., Asikainen, V., Tuomainen, M., Björkroth, M., Pasanen, P. and Seppänen, O. 2003. Effectiveness of duct cleaning methods on newly installed duct surfaces, *Indoor Air*, 13, 212-222.
- [5] Morey, P.R. 1988. Experience on the contribution of structure to environmental pollution. In R. B. Kundisin (ed.), *Architectural design and indoor microbial pollution*. Oxford University Press, New York: 40-79.
- [6] HVCA, 1998. Cleanliness of Ventilation System, Guide to Good Practice Cleanliness of Ventilation Systems. Heating and Ventilating Contractors' Association, London, HVCA Publications.
- [7] Robotics Design, ANATROLLER ARI-100, Canada. DOI = <http://www.roboticsdesign.qc.ca/mobile-robots>.
- [8] Hanlim Mechatronics Co. Ltd., XPW-601 Duct Robot, Korea. DOI = <http://www.ductrobot.com>.
- [9] Jeong, W., Jeon, S., Park, D. and Kwon S., 2012. Force Control of a Duct Cleaning Robot Brush Using a Compliance Device, In *Proceedings of the ICINCO 9th Int. Conference on Informatics in Control, Automation and Robotics* (Rome, Italy, July 28 - 31, 2012).
- [10] Wang, Y. and Zhang, J., 2006. Autonomous Air Duct Cleaning Robot System, *Proc. of International Midwest Symposium on Circuits And System*, pp. 510-513, 2006
- [11] Rawls, H.R., Mkwai-Tulloch, N.J. and Krull, M. E., 1990. A mathematical model for predicting toothbrush stiffness. *Dental Materials*, Vol. 6(2), pp. 111-117