

- .

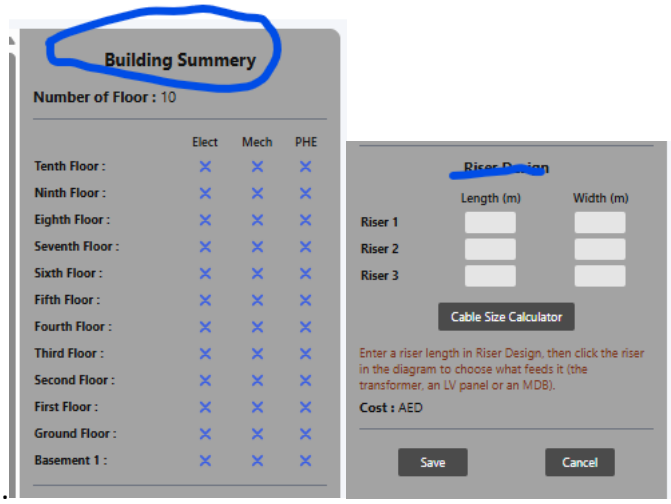



- UPS object is missing;
- Under Earth Leakage Drop Down Menu – include 100mA, ELS+Alarm; 0-300mA ELS+Alarm; 0-500mA ELS+Alarm

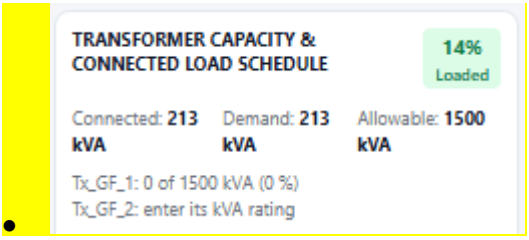


- i still havent connected any loads but it is showing the allowable

- Starter Drop Down Menu is missing;
- For Isolators, the display tag should include the current rating, TP/SP, and equipment fed and the source feeding the isolator;

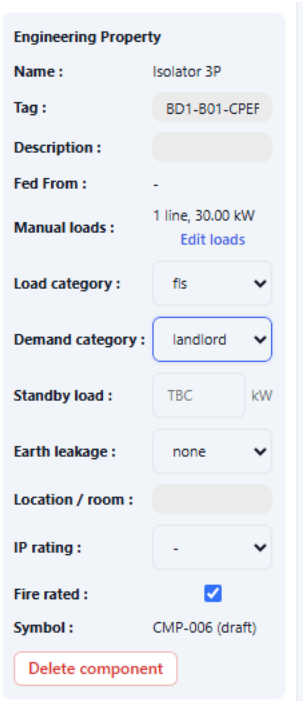
- 

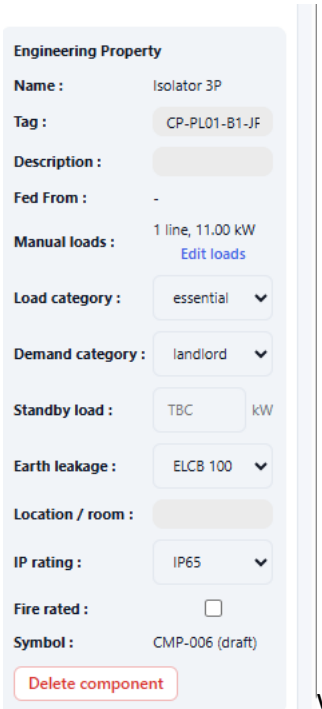For FLS items, we need to include check boxes to identify if it will run during: 1.Normal mode; 2.power failure mode; 3. Fire Mode – this will be required to assess whether this equipment should be included in the transformer load estimate & generator load estimate (power failure & fire mode);
- 


when I choose FLS load – fire rated check box automatically ticks but when I change the load category back to essential it doesn't uncheck;

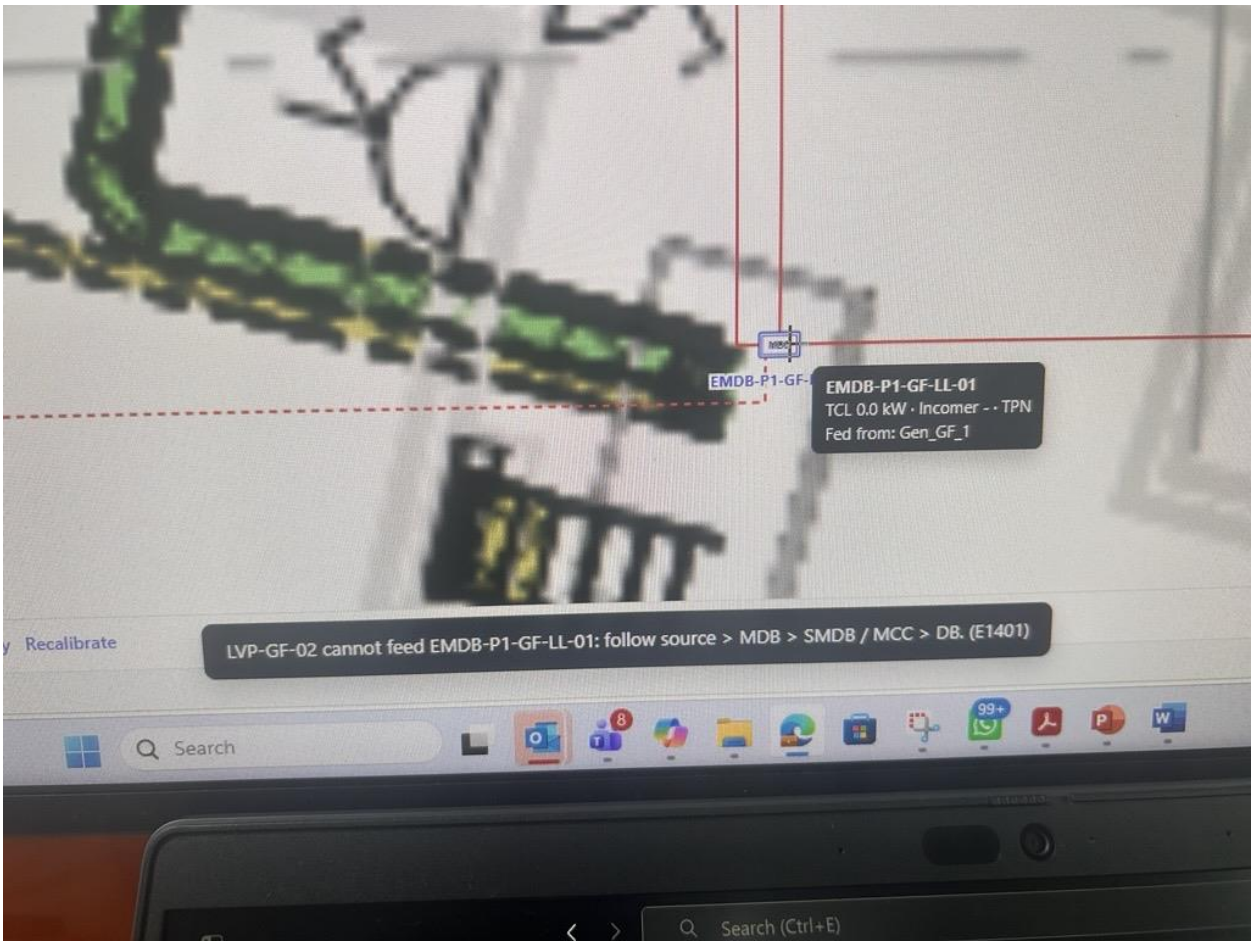

This rule is incorrect; LV Panel can feed EMDB

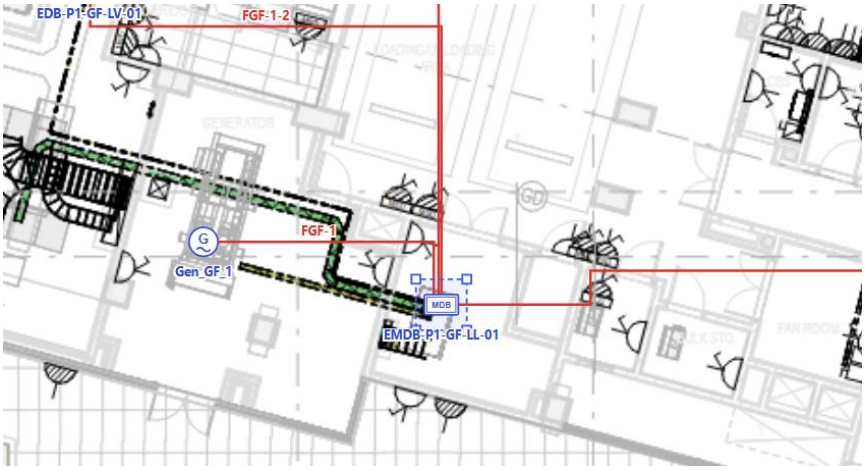

If I want to change this EMDB to ESMDB – the option should be available without deleting all the feeders connecting the upstream & downstream panels/loads;

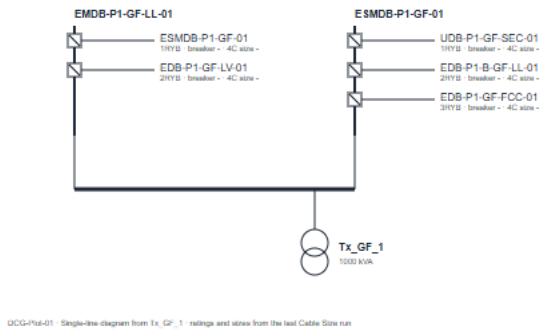

Schematic representation is incorrect; Tx & Gen both are feeding EMDB -> ESDMD -> EDB & UDB



This view should show the MDB's, EMDB's, ESMDB's for connecting the panels in other floors;