

a) UCB: Group−Level Patterns

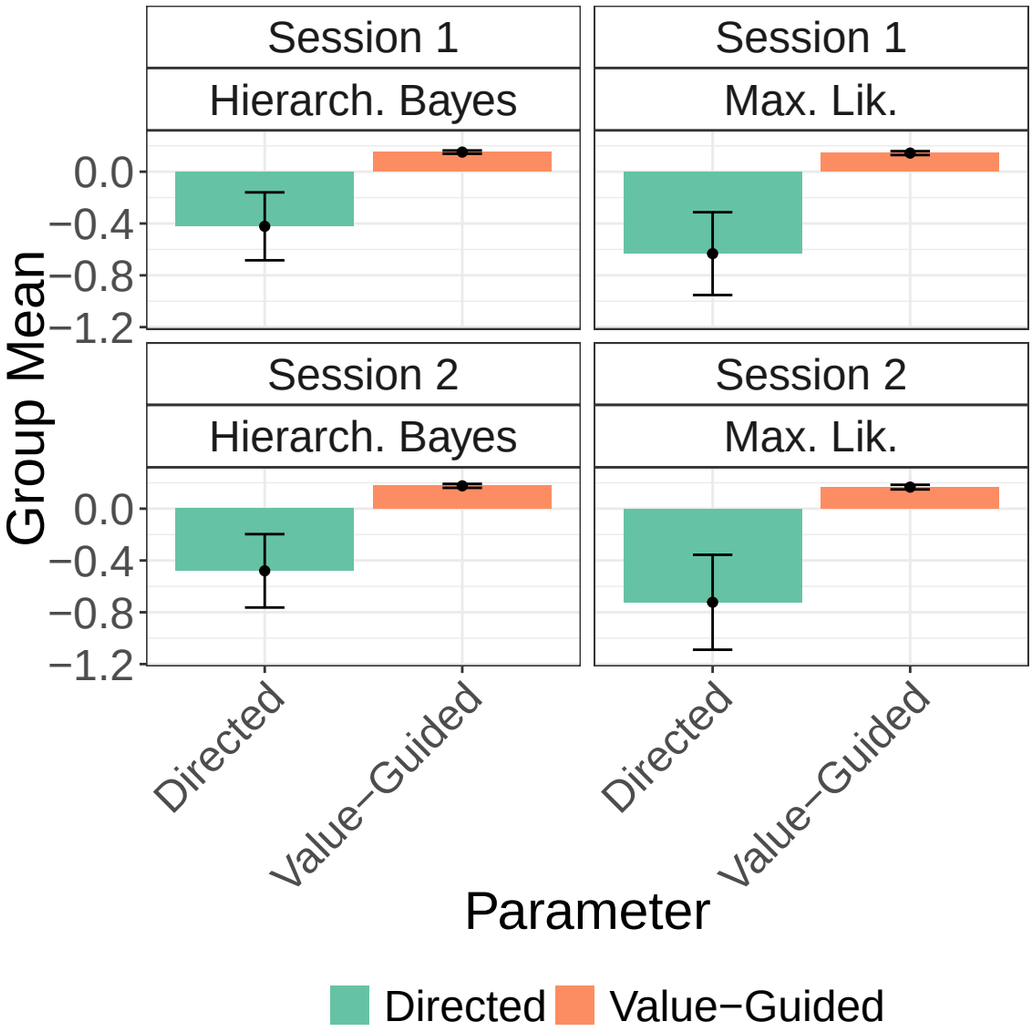

b) UCB: Indiv. Param.

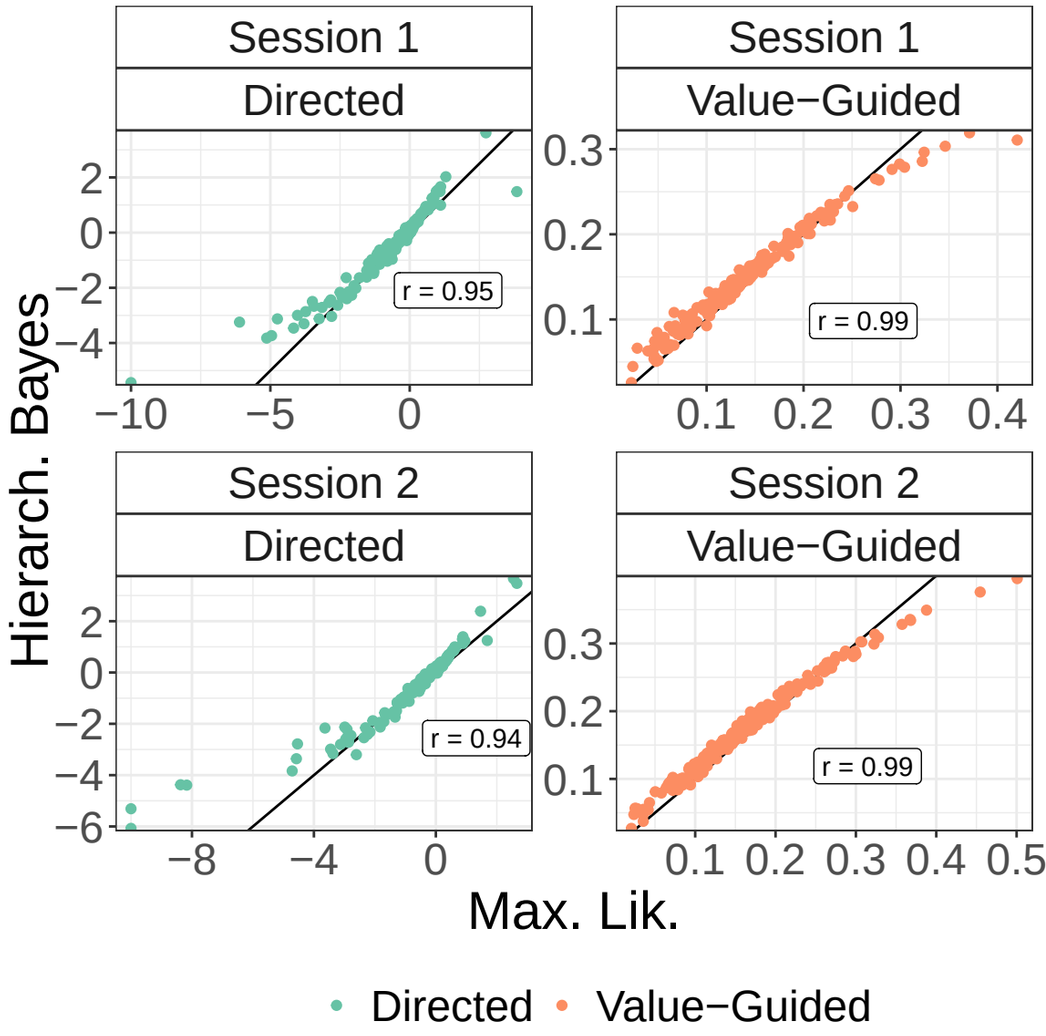

c) Reliability

	Parameter	Method	Reliability
1	Directed	hcb	0.52
2	Directed	ml	0.40
3	Value−Guided	hcb	0.48
4	Value−Guided	ml	0.43

d) Value−Guided: Indiv. Param.

