Finding more resistance brings more false alerts

Cutoffs chosen on validation, then applied unchanged to test | counts per 1,000 candidate test rows

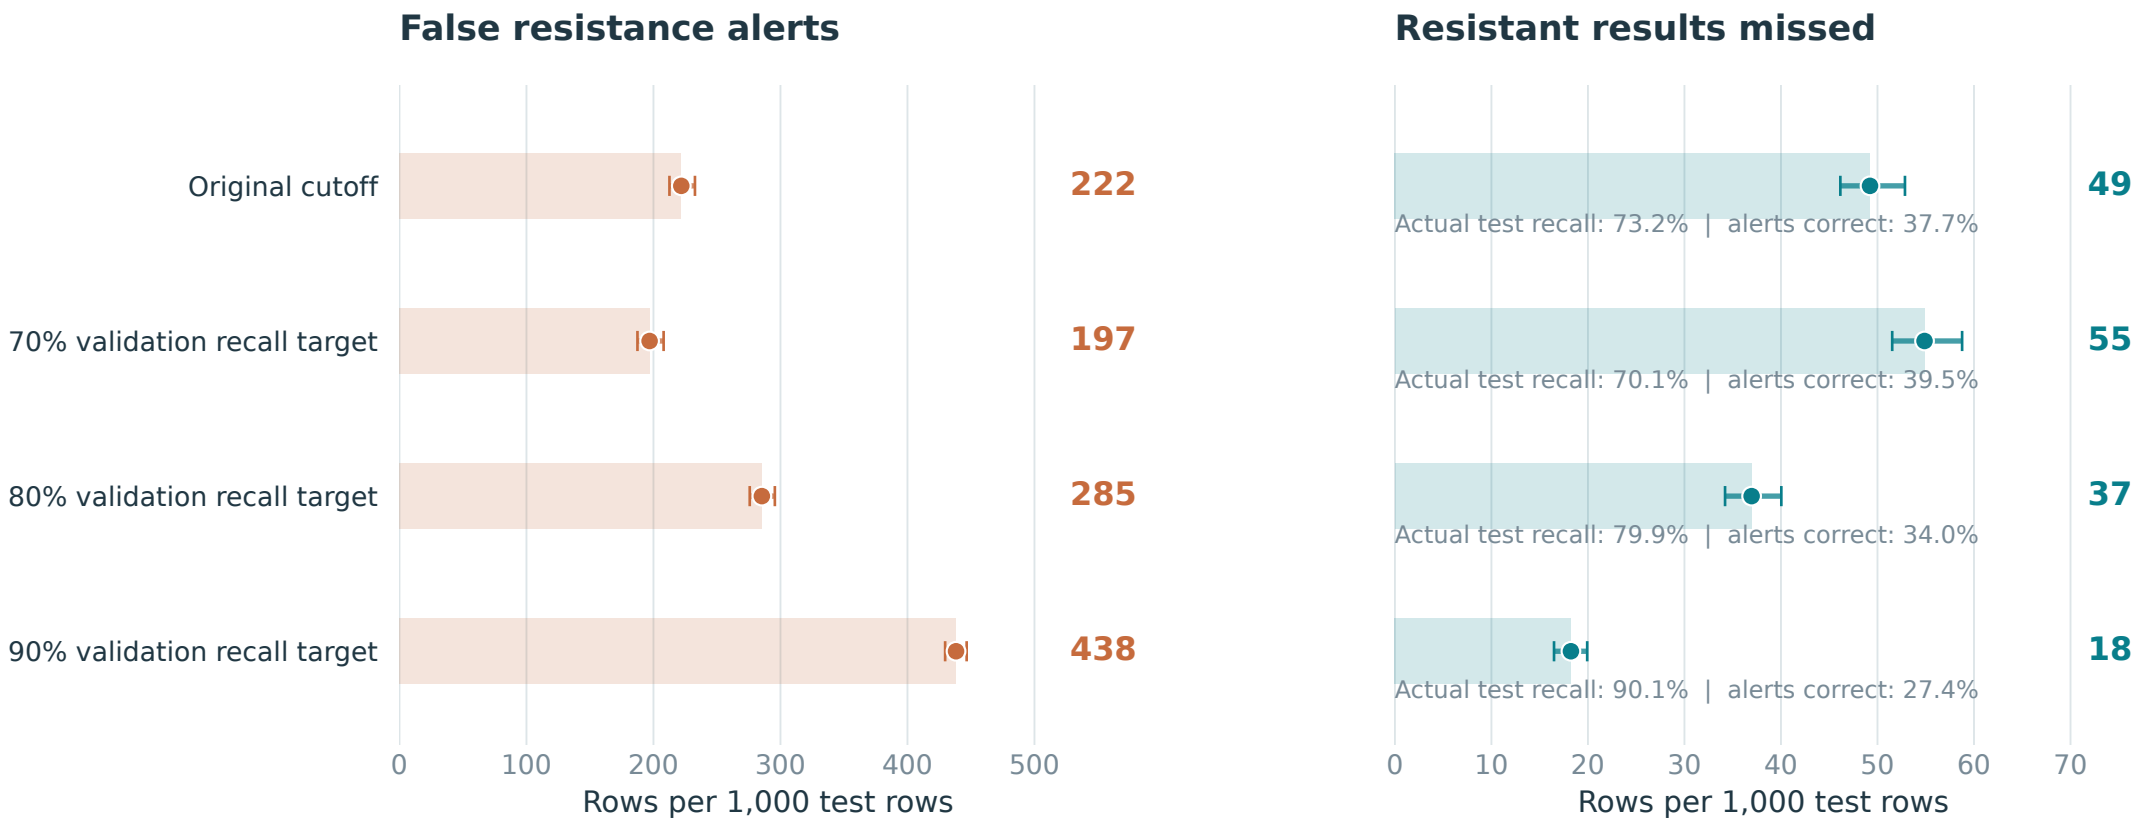

False alerts are susceptible rows flagged as resistant. Misses are resistant rows flagged as susceptible. Lines are 95% patient-bootstrap intervals.
Targets describe validation recall; actual test recall may differ. These retrospective operating points are not clinical treatment rules.