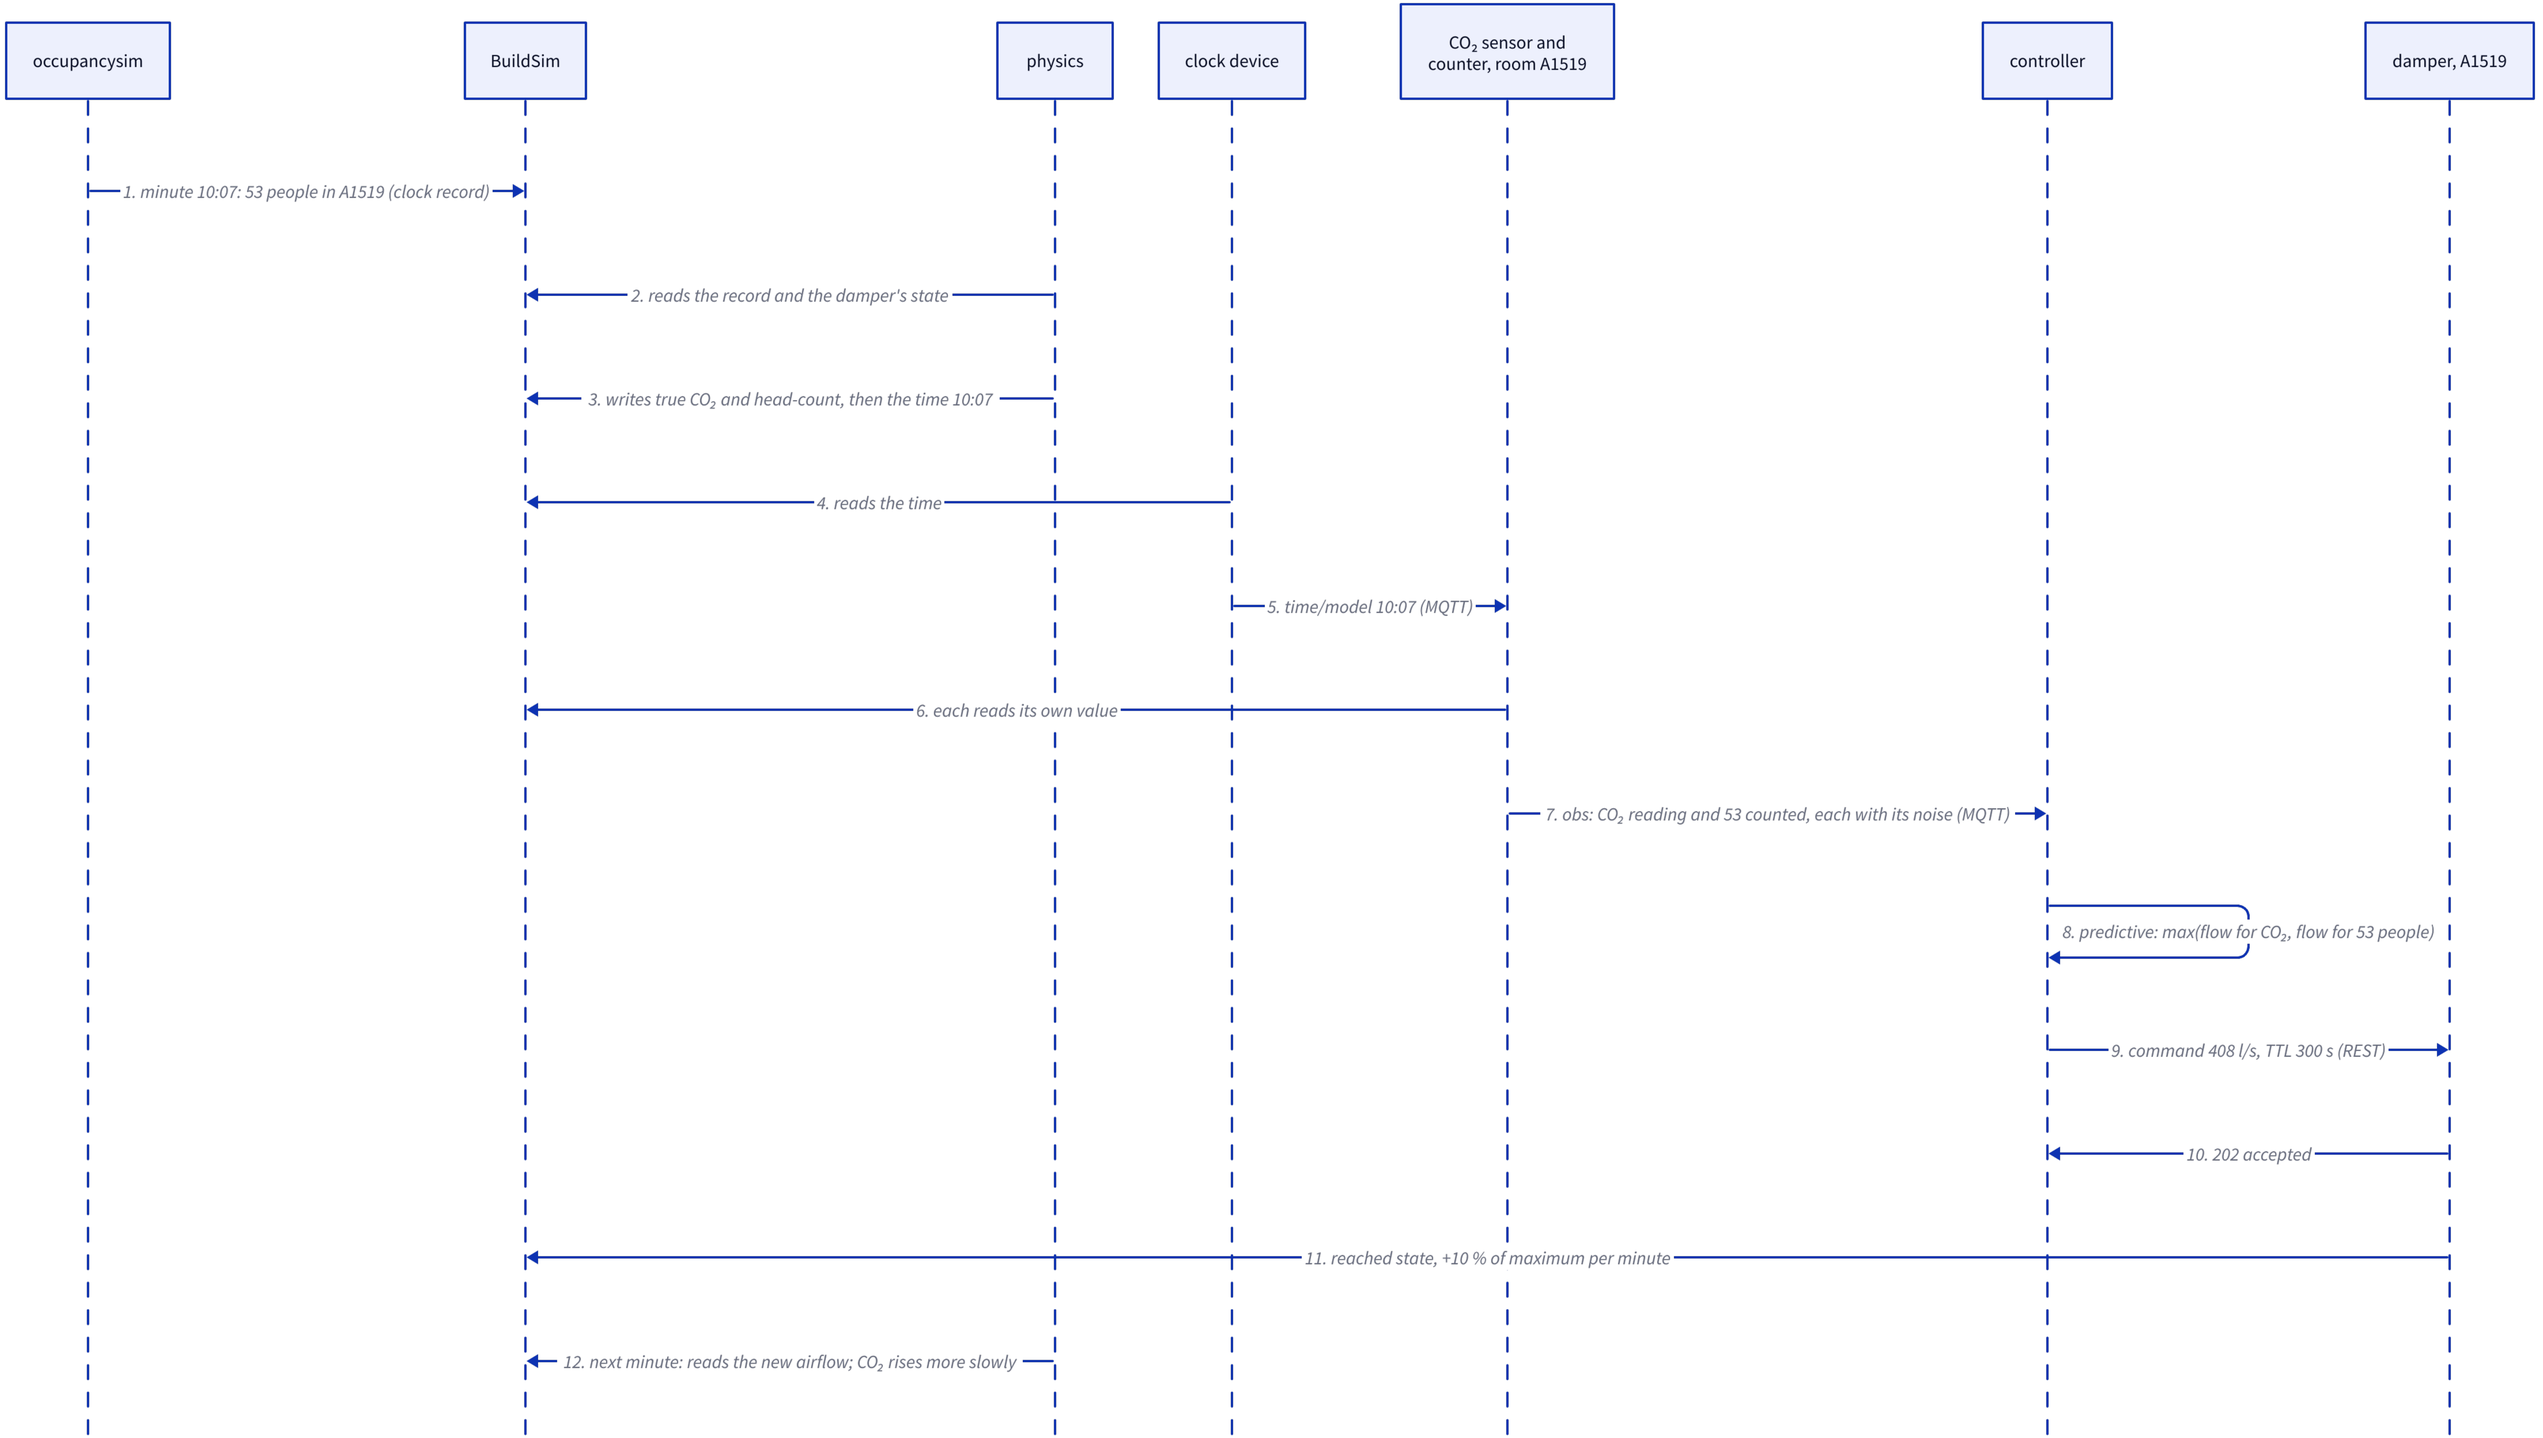

occupancysim
BuildSim
physics
clock device
CO2 sensor and counter, room A1519
controller
damper, A1519
1. minute 10:07: 53 people in A1519 (clock record)
2. reads the record and the damper's state
3. writes true CO2 and head-count, then the time 10:07
4. reads the time
5. time/model 10:07 (MQTT)
6. each reads its own value
7. obs: CO2 reading and 53 counted, each with its noise (MQTT)
8. predictive: max(flow for CO2, flow for 53 people)
9. command 408 l/s, TTL 300 s (REST)
10. 202 accepted
11. reached state, +10 % of maximum per minute
12. next minute: reads the new airflow; CO2 rises more slowly