

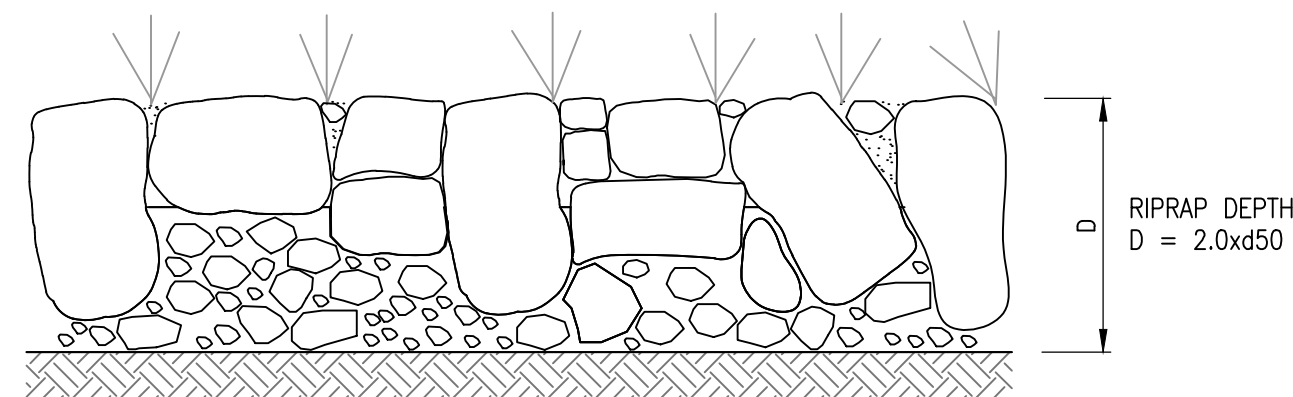
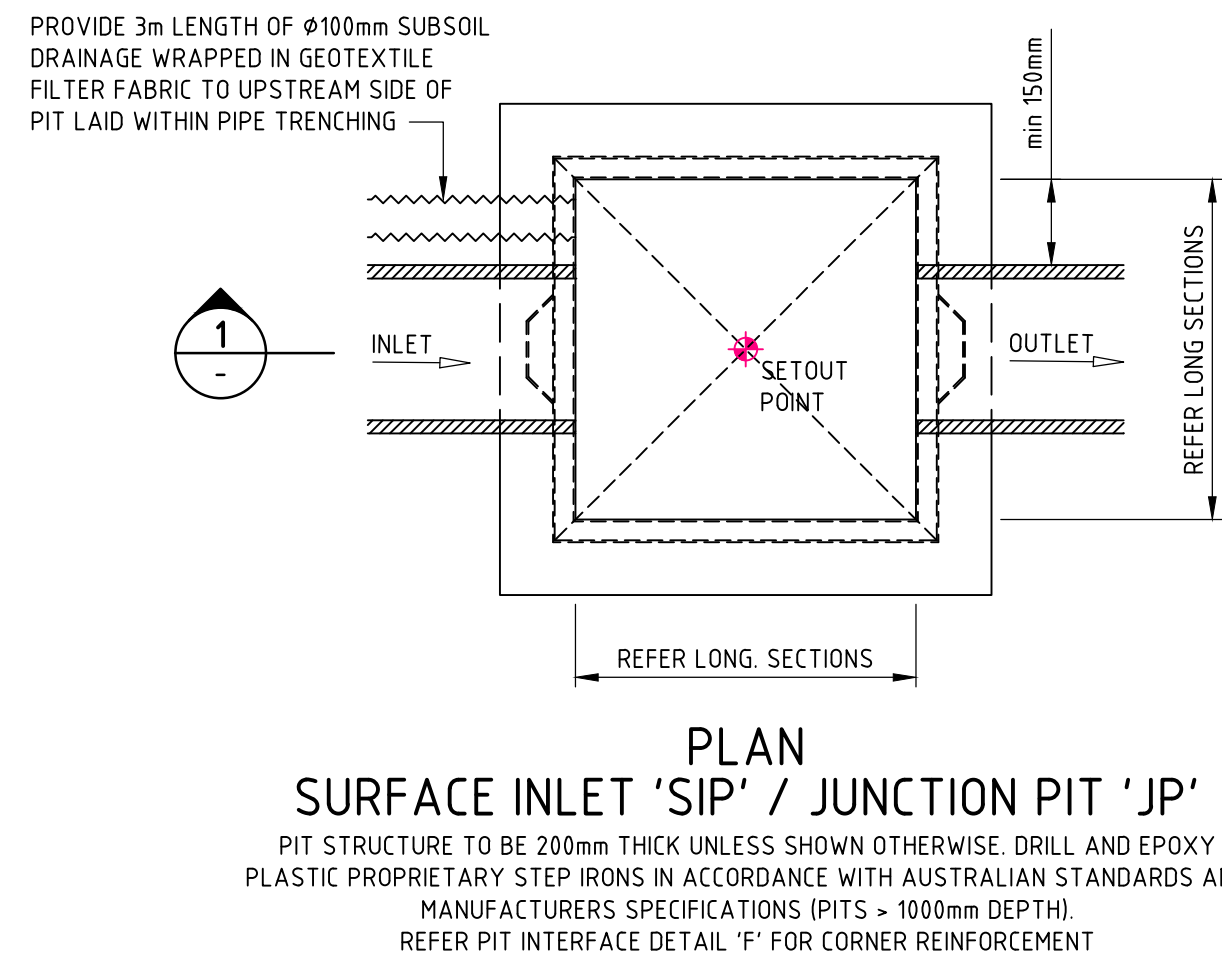
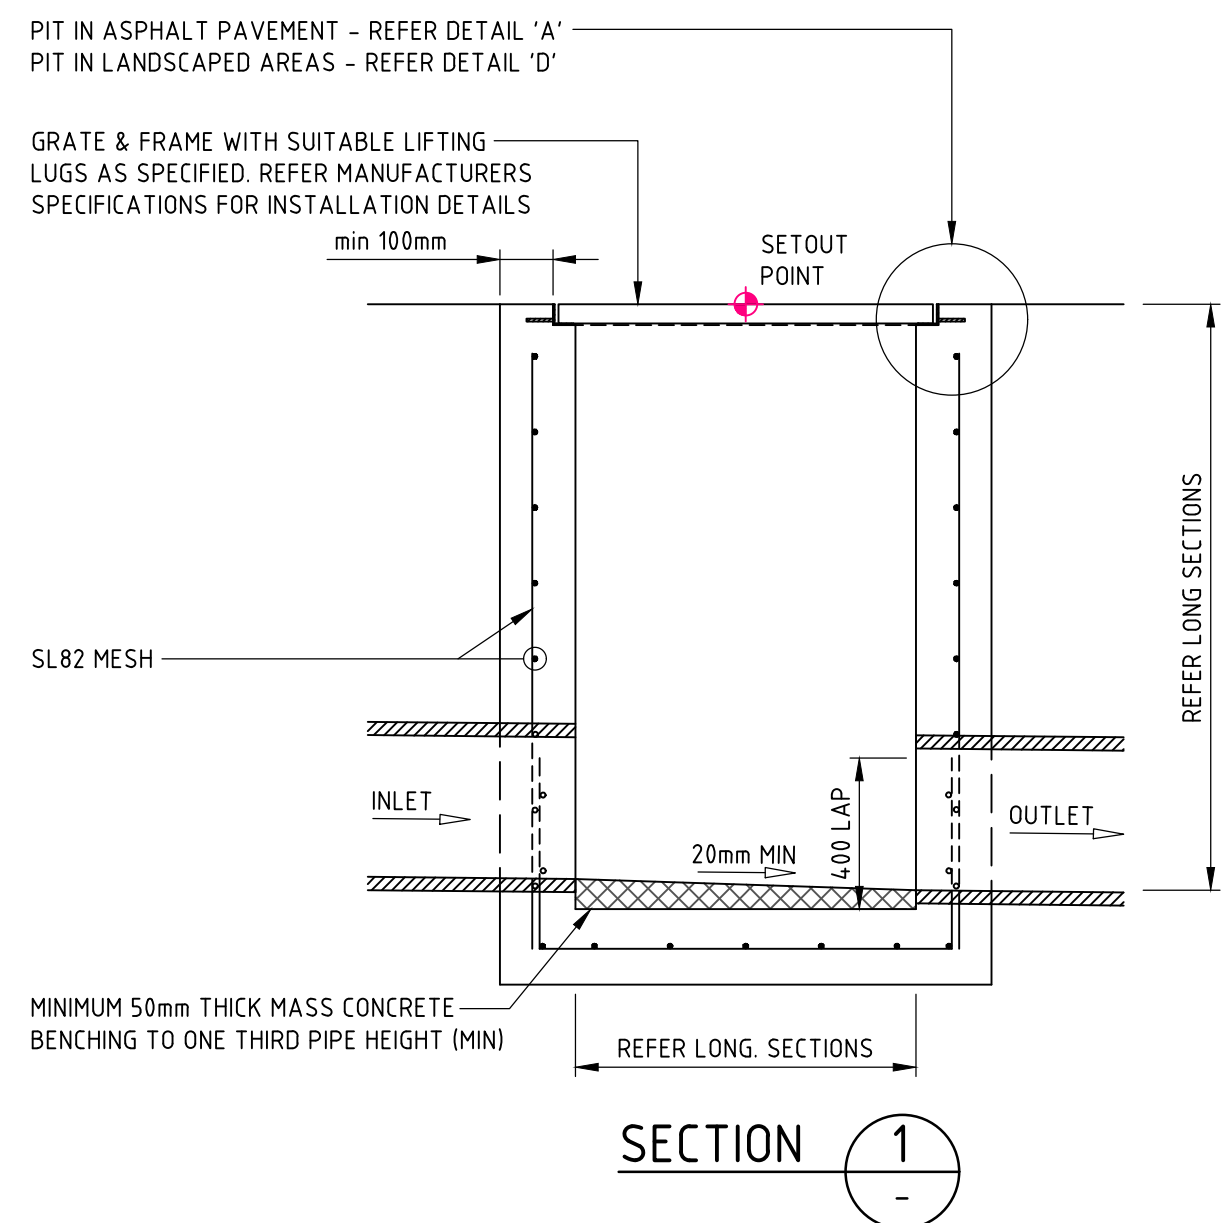
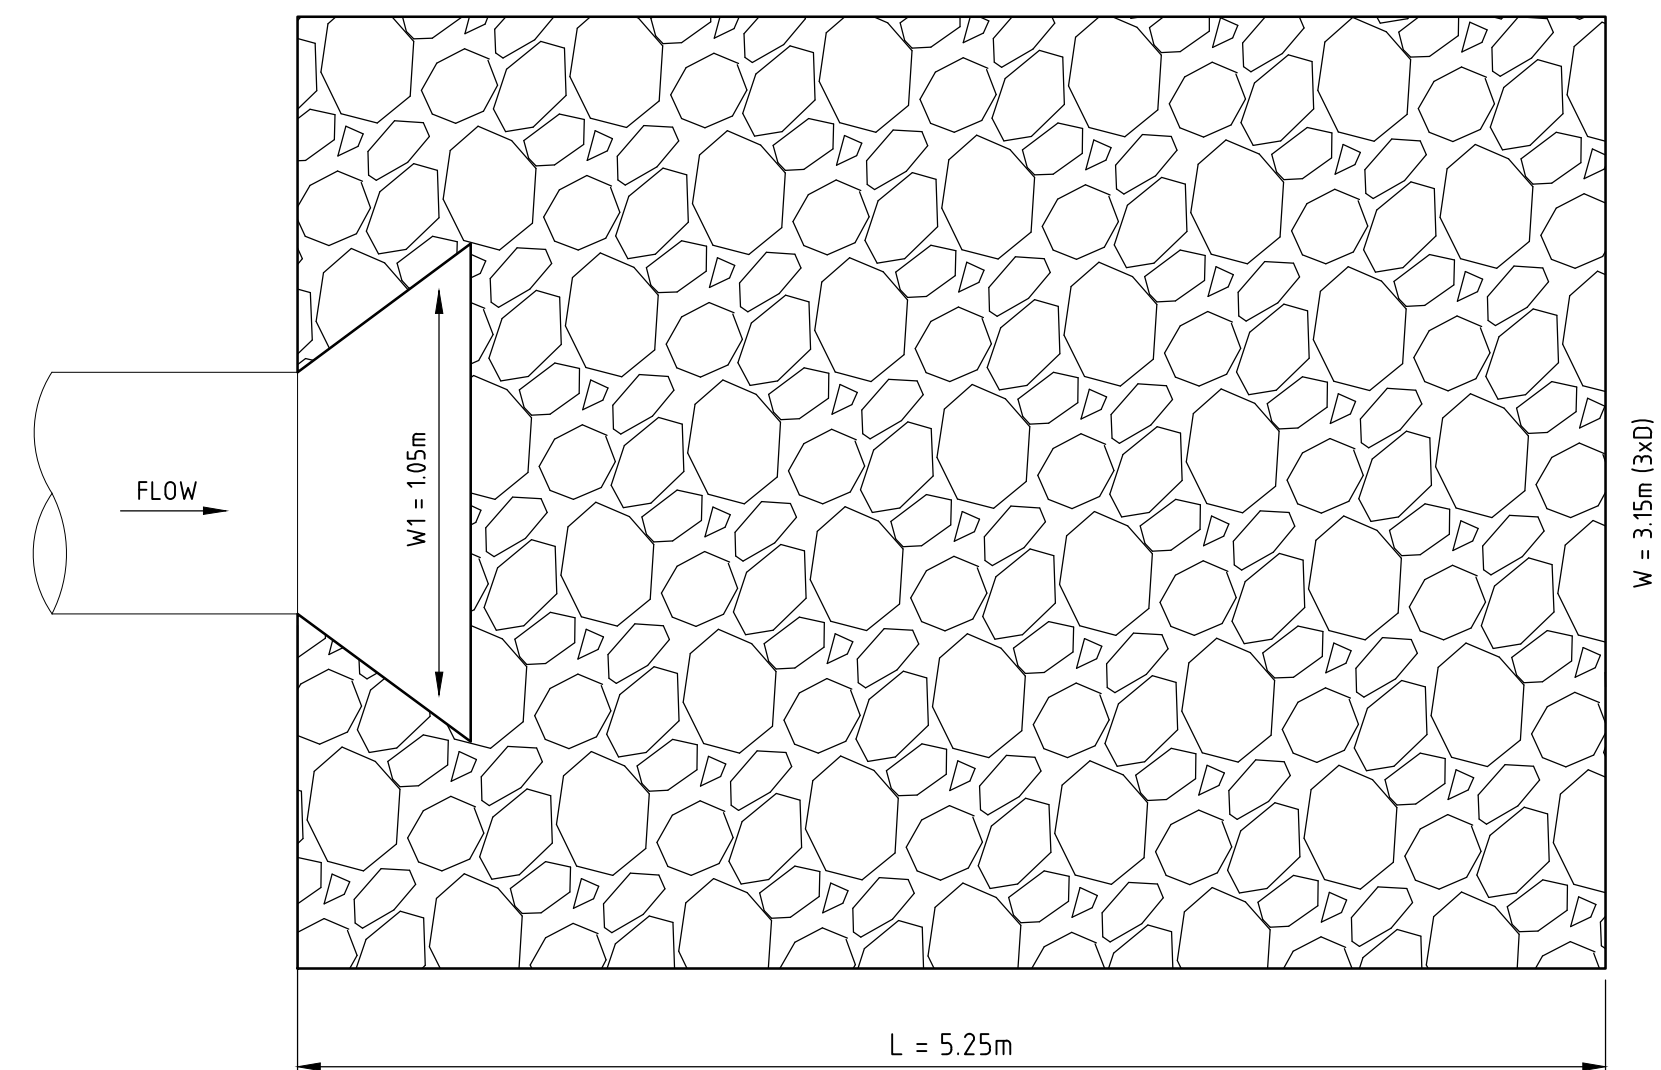
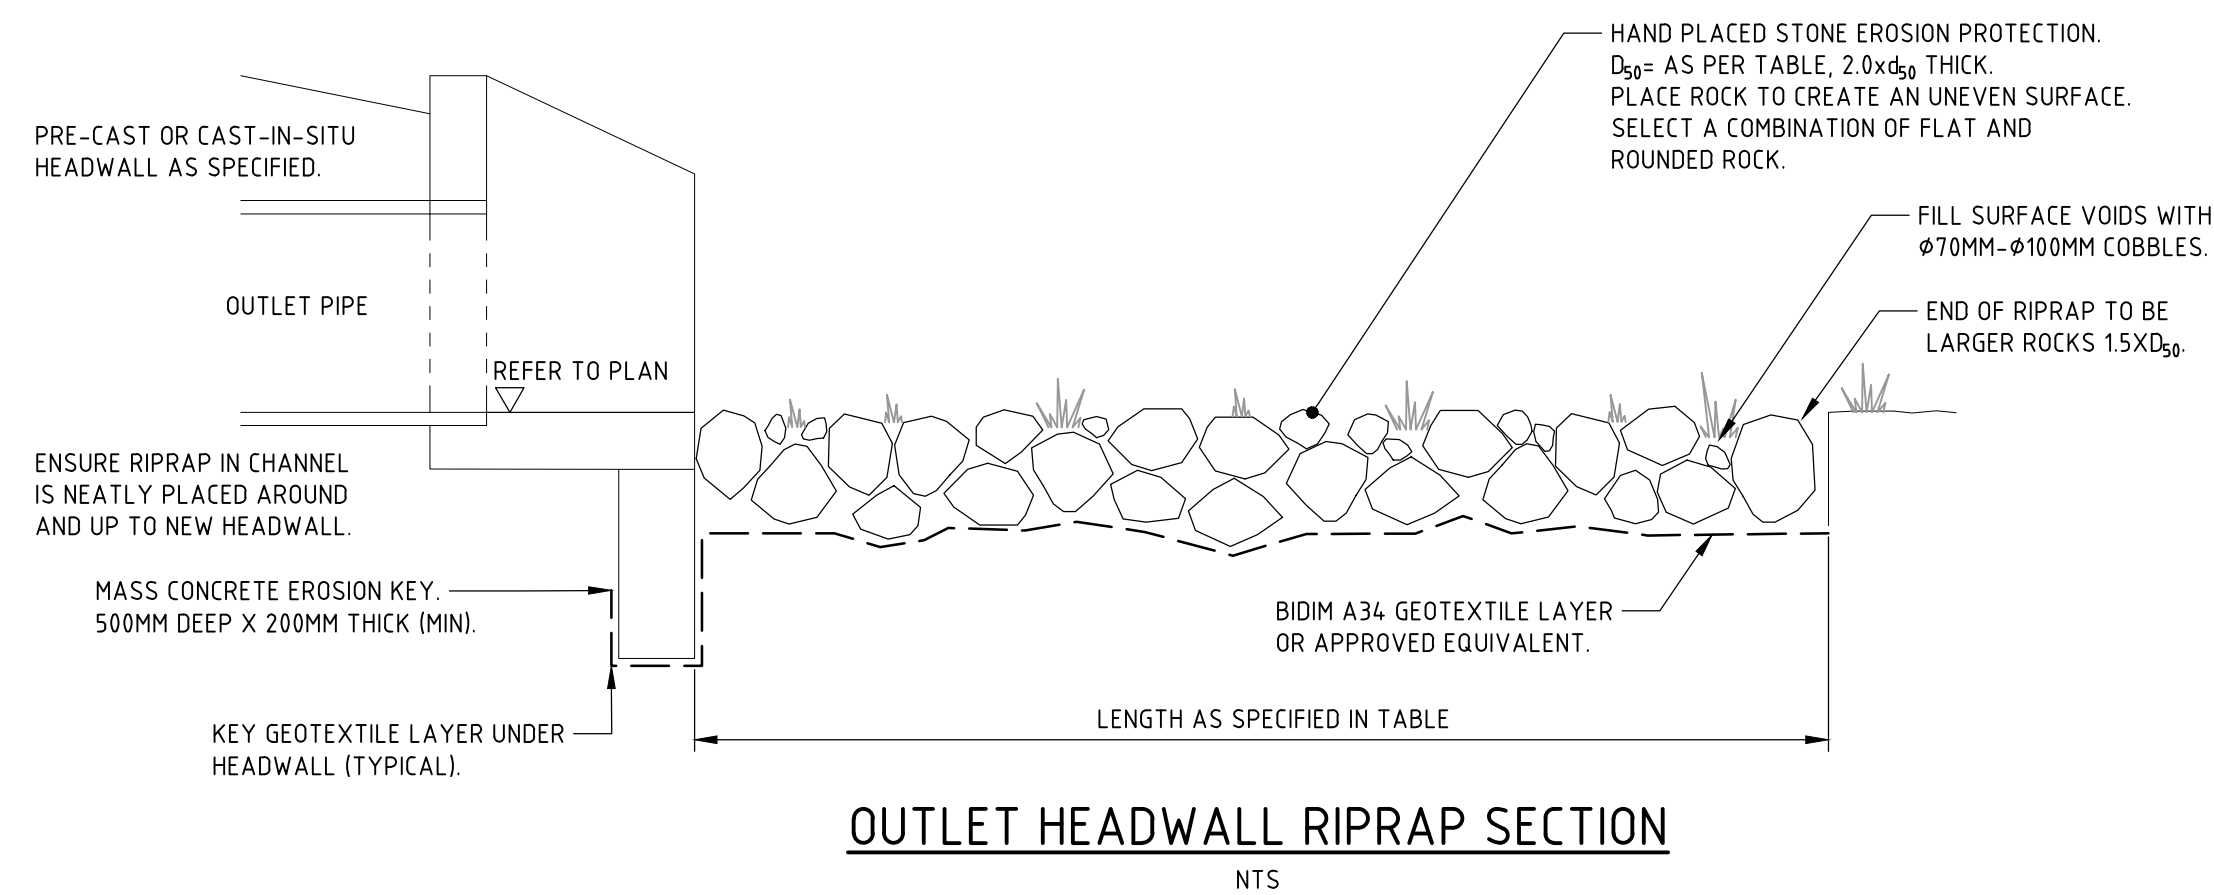
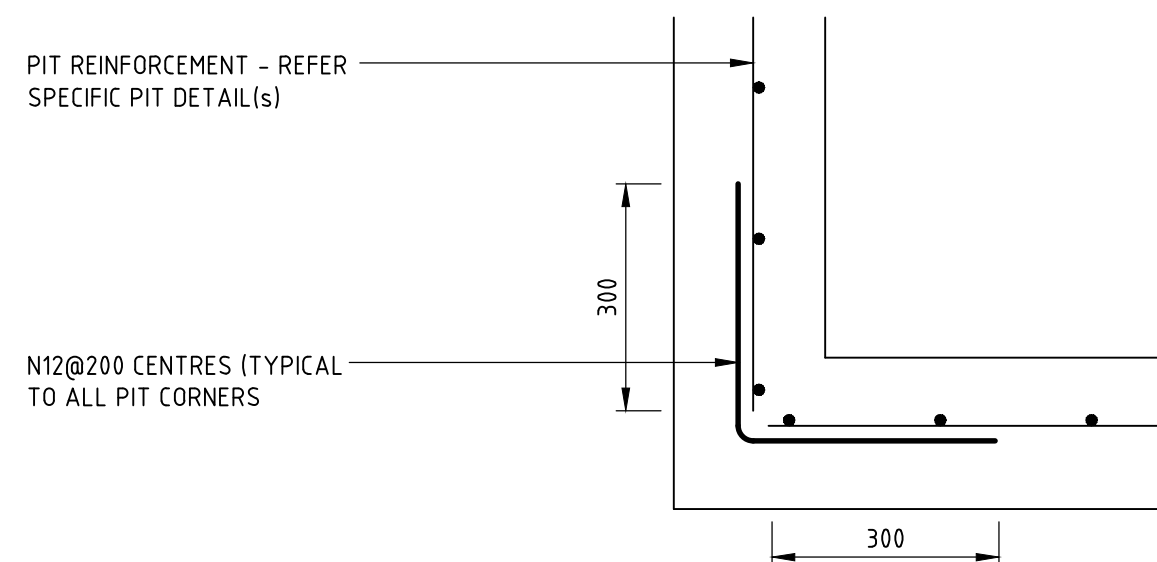


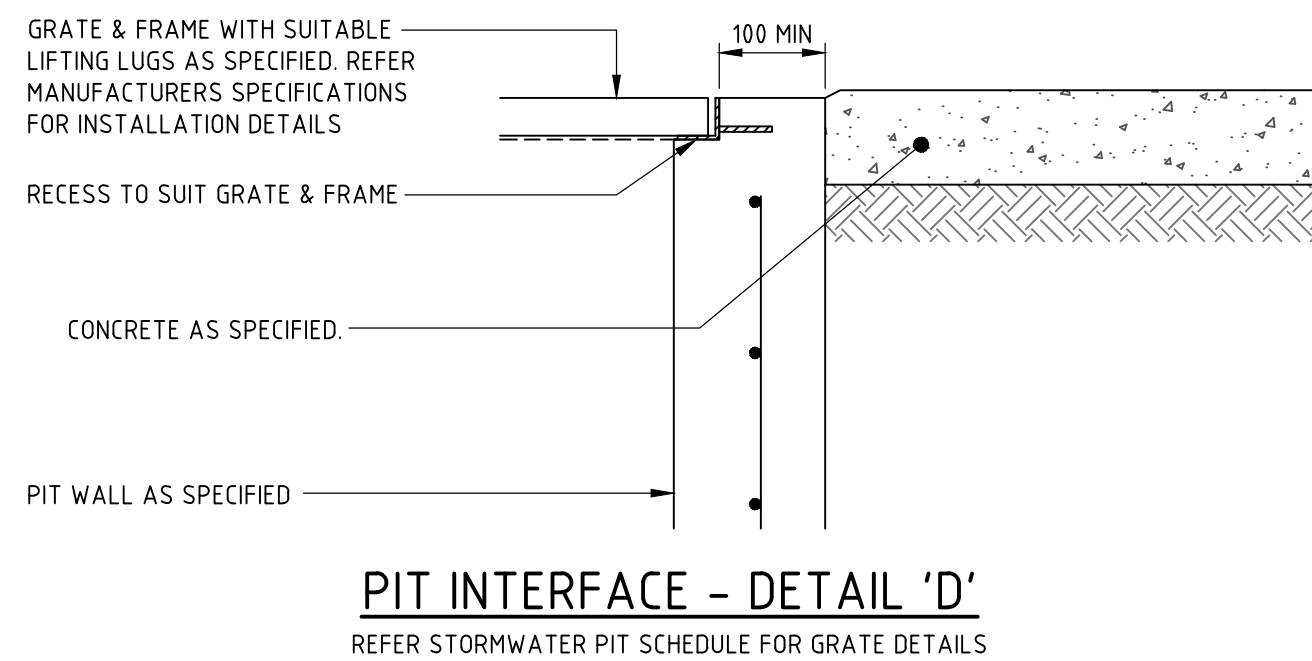

RIPRAP DETAIL

NOTES:

1. ALL RIPRAP MUST CONSIST OF HARD, DURABLE ANGULAR RUN-OF-QUARRY ROCK; RESISTANT TO WEATHERING & WATER ACTION, FREE FROM OVERBURDEN, SOIL, SHALE & ORGANIC MATERIAL; & SHALL MEET THE GRADATION REQUIREMENTS SPECIFIED.
 2. ROUNDED STONES/BOULDERS WILL NOT BE ACCEPTABLE.
 3. SHALE AND ROCK WITH SHALE SEAMS WILL NOT BE ACCEPTABLE.
 4. ROCKS ARE TO BE PLACED OVER A 200mm LAYER OF ANGULAR COBBLES $D_{50}=14.0\text{mm}$.
 5. ALL ROCK AND COBBLES TO BE PACKED WITH TOPSOIL. GAPS IN RIPRAP TO BE PLANTED WITH SUITABLE NATIVE GRASSES/SEDGES.
 6. RIPRAP SHALL BE PLACED ON THE PREPARED SLOPE IN A MANNER THAT WILL PRODUCE A REASONABLY WELL GRADED MASS OF STONE WITH THE MINIMUM PRACTICAL PERCENTAGE OF VOIDS.
 7. LARGER STONES SHALL BE WELL DISTRIBUTED & THE ENTIRE MASS OF STONE SHALL CONFORM TO THE GRADATION SPECIFIED BY THE ENGINEERING PLANS.
 8. THE MINIMUM THICKNESS OF THE RIPRAP LAYER IS TO BE 15 TIMES THE d_{50} ROCK SIZE & NOT BE LESS THAN 300mm FOR PRACTICAL PLACEMENT.
 9. THE MINIMUM DENSITY OF STONE USED SHALL NOT BE LESS THAN 2200 kg/cu.m.
- TYPICAL ROCK WEIGHT RANGES FOR RIPRAP ARE:
- M50 – 60kg (NOM 300MD)
 - M15 – 25kg
 - M100 – 120kg

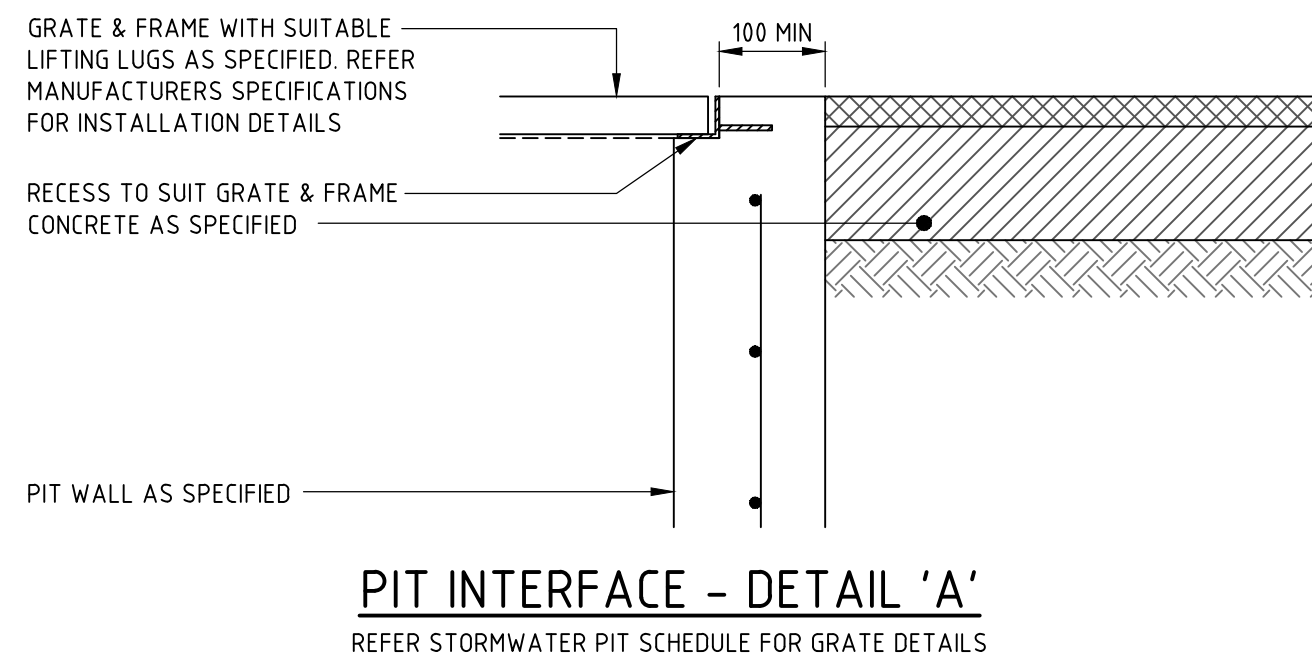

OUTLET ROCK SIZING		
OUTLET NUMBER	ROCK SIZE (d50min)	LENGTH OF ROCK PAD (m)
HW8/1	250mm	5.15m

NOT FOR CONSTRUCTION

NOT TO SCALE