


D&C PRICING ISSUE


This drawing is diagrammatic & approximate only. The (sub-)contractor shall make all allowances necessary to price the project on a Design & Construct methodology. Where items are not specifically shown or included, but are required, the (sub-)contractor shall make all allowances for such items to ensure compliant system(s) are provided that satisfy the client's expectations & operational requirements.

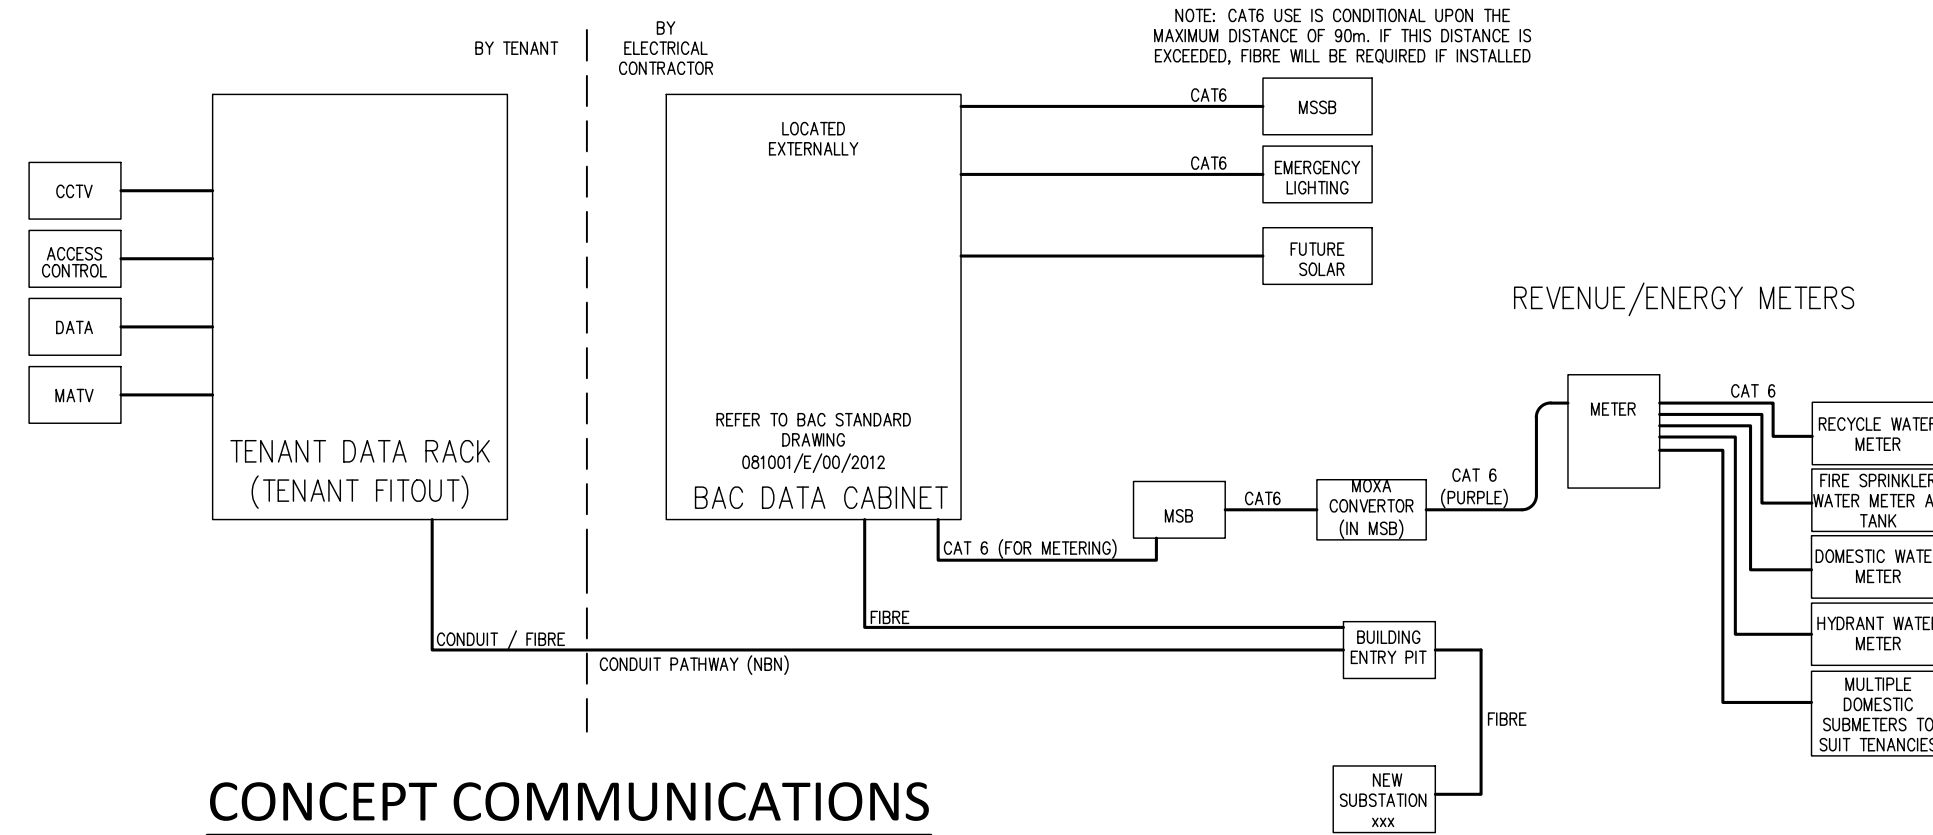

CONCEPT COMMUNICATIONS DIAGRAM (TYPICAL FOR EACH TENACY)

NOTES


1. ANY DATA CABLING INSTALLED IN CONDUITS UNDERGROUND SHALL BE GEL FILLED UNDERGROUND TYPE CABLE.

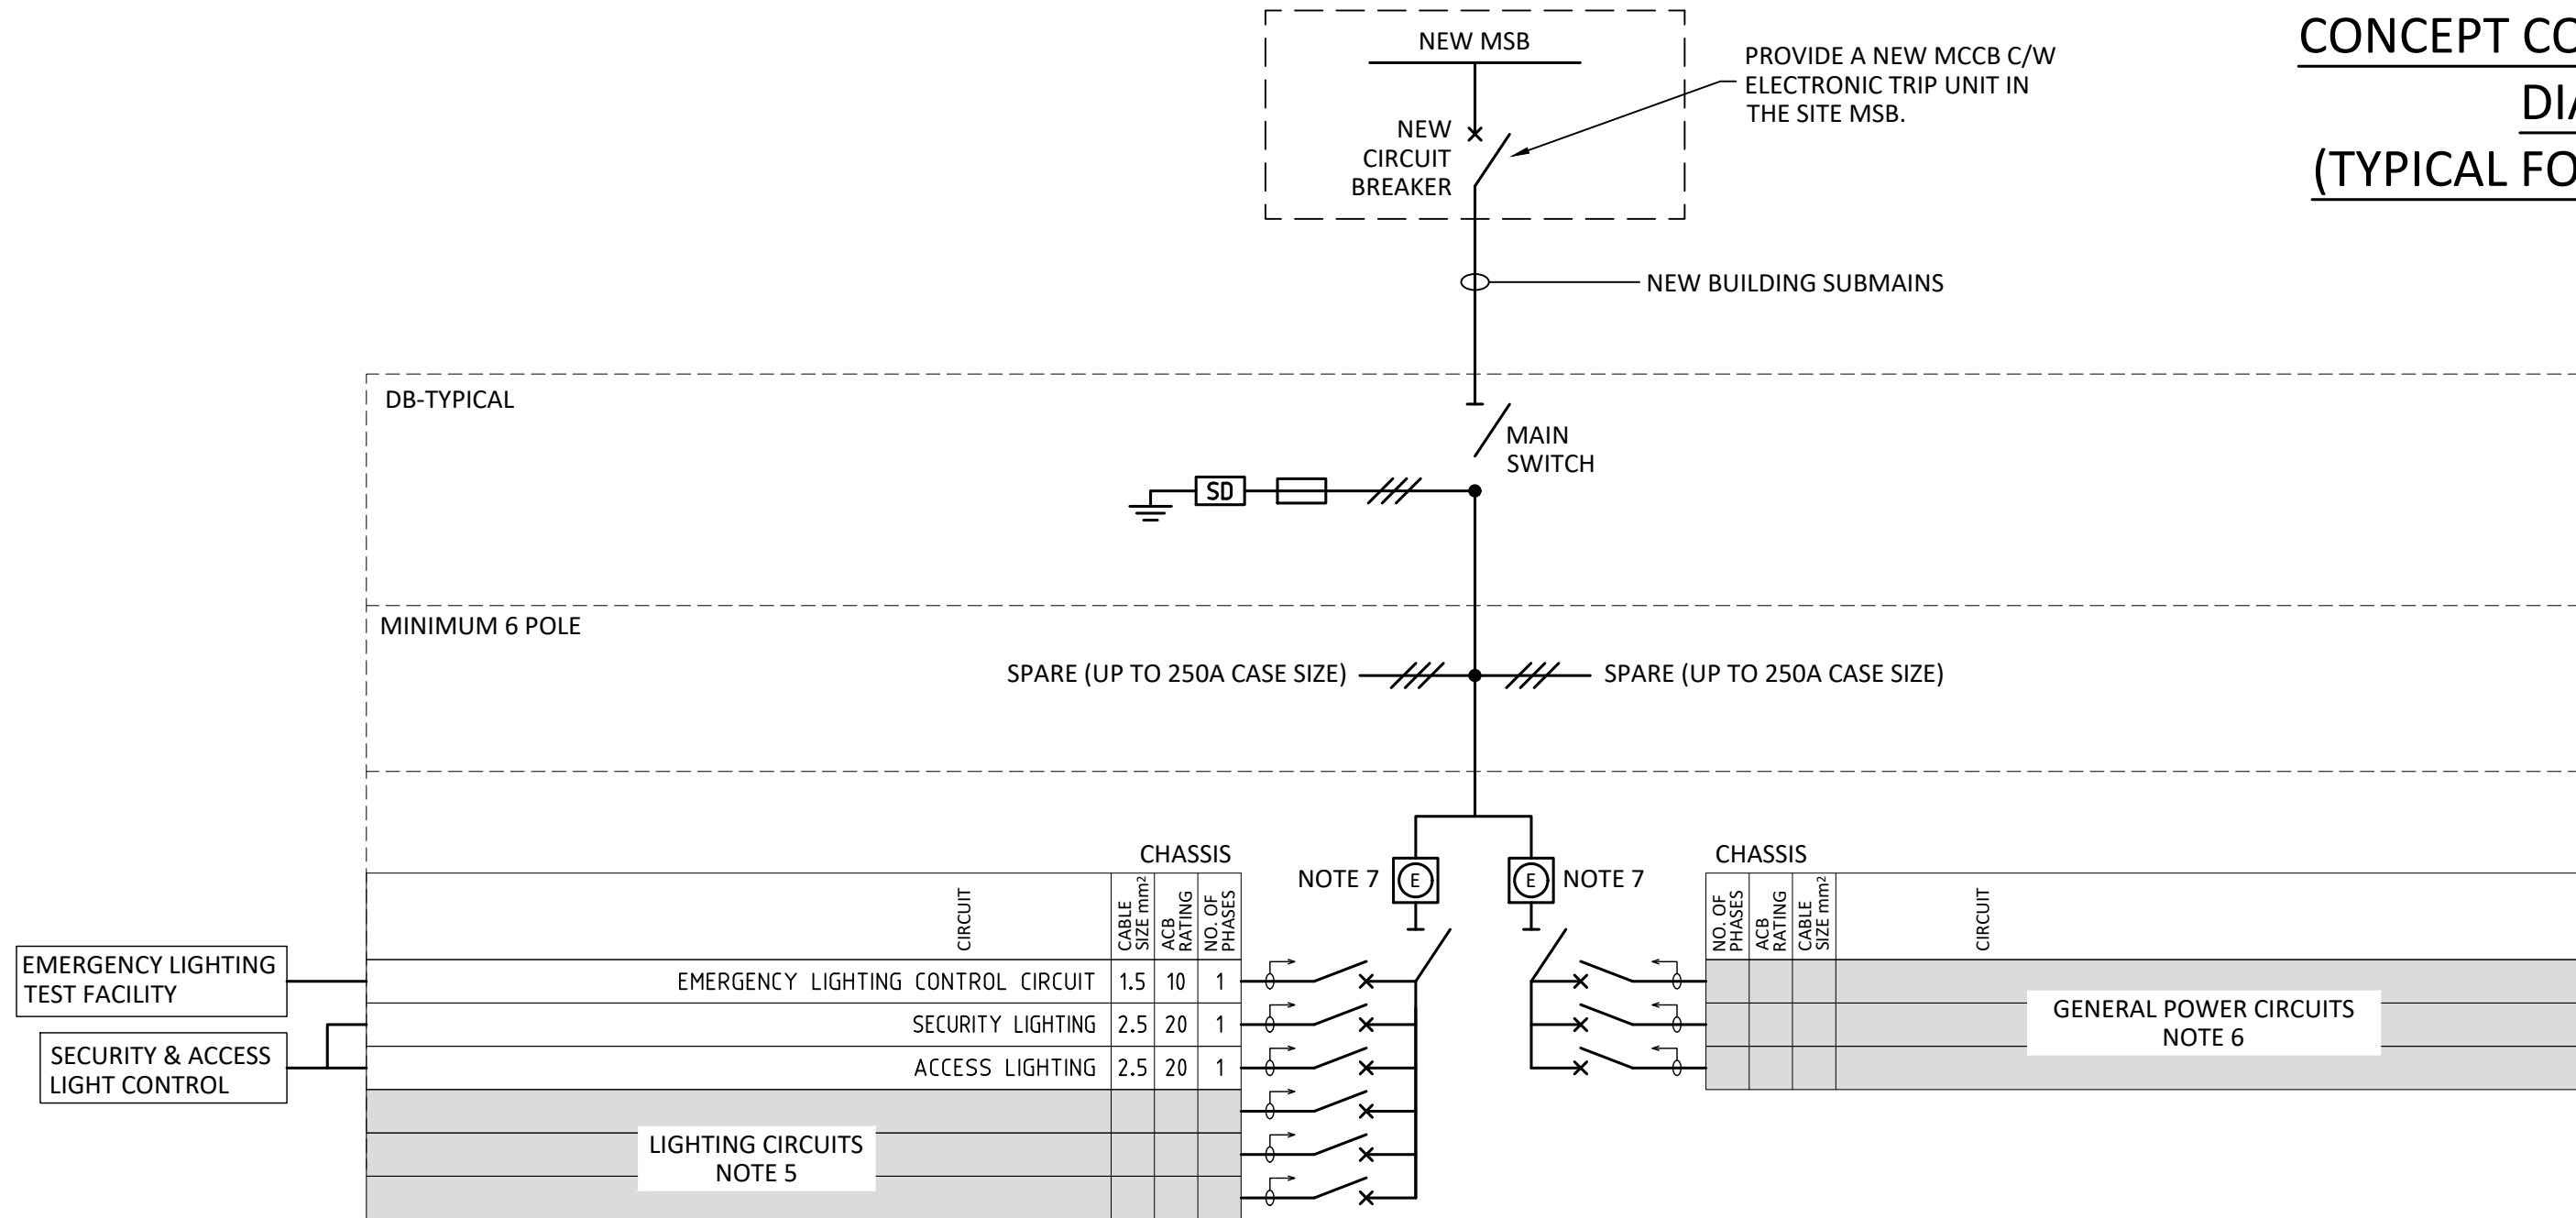

SWITCHBOARD NOTES

1. MAKE ALL ALLOWANCE TO SIZE CIRCUIT BREAKERS IN ACCORDANCE WITH AS/NZS 3000, BASED ON FINAL LOAD REQUIREMENTS AND FAULT LEVELS.
2. CABLE SIZING TO BE UNDERTAKEN IN ACCORDANCE WITH AS/NZS 3008, ACCOUNTING FOR INSTALLATION CONDITIONS, VOLTAGE DROP AND DEMAND.
3. ALL SWITCHBOARDS SHALL BE RATED TO WITHSTAND THE MAXIMUM PROSPECTIVE FAULT CURRENT AT THE POINT OF INSTALLATION, IN ACCORDANCE WITH AS/NZS 61439 AND AS/NZS 3000.
4. PROVIDE MINIMUM 25% SPARE POLE CAPACITY ON EACH SWITCHBOARD. ALL SWITCHBOARDS ALSO SHALL BE SIZED TO INCORPORATE ZENCONTROL LIGHTING CONTROL SYSTEMS AND RAPID RCD TESTING FACILITIES.
5. NUMBER OF LIGHTING CIRCUITS TO BE DETERMINED BY ELECTRICAL LAYOUTS AND AS/NZS 3000 REQUIREMENTS. LIGHTING CIRCUITS TO HAVE MAXIMUM 12A ACTUAL LOAD, MINIMUM 16A CIRCUIT BREAKER.
6. NUMBER OF GENERAL POWER CIRCUITS TO BE DETERMINED BY ELECTRICAL LAYOUTS AND AS/NZS 3000 REQUIREMENTS. POWER CIRCUITS TO HAVE MAXIMUM 10 OUTLETS, MINIMUM 20A RCD CIRCUIT BREAKER.
7. PROVIDE SEPARATE POWER AND LIGHTING CHASSIS WITHIN DISTRIBUTION BOARDS TO COMPLY WITH J9D3 ENERGY MONITORING REQUIREMENTS.
8. PROVIDE DEDICATED CIRCUITS FOR FIXED APPLIANCES SUCH AS HOT WATER UNITS, OVENS, COOKTOPS, MICROWAVES, ZIP UNITS, AIR CONDITIONING, GATES OR ANY OTHER SIGNIFICANT LOADS AND SPECIALIST EQUIPMENT AS DETERMINED BY TENANCIES.
9. PROVIDE RCD'S WITH THE CORRECT EARTH LEAKAGE TRIP TYPE TO SUIT THE NATURE OF THE LOAD, AS OUTLINED IN AS/NZS3000 2.6.2.2. RAPID TESTING MUST BE INSTALLED AND USED FOR TESTING OF ALL RCDs.
10. ALL SWITCHBOARDS TO BE INSTALLED IN ENCLOSURES WITH MINIMUM IP RATING SUITABLE TO ENVIRONMENT AND AS PER AS/NZS 60529. INTERNAL AREAS TO BE MIN. IP42. EXTERNAL OR DUSTY/WET AREAS TO BE MIN. IP66
11. ALLOW FOR METERING, TIMERS, OR CONTROL DEVICES IN ACCORDANCE WITH BAC'S REQUIREMENTS.
12. PROVIDE NEW TYPED LEGEND CARDS TO CONFIRM AREAS OR EQUIPMENT. CIRCUIT CARD MUST SPECIFY THE SIZE, TYPE, AND ROUTE LENGTH OF THE SUBMAINS SUPPLYING THE DB, AS WELL AS THE RATING OF THE UPSTREAM PROTECTIVE DEVICE.
13. BALANCE LOAD ACROSS PHASES ON COMPLETION.

DB-TYPICAL (NEW)

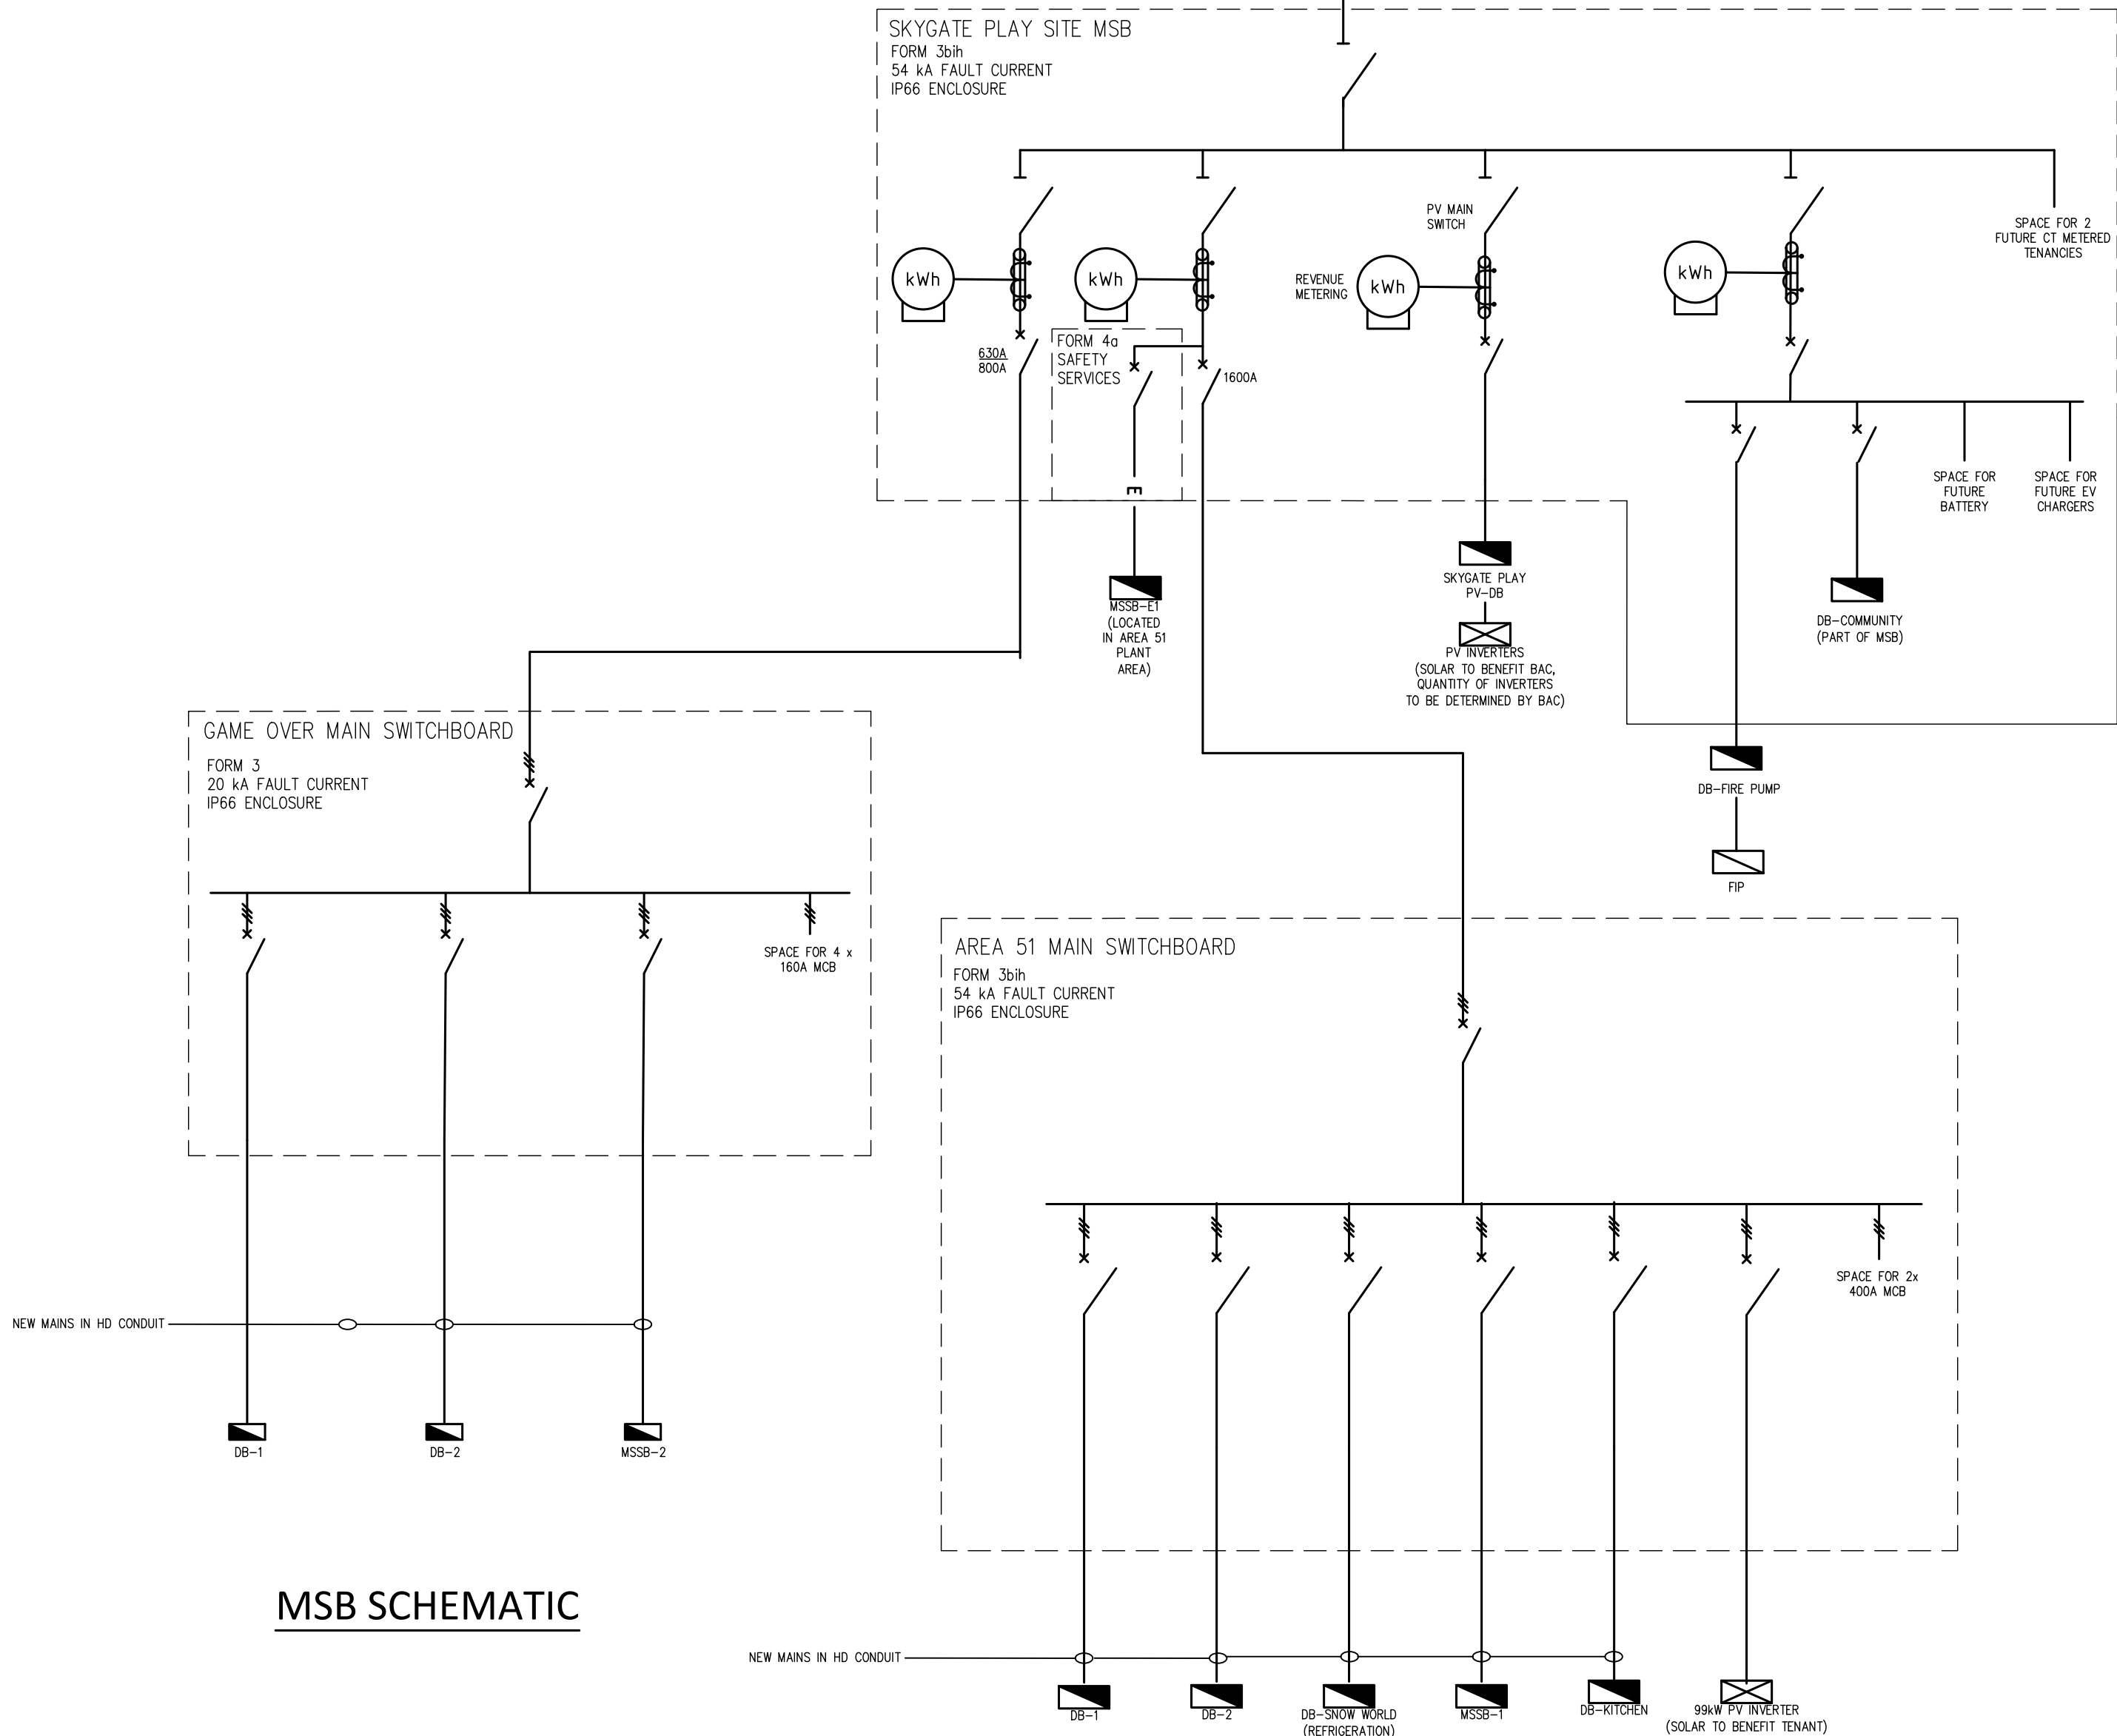

MSB SCHEMATIC

COPYRIGHT : REPRODUCTION OF WHOLE OR PART OF THIS DOCUMENT CONSTITUTES AN INFRINGEMENT OF COPYRIGHT. THE INFORMATION, IDEAS AND CONCEPTS CONTAINED IN THIS DOCUMENT ARE CONFIDENTIAL. THE RECIPIENT(S) OF THIS DOCUMENT IS PROHIBITED FROM DISCLOSING SUCH INFORMATION IDEAS AND CONCEPTS TO ANY PERSON WITHOUT THE PRIOR WRITTEN CONSENT OF THE BRISBANE AIRPORT CORPORATION PTY. LTD	RA RA DRN	D&C PRICING ISSUE D&C PRICING ISSUE AMENDMENTS	04/02/26 17/12/25 DATE	B A REV
---	-----------------	--	------------------------------	---------------

25-0437	Ashburner Francis	Archipelago	Electrical Services
---------	-------------------	-------------	---------------------

Archipelago Level 3, 159 George Street, Brisbane QLD 4000 T +617 3228 4008 www.archipelago.com.au © ARCHIPELAGO ARCHITECTS PTY LTD. All Rights Reserved This work is copyright and cannot be reproduced or copied by any means without written permission of Archipelago Architects Pty Ltd. Any license, express or implied, to use this document for any purpose whichever is restricted to the terms of the agreement between Archipelago Architects P y Ltd and the instructing party.
--

Drawn RA Design Coordinated RA Authorised For Issue DE	Checked Compliance Checked Construction Checked
---	---

SKYGATE PLAY THE CIRCUIT, BRISBANE AIRPORT ELECTRICAL SERVICES SCHEMATICS
--

Brisbane Airport Corporation Pty Ltd 11 The Circuit Brisbane Airport QLD 4008 PO Box 61 Hamilton QLD 4007 Australia Telephone : 61 7 3406 3000 Facsimile : 61 7 3406 3111 Email : info@bne.com.au www.brisbaneairport.com.au ABN 54 070 870 650	Scale N.T.S. Size A1 Revision B
Project No. 25021 - ASH - XX - XX -DR- EL - 001003	Number