


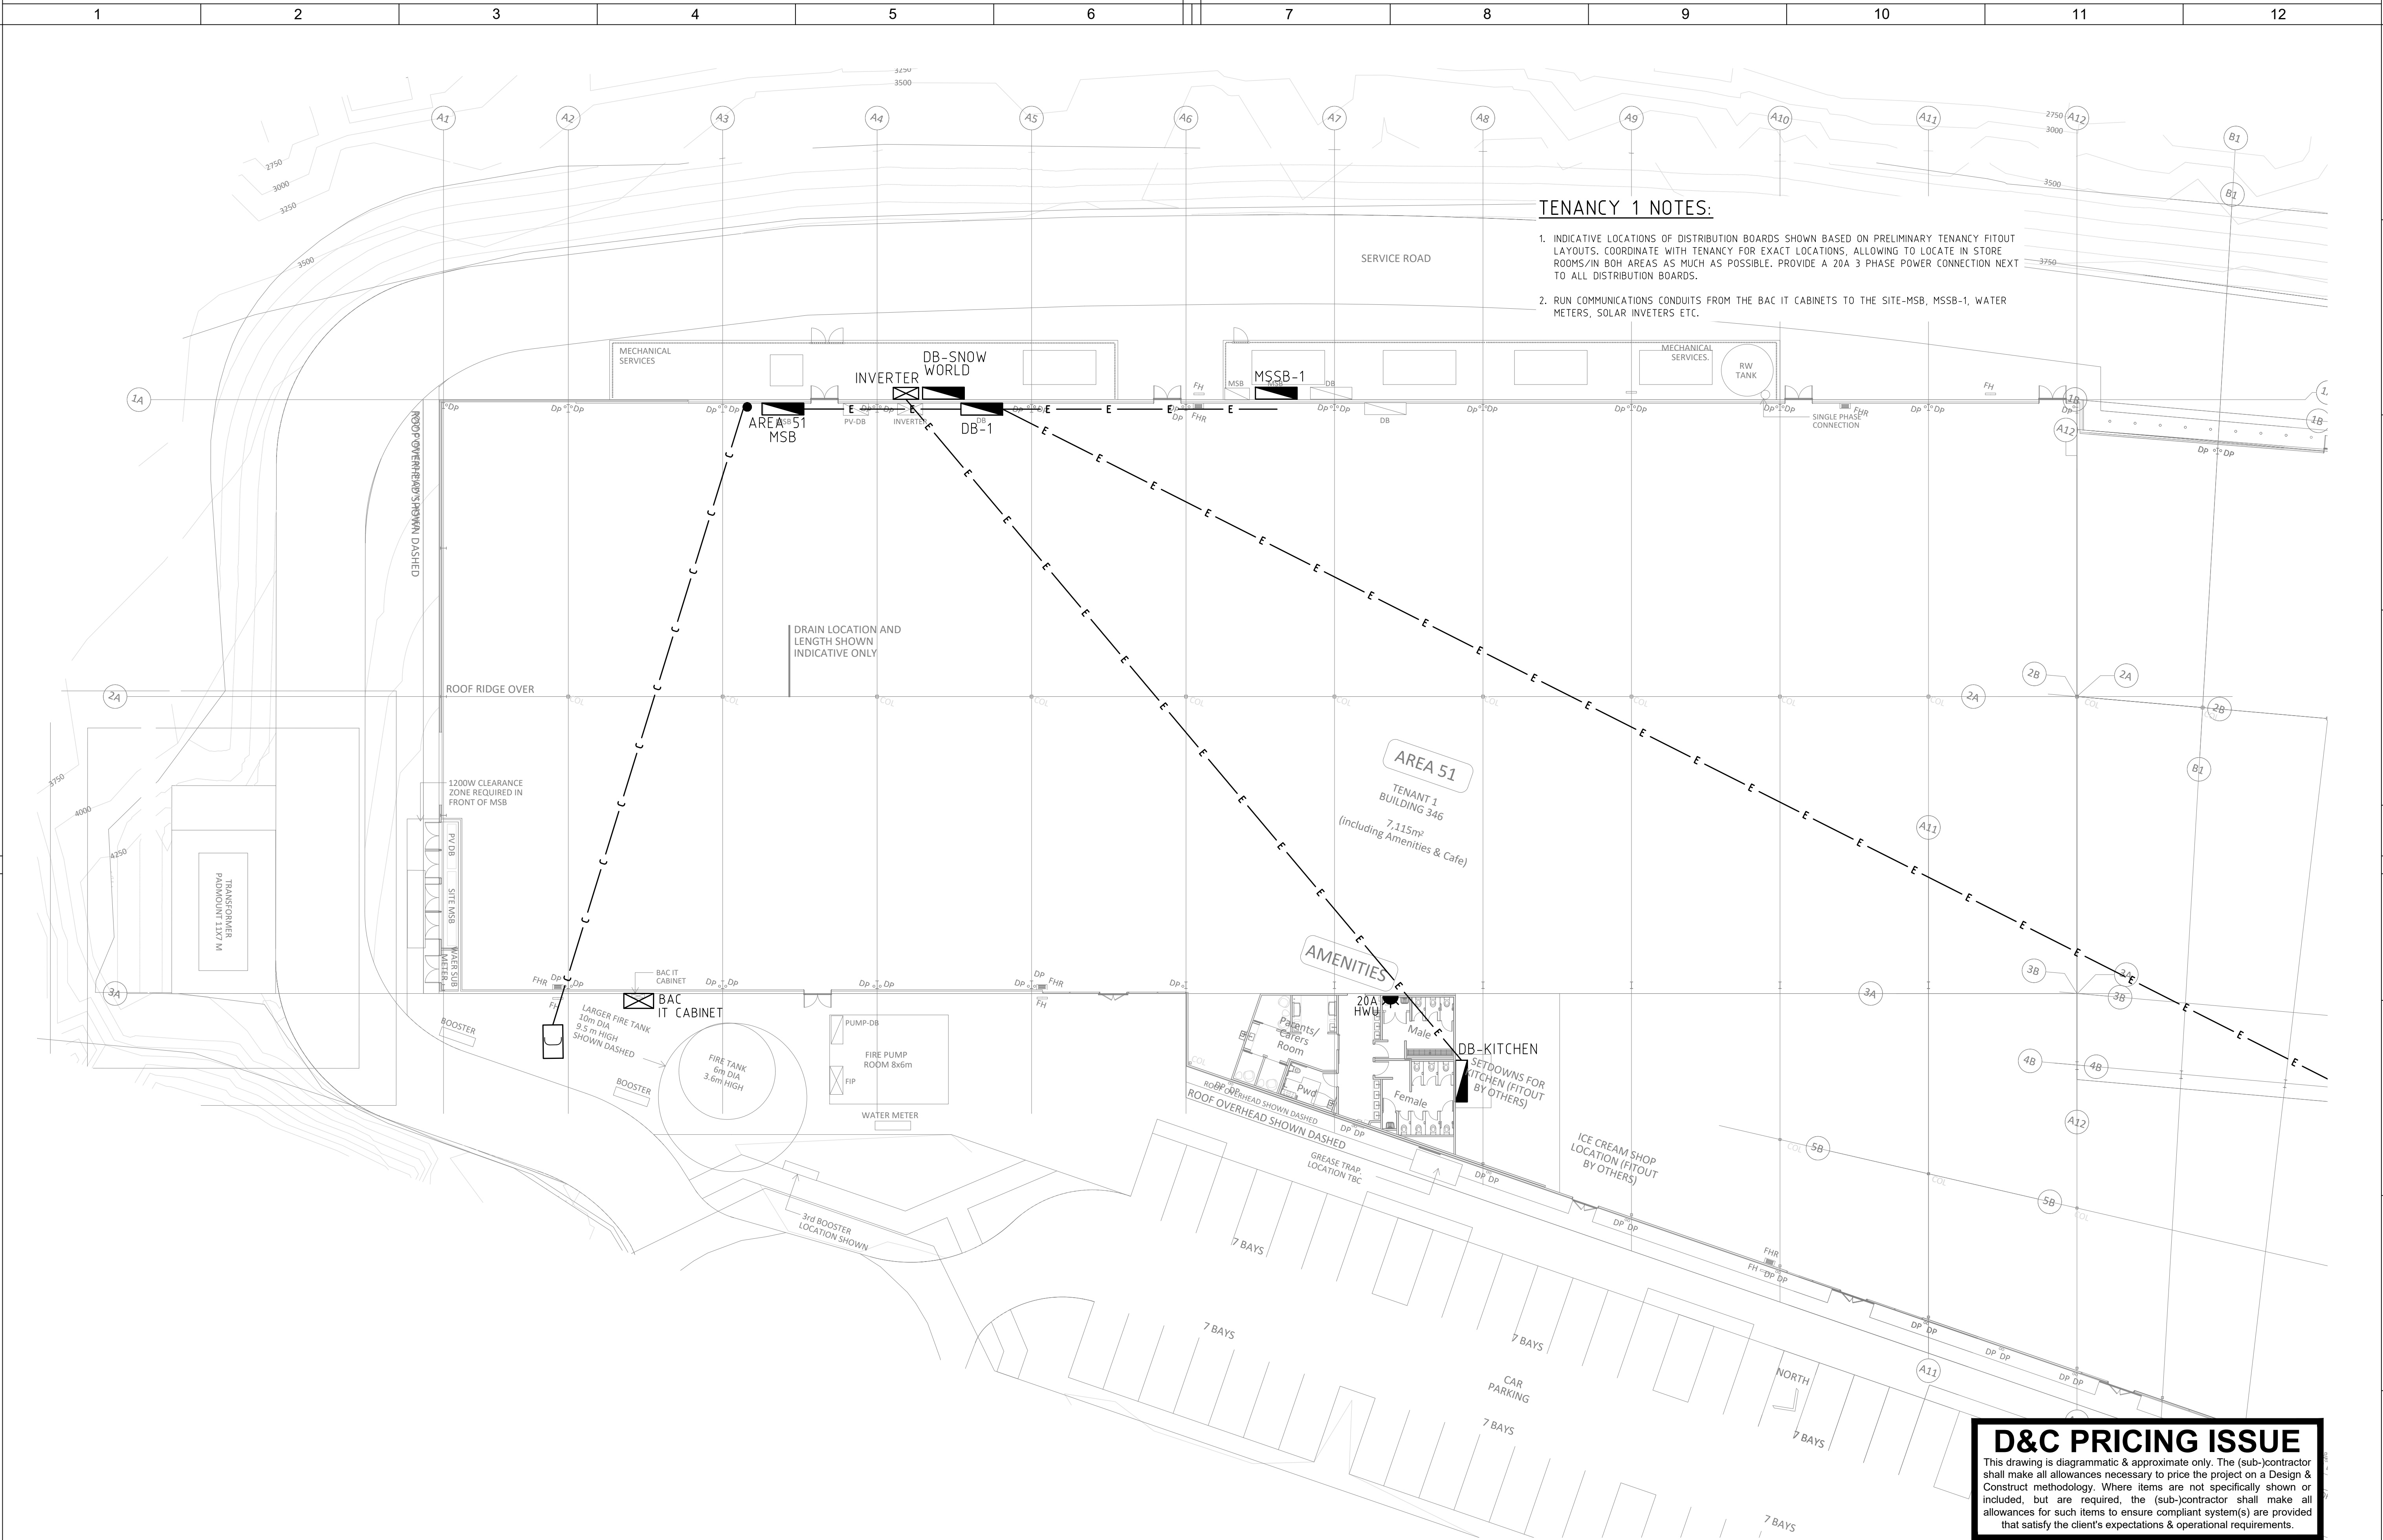

TENANCY 1 NOTES:

- 1. INDICATIVE LOCATIONS OF DISTRIBUTION BOARDS SHOWN BASED ON PRELIMINARY TENANCY FITOUT LAYOUTS. COORDINATE WITH TENANCY FOR EXACT LOCATIONS, ALLOWING TO LOCATE IN STORE ROOMS/IN BOH AREAS AS MUCH AS POSSIBLE. PROVIDE A 20A 3 PHASE POWER CONNECTION NEXT TO ALL DISTRIBUTION BOARDS.
- 2. RUN COMMUNICATIONS CONDUITS FROM THE BAC IT CABINETS TO THE SITE-MSB, MSSB-1, WATER METERS, SOLAR INVERTERS ETC.

D&C PRICING ISSUE
This drawing is diagrammatic & approximate only. The (sub-)contractor shall make all allowances necessary to price the project on a Design & Construct methodology. Where items are not specifically shown or included, but are required, the (sub-)contractor shall make all allowances for such items to ensure compliant system(s) are provided that satisfy the client's expectations & operational requirements.