Sheet List Table	
Sheet Number	Sheet Title
000001	LEGEND, SCHEMATICS, LOCALITY PLAN & DRAWING LIST
001100	FIRE PROTECTION LAYOUT

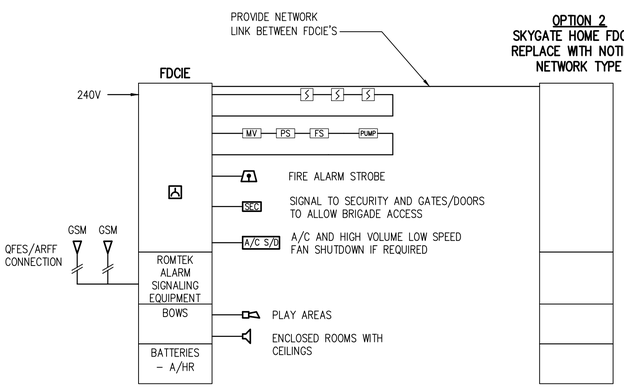

FIRE DETECTION, CONTROL AND ALARM SYSTEM CONCEPT SCHEMATIC

OPTION 2:
CONNECT INTO ADJACENT B344 SPRINKLER Ø150 PIPE RISER (BELOW CONTROL VALVE SET), CONTINUE Ø150 TO ABOVE ROOF, RUN OVER ROOF AS SHOWN AND DROP EXTERNAL TO INGROUND TO CROSS ROAD TO NEW BUILDING.
CREATE SPRINKLER HEADER AT LOW LEVEL WITH 2x SPRINKLER CONTROL VALVE SETS (TENANCY 1 & 2 OF NEW BUILDING)

THE FDCIE FOR BNE PLAY SHALL BE NETWORKED WITH THE EXISTING FDCIE SKYGATE HOME. PROVIDE NETWORK CABLE INTERFACE BETWEEN FDCIE'S REPLACE EXISTING SKYGATE HOME FDCIE WITH A NOTIFIER NETWORK TYPE TO BAC REQUIREMENTS

OPTION 2:
EXISTING FDCIE, REPLACE WITH NOTIFIER NETWORK TYPE AND REPROGRAM TO SUIT

CUT INTO Ø150 PIPING ABOVE GROUND AND BELOW EXISTING SPRINKLER VALVE SET. RUN NEW GALVANISED PIPING TO ABOVE ROOF AND CONTINUE ABOVE ROOF AS SHOWN TO DROP ON OPPOSITE END TO INGROUND PIPING TO NEW BUILDING.

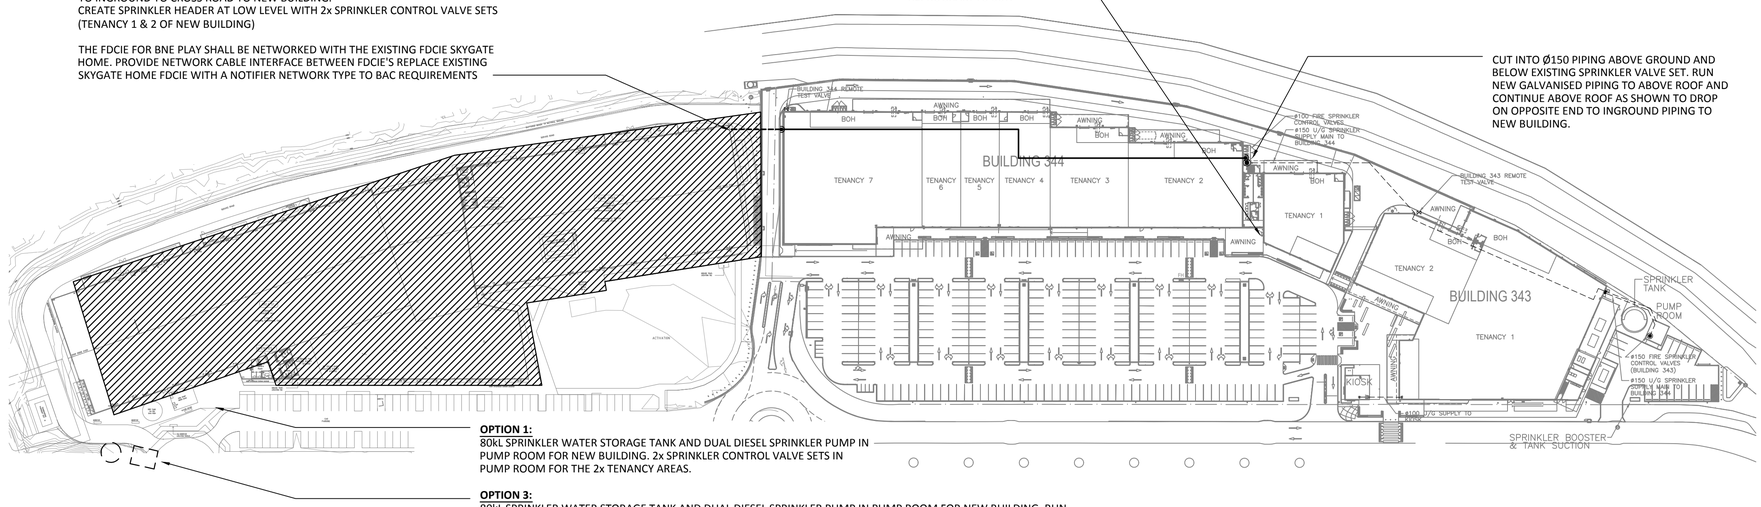

OPTION 1:
80kL SPRINKLER WATER STORAGE TANK AND DUAL DIESEL SPRINKLER PUMP IN PUMP ROOM FOR NEW BUILDING. 2x SPRINKLER CONTROL VALVE SETS IN PUMP ROOM FOR THE 2x TENANCY AREAS.

OPTION 3:
80kL SPRINKLER WATER STORAGE TANK AND DUAL DIESEL SPRINKLER PUMP IN PUMP ROOM FOR NEW BUILDING. RUN PIPING INGROUND TO CORNER OF NEW BUILDING AND ESTABLISH HEADER WITH 2x SPRINKLER CONTROL VALVE SETS FOR THE 2 TENANCY AREAS. ALLOW ADDITIONAL STUB IN PUMP ROOM PIPING FOR FUTURE INGROUND PIPING TO NEW DEVELOPMENT TOWARDS SOUTH-WEST.

LOCALITY PLAN
SCALE 1:1000

LEGEND

	ABOVE GROUND PIPEWORK - FIRE SPRINKLER (MAIN)	FBP	FIRE BRIGADE PANEL
	IN GROUND PIPEWORK - FIRE SPRINKLER (MAIN)		WARDEN INTERCOMMUNICATION POINT MOUNTED AT 1500mm AFL
C	RISER - SIDE		MANUAL CALL POINT MOUNTED AT 1200
ø	NOMINAL PIPE SIZING TAG		EXTERNAL ALARM INDICATION
	ANNUBAR SENSING ELEMENT		VISUAL INDICATING LIGHT (AMBER/RED) - CEILING MOUNTED
P	PRESSURE GAUGE		ELECTROMAGNETIC DOOR HOLDER WITH MANUAL OVERRIDE PUSH BUTTON AND REMOTE RELEASE FACILITY
X	FIRE PUMP *(DI = DIESEL ENGINE DRIVER)*	F	FIRE ALARM INPUT/OUTPUT SIGNAL
S	VALVE - FIRE SPRINKLER CONTROL VALVE ASSEMBLY (SCV)	FADR	FIRE ALARM DOOR RELEASE SIGNAL
	VALVE - FLOAT VALVE		LOUD SPEAKER, FLUSH MOUNTED S = SURFACE MOUNTED
	VALVE - NON-RETURN		ALARM SOUNDER, SURFACE MOUNTED
	VALVE - GATE		HEAT DETECTOR
	VALVE - GLOBE		HEAT DETECTOR IN CONCEALED SPACE
	VALVE - BUTTERFLY		HEAT DETECTOR WITHIN AIR DUCT
	FLEXIBLE CONNECTION		SMOKE DETECTOR
MV	VALVE MONITOR		SMOKE DETECTOR IN CONCEALED SPACE
FS	FLOW SWITCH		SMOKE DETECTOR WITHIN AIR DUCT
PS	PRESSURE SWITCH		MULTI CRITERIA SMOKE/HEAT DETECTOR
PUMP	FIRE PUMP CONTROL PANEL		
	SMOKE EXHAUST FAN BY MECHANICAL SERVICES		

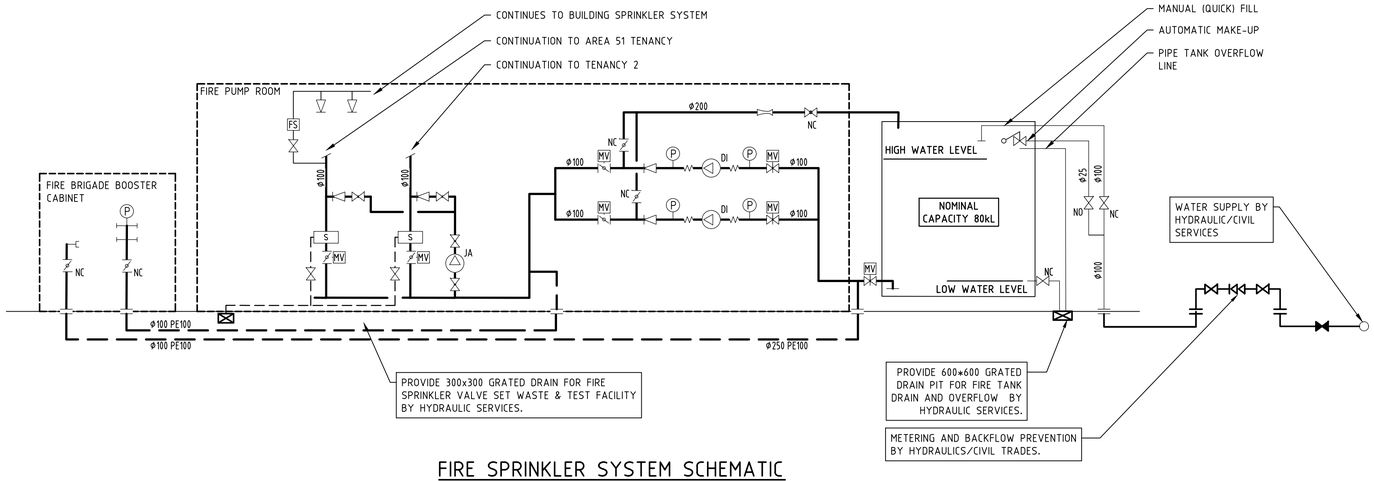

FIRE SPRINKLER SYSTEM SCHEMATIC

NOTES:
1. ALL VALVES ARE TO BE LOCKED OPEN UNLESS OTHERWISE NOTED
2. NC : NORMALLY CLOSED

D&C PRICING ISSUE
This drawing is diagrammatic & approximate only. The (sub-)contractor shall make all allowances necessary to price the project on a Design & Construct methodology. Where items are not specifically shown or included, but are required, the (sub-)contractor shall make all allowances for such items to ensure compliant system(s) are provided that satisfy the client's expectations & operational requirements.

COPYRIGHT :
REPRODUCTION OF WHOLE OR PART OF THIS DOCUMENT CONSTITUTES AN INFRINGEMENT OF COPYRIGHT. THE INFORMATION, IDEAS AND CONCEPTS CONTAINED IN THIS DOCUMENT ARE CONFIDENTIAL. THE RECIPIENT(S) OF THIS DOCUMENT IS PROHIBITED FROM DISCLOSING SUCH INFORMATION IDEAS AND CONCEPTS TO ANY PERSON WITHOUT THE PRIOR WRITTEN CONSENT OF THE BRISBANE AIRPORT CORPORATION PTY. LTD.

DRN	AMENDMENTS	DATE	REV
NB	D&C PRICING ISSUE	05/02/26	B
NB	D&C PRICING ISSUE	17/12/25	A

25-0437

Ashburner Francis
Ashburner Francis Pty Ltd ABN 46 009 975 197
T 07 3510 8888
E brisbane@ashburnerfrancis.com.au
977 Stanley Street East, East Brisbane QLD 4169
BRISBANE | TOOWOOMBA | TOWNSVILLE | DARWIN
FIRE SPRINKLER SERVICES
QBCC LICENCE No: 15206403

Archipelago
Archipelago
Level 3, 199 George Street, Brisbane QLD 4000
T +617 3236 4606 www.archipelago.com.au
© ARCHIPELAGO ARCHITECTS PTY. LTD. All Rights Reserved
This work is copyright and cannot be reproduced or copied by any means without written permission of Archipelago Architects Pty Ltd. Any license, express or implied, to use this document for any purpose whatsoever is restricted to the terms of the agreement between Archipelago Architects Pty Ltd and the instructing party.

Drawn: NB	Checked:
Design Coordinated: KDL	Compliance Checked:
Authorised For Issue: SS	Construction Checked:

SKYGATE PLAY
THE CIRCUIT, BRISBANE AIRPORT

FIRE SPRINKLERS SERVICES

LEGEND, SCHEMATICS, LOCALITY PLAN & DRAWING LIST

Brisbane Airport
Brisbane Airport Corporation Pty Ltd
11 The Circuit Brisbane Airport QLD 4008
PO Box 61 Hamilton QLD 4007 Australia
Telephone : 61 7 3406 3000
Facsimile : 61 7 3406 3111
Email : info@bne.com.au
www.brisbaneairport.com.au
ABN 54 076 870 650

Scale	Size	Revision
AS SHOWN	A1	B

Drawing Number	Project No.	Originator	Volume	Level	Type	Discipline	Number
	25021	ASH	XX	XX	DR	FR	000001

File: 2528 - TMR Depot | Pentable: | Printer: | User: #### | Plot Date & Time: 4/06/2025 7:54 PM