


SITE PLAN NOTES:

1. PROVIDE CARPARK LIGHTING TO AS1158 TO ALL CARPARK SPACES. ENSURE COMPLIANCE TO OBTRUSIVE LIGHTING STANDARD AS4282 REQUIREMENTS.
2. INDICATIVE QUANTITY AND LOCATIONS OF COMPONENTS SHOWN, ENSURE COMPLIANCE WITH BRIEF STANDARDS & BRISBANE AIRPORT GUIDELINES.
3. PROVIDE A PAINTED HATCHED 'KEEP CLEAR' ZONE IN FRONT OF EXTERNAL MSB & MSSB ZONE.
4. PROVIDE CONDUIT SLEEVES BELOW THE NEW DRIVEWAY CROSSOVERS FOR FUTURE SERVICES.
5. PROVIDE SIGNAGE POWER.
6. COORDINATE ELECTRICAL & COMMUNICATIONS CONDUITS & PITS WITH ALL UNDERGROUND SERVICES AND STRUCTURE.
7. HYDROVAC TO BE USED FOR ALL AREAS ALONG FRONT BOUNDARY WHERE THERE ARE EXISTING SERVICES.
8. PROVIDE COMMUNICATIONS CONDUIT + CABLE TO WATER METERS AS REQUIRED.
9. EXISTING SERVICES AND PITS REMAINING WITHIN NEW DRIVEWAYS TO BE REPLACED WITH CLASS D TRAFFICABLE PITS.
10. NEW COMMUNICATIONS PITS SHALL BE CUBIS HIGH SECURITY PRE-CAST CONCRETE OR APPROVED EQUIVALENT WITH A CLASS B (NON-TRAFFICABLE AREAS) OR CLASS C (TRAFFICABLE AREAS) LOCKABLE STEEL LIDS. THE PITS LOCATED ON THIS PLAN TO BE CUBIS J8.

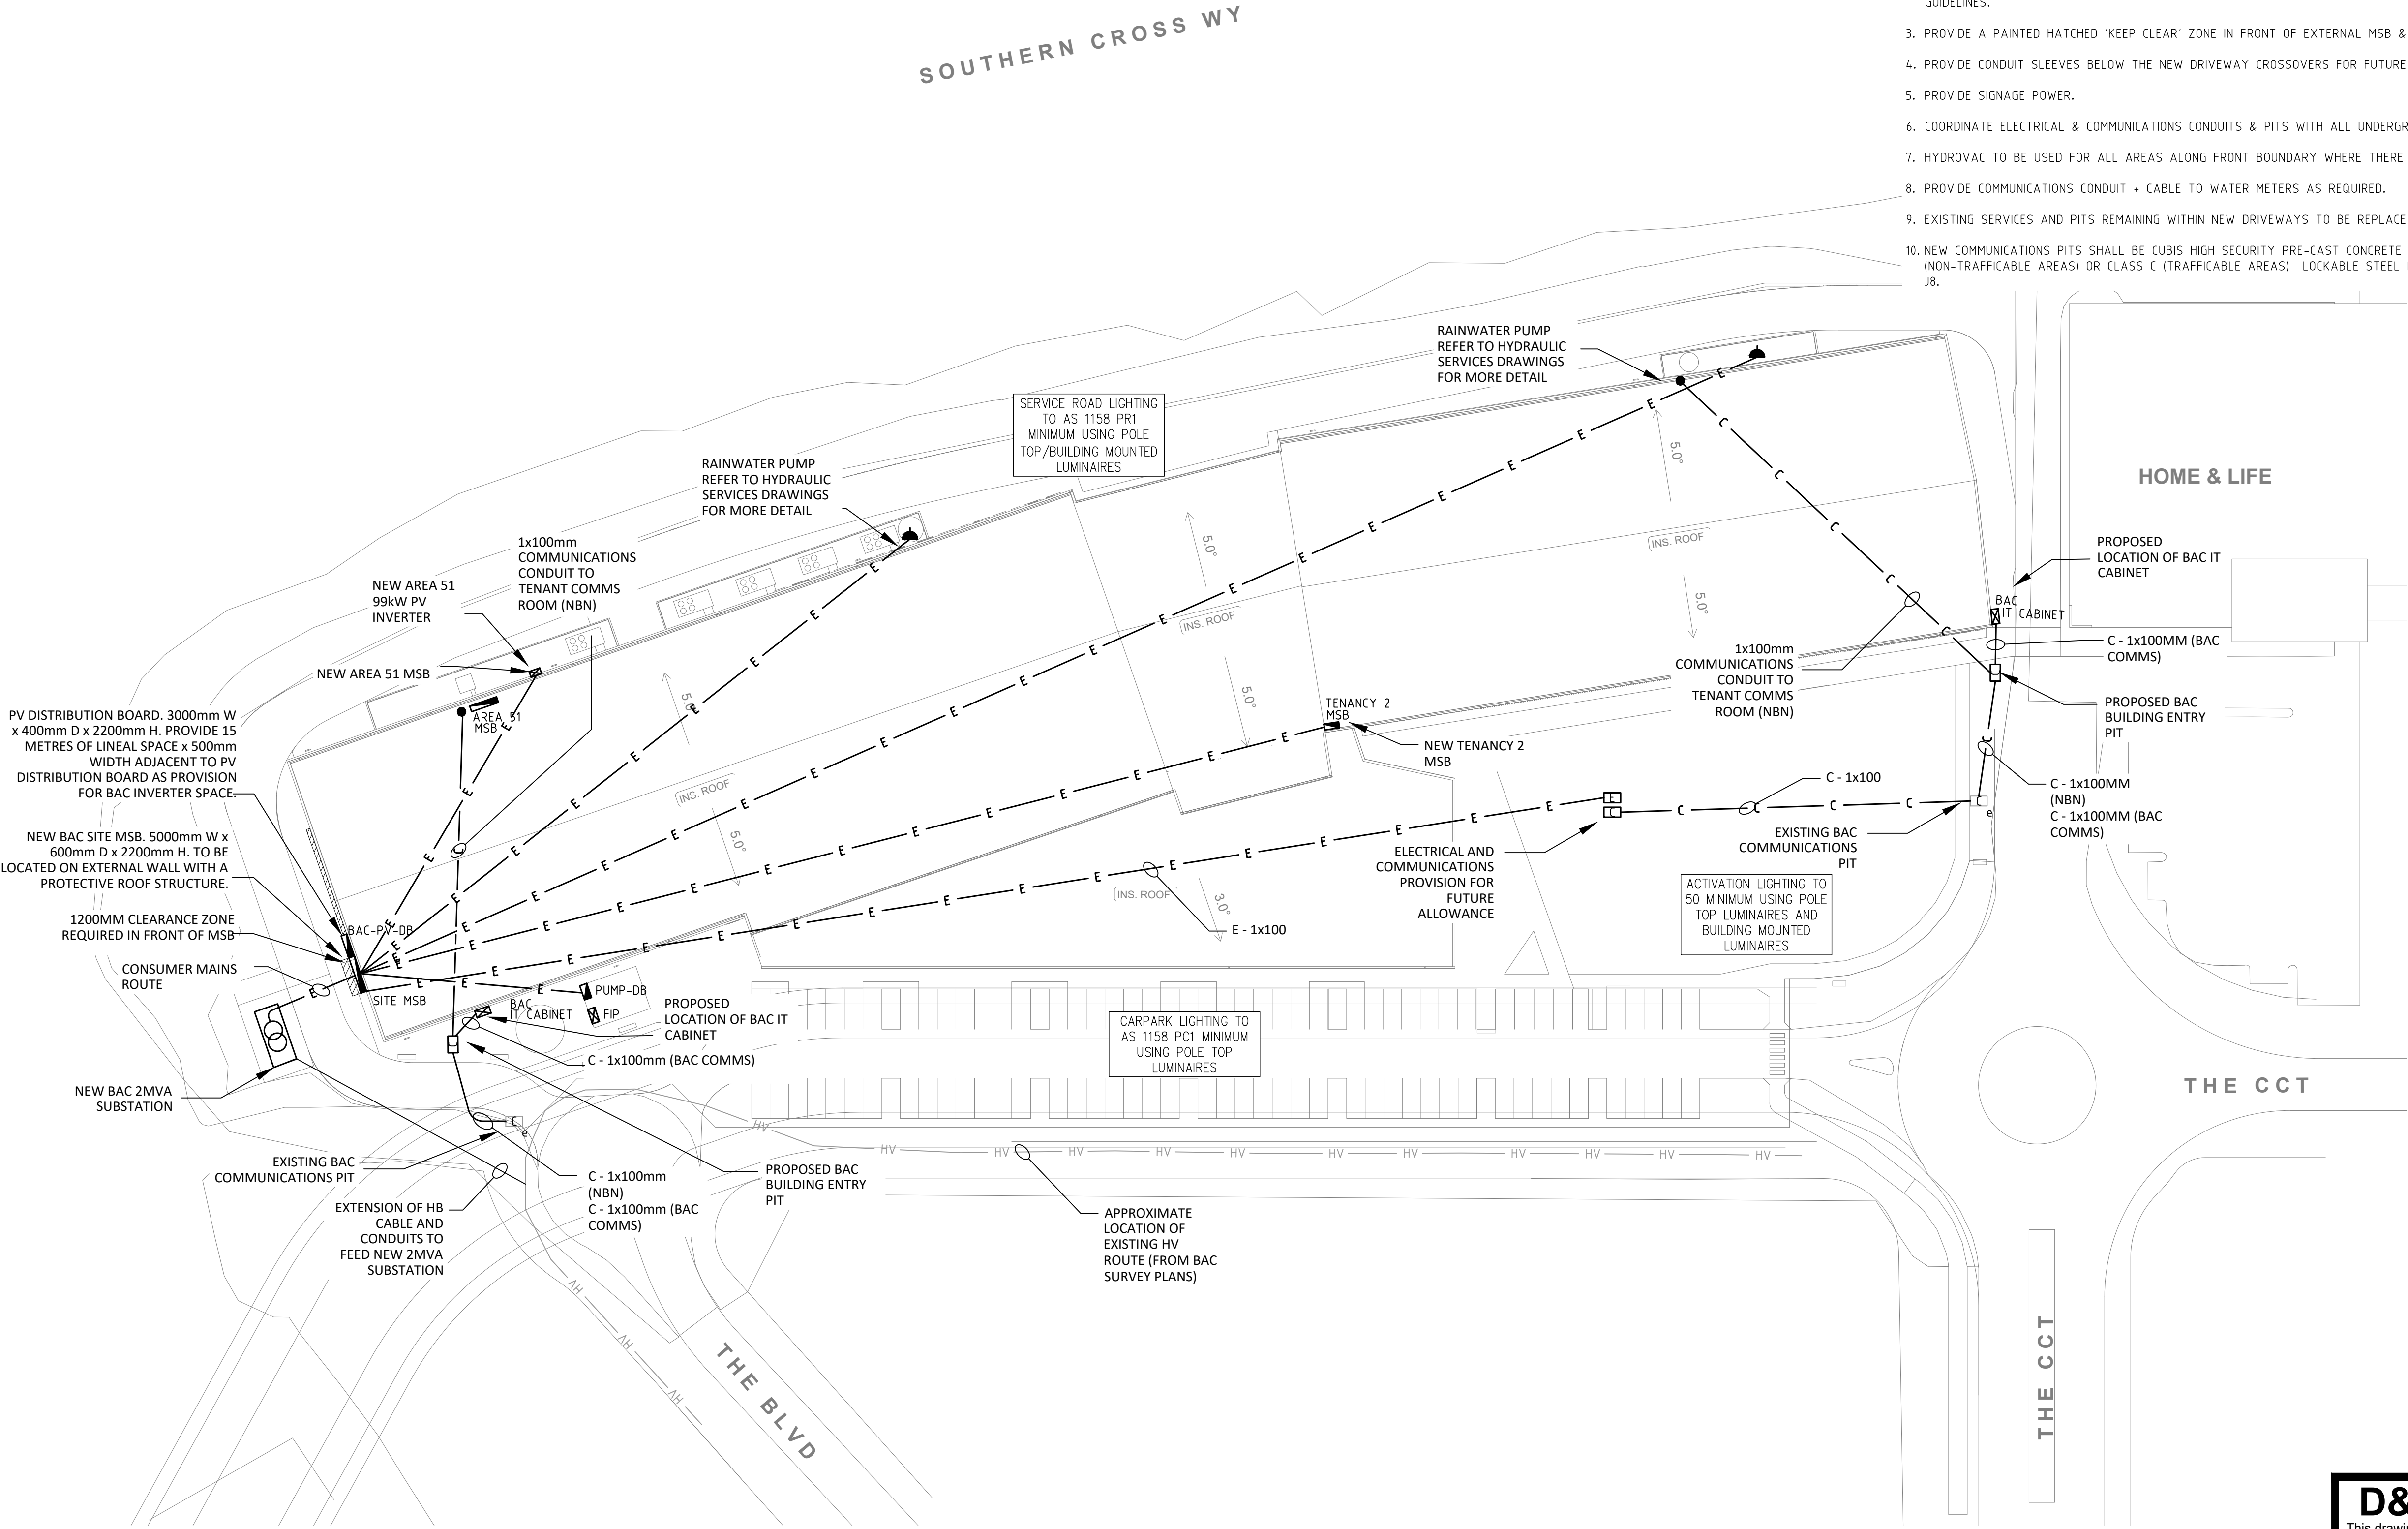

D&C PRICING ISSUE

This drawing is diagrammatic & approximate only. The (sub-)contractor shall make all allowances necessary to price the project on a Design & Construct methodology. Where items are not specifically shown or included, but are required, the (sub-)contractor shall make all allowances for such items to ensure compliant system(s) are provided that satisfy the client's expectations & operational requirements.