



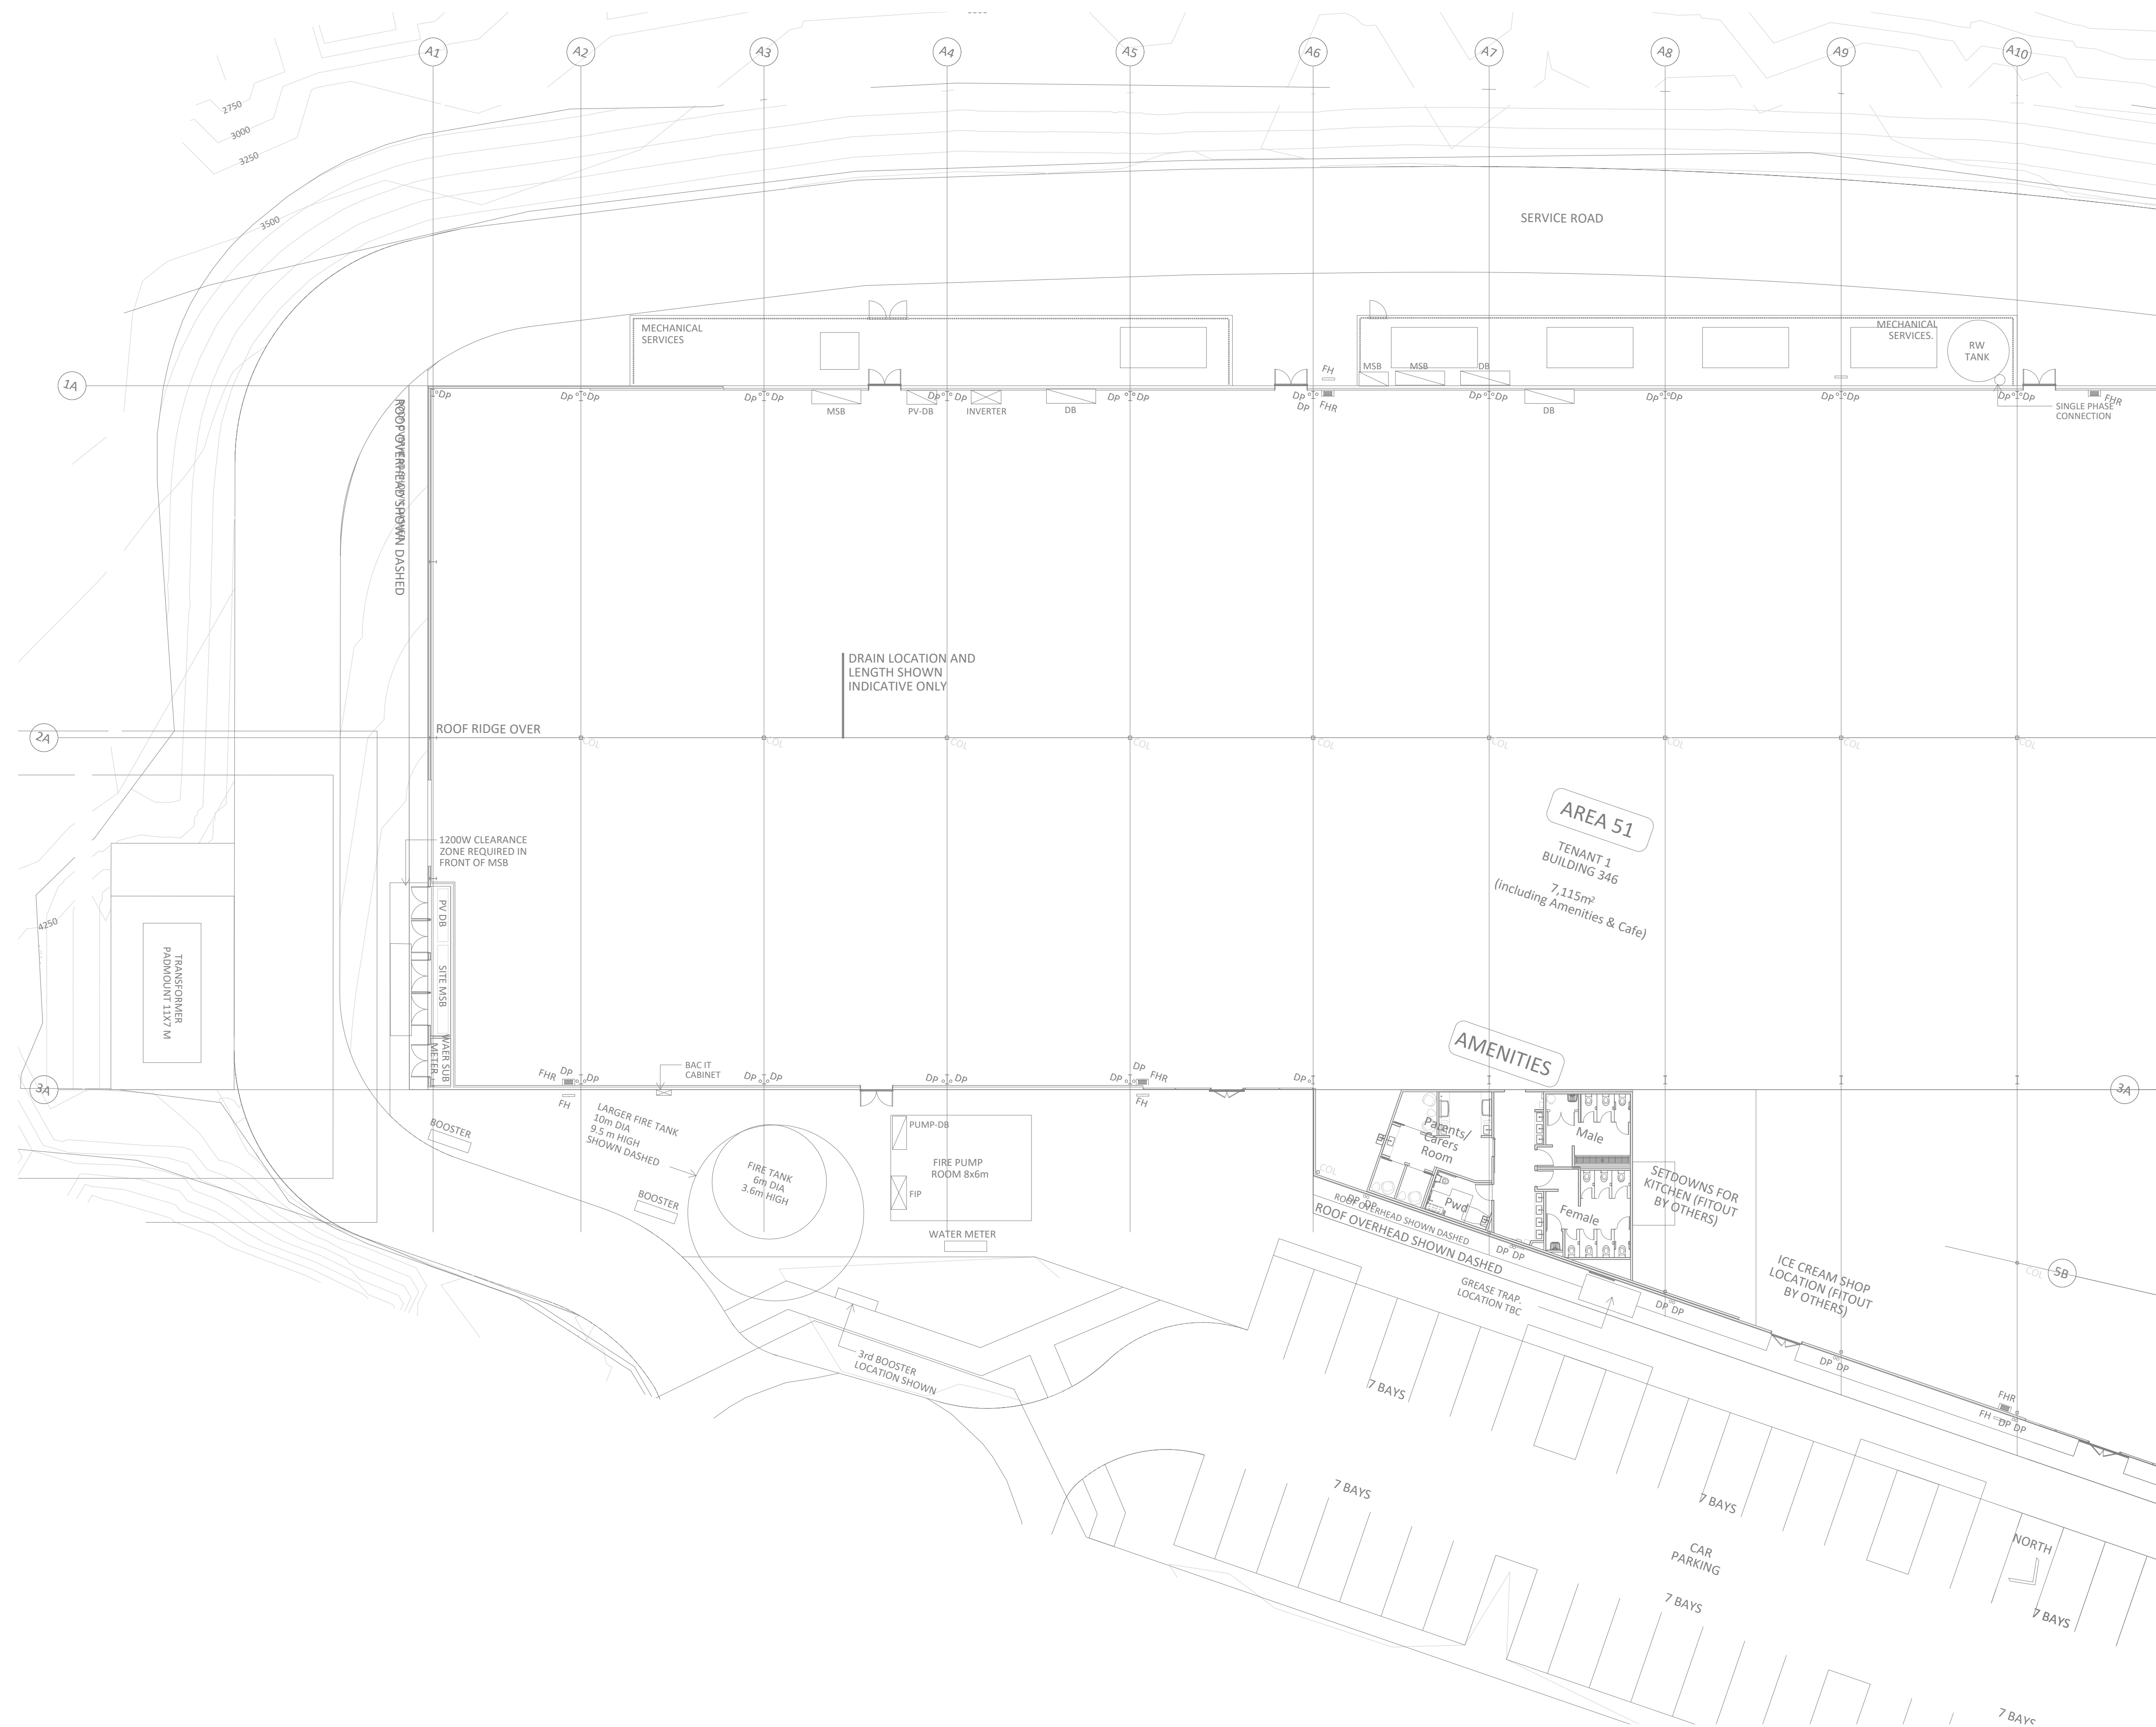

| Room/Space                                                                                      | Lighting Requirements to AS1680 | Fitting type                        | Control method                                                                  |
|-------------------------------------------------------------------------------------------------|---------------------------------|-------------------------------------|---------------------------------------------------------------------------------|
| Area 51                                                                                         | 320 lux                         | High Bay Luminaires                 | Switches located near entrances in BOH areas                                    |
| BOH Areas                                                                                       | 240 lux                         | Recessed LED panels                 | Combination of switches located near entrances and motion sensors in each space |
| Cafe kitchens                                                                                   | 320 lux                         | Recessed LED Panels                 | Switches located near cafe kitchen entrances                                    |
| Amenities                                                                                       | 80 lux                          | Recessed LED downlights             | Motion sensor                                                                   |
| PWD                                                                                             | 200 lux                         | Recessed LED downlights             | Motion sensor                                                                   |
| Outdoor Area                                                                                    | 80 lux                          | IP rated surface mounted luminaires | Switches located on inside of building                                          |
| <p align="center"><b>PROVIDE EXIT AND EMERGENCY LIGHTING TO NCC AND AS2293 REQUIREMENTS</b></p> |                                 |                                     |                                                                                 |

LIGHTING TO AREA 51 TENANCY

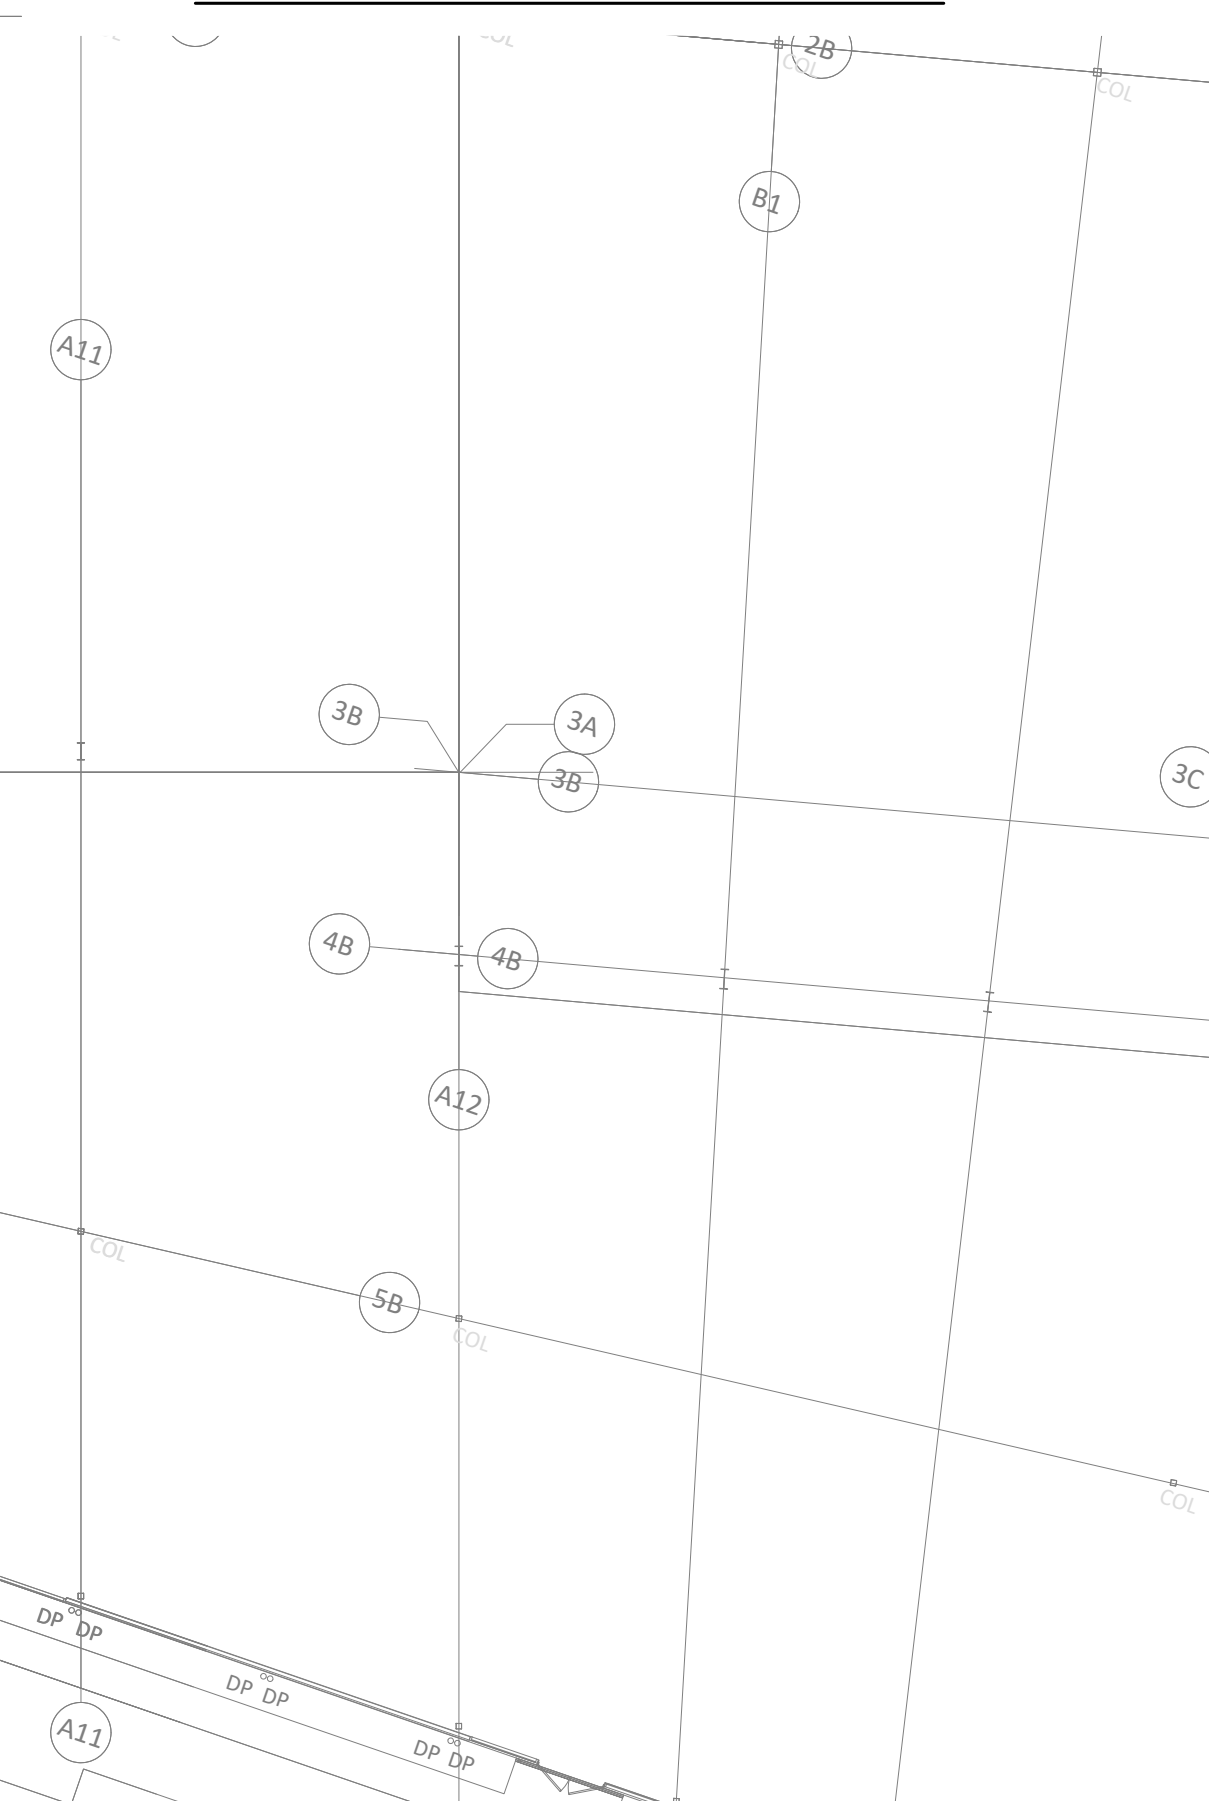

## D&C PRICING ISSUE

This drawing is diagrammatic & approximate only. The (sub-)contractor shall make all allowances necessary to price the project on a Design & Construct methodology. Where items are not specifically shown or included, but are required, the (sub-)contractor shall make a allowances for such items to ensure compliant system(s) are provided that satisfy the client's expectations & operational requirements.