


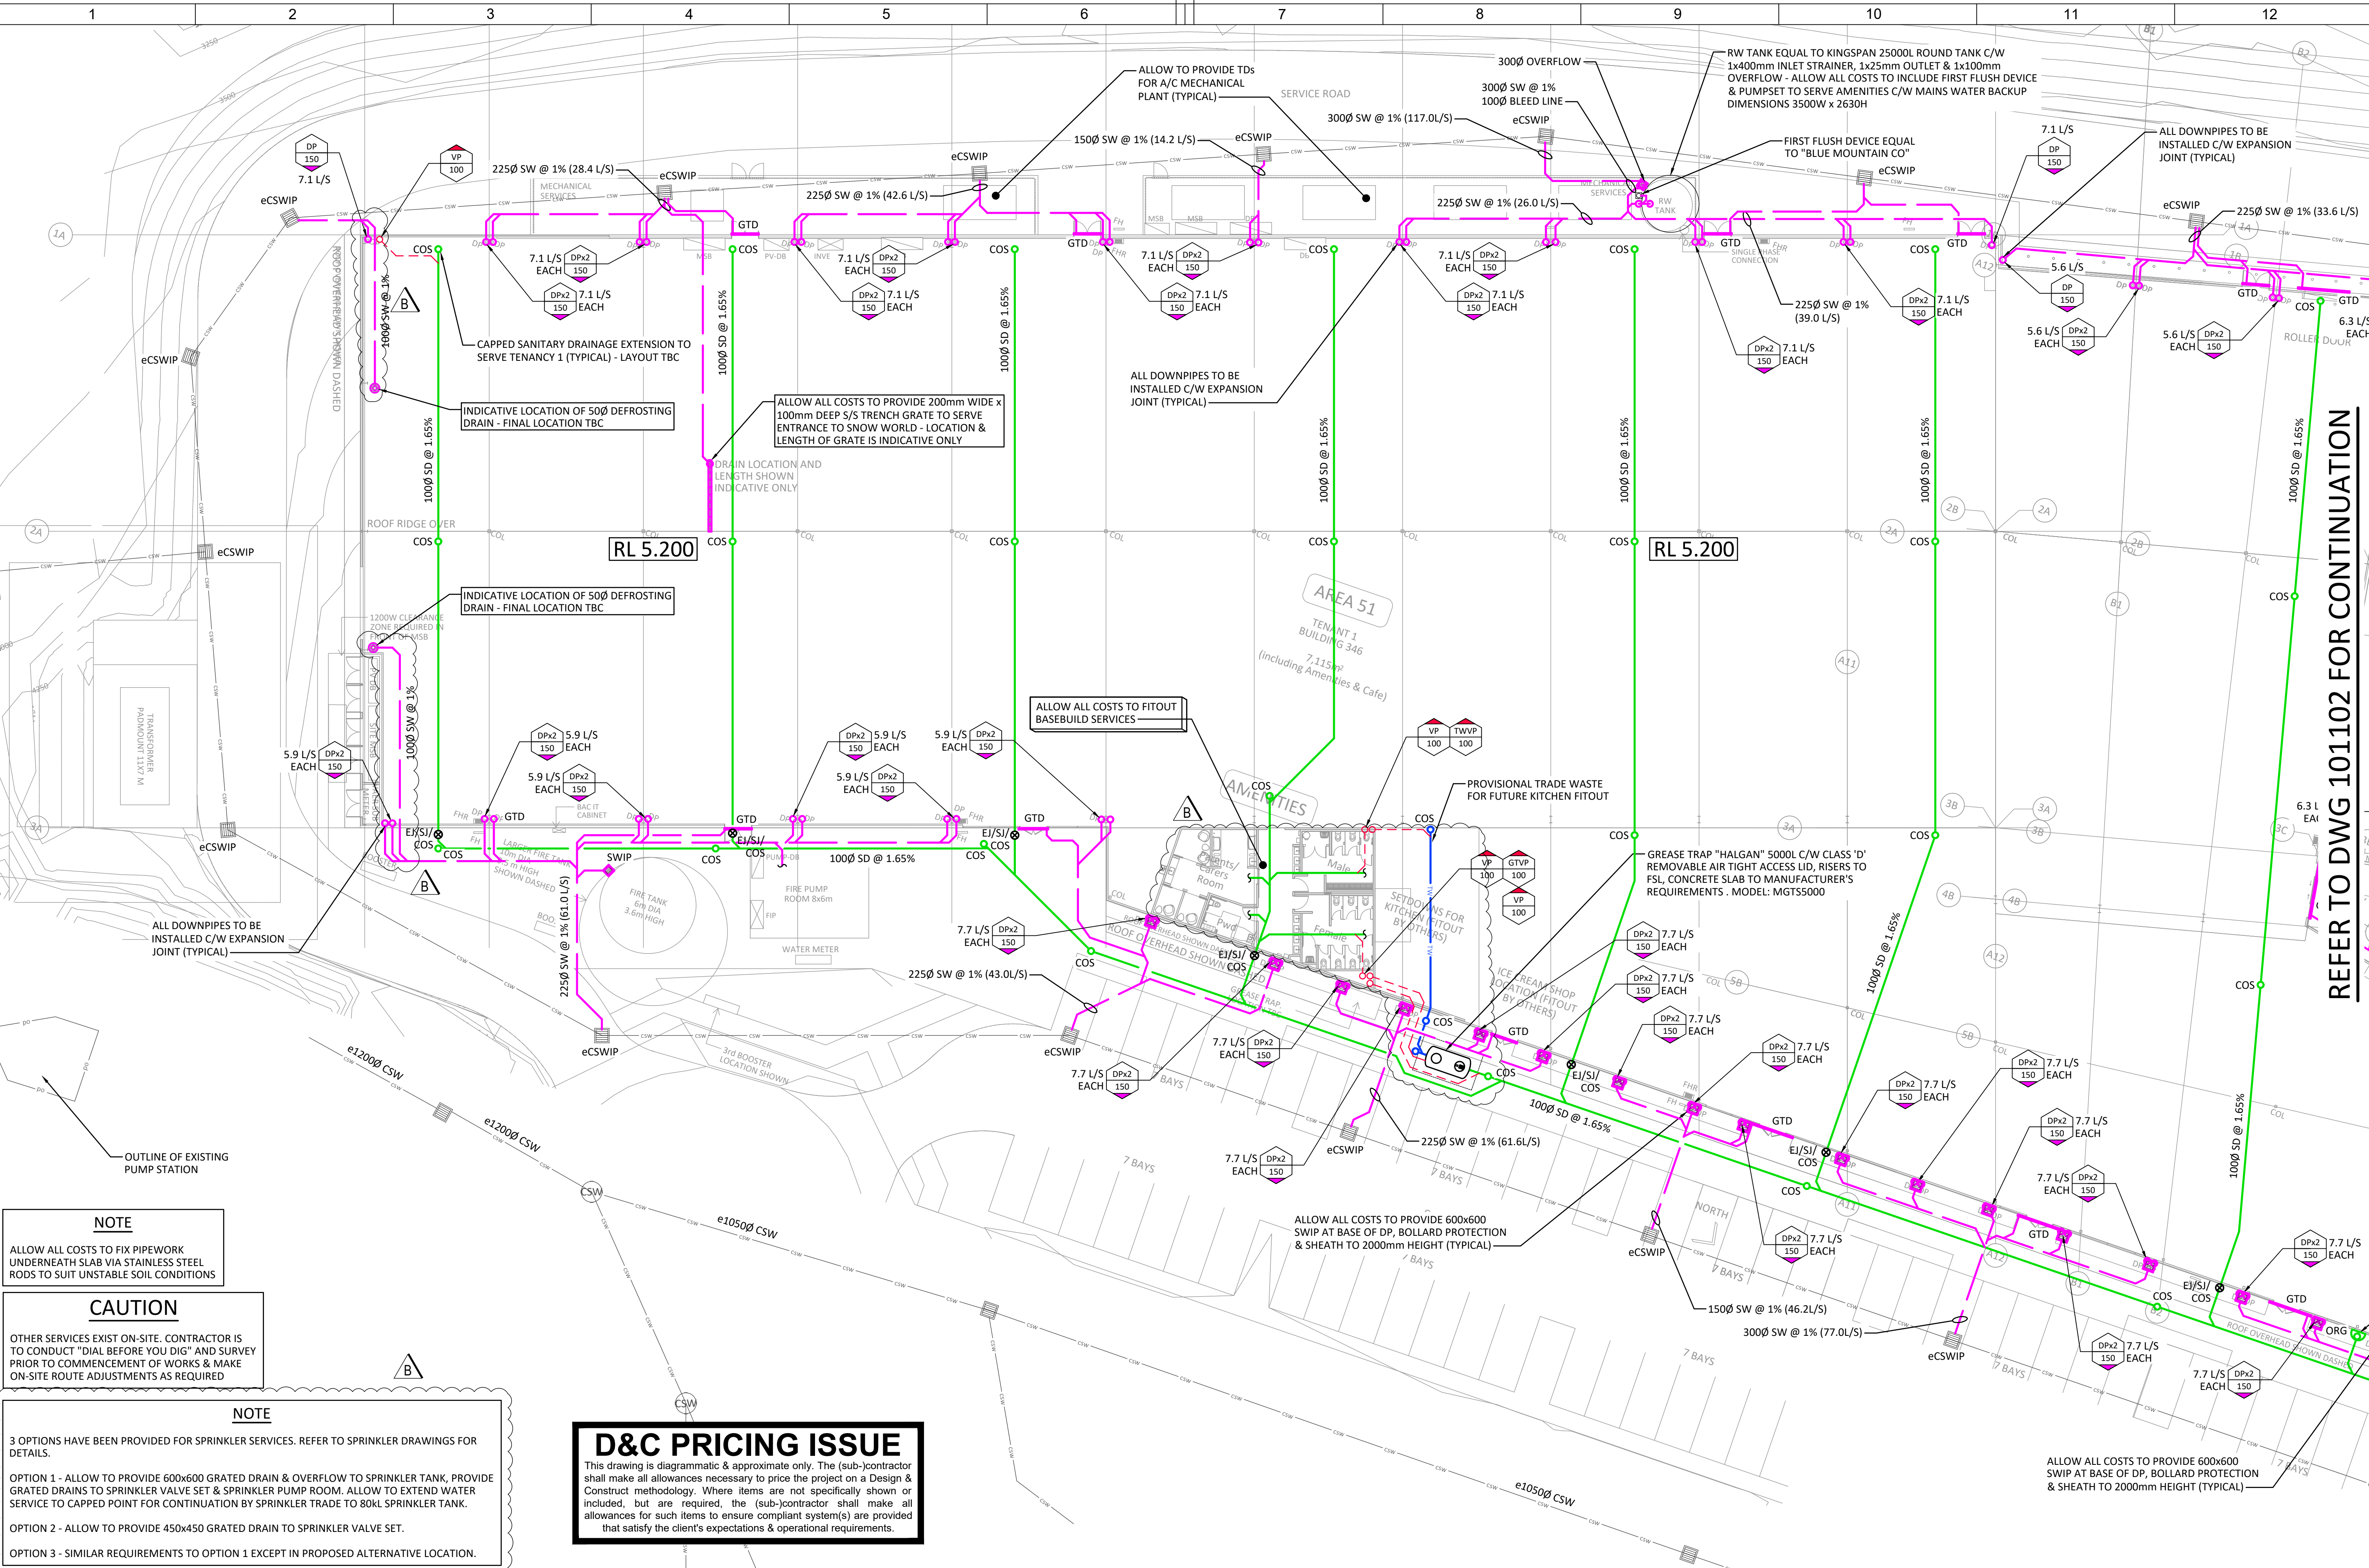

REFER TO DWG 101102 FOR CONTINUATION

NOTE
ALLOW ALL COSTS TO FIX PIPEWORK UNDERNEATH SLAB VIA STAINLESS STEEL RODS TO SUIT UNSTABLE SOIL CONDITIONS

CAUTION
OTHER SERVICES EXIST ON-SITE. CONTRACTOR IS TO CONDUCT "DIAL BEFORE YOU DIG" AND SURVEY PRIOR TO COMMENCEMENT OF WORKS & MAKE ON-SITE ROUTE ADJUSTMENTS AS REQUIRED

NOTE
3 OPTIONS HAVE BEEN PROVIDED FOR SPRINKLER SERVICES. REFER TO SPRINKLER DRAWINGS FOR DETAILS.
OPTION 1 - ALLOW TO PROVIDE 600x600 GRATED DRAIN & OVERFLOW TO SPRINKLER TANK. PROVIDE GRATED DRAINS TO SPRINKLER VALVE SET & SPRINKLER PUMP ROOM. ALLOW TO EXTEND WATER SERVICE TO CAPPED POINT FOR CONTINUATION BY SPRINKLER TRADE TO 80KL SPRINKLER TANK.
OPTION 2 - ALLOW TO PROVIDE 450x450 GRATED DRAIN TO SPRINKLER VALVE SET.
OPTION 3 - SIMILAR REQUIREMENTS TO OPTION 1 EXCEPT IN PROPOSED ALTERNATIVE LOCATION.

D&C PRICING ISSUE
This drawing is diagrammatic & approximate only. The (sub-)contractor shall make all allowances necessary to price the project on a Design & Construct methodology. Where items are not specifically shown or included, but are required, the (sub-)contractor shall make all allowances for such items to ensure compliant system(s) are provided that satisfy the client's expectations & operational requirements.