1	2	3	4	5	6	7	8	9	10	11	12

PROPOSED AREA 51:
CEILING LEVEL SPRINKLER PROTECTION ONLY THROUGHOUT ENTIRE BUILDING TO AS2118.1-2017 ORDINARY HAZARD OH3 AND TO FIRE ENGINEERING REPORT PREPARED BY OMNII.


REVIEW ALL TENANCY FITOUT DETAILS AND MAKE ALLOWANCE FOR:
*ALL REQUIRED DROPPERS TO LOW LEVEL CEILING PROTECTION AND CONCEALED SPACE PROTECTION WHERE REQUIRED.,
*SPRINKLER HEADS BELOW EXPOSED AIR CONDITIONING DUCTING AS REQUIRED
*ROOF LEVEL SPRINKLER PROTECTION TO CONTINUE ABOVE SNOW WORLD AREA AS NOTED
*NO SPECIAL ALLOWANCE FOR STORAGE BEYOND THAT ALLOWED UNDER AS2118.1-2017 INCIDENTAL HIGH HAZARD STORAGE IN A NON-HIGH-HAZARD PROTECTED AREA

PROPOSED GAME OVER:
CEILING LEVEL SPRINKLER PROTECTION ONLY THROUGHOUT ENTIRE BUILDING TO AS2118.1-2017 ORDINARY HAZARD OH3 AND TO FIRE ENGINEERING REPORT PREPARED BY OMNII.

REVIEW ALL TENANCY FITOUT DETAILS AND MAKE ALLOWANCE FOR:
*ALL REQUIRED DROPPERS TO LOW LEVEL CEILING PROTECTION AND CONCEALED SPACE PROTECTION WHERE REQUIRED.,
*SPRINKLER HEADS BELOW EXPOSED AIR CONDITIONING DUCTING AS REQUIRED
*NO SPECIAL ALLOWANCE FOR STORAGE BEYOND THAT ALLOWED UNDER AS2118.1-2017 INCIDENTAL HIGH HAZARD STORAGE IN A NON-HIGH-HAZARD PROTECTED AREA

SNOW WORLD:
APPROXIMATE EXTENT OF SNOW WORLD INSIDE AREA 51 SHOWN. THIS IS A -5°C FREEZER ENVIRONMENT WITH CEILING LEVEL ONLY DRY PENDENT HEADS SUITABLE FOR THE TEMPERATURE.

THE AREA ABOVE THIS FREEZER IS TO BE PROTECTED AS PART OF THE OVERALL AREA 51 ROOF LEVEL SPRINKLER SYSTEM

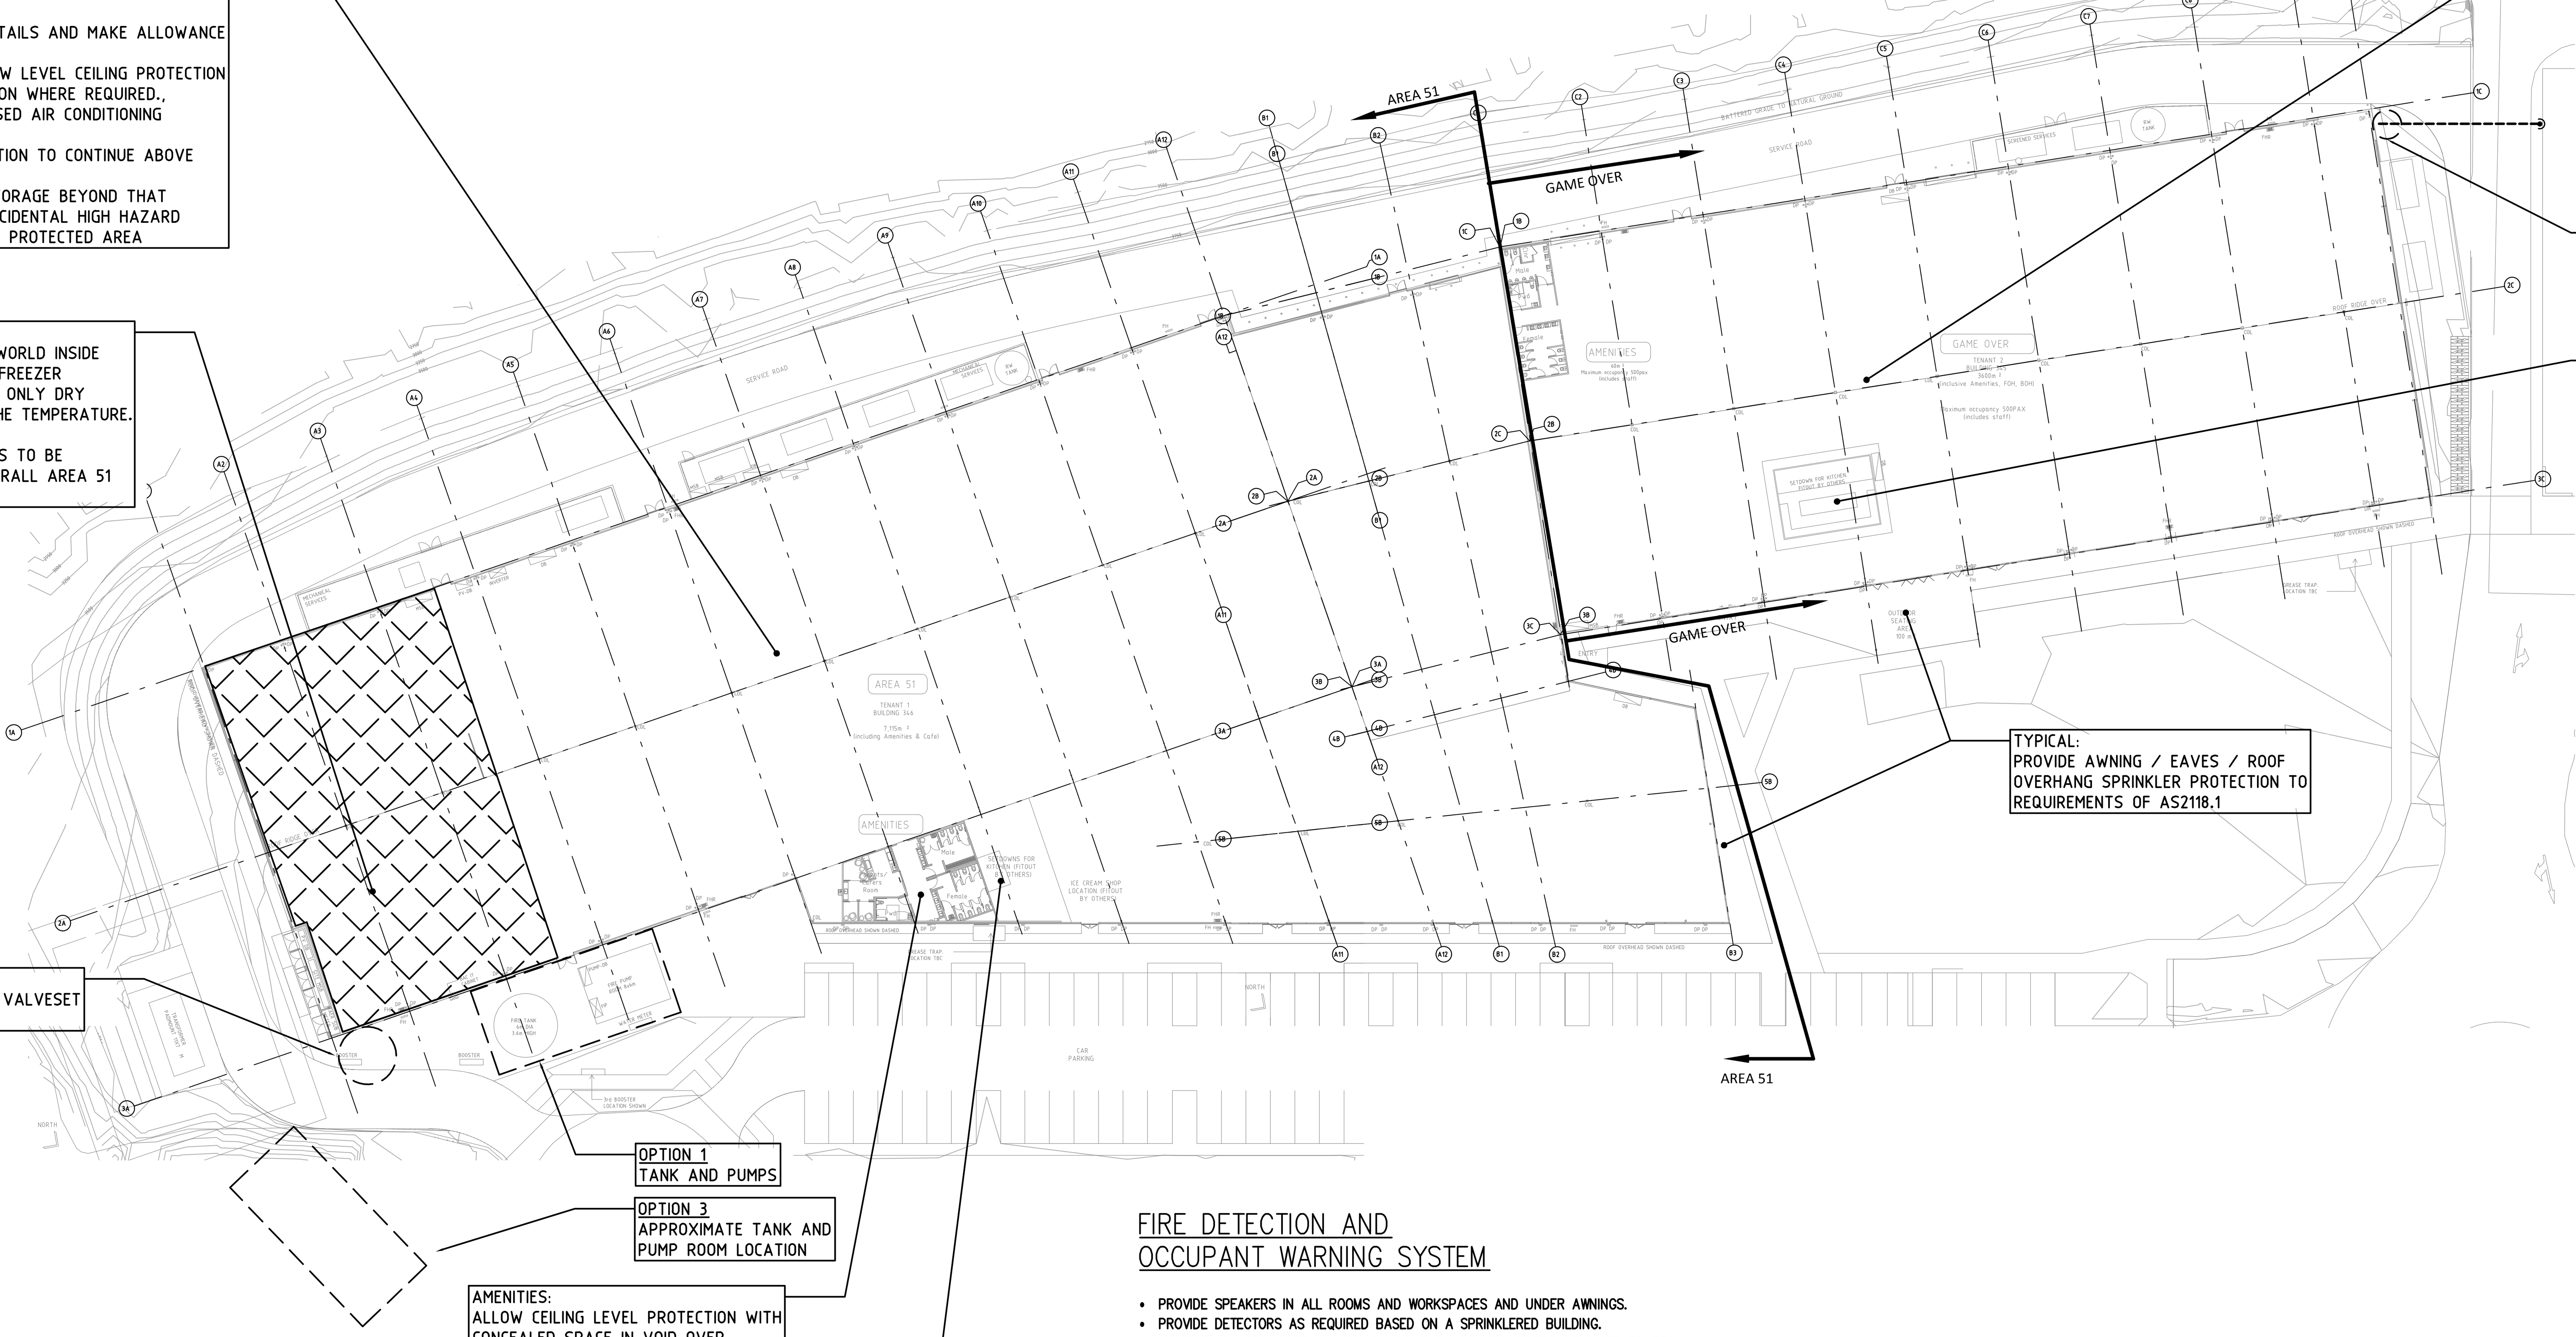

OPTION 2
PROPOSED VALVE SET LOCATION FROM INGROUND AND VIA ADJACENT BUILDING ROOF, CONNECTED TO EXISTING PUMPS (SEE INSET TO THE SIDE) AND TANK (200kL)

KITCHEN:
ALLOW FOR PROTECTION TO COOKING CANOPY AND HORIZONTAL EXHAUST DUCTING TO FRONT EXTERNAL WALL

EXISTING HOME&LIFE SPRINKLER PUMP INFO:

PUMP DESIGN DATA
2 X DIESEL FM PUMPS
FIRE PUMP LISTING: FM
FLANGE RATING: ANSI 125lb
SUCTION /125lb DISCHARGE
RATED FLOW: 500 USGPM
RATED HEAD: 449.6 kPa
DESIGN FLOW: 749.5 USGPM
DESIGN HEAD: 392 kPa

TYPICAL:
PROVIDE AWNING / EAVES / ROOF OVERHANG SPRINKLER PROTECTION TO REQUIREMENTS OF AS2118.1

OPTION 3
PROPOSED VALVESET LOCATION

OPTION 1
TANK AND PUMPS

OPTION 3
APPROXIMATE TANK AND PUMP ROOM LOCATION

AMENITIES:
ALLOW CEILING LEVEL PROTECTION WITH CONCEALED SPACE IN VOID OVER.

KITCHEN:
ALLOW FOR PROTECTION TO COOKING CANOPY AND HORIZONTAL EXHAUST DUCTING TO FRONT EXTERNAL WALL

NOTES ON OPTIONS SHOWN:

OPTION 1:
OPTION 1 IS THE BASE PRICING OPTION, WITH TANK AND PUMPS AT GRID 3A - A3/4 ADJACENT TO BUILDING


OPTION 2:
THERE IS A POSSIBILITY TO UTILISE THE ADJACENT HOME & LIFE BUILDING'S FIRE SPRINKLER INFRASTRUCTURE, AS INDICATED, BY CONNECTING INTO Ø150 PIPE WHERE IT RISES ABOVE GROUND, EXTEND TO ABOVE ROOF AND TRAVERSE THE ROOF TO DROP AT FAR END, CONTINUE UNDERGROUND TO RISE AT CORNER ON GRID 1C - C10 OF THIS PROJECT.

OPTION 3:
OPTION 3 IS SIMILAR TO OPTION 1, EXCEPT THAT TANK AND PUMPS ARE NOW ON OTHER SIDE OF THE ROAD AND ARE INTENDED TO ALSO BE USED FOR FUTURE DEVELOPMENT TOWARDS NORTH-EAST. PIPING TO THIS PROJECT TO BE RUN UNDER GROUND TO VALVESETS AT CORNER ON GRID 3A - A1 AS INDICATED.

FIRE DETECTION AND OCCUPANT WARNING SYSTEM

- PROVIDE SPEAKERS IN ALL ROOMS AND WORKSPACES AND UNDER AWNINGS.
- PROVIDE DETECTORS AS REQUIRED BASED ON A SPRINKLERED BUILDING.
- MONITOR ALL SPRINKLER VALVES, PUMPS, FLOW DEVICES, PRESSURE SWITCHES, ETC.
- PROVIDE RED STROBES TO AREAS AS REQUIRED BY THE FER.
- PROVIDE DETECTORS IF REQUIRED IN OFFICE CEILING SPACE GREATER THAN 800mm.
- ELECTRIC CONTROLLED DOORS TO UNLATCH IN A FIRE EVENT IF REQUIRED.
- PROVIDE SMOKE DETECTION SYSTEM TO PLAY AREAS AS REQUIRED FOR THE ACTIVATION OF SMOKE EXHAUST SYSTEM.

SITE PLAN
SCALE 1:500

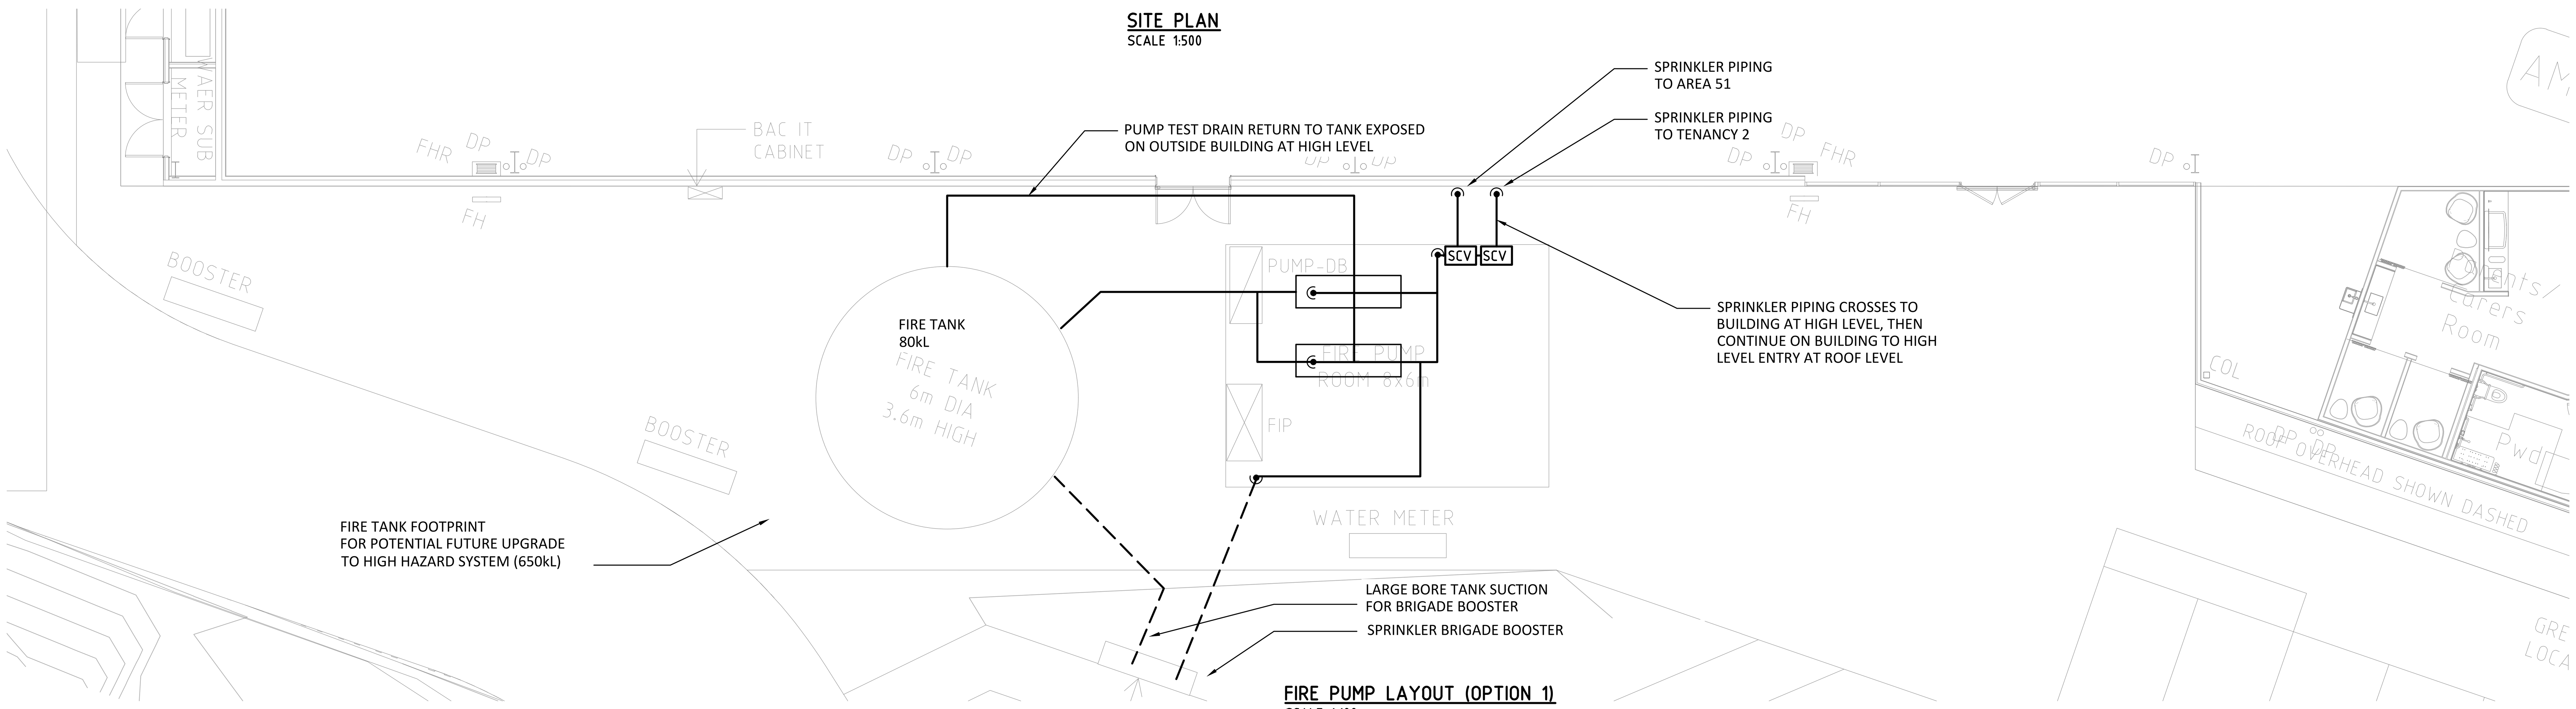

PUMP TEST DRAIN RETURN TO TANK EXPOSED ON OUTSIDE BUILDING AT HIGH LEVEL

SPRINKLER PIPING TO AREA 51

SPRINKLER PIPING TO TENANCY 2

SPRINKLER PIPING CROSSES TO BUILDING AT HIGH LEVEL, THEN CONTINUE ON BUILDING TO HIGH LEVEL ENTRY AT ROOF LEVEL

FIRE TANK FOOTPRINT FOR POTENTIAL FUTURE UPGRADE TO HIGH HAZARD SYSTEM (650kL)

LARGE BORE TANK SUCTION FOR BRIGADE BOOSTER

SPRINKLER BRIGADE BOOSTER

FIRE PUMP LAYOUT (OPTION 1)
SCALE 1:100

A	B	C	D	E	F	G	H

D&C PRICING ISSUE
This drawing is diagrammatic & approximate only. The (sub-)contractor shall make all allowances necessary to price the project on a Design & Construct methodology. Where items are not specifically shown or included, but are required, the (sub-)contractor shall make all allowances for such items to ensure compliant system(s) are provided that satisfy the client's expectations & operational requirements.

COPYRIGHT :
REPRODUCTION OF WHOLE OR PART OF THIS DOCUMENT CONSTITUTES AN INFRINGEMENT OF COPYRIGHT. THE INFORMATION, IDEAS AND CONCEPTS CONTAINED IN THIS DOCUMENT ARE CONFIDENTIAL. THE RECIPIENT(S) OF THIS DOCUMENT IS PROHIBITED FROM DISCLOSING SUCH INFORMATION IDEAS AND CONCEPTS TO ANY PERSON WITHOUT THE PRIOR WRITTEN CONSENT OF THE BRISBANE AIRPORT CORPORATION PTY. LTD.

DRN	AMENDMENTS	DATE	REV
NB	D&C PRICING ISSUE	05/02/26	B
NB	D&C PRICING ISSUE	17/12/25	A

25-0437

Ashburner Francis
Ashburner Francis Pty Ltd ABN 46 009 975 197
T 07 3510 8888
E brisbane@ashburnerfrancis.com.au
977 Stanley Street East, East Brisbane QLD 4169
BRISBANE | TOOWOOMBA | TOWNSVILLE | DARWIN
FIRE SPRINKLER SERVICES
QBCC LICENCE No: 15126403

Archipelago
Level 3, 199 George Street, Brisbane QLD 4000
T +617 3236 4606 www.archipelago.com.au

© ARCHIPELAGO ARCHITECTS PTY. LTD. All Rights Reserved
This work is copyright and cannot be reproduced or copied by any means without written permission of Archipelago Architects Pty Ltd. Any license, express or implied, to use this document for any purpose whatsoever is restricted to the terms of the agreement between Archipelago Architects Pty Ltd and the instructing party.

Drawn	Checked
NB	
Design Coordinated	Compliance Checked
KDL	
Authorised For Issue	Construction Checked
SS	

SKYGATE PLAY
THE CIRCUIT, BRISBANE AIRPORT

FIRE SPRINKLERS SERVICES

FIRE PROTECTION LAYOUT

Brisbane Airport
Brisbane Airport Corporation Pty Ltd
11 The Circuit Brisbane Airport QLD 4008
PO Box 61 Hamilton QLD 4007 Australia
Telephone : 61 7 3406 3000
Fascimile : 61 7 3406 3111
Email : info@bne.com.au
www.brisbaneairport.com.au
ABN 54 076 870 650

Scale: AS SHOWN
Size: A1
Revision: B

Drawing Number	Project No.	Originator	Volume	Level	Type	Discipline	Number
	25021 -	ASH -	XX -	XX -	DR -	FR	- 001100

File: 2528 - TMR Depot Pentable: Printer: User: #### Plot Date & Time: 4/06/2025 7:54 PM