

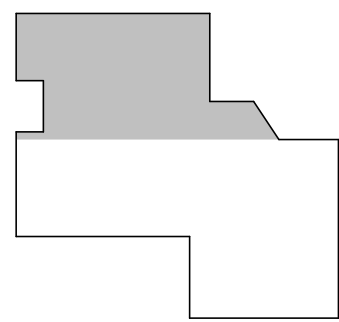




KEYPLAN

DRAWING NOTES:

1. ALL HOSE TAPS EXCEPT FOR GIT TAP WILL HAVE A VERTICAL BREAK OR SINGLE CHECK VALVE INSTALLED.
2. DRAIN GRADE SHOULD BE 1:40 FOR THE FIRST 800mm EXTERNAL TO THE SLAB.
3. SWIVEL EXPANSION JOINTS INSTALLED ON GRADE SHOULD BE USED TO CORRECT PIPE MISALIGNMENT.
4. SWIVEL EXPANSION JOINTS AND EXPANSION JOINTS SHOULD BE INSTALLED AT 50% OF THEIR TELESCOPIC MOVEMENT.
5. EXPANSION JOINTS INSTALLED ON VERTICAL RISERS SHOULD HAVE A MINIMUM OF 40mm TELESCOPIC MOVEMENT.

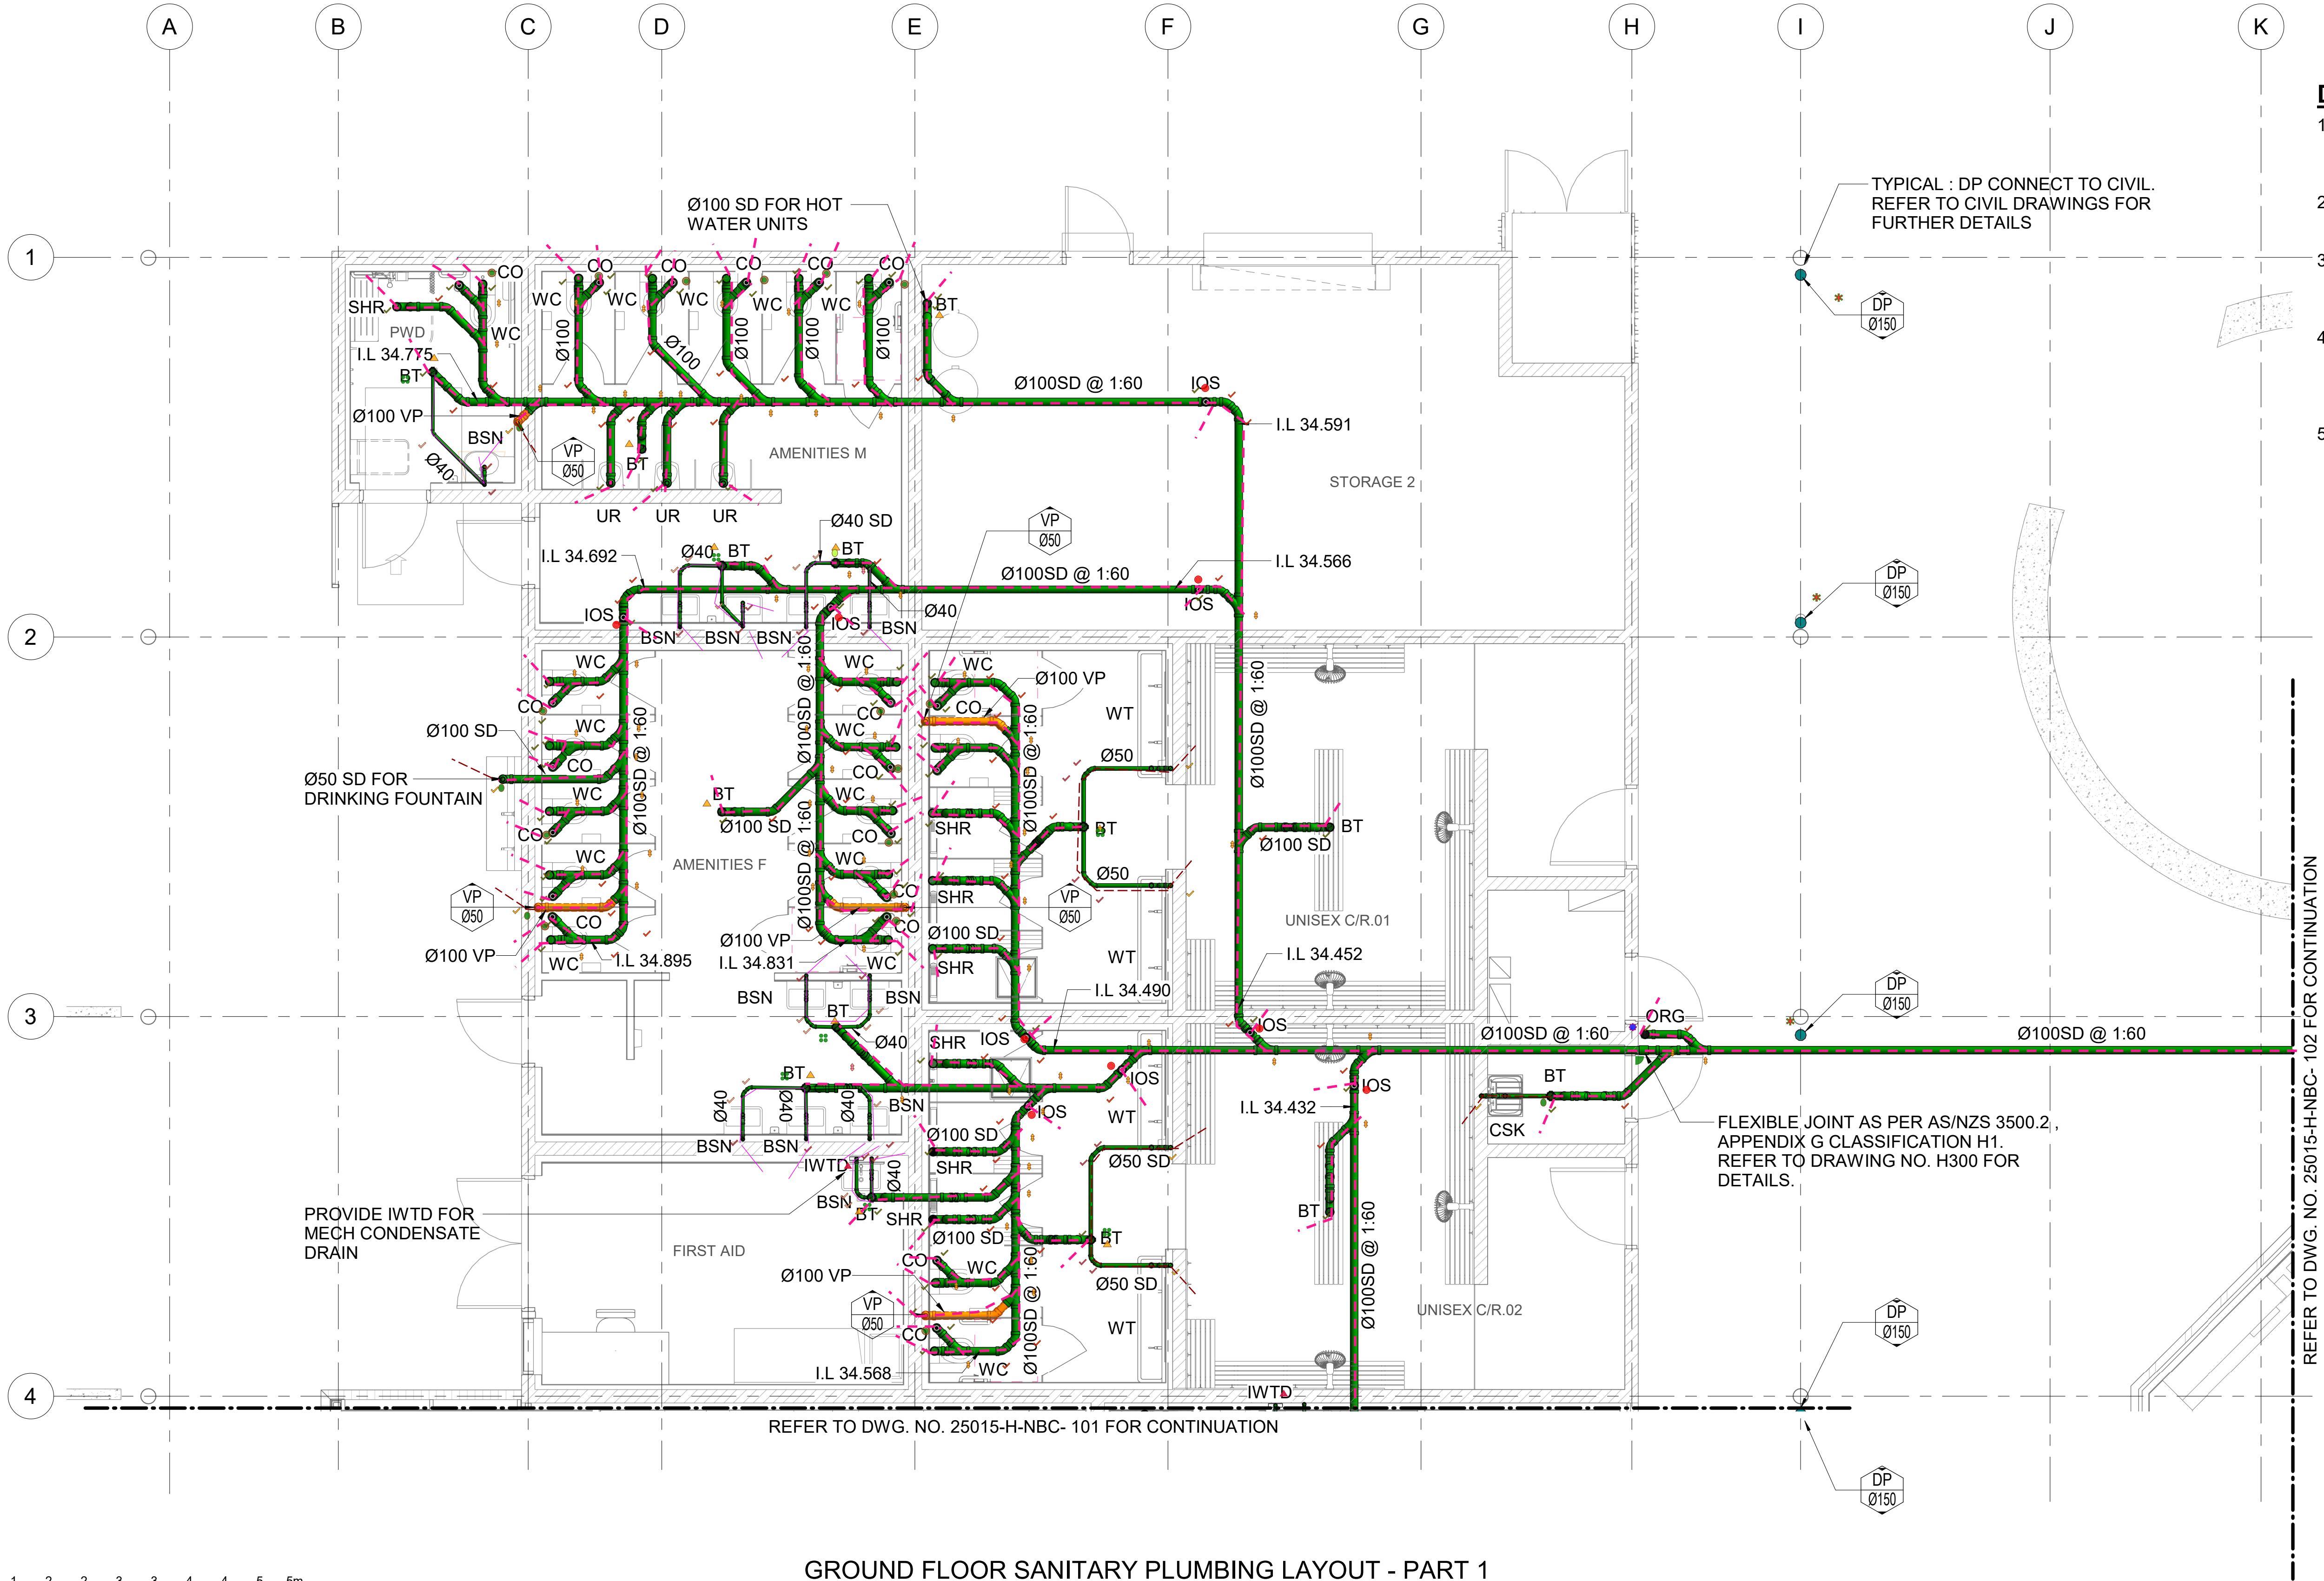

GROUND FLOOR SANITARY PLUMBING LAYOUT - PART 1

1 : 50

0 1 1 2 2 3 3 4 4 5 5m
SCALE 1:50 AT A1 SHEET | 1:100 AT A3 SHEET

ALL DIMENSIONS SHOWN IN MM. DO NOT SCALE FROM DRAWINGS.
DIMENSIONS TAKE PRECEDENCE. IF IN DOUBT REFER TO HK SOLUTIONS.

T1	ISSUE FOR TENDER	17.06.2026	MC	HKS
REV.	DESCRIPTION	DATE	INT.	COMPANY
REVISIONS				



ENGINEERING
PROJECT MANAGEMENT
DARWIN, GEELONG,
CAIRNS, TOWNSVILLE,
PERTH, BALLARAT
admin@hksolutions.com.au
www.hksolutions.com.au

Conditions of use. This document may only be used by
Harris Kmon Solutions clients for the purpose for which
it was prepared and must not be used by any other
person or for any other purpose.

SPORTENG™

DRAWN	AL
CHECKED	MC
DESIGNED	MC
CHECKED	LM
APPROVED	

THIS DRAWING MUST
NOT BE USED FOR
CONSTRUCTION UNLESS
SIGNED AS APPROVED

STAGE 1
ROCKHAMPTON SPORTS PRECINCT - NETBALL CLUBHOUSE
554-700 YAAMBA ROAD, NORMAN GARDEN - 4701
GROUND FLOOR SANITARY PLUMBING LAYOUT - PART 1

PAGE No	PROJECT No - DRAWING No	DISCIPLINE	REV.	SHEET SIZE
04 of 10	25015-H-NBC-100	HYDRAULIC	T1	A1

FOR TENDER

DRAWINGS TO BE PRINTED IN COLOUR