


ROCKHAMPTON SPORTS PRECINCT, 554-700 YAAMBA ROAD NORMAN
GARDENS

<u>DRAWING SCHEDULE</u>		
<u>DWG No.</u>	<u>DRAWING TITLE</u>	<u>REV.</u>
25015 - H001	COVER SHEET, LOCALITY PLAN, SYMBOLS & LEGEND	T1
25015 - H002	SPECIFICATION	T1
25015 - H003	STAGE 1 SITE RETICULATION	T1
25015 - H300	DETAILS	T1
25015 - QCPS32VC/AO1	Q-MAX FORTIS 3200 PUMP STATION GENERAL LAYOUT (SECTIONAL PLAN VIEW)	T1
25015 - QCPS32VC/AO2	Q-MAX FORTIS 3200 PUMP STATION GENERAL LAYOUT (SECTIONAL ELEVATION)	T1

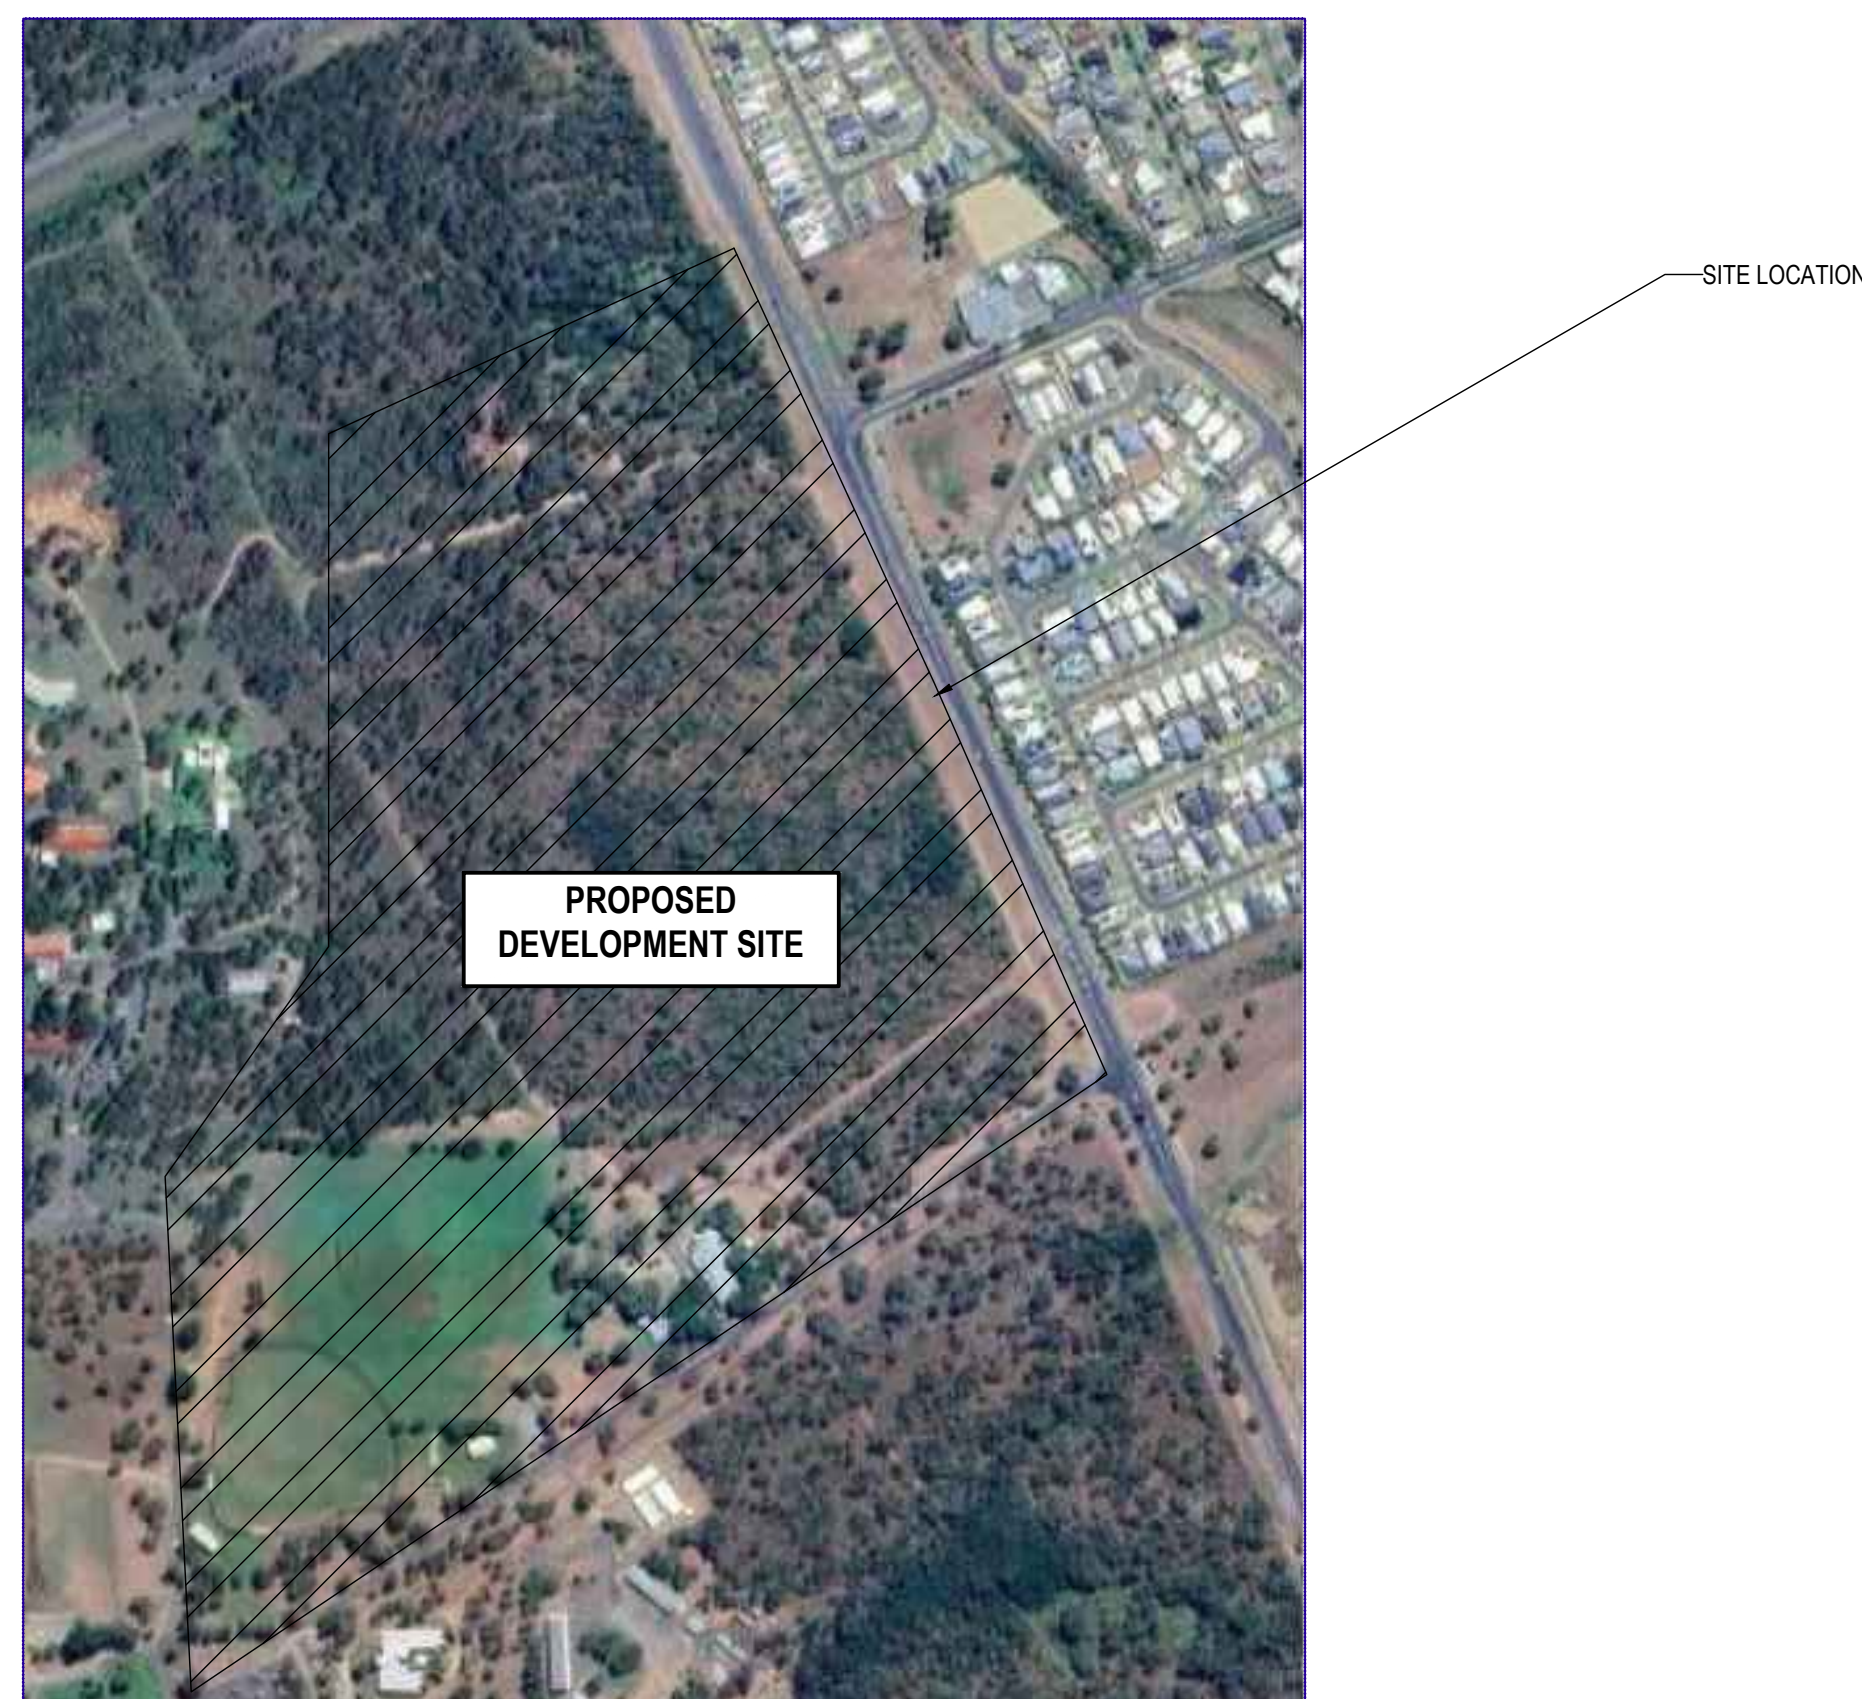

LOCALITY PLAN
NOT TO SCALE

LEGEND OF ABBREVIATIONS

SS	SOIL STACK
BV	BRANCH VENT
RV	RELIEF VENT
BRTHV	BREATHER VENT
TWV	TRADE WASTE VENT
SGV	SEALED GULLY VENT
TA	TO ABOVE.
TB	TO BELOW.
FA	FROM ABOVE.
I/G	IN GROUND
A/G	ABOVE GROUND
FB	FROM BELOW.
DCW	DOMESTIC COLD WATER
NPWCW	NON-POTABLE COLD WATER
NDCW	NON-DRINKABLE COLD WATER
DHW	DOMESTIC HOT WATER
DHWF	DOMESTIC HOT WATER FLOW
DHWR	DOMESTIC HOT WATER RETURN
DWW	DOMESTIC WARM WATER
NG	NATURAL GAS
IWTD	IN WALL TUNDISH
AAV	AIR ADMITTANCE VALVE
HWU	HOT WATER UNIT
TMV	THERMOSTATIC MIXING VALVE
TDCV	TESTABLE DOUBLE CHECK VALVE
BPD	BACK FLOW PREVENTION DEVICE
SMS	SEWER MAINTENANCE SHAFT
IL	INVERT LEVEL.
FFL	FINISHED FLOOR LEVEL.
—	SANITARY PIPE LINE TYPE.
—	TRADE WASTE PIPE LINE TYPE.
— W — W — W — W —	COLD WATER PIPE LINE TYPE.
—	HOT WATER PIPE LINE TYPE.
— F — F — F —	FIRE WATER PIPE LINE TYPE.


LEGEND OF SYMBOLS

	INSPECTION OPENING TO SURFACE c/w CHROME PLATED BRASS COVER.
 IOS	INSPECTION OPENING TO SURFACE c/w CONCRETE OR CAST IRON COVER.
	INSPECTION POINT
	PENETRATION
	CHANGE OF MATERIAL OR SIZES.
	ISOLATING VALVE.
	CHECK VALVE.
	ISOLATION VALVE IN GROUND BOX
 HWU	HOT WATER UNIT
	GAS METER
	WATER METER
	REMOTE PULSE WATER METER
	REDUCED PRESSURE ZONE DEVICE
	TESTABLE DOUBLE CHECK VALVE
	CIRCULATING PUMP (ARROW FACING PUMP DIRECTIC
	CAPPED END
	DIRECTION OF FLOW
	GAS OUTLET
GT 	GULLY TRAP
	SOLENOID FLUSHING VALVE
	AIR ADMITTANCE VALVE
	FIRE BOOSTER CUPBOARD
FH 	FIRE HYDRANT
DHFH 	DUAL HEAD FIRE HYDRANT

ALL DIMENSIONS SHOWN IN MM. DO NOT SCALE FROM DRAWINGS. DIMENSIONS TAKE PRECEDENCE. IF IN DOUBT REFER TO HK SOLUTIONS.

TENDER ISSUE

				HKSolutions ENGINEERING PROJECT MANAGEMENT DARWIN. GEELONG. CAIRNS. TOWNSVILLE. PERTH. BALLARAT admin@hksolutions.com.au www.hksolutions.com.au						DRAWN CHECKED DESIGNED CHECKED APPROVED Date Approved THIS DRAWING MUST NOT BE USED FOR CONSTRUCTION UNLESS SIGNED AS APPROVED MC DG MC AB		CITY OF ROCKHAMPTON ROCKHAMPTON SPORTS PRECINCT 554-700 YAAMBA ROAD NORMAN GARDENS HYDRAULIC SERVICES COVER SHEET, DRAWING SCHEDULE, SYMBOLS AND ABBREVIATIONS			
T1	ISSUE FOR TENDER	17.06.2026	MC	HKS	Conditions of use. This document may only be used by Harris Kmon Solutions clients for the purpose for which it was prepared and must not be used by any other person or for any other purpose.										
REV.	DESCRIPTION	DATE	INIT.	COMPANY	PAGE No		PROJECT No		DRAWING No		DISCIPLINE		REV.	SHEET SIZE	
REVISIONS					1 OF 4		25015 - H001				HYDRAULIC		T1	A1	

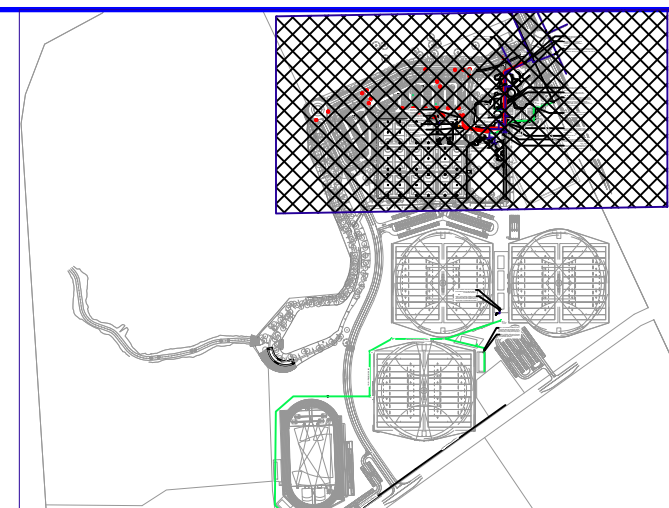

N

WATER TO CONNECT UP TO NEW HOUSES ESTATE TO THE NORTH OF THE SITE AT A FUTURE POINT

020mm COLD WATER COMPLETE WITH ISOLATING VALVE CAPPED FOR FUTURE CONNECTION TO MAINTENANCE BUILDING.

EXISTING AUTHORITY 0250 MPVC COLD WATER

EXISTING AUTHORITY 0250 MPVC COLD WATER

EXISTING AUTHORITY 0250 MPVC COLD WATER

4m x 2m SLAB FOR WATER METERS COMPLETE WITH BOLLARDS TO PROTECT METER ASSEMBLY

PROPOSED Ø100mm FIRE WATER METER ASSEMBLY AND Ø100 COLD WATER ASSEMBLY AUTHORITY'S REQUIREMENTS AND APPROVAL

PROPOSED Ø200mm COLD WATER TAPPING FOR FIRE AND GENERAL TO AUTHORITY'S WATER MAIN LOCATED EAST OF NORMAN ROAD TO ROCKHAMPTON REGIONAL COUNCIL REQUIREMENTS AND APPROVAL

SL 36.490
IL 34.805

Ø100 FS INGROUND
Ø100 CW INGROUND

Ø100mm SEWER FOR TO PUBLIC TOILETS BUILDING FOR CONTINUATION REFER TO DRAWING NOS. 25015-H-PAM-100

Ø25mm COLD WATER CAPPED FOR FUTURE CONNECTION TO PUBLIC AMENITIES BUILDING

Ø150 SEWER PROPERTY SEWER CONNECTION IN GROUND, ALLOW TO EXTEND AND CONNECT INTO EXISTING SEWER PIT (MH) TO LOCAL AUTHORITY'S REQUIREMENTS AND APPROVAL. FINAL AND EXACT LOCATION TO BE CONFIRMED ON SITE. CONTRACTOR TO ALLOW FOR SITE CONNECTION, SUBMIT APPLICATION FOR APPROVAL PAY FEES AND CHARGES AS REQUIRED.

MH-1
RL 37.800
IL 35.716

NEW Ø150 UPVC SEWER @ 1:100 FALL

IL 35.433

PROPOSED SEWER RAISING MAIN TO BE CONNECTED TO SITE SEWER RETICULATION LOCATION TO BE CONFIRMED AND COORDINATED

FOR DETAIL DRAWINGS H-NBC-102 AND H-NBC-202 FOR MORE DETAILS.

PROPOSED VANDAL PROOF GARDEN TAP COMPLETE TO STAND 600mm ABOVE FSL.

I.L 35.061

Ø100mm SEWER FOR TO NETBALL CLUB HOUSE BUILDING FOR CONTINUATION REFER TO DRAWING NOS. 25015-H-NBC-102 FOR CONTINUATION REFER TO DRAWING H-NBC-102 FOR FURTHER DETAILS

Ø32mm COLD WATER CAPPED FOR FUTURE CONNECTION TO NETBALL CLUB HOUSE BUILDING

I.L 34.610

SMS -1
RL 35.700
IL 34.556

NEW Ø100 UPVC SEWER @ 1:60 FALL

Ø100 FS INGROUND
Ø100 CW INGROUND
Ø100 S @ 1:60
REFER TO DRAWING H300 FOR THE TRENCH DETAIL

I.L 33.380

I.L 34.603

Ø100 SEWER RAISING MAIN

Ø100 SEWER RAISING MAIN

PROPOSED SEWER PUMP AND CHAMBER (PIT) IN GROUND. QMAX FORTIS 3200 PUMPPWELL OR EQUALLY APPROVED. REFER TO DETAILS QCPS32VCA01 & A02 FOR FURTHER DETAILS.

R/L TO BE SET AS THE FSL.

Ø100mm COLD WATER COMPLETE WITH ISOLATING AND CHECK METER VALVE CAPPED FOR FUTURE CONNECTION TO HIGH PERFORMANCE CENTER BUILDING AMENITIES

Ø100mm COLD WATER POINT FOR IRRIGATION TO TAKE OFF FROM. ISOLATION VALVE AND CHECK VALVE COMPLETE WITH E TYPE FLANGE CAPPED ABOVE GROUND.

Ø20 TO CONNECT TO PILLAR SUPPLY—REFER TO ARCHITECTURAL DRAWINGS AND FIXTURE SCHEDULE FOR FURTHER DETAILS. (TYPICAL)

FOR CONTINUATIONLN REFER TO DRAWING H004

ALL DIMENSIONS SHOWN IN MM! DO NOT SCALE FROM DRAWINGS. DIMENSIONS TAKE PRECEDENCE. IF IN DOUBT REFER TO HK SOLUTIONS.

SCALE 1:500 @A1

TENDER ISSUE

FOR CONTINUATION LN REFER TO DRAWING H004

TENDER ISSUE

				HK Solutions ENGINEERING PROJECT MANAGEMENT DARWIN. GEELONG. CAIRNS. TOWNSVILLE. PERTH. BALLARAT admin@hksolutions.com.au www.hksolutions.com.au						DRAWN CHECKED DESIGNED CHECKED APPROVED Date Approved THIS DRAWING MUST NOT BE USED FOR CONSTRUCTION UNLESS SIGNED AS APPROVED MC AB MC AB		CITY OF ROCKHAMPTON ROCKHAMPTON SPORTS PRECINCT 554-700 YAAMBA ROAD NORMAN GARDENS											
T1		ISSUE FOR TENDER		17.06.2026		MC		HKS		Conditions of use. This document may only be used by Harris Kmon Solutions clients for the purpose for which it was prepared and must not be used by any other person or for any other purpose.		HYDRAULIC SERVICE STAGE 1 SITE RETICULATION											
REV.		DESCRIPTION		DATE		INT.		COMPANY				PAGE No 3 OF 4		PROJECT No 25015 - H003		DRAWING No HYDRAULIC		DISCIPLINE T1		REV. A1		SHEET SIZE A1	
REVISIONS																							




TENDER ISSUE

						 ENGINEERING PROJECT MANAGEMENT DARWIN. GEELONG. CAIRNS. TOWNSVILLE. PERTH. BALLARAT admin@hksolutions.com.au www.hksolutions.com.au
T1	ISSUE FOR TENDER	17.06.2026	MC	HKS		
REV.	DESCRIPTION	DATE	INIT	COMPANY		
REVISIONS						
Conditions of use. This document may only be used by Harris Kmon Solutions clients for the purpose for which it was prepared and must not be used by any other person or for any other purpose.						

DRAWN	MC	CITY OF ROCKHAMPTON ROCKHAMPTON SPORTS PRECINCT 554-700 YAAMBA ROAD NORMAN GARDENS HYDRAULIC SERVICES DETAILS			
CHECKED	AB				
DESIGNED	MC				
CHECKED	AB				
APPROVED	##				
Date Approved	##				
THIS DRAWING MUST NOT BE USED FOR CONSTRUCTION UNLESS SIGNED AS APPROVED					
PAGE No	PROJECT No	DRAWING No	DISCIPLINE	REV.	SHEET SIZE
4 OF 4	25015 - H300		HYDRAULIC	T1	A1

c:\users\saeed.shokravi\q-max_pumping_systems_ptd\operations - documents\8.0.qmax_standard_drawings\concrete_pump_station\2021_new_project\drawings\cad\qmax_fortis_3200.sps reva - 27.03.24.dwg

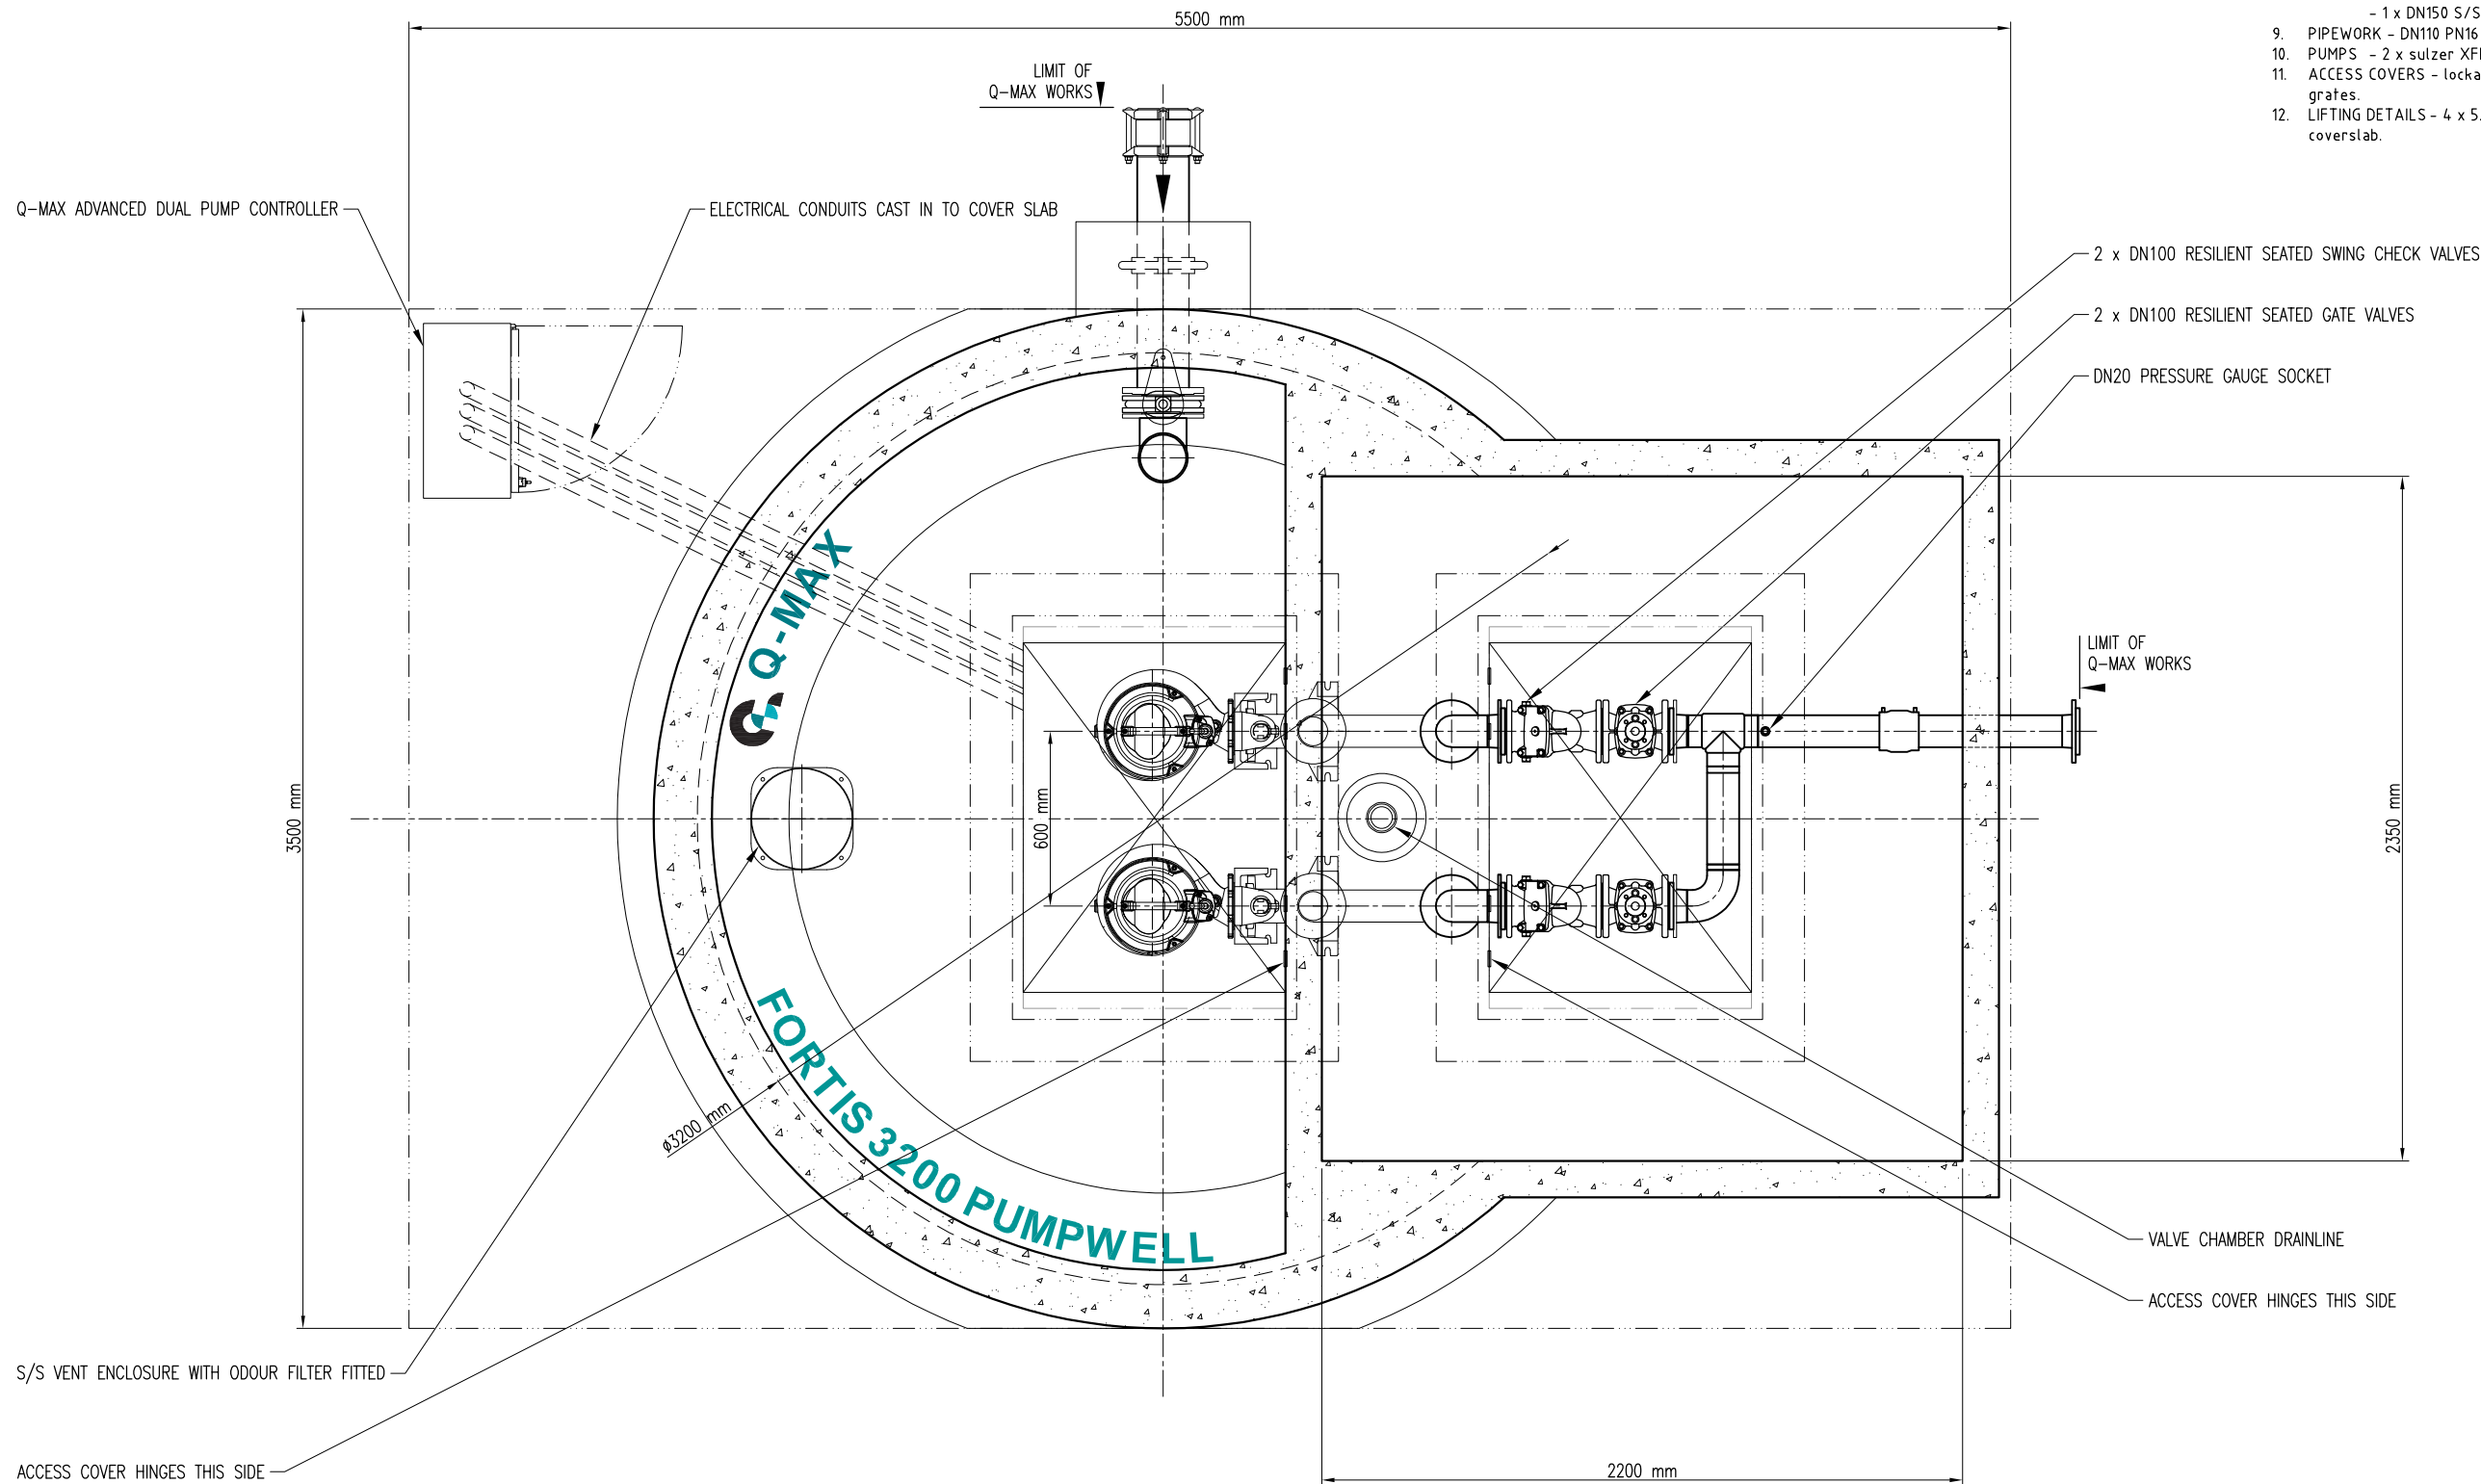

SECTIONAL PLAN VIEW
SCALE: 1 : 25 @ A3

SPECIFICATIONS:

1. INTERNAL DIAMETER - Fortis 3200mm nominal.
2. METHOD OF MANUFACTURE - steel mould formed with intense mechanical vibration.
3. CONCRETE TYPE - sulfate resistant using calcareous aggregate.
4. STRENGTH - 70 MPa at 28 days. Internal finish to meet AS3610 Class 2.
5. WALL THICKNESS - 150mm with 65mm internal cover over reinforcement. Design conforms to AS 3735.
6. REINFORCEMENT - complies with AS3600 and AS4671.
7. VALVE CHAMBER - full size 2350mm X 2200mm - formed as one section.
8. VALVES - 2 x DN100 resilient seated gate valves.
 - 2 x DN100 resilient seated check valves.
 - 1 x DN150 S/S Knifegate valve.
9. PIPEWORK - DN110 PN16 (SDR11) HDPE pipework.
10. PUMPS - 2 x sulzer XFP100E CB1 PE60 submersible pumps - guiderail mounted.
11. ACCESS COVERS - lockable hinged aluminium access covers with hinged safety grates.
12. LIFTING DETAILS - 4 x 5.0t 'Swift-Lifts' in base, in increments, in valve chamber & coverslab.

- Copyright of this design shown hereon is retained by Q-MAX PUMPING SYSTEMS
- Reproduction of any kind not permitted unless prior authorisation is given in writing from Q-MAX PUMPING SYSTEMS
- Figured dimensions to be used in preference to scaling.
- Any dimensional or drawing discrepancy to be referred to the Q-MAX Project Manager Prior to the commencement of work.

Rev	Description	Date
A	For Approval	27.03.24

Status
FOR APPROVAL

**QMAX**
PUMPING SYSTEMS
Q-MAX PUMPING SYSTEMS
PO BOX 6006
72 HIGH STREET
QUEANBEYAN NSW 2620
P 02 6128 1000 F 02 6128 1055
E SALES@QMAXPUMPING.COM.AU
WWW.QMAXPUMPING.COM.AU
DESIGNED FOR PERFORMANCE.
BASED ON EXPERIENCE.

Client

Project


**SAMPLE SEWER PUMP
STATION**

Drawn	S. SHOKRAVI	Date	27.03.2024
Designed	D. PRIDHAM		
Checked	P. PRIDHAM	Size	A3

Title
**Q-MAX FORTIS 3200 PUMP
STATION GENERAL LAYOUT
(SECTIONAL PLAN VIEW)**

Scale	1 : 25	Rev	A
-------	--------	-----	---

Drg No. **QCPS32VC/A01**

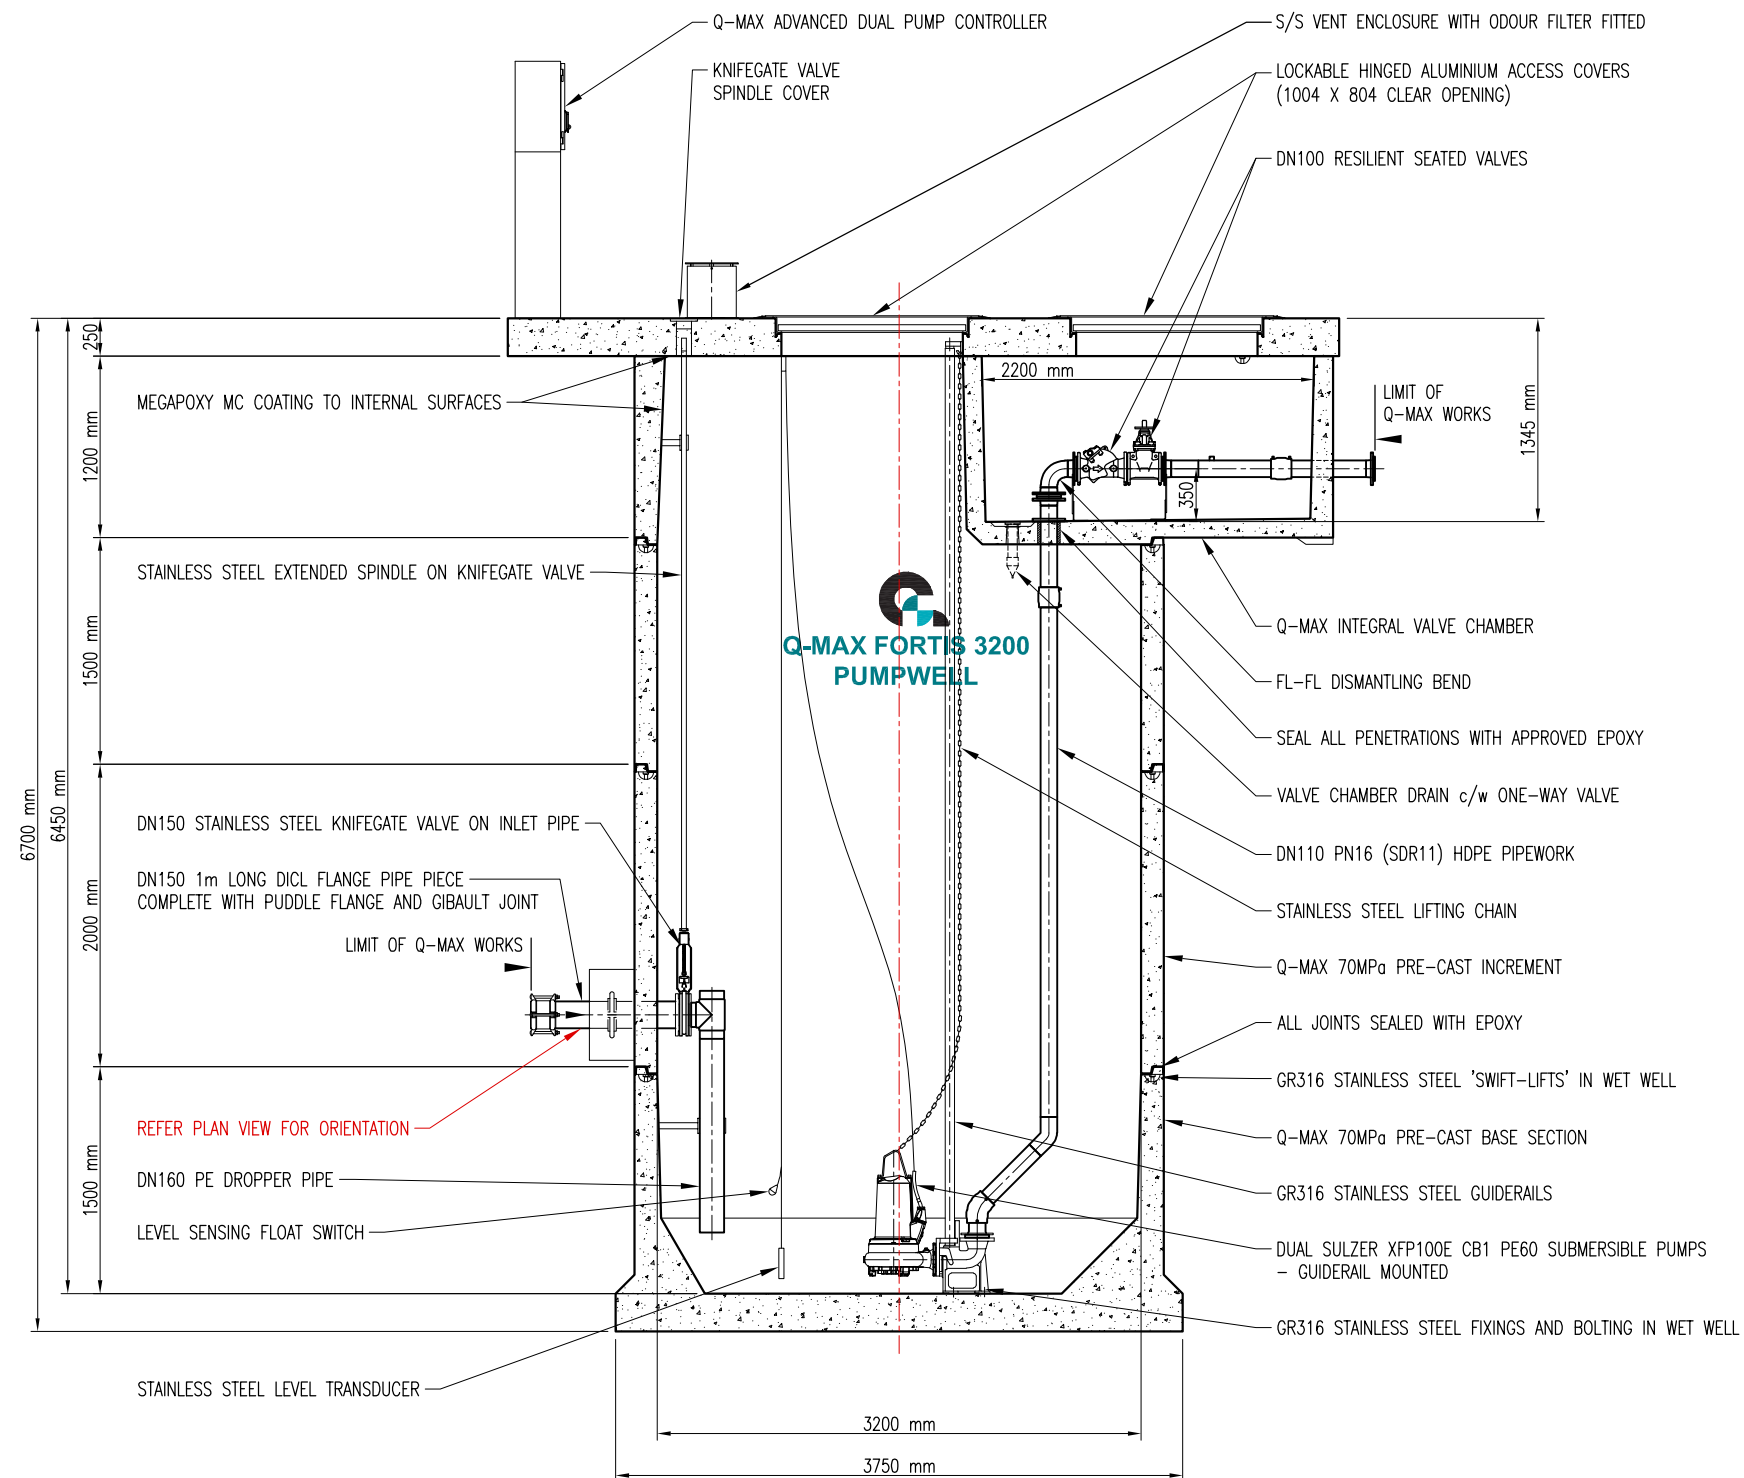

SECTIONAL ELEVATION
SCALE: 1 : 50 @ A3

Copyright of this design shown hereon is retained by Q-MAX PUMPING SYSTEMS
Reproduction of any kind not permitted unless prior authorisation is given in writing from Q-MAX PUMPING SYSTEMS
Figured dimensions to be used in preference to scaling.
Any dimensional or drawing discrepancy to be referred to the Q-MAX Project Manager Prior to the commencement of work.

Rev	Description	Date
A	For Approval	27.03.24

Status
FOR APPROVAL

QMAX PUMPING SYSTEMS
P O BOX 6006
72 HIGH STREET
QUEANBEYAN NSW 2620
P 02 6128 1000 F 02 6128 1055
E SALES@QMAXPUMPING.COM.AU
WWW.QMAXPUMPING.COM.AU
DESIGNED FOR PERFORMANCE.
BASED ON EXPERIENCE.

Client
-

Project
SAMPLE SEWER PUMP STATION

Drawn	S. SHOKRAVI	Date	27.03.2024
Designed	D. PRIDHAM		
Checked	P. PRIDHAM	Size	A3

Title
Q-MAX FORTIS 3200 PUMP STATION GENERAL LAYOUT (SECTIONAL ELEVATION)

Scale	1 : 50	Rev	A
-------	--------	-----	---

Drg No. **QCPS32VC/A02**