


c:\users\saeed.shokravi\q-max_pumping_systems_ptd\operations - documents\8.0.qmax_standard_drawings\concrete pump station\2021_new project\drawings\cad\qmax_fortis_3200.sps reva - 27.03.24.dwg

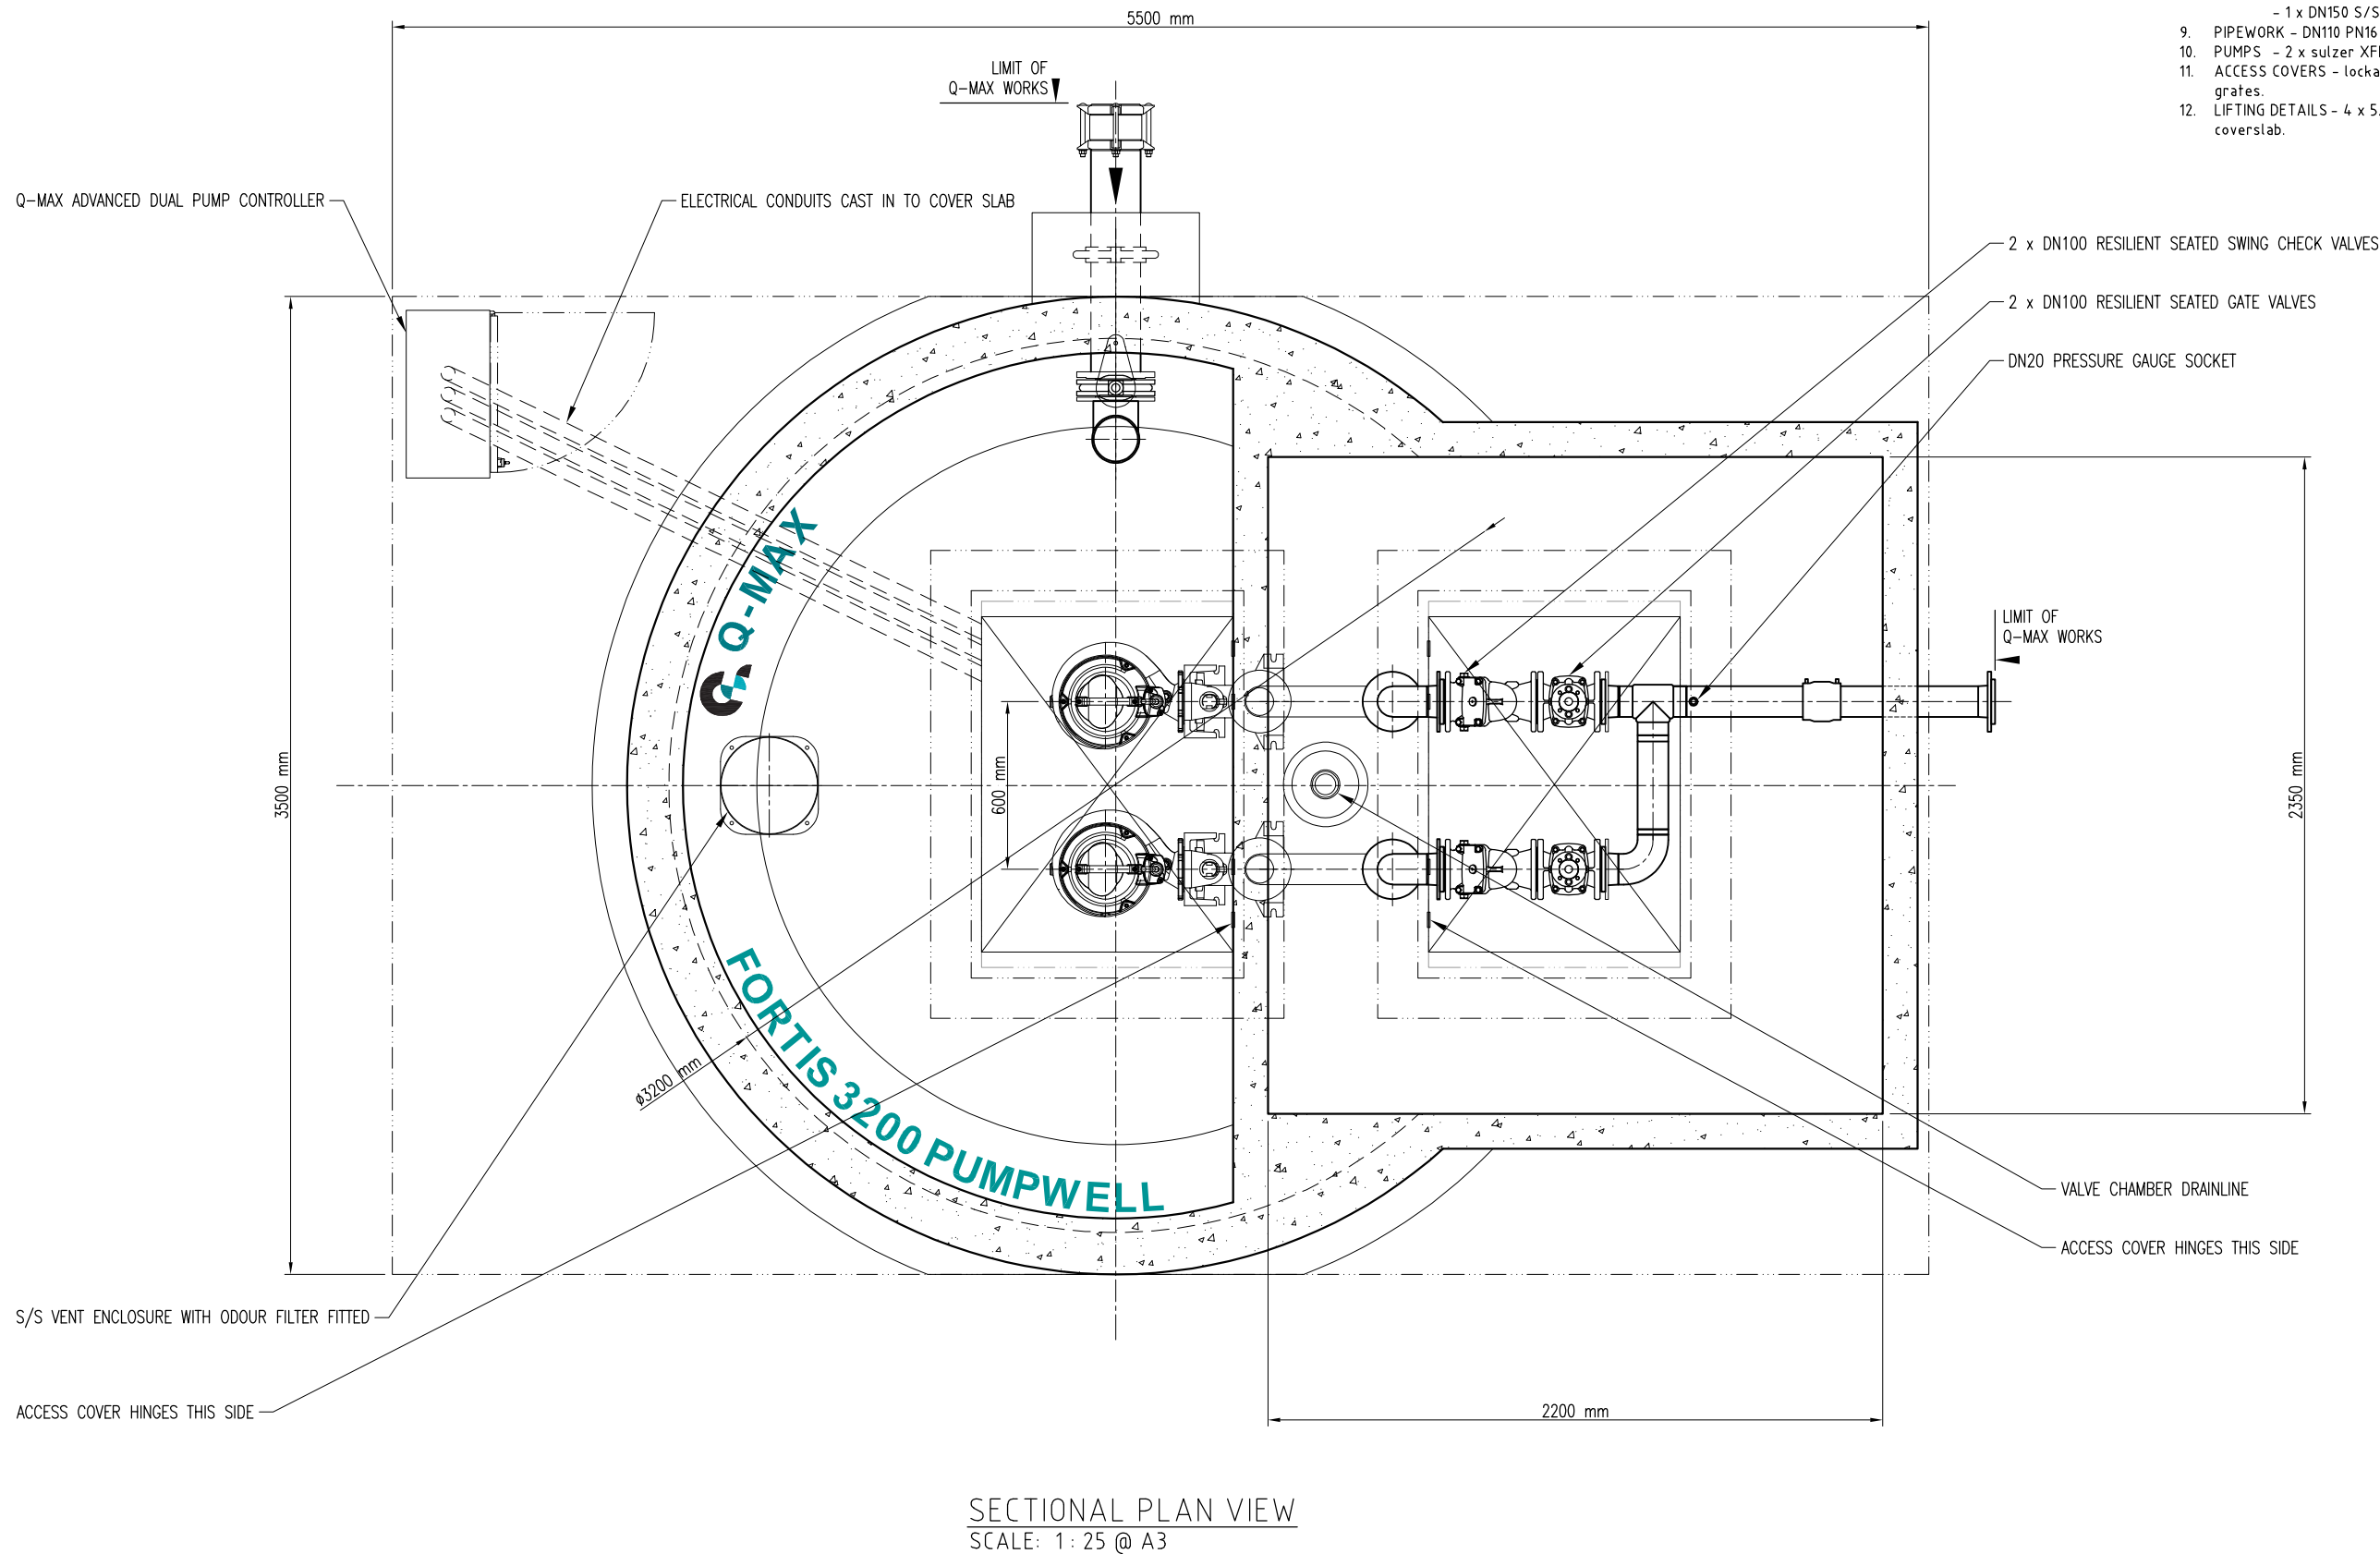

SPECIFICATIONS:

1. INTERNAL DIAMETER - Fortis 3200mm nominal.
2. METHOD OF MANUFACTURE - steel mould formed with intense mechanical vibration.
3. CONCRETE TYPE - sulfate resistant using calcareous aggregate.
4. STRENGTH - 70 MPa at 28 days. Internal finish to meet AS3610 Class 2.
5. WALL THICKNESS - 150mm with 65mm internal cover over reinforcement. Design conforms to AS 3735.
6. REINFORCEMENT - complies with AS3600 and AS4671.
7. VALVE CHAMBER - full size 2350mm X 2200mm - formed as one section.
8. VALVES - 2 x DN100 resilient seated gate valves.
 - 2 x DN100 resilient seated check valves.
 - 1 x DN150 S/S Knifegate valve.
9. PIPEWORK - DN110 PN16 (SDR11) HDPE pipework.
10. PUMPS - 2 x sulzer XFP100E CB1 PE60 submersible pumps - guiderail mounted.
11. ACCESS COVERS - lockable hinged aluminium access covers with hinged safety grates.
12. LIFTING DETAILS - 4 x 5.0t 'Swift-Lifts' in base, in increments, in valve chamber & coverslab.

- Copyright of this design shown hereon is retained by Q-MAX PUMPING SYSTEMS
- Reproduction of any kind not permitted unless prior authorisation is given in writing from Q-MAX PUMPING SYSTEMS
- Figured dimensions to be used in preference to scaling.
- Any dimensional or drawing discrepancy to be referred to the Q-MAX Project Manager Prior to the commencement of work.

A	For Approval	27.03.24
Rev	Description	Date

Status

FOR APPROVAL

 Q-MAX PUMPING SYSTEMS
PO BOX 6006
72 HIGH STREET
QUEANBEYAN NSW 2620
P 02 6128 1000 F 02 6128 1055
E SALES@QMAXPUMPING.COM.AU
WWW.QMAXPUMPING.COM.AU
DESIGNED FOR PERFORMANCE.
BASED ON EXPERIENCE.

Client

-

Project

SAMPLE SEWER PUMP STATION

Drawn	S. SHOKRAVI	Date	27.03.2024
Designed	D. PRIDHAM		
Checked	P. PRIDHAM	Size	A3

Title

Q-MAX FORTIS 3200 PUMP STATION GENERAL LAYOUT (SECTIONAL PLAN VIEW)

Scale	1 : 25	Rev	A
-------	--------	-----	---

Drg No. **QCPS32VC/A01**