

Material Test Report

Report Number: R16-140A-122
Issue Number: 1
Date Issued: 22/07/2026
Client: Rockhampton Regional Council
 PO Box 1860, Rockhampton Qld 4700
Contact: Aaron Pont
Project Number: R16-140A
Project Name: General Testing
Project Location: Rockhampton & Surrounds
Client Reference: BUE009408
Work Request: 29180
Sample Number: R26-29180A
Date Sampled: 30/06/2026
Dates Tested: 30/06/2026 - 07/07/2026
Sampling Method: AS 1289.1.2.1 6.2 - Sampling from stockpiles
Preparation Method: In accordance with the test method
Sample Location: **Boundary Rd, Gomersall Rd - Stockpile #3**
Material: Silty Sandy Gravel
Material Source: Insitu



Butler Partners
 geotechnical • geo-environmental • groundwater

Butler Partners (Regional) Pty Ltd
 Rockhampton Laboratory
 246 Kent Street Rockhampton QLD 4700
 Phone: (07) 4927 1400
 Email: abird@butlerpartners.com.au

Accredited for compliance with ISO/IEC 17025 - Testing



(Signature)

Approved Signatory: Adam Bird
 Laboratory Manager
 Laboratory Number: 19529


Particle Size Distribution (AS1289 3.6.1)

Sieve	Passed %	Passing Limits
75 mm	100	
63 mm	98	
53 mm	96	
37.5 mm	92	
26.5 mm	84	
19 mm	78	
13.2 mm	64	
9.5 mm	57	
6.7 mm	49	
4.75 mm	42	
2.36 mm	30	
1.18 mm	22	
0.6 mm	18	
0.425 mm	16	
0.3 mm	15	
0.15 mm	12	
0.075 mm	8	

Atterberg Limit (AS1289 3.1.2 & 3.2.1 & 3.3.1)		Min	Max
Sample History	Oven Dried		
Preparation Method	Dry Sieve		
Liquid Limit (%)	34		
Plastic Limit (%)	20		
Plasticity Index (%)	14		

Linear Shrinkage (AS1289 3.4.1)		Min	Max
Moisture Condition Determined By	AS 1289.3.1.2		
Linear Shrinkage (%)	10.5		
Cracking Crumbling Curling	None		

Particle Size Distribution

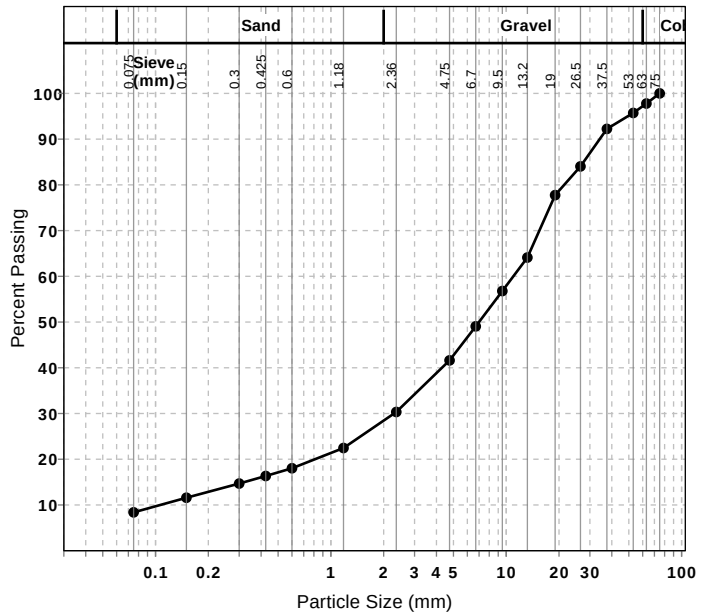

Material Test Report

Report Number: R16-140A-122
Issue Number: 1
Date Issued: 22/07/2026
Client: Rockhampton Regional Council
 PO Box 1860, Rockhampton Qld 4700
Contact: Aaron Pont
Project Number: R16-140A
Project Name: General Testing
Project Location: Rockhampton & Surrounds
Client Reference: BUE009408
Work Request: 29180
Sample Number: R26-29180A
Date Sampled: 30/06/2026
Dates Tested: 30/06/2026 - 17/07/2026
Sampling Method: AS 1289.1.2.1 6.2 - Sampling from stockpiles
Preparation Method: In accordance with the test method
Sample Location: **Boundary Rd, Gomersall Rd - Stockpile #3**
Material: Silty Sandy Gravel
Material Source: Insitu



Butler Partners
 geotechnical • geo-environmental • groundwater


Butler Partners (Regional) Pty Ltd
 Rockhampton Laboratory
 246 Kent Street Rockhampton QLD 4700
 Phone: (07) 4927 1400
 Email: abird@butlerpartners.com.au

Accredited for compliance with ISO/IEC 17025 - Testing



Approved Signatory: Adam Bird
 Laboratory Manager
 Laboratory Number: 19529

California Bearing Ratio (AS 1289 6.1.1 & 2.1.1)		Min	Max
CBR taken at	2.5 mm		
CBR %	5		
Method of Compactive Effort	Standard		
Method used to Determine MDD	AS 1289 5.1.1 & 2.1.1		
Method used to Determine Plasticity	Visual / Tactile		
Maximum Dry Density (t/m ³)	1.91		
Optimum Moisture Content (%)	11.0		
Laboratory Density Ratio (%)	100.0		
Laboratory Moisture Ratio (%)	99.5		
Dry Density after Soaking (t/m ³)	1.90		
Field Moisture Content (%)	6.7		
Moisture Content at Placement (%)	11.0		
Moisture Content Top 30mm (%)	13.7		
Moisture Content Rest of Sample (%)	14.3		
Mass Surcharge (kg)	4.5		
Soaking Period (days)	4		
Curing Hours (h)	20		
Swell (%)	1.0		
Oversize Material (mm)	19		
Oversize Material Included	Excluded		
Oversize Material (%)	0.0		

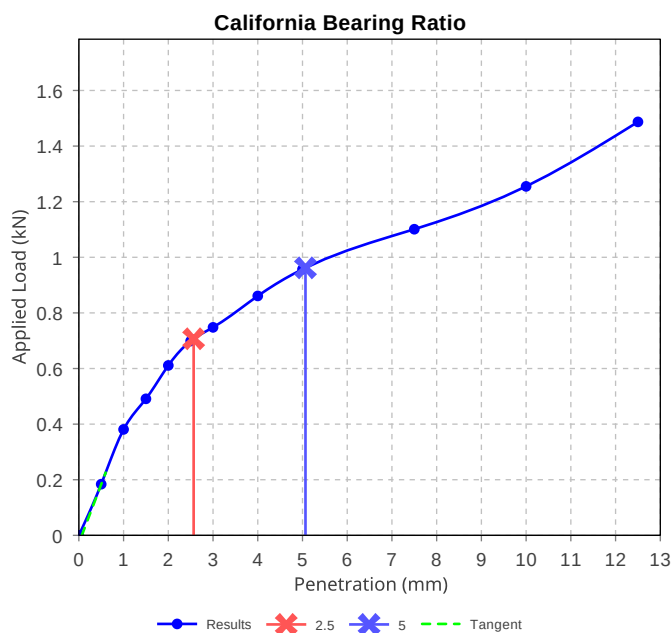



Stockpile #3

Stockpile #3