



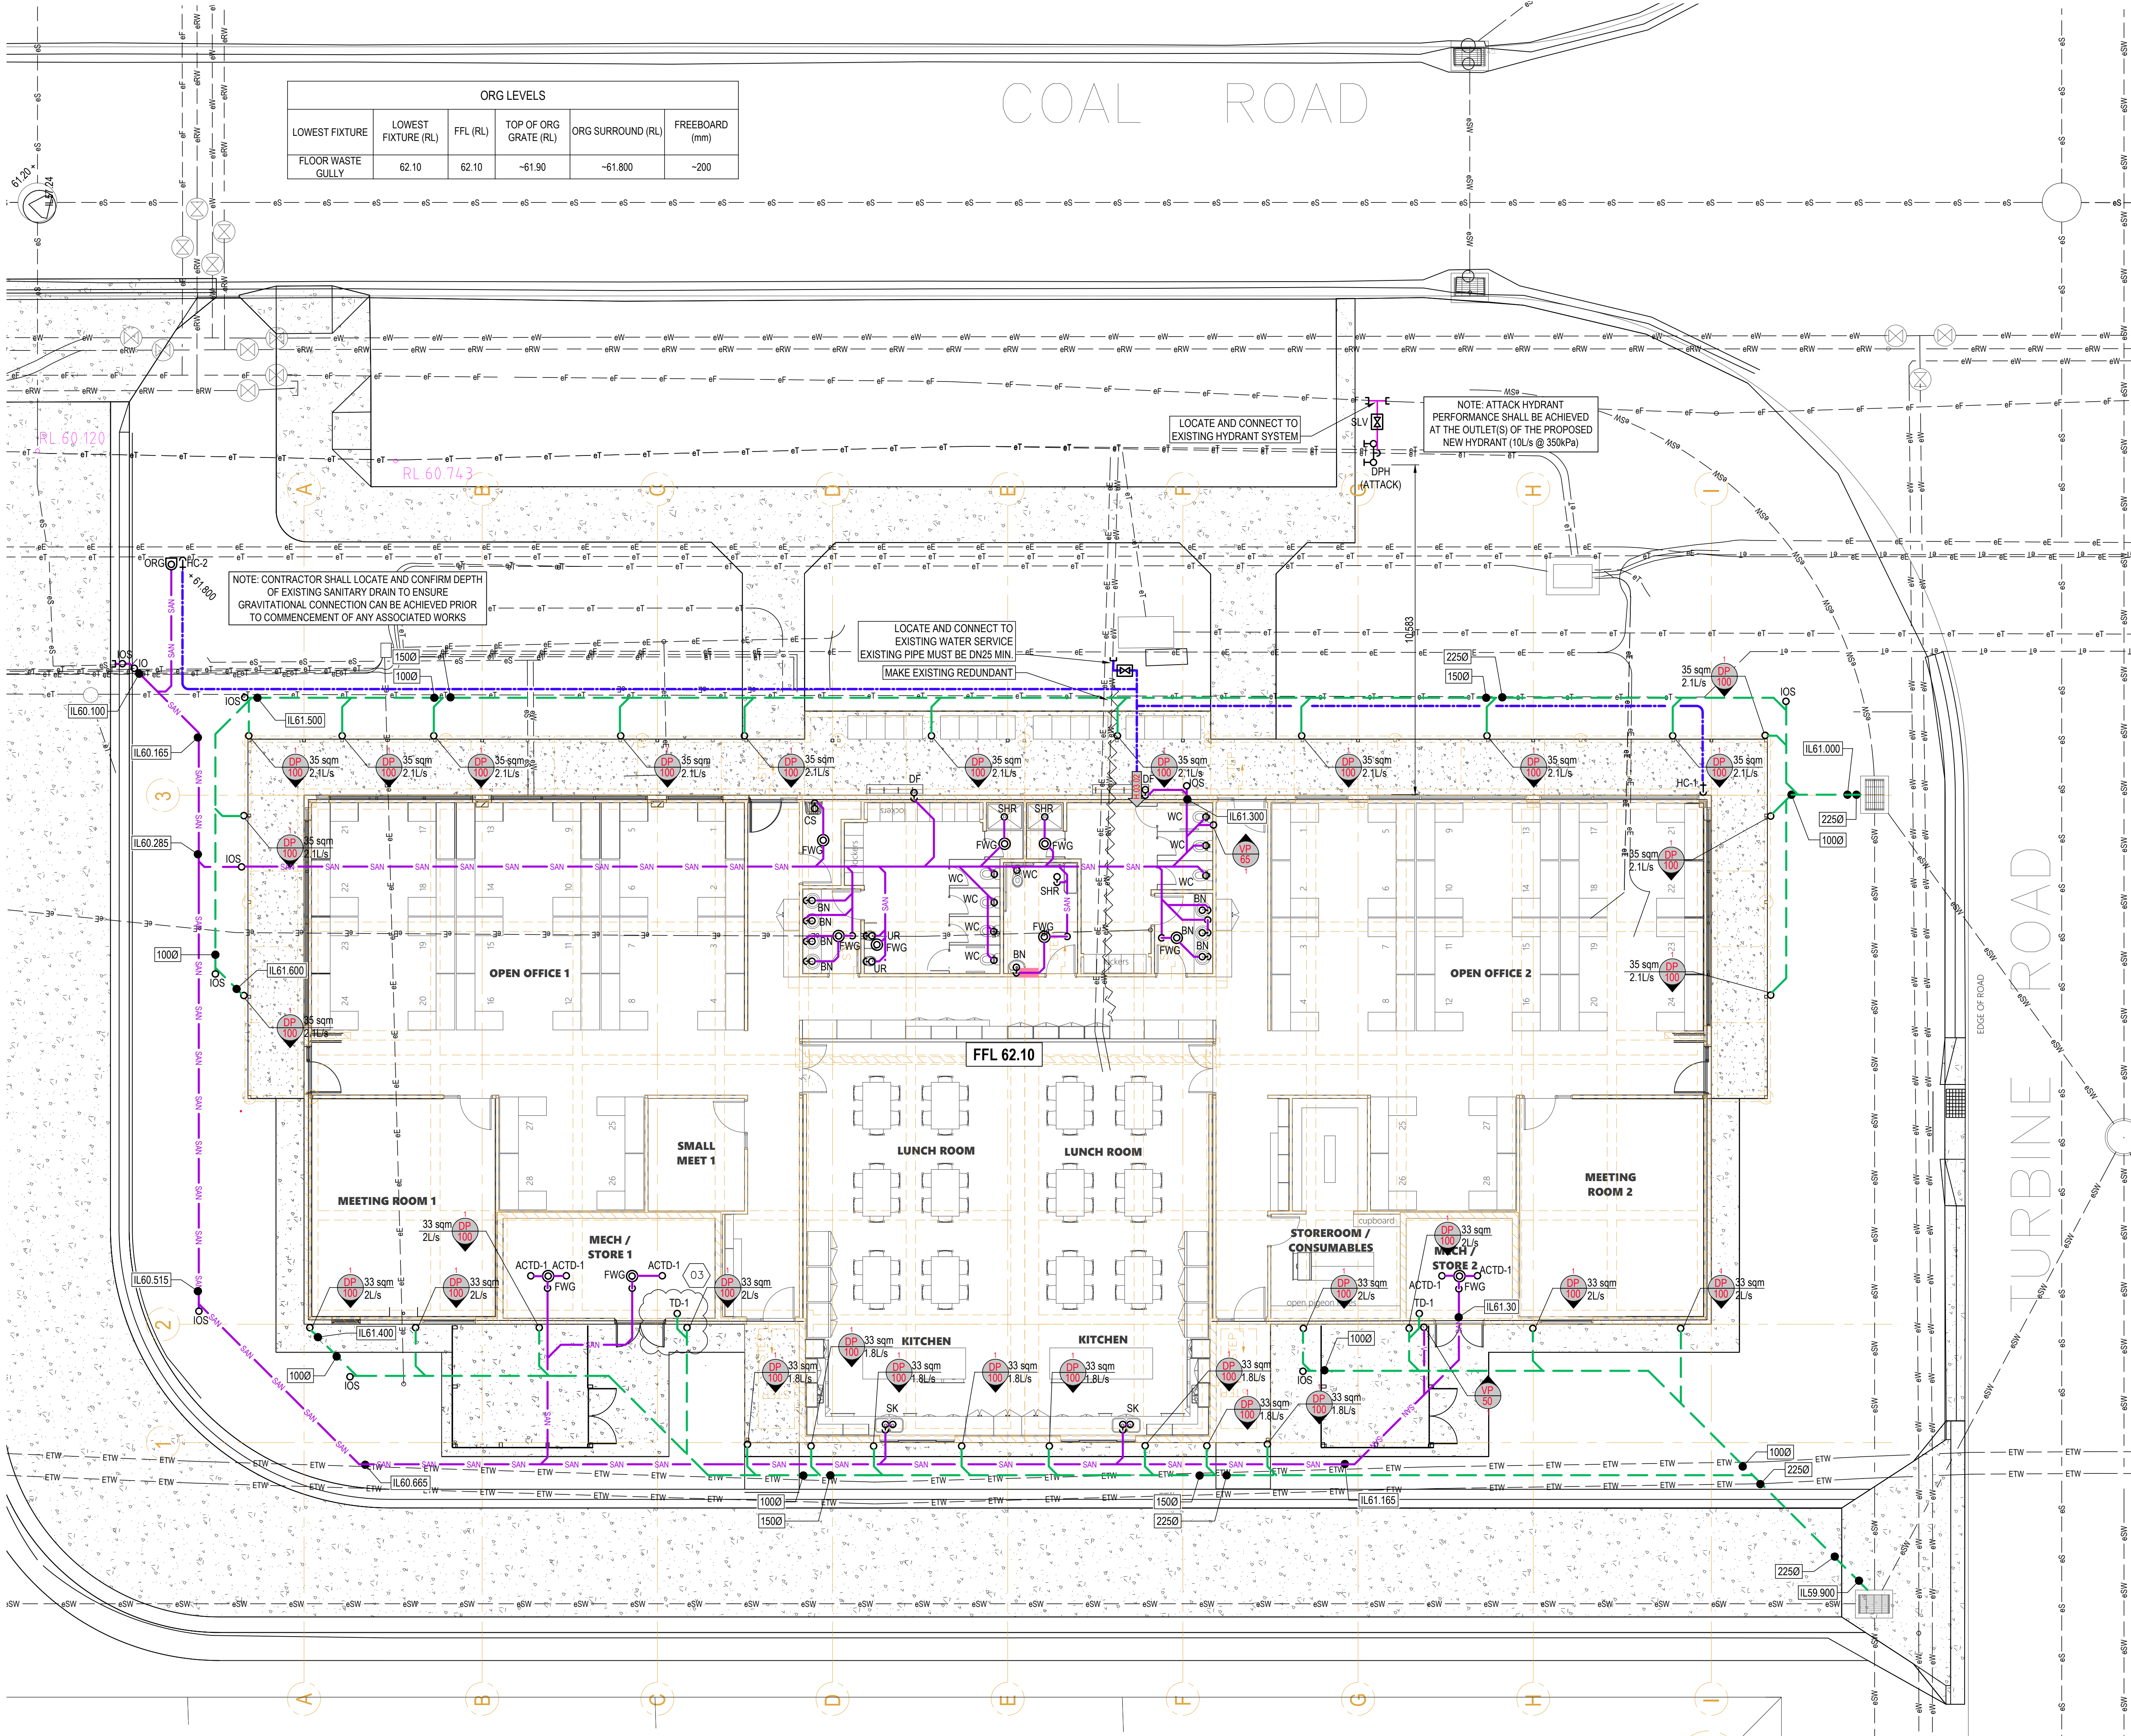

| ORG LEVELS        |                     |          |                       |                   |                |
|-------------------|---------------------|----------|-----------------------|-------------------|----------------|
| LOWEST FIXTURE    | LOWEST FIXTURE (RL) | FFL (RL) | TOP OF ORG GRATE (RL) | ORG SURROUND (RL) | FREEBOARD (mm) |
| FLOOR WASTE GULLY | 62.10               | 62.10    | -61.90                | -61.800           | -200           |

COAL ROAD



Issued for  
TENDER ONLY

NOT FOR  
CONSTRUCTION

DRAWING SHOULD BE  
READ IN COLOUR PRINT

| SANITARY DRAIN SCHEDULE |                                              |
|-------------------------|----------------------------------------------|
| FIXTURE TYPE            | SIZE                                         |
| SINK TO DRAIN           | 50 TRAPPED                                   |
| WC TO DRAIN             | 100                                          |
| BASIN TO DRAIN          | 40 TRAPPED                                   |
| DF TO DRAIN             | 50 TRAPPED                                   |
| URINAL TO DRAIN         | 40 TRAPPED, PIPE IN WALL                     |
| BASIN TO FWG            | 40 TRAPPED, PIPE IN WALL                     |
| IWTD TO FWG             | 40                                           |
| SHR TO FWG              | 50 (80 or 100 PALAZZI TRAP IF >2.5 FROM FWG) |
| SHR TO DRAIN            | 100x65 PALAZZI GULLY                         |
| CS TO FWG               | 50 TRAPPED                                   |

NOTE: EXISTING SERVICES SHOWN ON THIS DRAWING REFLECTS INFORMATION PROVIDED BY OTHERS. HYDRO-TECH DESIGNS TAKE NO RESPONSIBILITY FOR ITS ACCURACY

NOTE: THE LOCATIONS OF TUNDISHES FOR THE COLLECTION OF A/C CONDENSATE SHOWN ON THESE DRAWINGS ARE INDICATIVE ONLY AND SHALL BE PROPERLY COORDINATION WITH THE MECHANICAL SERVICES CONTRACTORS

LEGEND: DRAINAGE

|        |                                                         |
|--------|---------------------------------------------------------|
| TD-1   | 100 GRATED DRAIN FOR THE COLLECTION OF RPZD WASTE       |
| ACTD-1 | 100 x 50 LIT FOR THE COLLECTION OF A/C CONDENSATE WASTE |

LEGEND: WATER

|      |                                                        |
|------|--------------------------------------------------------|
| HC-1 | HOSE TAP ON WALL/POST WITH ISOLATION VALVE UPSTREAM    |
| HC-4 | HOSE TAP ON POST SPECIFICALLY TO MAIN TRAP SEAL IN ORG |

|    |                   |            |
|----|-------------------|------------|
| 03 | AS CLOUDED        | 25.05.2026 |
| 02 | REVISION          | 09.03.2026 |
| 01 | ISSUED FOR TENDER | 24.02.2026 |
| P1 | ISSUED FOR REVIEW | 12.01.2026 |

ISSUE: DESCRIPTION: DATE:

**HTD** HYDRO-TECH DESIGNS PTY LTD  
HYDRAULIC AND FIRE PROTECTION CONSULTANTS  
Tel: 0438 433 544  
Email: rch@bigpond.net.au

CLIENT:



BUILDING DESIGNER



PROJECT:  
NEW OFFICE BUILDING

STANWELL POWER STATION  
SWITCHYARD ROAD, STANWELL

TITLE:  
HYDRAULIC SERVICES  
SITE AND GROUND FLOOR  
DRAINAGE, STORMWATER, WATER  
& FIRE SERVICES

|                 |         |            |  |
|-----------------|---------|------------|--|
| Datum:          |         | Status:    |  |
| AHD             |         | TENDER     |  |
| Scale:          |         | Date:      |  |
| A1-1:100 @ A1   |         | 19.11.2025 |  |
| Project Number. | Sheet   | Issue.     |  |
| HS-0690-b       | H.03.02 | 03         |  |