


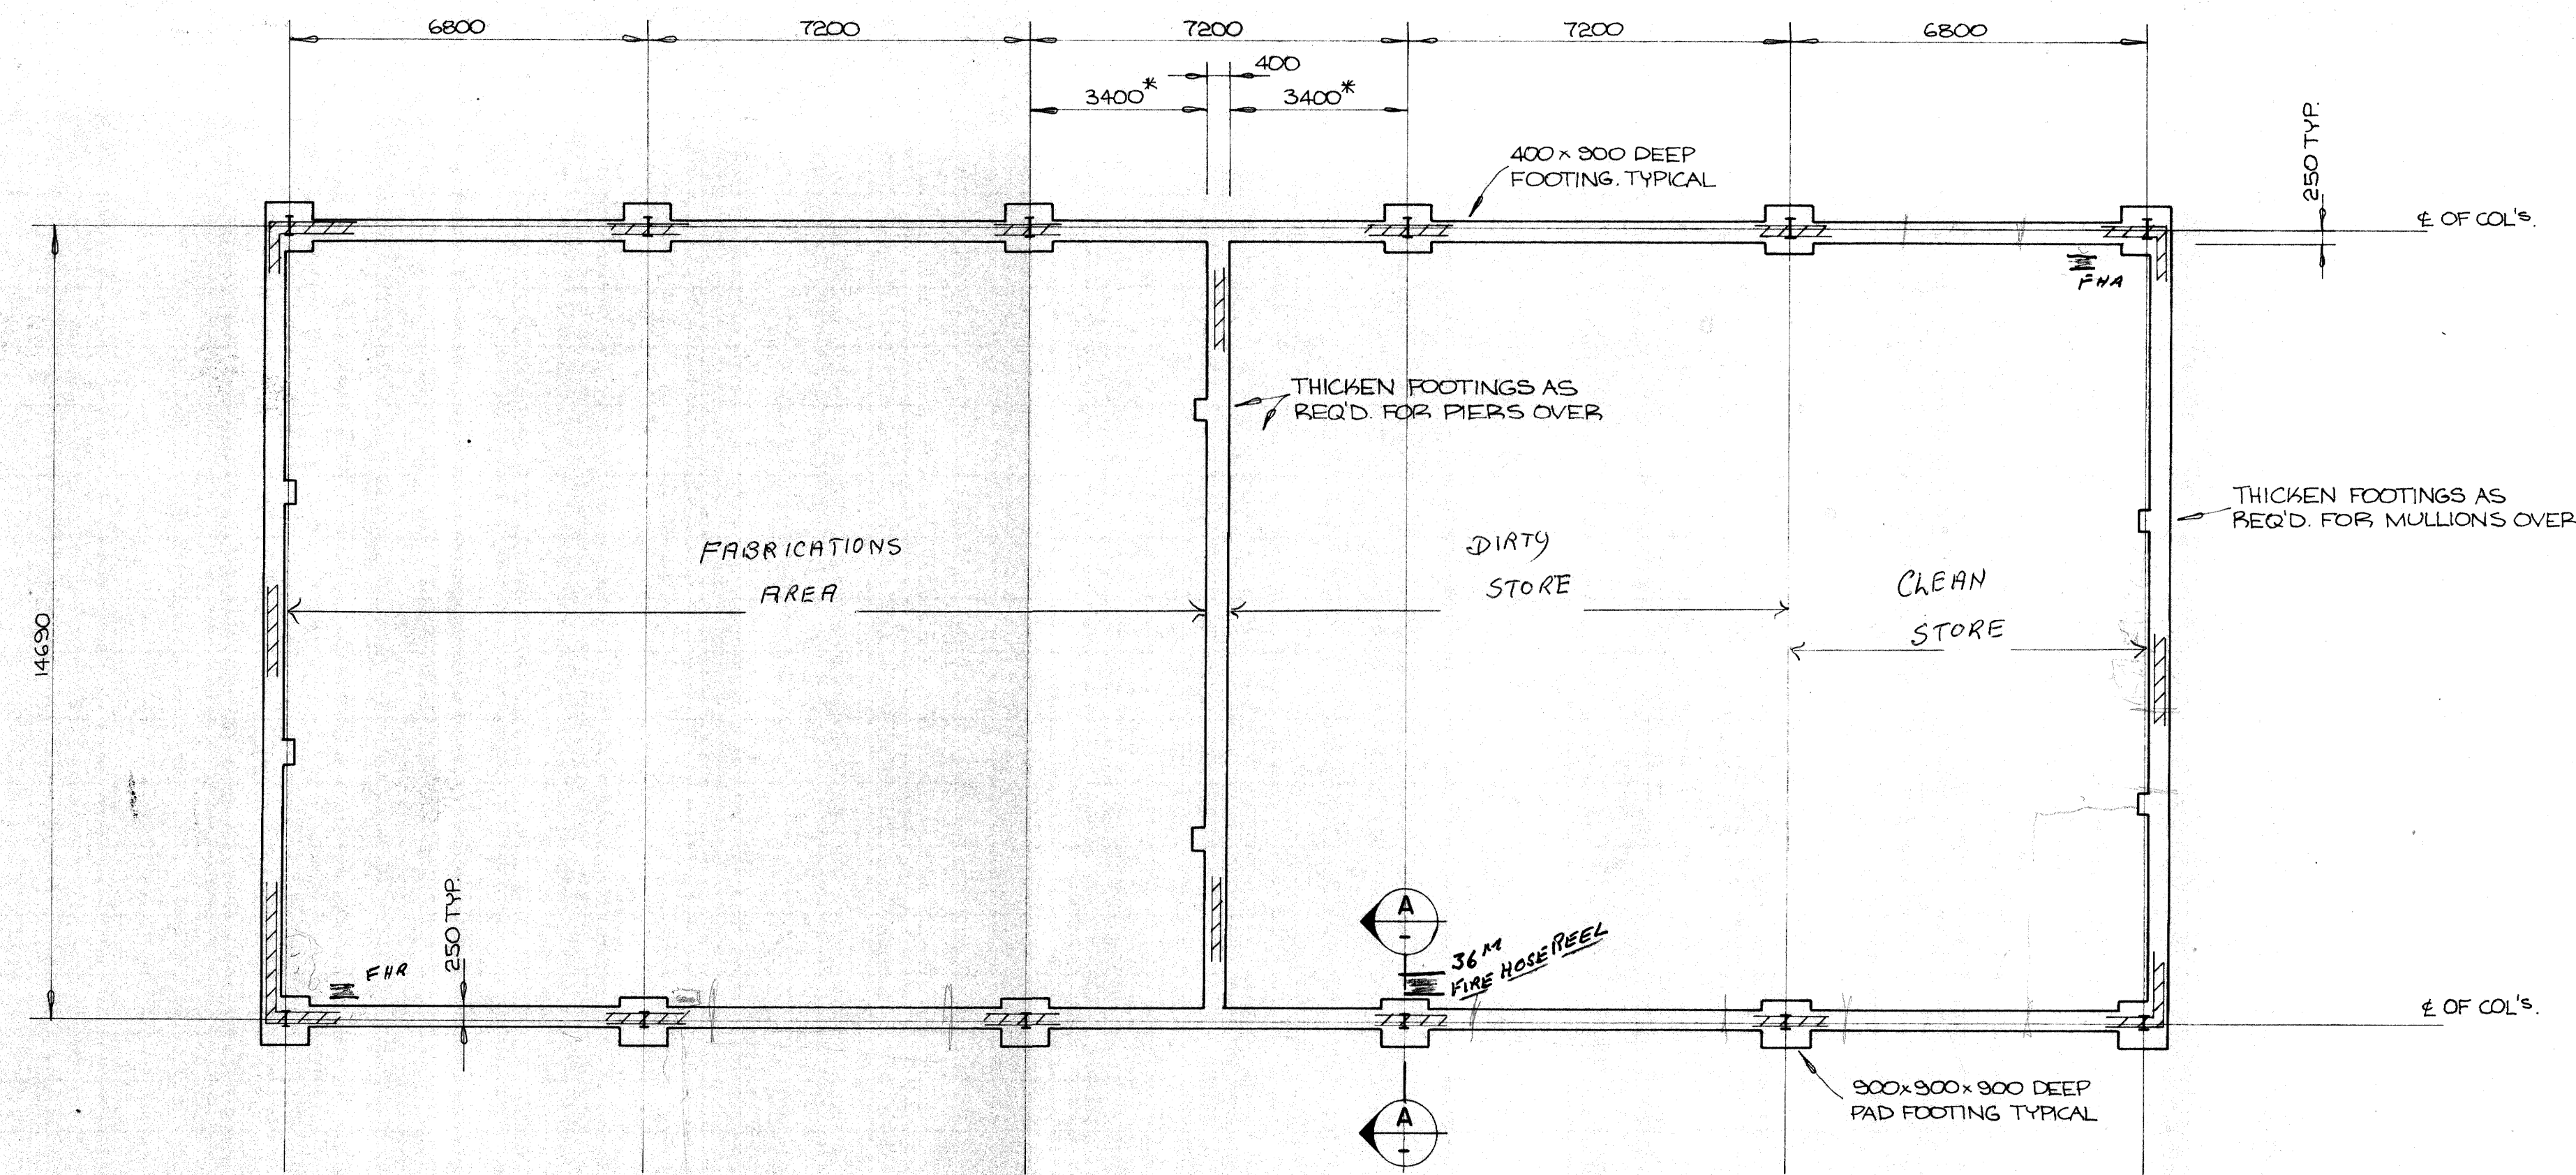

STATE FIRE SERVICES COUNCIL

This is sheet No. 3 of 3 sheets of
Interim Certificate of Approval
No. 3/594/4
Signed [Signature]
Date 20 SEP 1983 Fire Safety Officer

Fire hose reels will be installed to comply with By-law 27.3 of the Standard Building By-laws.

SIGNED 

FOUNDATIONS

F.1. EXCAVATIONS FOR BORED PIERS SHALL BE DONE BY MECHANICAL AUGER OR OTHER APPROVED MEANS. SIDES OF HOLES SHALL BE VERTICAL, AND SIDES AND BOTTOM SHALL BE FREE FROM LOOSE MATERIAL.

F.2. CONCRETE SHALL BE PLACED IN EACH HOLE WITHIN 12 HOURS. EXCAVATIONS SHALL BE KEPT OPEN AND SHALL BE TAKEN TO THE DEPTHS SHOWN, OR TO A FOUNDATION STRATA CAPABLE OF SAFELY SUSTAINING A BEARING PRESSURE OF 1000 KPA, WHICHEVER IS THE DEEPER. ALL EXCAVATIONS SHALL BE APPROVED BY THE ENGINEER. THE BOTTOM OF ALL EXCAVATIONS SHALL BE FREE FROM LOOSE MATERIAL, MUD AND WATER.

F.3. ALL EXCAVATIONS SHALL BE KEPT OPEN TO A MINIMUM OF 500 mm BELOW FINISHED GROUND LEVEL UNLESS SHOWN OTHERWISE. PROVIDE SO THAT ALL EXCAVATIONS SHALL BE KEPT OPEN, PLACED AFTER APPROVAL OF THE EXCAVATION AND WITHIN 12 HOURS OF EXCAVATING.

CONCRETE

C.1 ALL CONCRETE WORK SHALL BE IN ACCORDANCE WITH THE CURRENT EDITIONS OF AS 1480 AND AS 1379, EXCEPT WHERE VARIED BY THE CONTRACT DOCUMENTS.

C.2 CONCRETE QUALITY:

ELEMENT	CONCRETE GRADE	SLUMP	MAX. SIZE AGGREGATE	CEMENT TYPE	ADMIXTURE
ALL CONC.	20 MPa	75 ± 20 mm	20 mm	A	-

C.3 AT 28 DAYS, THE CONCRETE CHARACTERISTIC STRENGTH (FC) SHALL BE VIBRATED.

C.4 NO HOLES OR CHASES OTHER THAN THOSE SHOWN ON THE STRUCTURAL DRAWING SHALL BE MADE IN BEAMS AND SLABERS WITHOUT THE PRIOR APPROVAL OF THE ENGINEER. PIPES OR ELECTRICAL CONDUITS SHALL NOT BE PLACED WITHIN THE CONCRETE COVER TO REINFORCEMENT WITHOUT THE APPROVAL OF THE ENGINEER. THE CONCRETE COVER TO EMBEDDED PIPES OR CONDUITS SHALL BE NOT LESS THAN 25 mm.

C.5 CONSTRUCTION JOINTS SHALL BE MADE ONLY WHERE SHOWN ON THE DRAWINGS OR WHERE APPROVED BY THE ENGINEER.

C.6 UNLESS OTHERWISE SPECIFIED, ALL BEAMS AND SLABS SHALL BE: mm. and -- mm. RESPECTIVELY AND SHALL BE DETERMINED BY THE ENGINEER. THE MINIMUM BEAM AND SLAB BEAM DEPTHS ARE DESIGNATED FIRST AND INCLUDE SLAB THICKNESS, IF ANY.

C.7 UNDERPINNINGS WHERE NOT SHOWN ON DRAWINGS MUST BE APPROVED BY THE ENGINEER. FOR UNDERPINNING ONLY, FC = 15 MPa.

C.9 ALL CONCRETE SURFACES TO BE CURED BY AN APPROVED METHOD FOR SEVEN DAYS IMMEDIATELY CONCRETE IS HARD.

C.10 ALL FORMWORK AND JOINTS SHALL BE REMOVED AND BEAMS SHALL REMAIN IN POSITION FOR 14 DAYS AFTER PLACING CONCRETE UNLESS SPECIFIED OTHERWISE. SUCH FLOORS SHALL BE REINFORCED BY 10mm. UNLOADED FOR 28 DAYS.

C.11 FOR SLABS ON GROUND ALL TOP SOIL AND UPPER STRATA CONTAINING ORGANIC MATERIAL SHALL BE REMOVED AND REPLACED BY AN APPROVED FILLING MATERIAL COMPACTED TO 95% A.A.S.N.O. MODIFIED.




C.12 BUILDING TO BE CAST ON TOP OF STEEL COLUMNS, BASE PLATES, AS SPECIFIED.

C.13 ALL REINFORCEMENT SHALL COMPLY WITH THE CURRENT EDITIONS OF IS 10302, IS 03 & IS 0304 AND SHALL BE DESIGNATED: C HARD DOWEL DEFORMED BARS, GRADE 40 C
S STRUCTURAL GRADE 40 C
R STRUCTURAL GRADE 40 C
W HARD DRAWN STEEL WIRE FABRIC
W HARD DRAWN PLAIN WIRE

C.14 ALL FABRIC SHALL BE SUPPLIED IN FLAT SHEETS, WELDING OF THE REINFORCEMENT SHALL NOT BE PERMITTED UNLESS SHOWN ON THE DRAWINGS.

C.15 CONCRETE ENCASED STEELWORK SHALL BE WRAPPED WITH #4 WIRE @ 200 mm. MINIMUM. THERE SHALL BE A MINIMUM OF 50 mm. COVER UNLESS NOTED OTHERWISE.


C.16 ALL CONCRETE COVER TO REINFORCEMENT IS SHOWN ON THE PRINTING. REINFORCEMENT SHALL BE AS FOLLOWS UNLESS OTHERWISE SHOWN ON THE DRAWINGS.

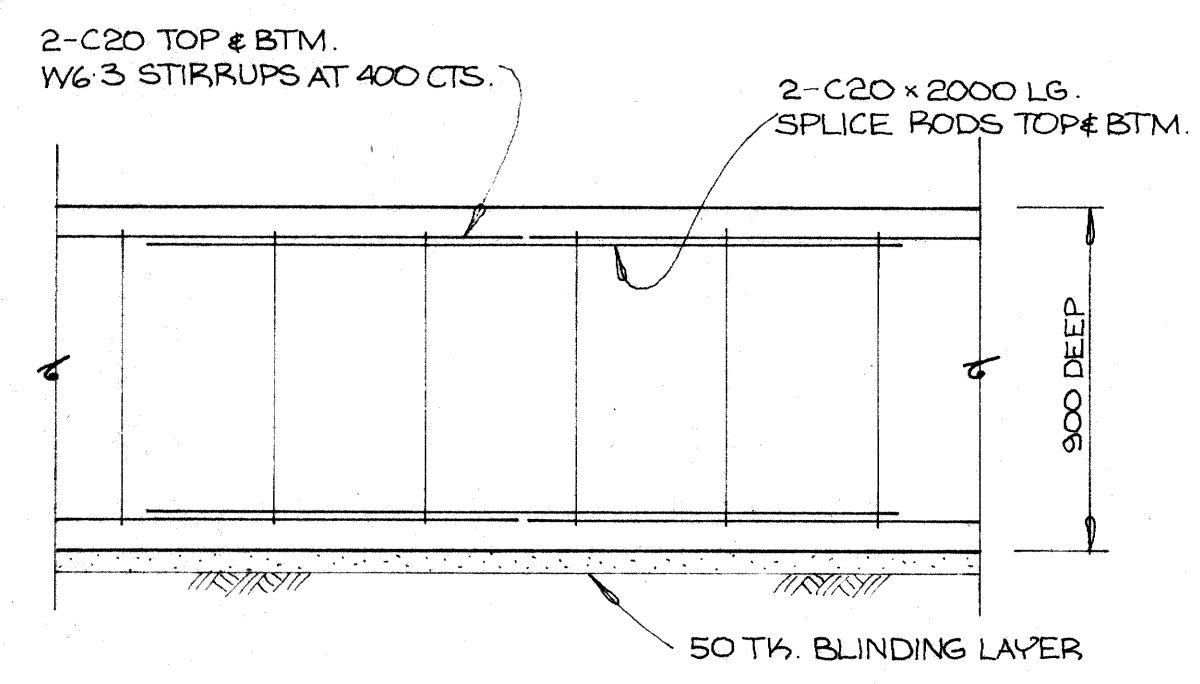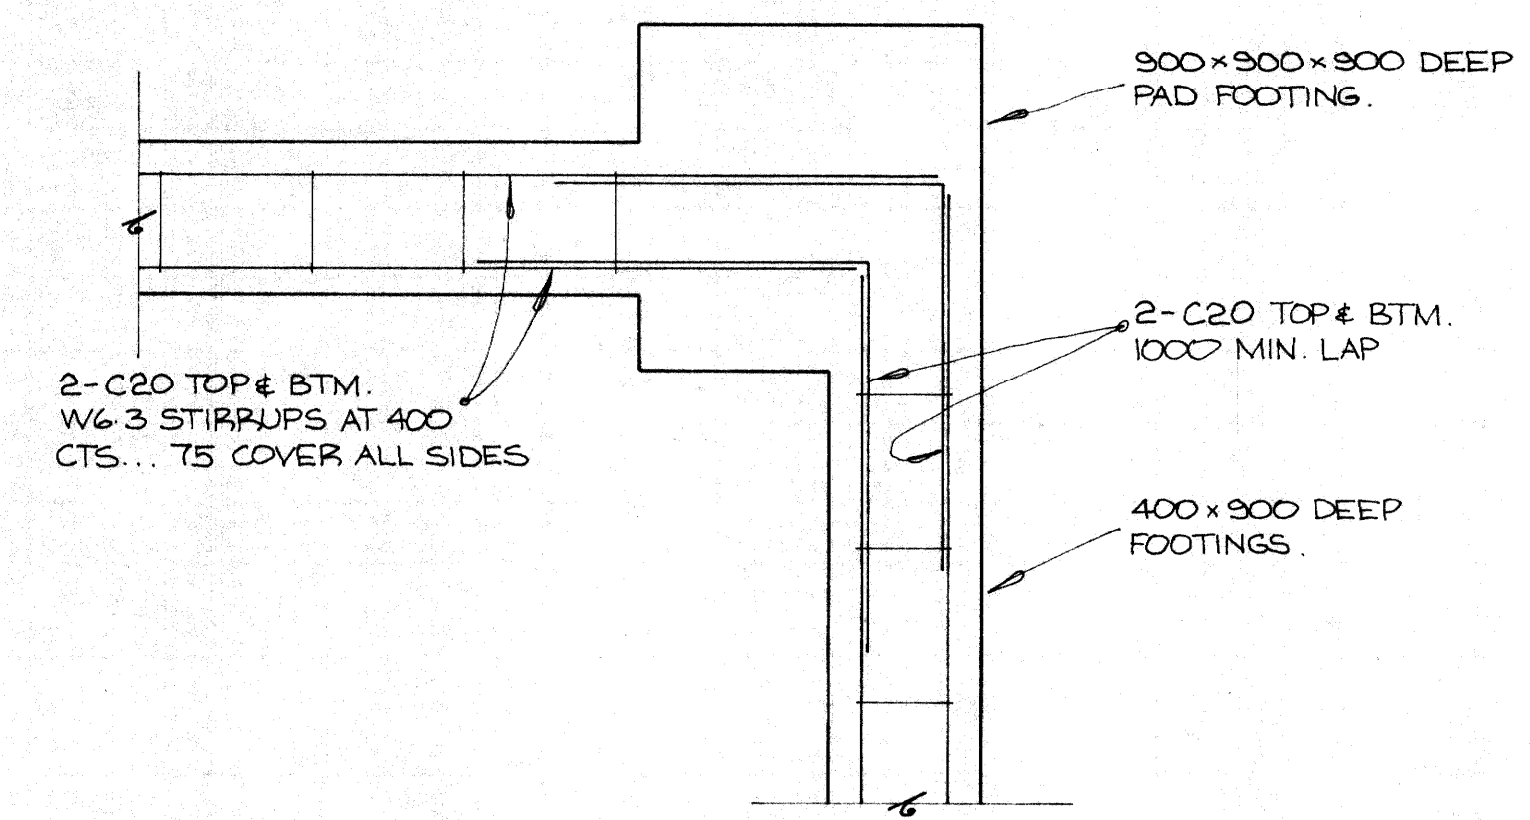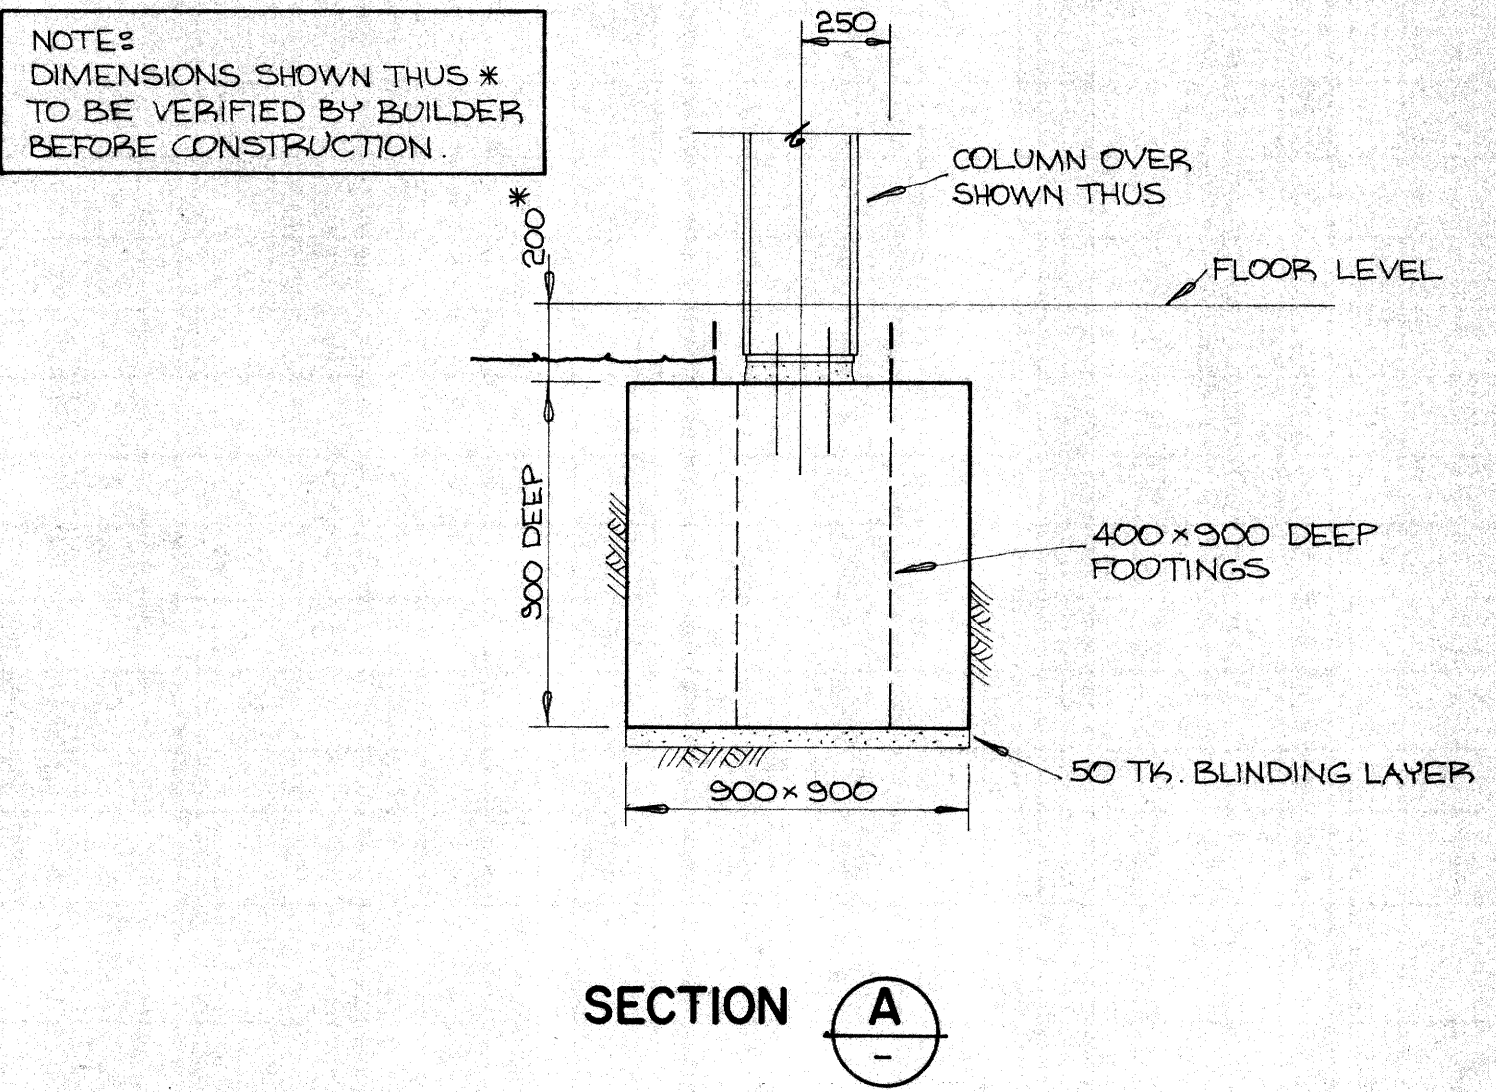

CAST IN FORMS COMPLYING WITH AS 1509			CONDITION 3 CAST AGAINST OTHER FORM- WORK ON THE GROUND
ELEMENT	CONDITION 1 NOT TO BE EXPOSED TO WEATHER OR FRESH WATER	CONDITION 2 TO BE EXPOSED TO WEATHER, GROUND WATER OR FRESH WATER	
PAD FOOTINGS AND PILE CAPS	-	65	75
STRIP FOOTINGS	-	60	75
BORED PIERS	-	60	75
COLUMNS	50	60	75
WALLS	20	30	65
BEAMS	35	50	75
SLABS	20	30	65

[illegible]

**M.L.HALLAHAN &
ASSOCIATES** PTY. LTD.
consulting engineers
27 Bolsover Street
Rockhampton 275066
architect :

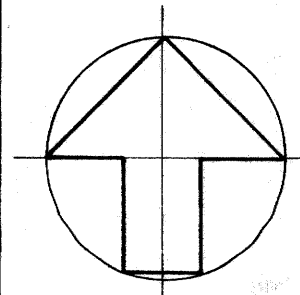

**CAPRICORNIA INSTITUTE OF ADVANCED
EDUCATION.**
NEW BULK STORE AT NORTH ROCKHAMPTON.

title : FOUNDATION PLAN & DETAILS

scale	1:100, 1:20	
date	9-8-83	
drawn	G.D.F.	
app'd	<i>L. P. Sainaraki</i>	
drg. no.	1284-2	amdt