

**CQU ROCKHAMPTON
TAFE
CONSOLIDATION -
STAGE 2**554/700 Yaamba Rd, Norman
Gardens QLD 4701

for



A	12/02/26	ISSUED FOR TENDER	BS
1	30/01/26	DRAFT 60% ISSUE	BS
rev	date	details	init.

drawn	date
PT	30/01/26
checked	date
BS	30/01/26
verified	date
BS	30/01/26

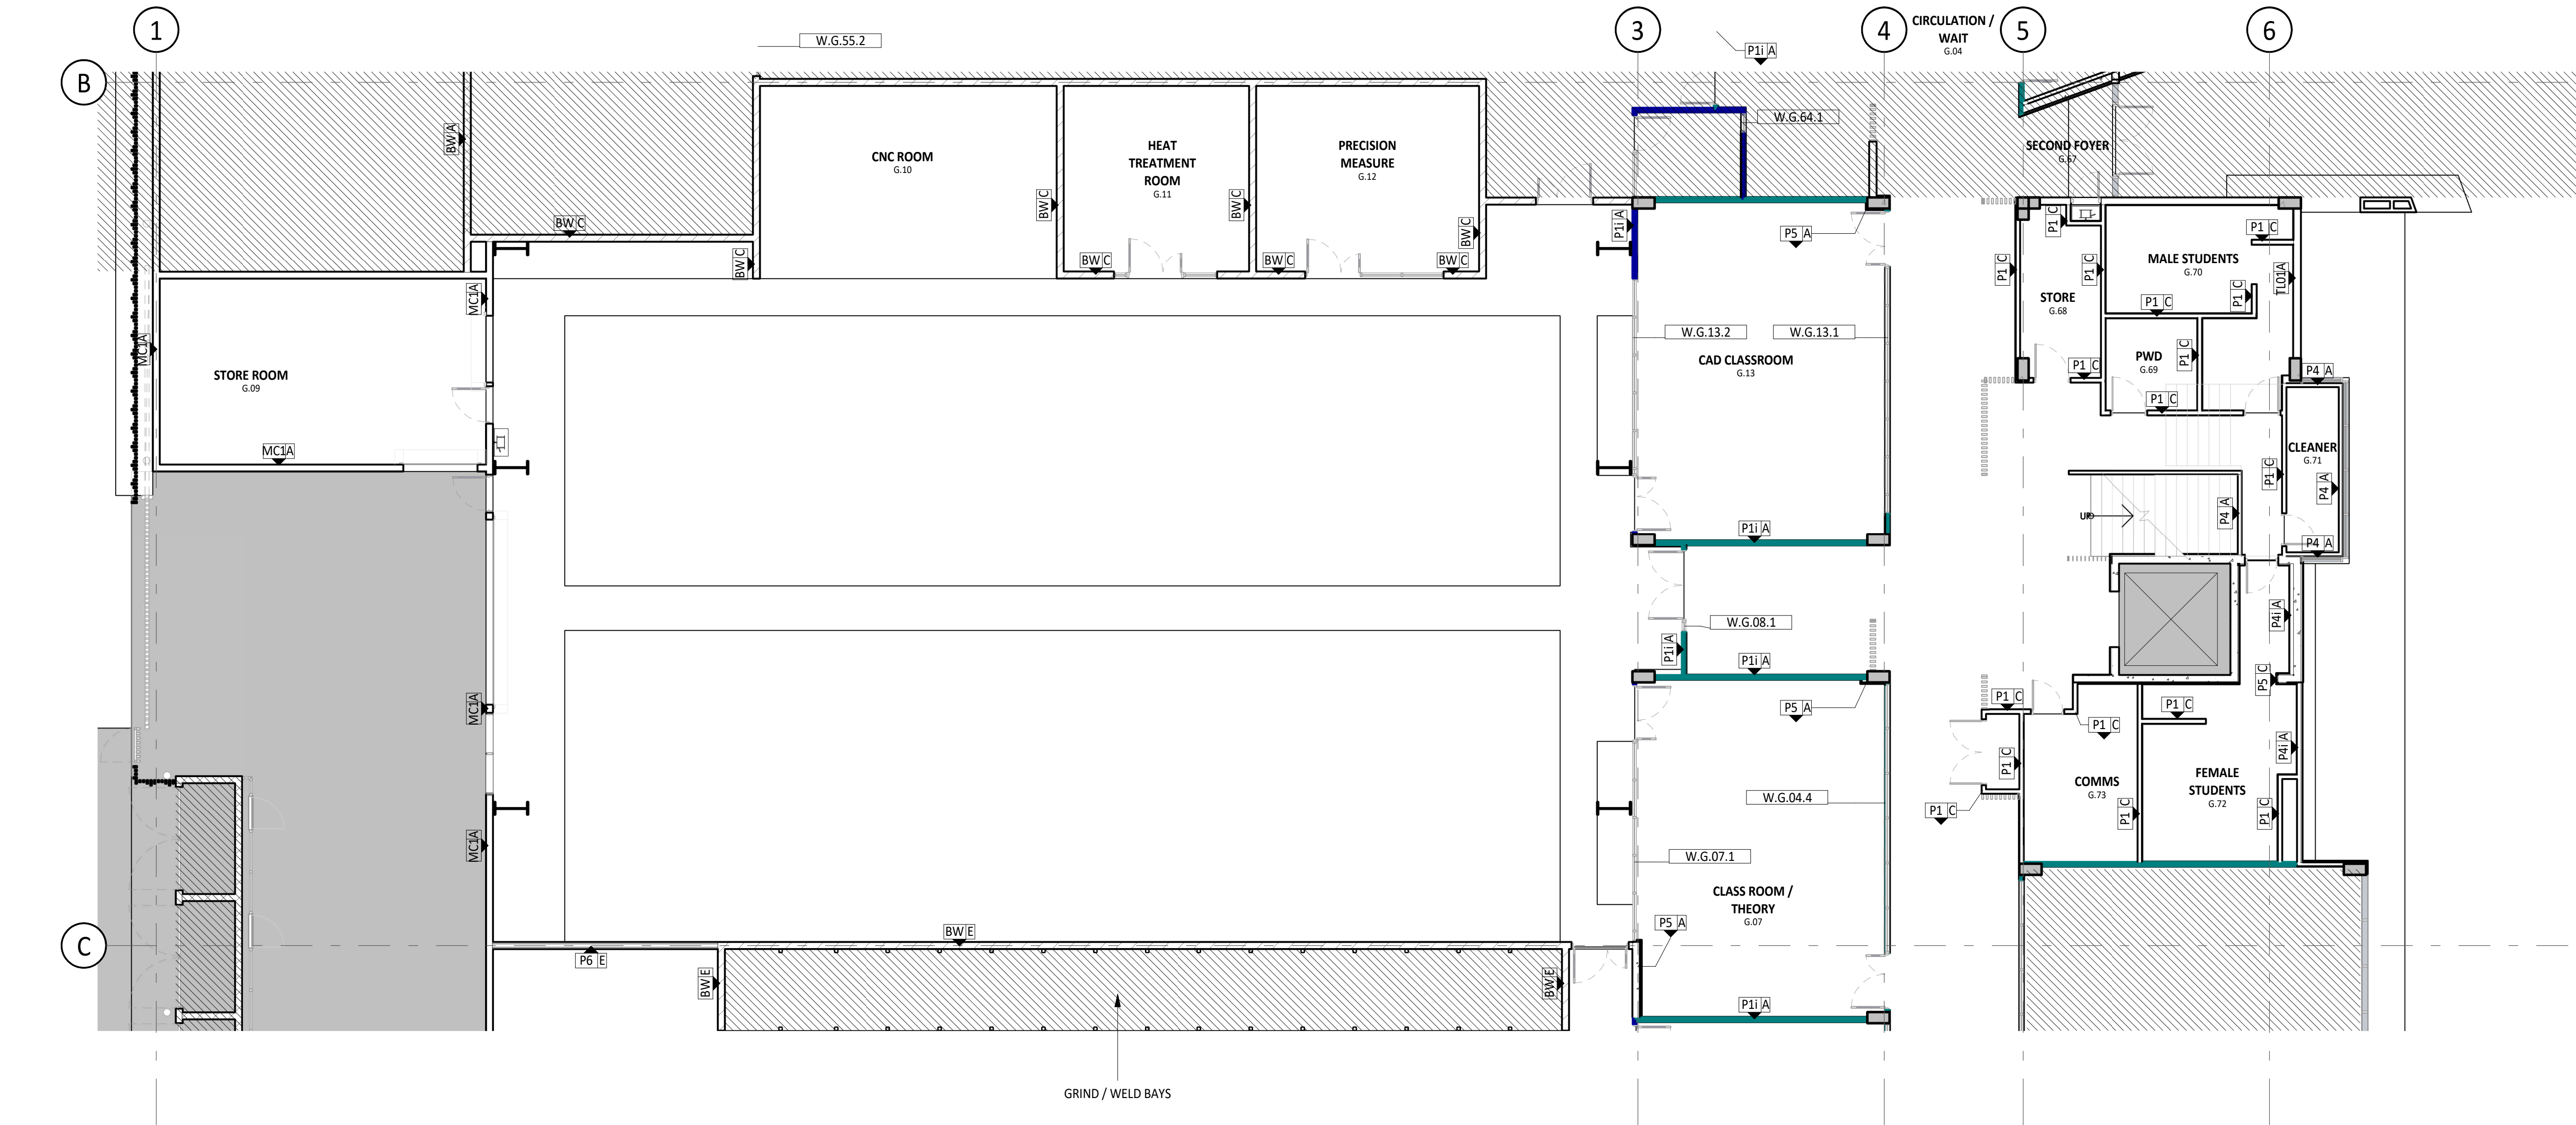
scale	

**PARTITION PLAN GROUND
LEVEL - ZONE 2**

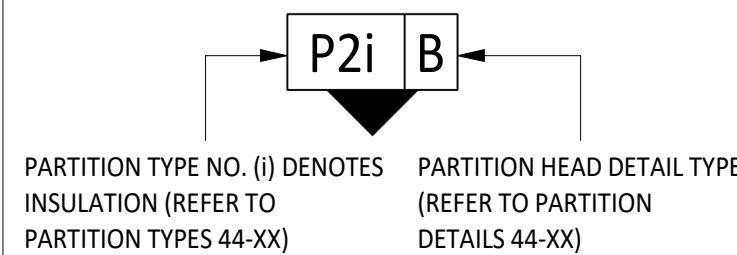

scale	project no.
1 : 100 @ A1	260018

revision
Asheet no.
CQU-ROK-092-GN-ARC-26-02

original sheet size - A1 (594mm x 841mm)



PARTITION TYPES KEY			
CODE	DESCRIPTION	FIRE RATING	ACOUSTIC RATING
BW	190mm Concrete Masonry		
MC1	16mm Cladding + 6mm Rigid Air Barrier + 150 Structure + Thermal & Acoustic Insulation + 16mm Cladding		Refer Acoustic & Green Star Reports
P1	92mm STEEL STUD WITH 1x13mm HIGH PERFORMANCE PLASTERBOARD (TRUROCK) TO BOTH SIDES	WHERE REQUIRED (-/60/60)	38Rw (30Rw+Ctr)
P1i	92mm STEEL STUD WITH 50mm ACOUSTIC INSULATION AND 1x13mm HIGH PERFORMANCE PLASTERBOARD (TRUROCK) TO BOTH SIDES - Rw 40 minimum	WHERE REQUIRED (-/60/60)	40 Rw minimum
P1i	92mm STEEL STUD WITH 50mm ACOUSTIC INSULATION AND 1x13mm HIGH PERFORMANCE PLASTERBOARD (TRUROCK) TO BOTH SIDES - Rw 45 minimum	WHERE REQUIRED (-/60/60)	45 Rw minimum
P2i	92mm STEEL STUD WITH 70mm ACOUSTIC INSULATION AND 2x13mm GYPROCK SOUNDCHECK PLASTERBOARD TO BOTH SIDES - Rw 55 minimum	N/A	55 Rw minimum
P4i	92mm STEEL STUD + INSULATION AS DOCUMENTED WITH 1x13mm HIGH PERFORMANCE PLASTERBOARD (TRUROCK) TO ONE SIDE ONLY	N/A	<varies>
P5	28mm FURRING CHANNEL WITH 1x13mm HIGH PERFORMANCE PLASTERBOARD	N/A	-
P6	WA15 + 92 STUD + WA15		

PARTITION TAG LEGEND**ACOUSTIC PROPERTY LEGEND**

LEGEND IDENTIFIES MINIMUM RW PARTITION WALL IS TO ACHIEVE

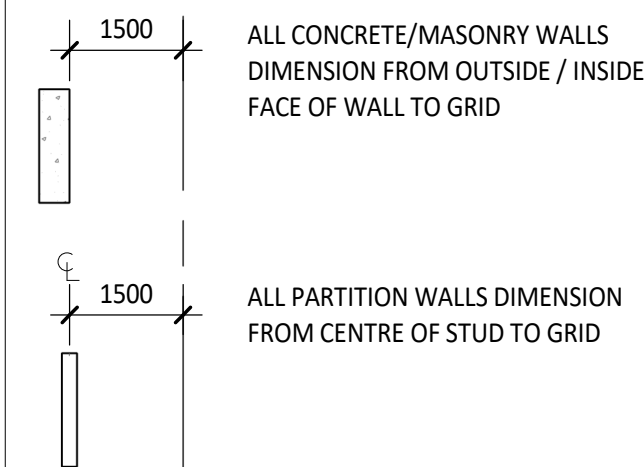
PLANS TO BE PRINTED IN COLOUR

PARTITION LEGEND

- REFER TO 52-00 SERIES FOR DETAIL ON GLAZING PARTITIONS.
- PROVIDE ALLOWANCE TO ADD SUPPORT TO WALLS FOR ALL FIXED ITEMS, INCLUDING BUT NOT LIMITED TO HANDBASINS, GRABRAILS, HANDRAILS, ETC. REFER TO ROOM LAYOUT SHEETS FOR FFE LAYOUTS.
- ALL PENETRATIONS THROUGH FIRE-RATED BUILDING ELEMENTS TO BE FIRE-STOPPED TO MAINTAIN THE LEVEL OF INTEGRITY OF THE HOST ELEMENT (I.E WALL, FLOOR, CEILING).
- TYPICAL DOOR SETOUTS TO BE COMPLIANT WITH AUSTRALIAN STANDARD 1428.1 UNLESS OTHERWISE NOTED.
- DOORS IN CORRIDORS TO BE CENTERED ON CORRIDOR WIDTH UNLESS OTHERWISE NOTED.
- REFER TO STRUCTURAL SETOUT PLANS FOR SETOUT OF ALL MASONRY WALLS.
- REFER TO WALL LINING PLANS FOR EXTENT OF WALL LININGS 28-00 SERIES.
- EXTERNAL PARTITIONS TO ACHIEVE MINIMUM THERMAL & ACOUSTIC PROPERTIES AS OUTLINED IN ACOUSTIC & JV3 / GREEN STAR REPORTS.
- EXTERNAL CLADDING AS NOTED ON ELEVATIONS.
- ALL INTERNAL GLAZING TO ACHIEVE MINIMUM RW OF PARTITION WALL IT IS WITHIN.
- DOORS WITHIN ACOUSTIC RATED WALLS TO ACHIEVE MATCHING MINIMUM Rw RATING.
- GLAZING WITHIN ACOUSTIC RATED WALLS TO ACHIEVE MATCHING MINIMUM RW RATING.

PARTITION HEAD TYPE LEGEND

- A = ACOUSTIC/SMOKE (FULL HEIGHT STUD TO U/S SLAB)
B = FIRE RATED (FULL HEIGHT STUD TO U/S SLAB)
C = 100mm ABOVE CEILING
D = TO UNDERSIDE OF CEILING
E = LOW WALL

WALL SETOUTS**FIRE MANAGEMENT LEGEND**

- FIRE RATED WALL - REFER TO PARTITION DETAILS FOR MORE INFO
 SMOKE COMPARTMENT WALL

PLANS TO BE PRINTED IN COLOUR

ISSUED FOR TENDER