


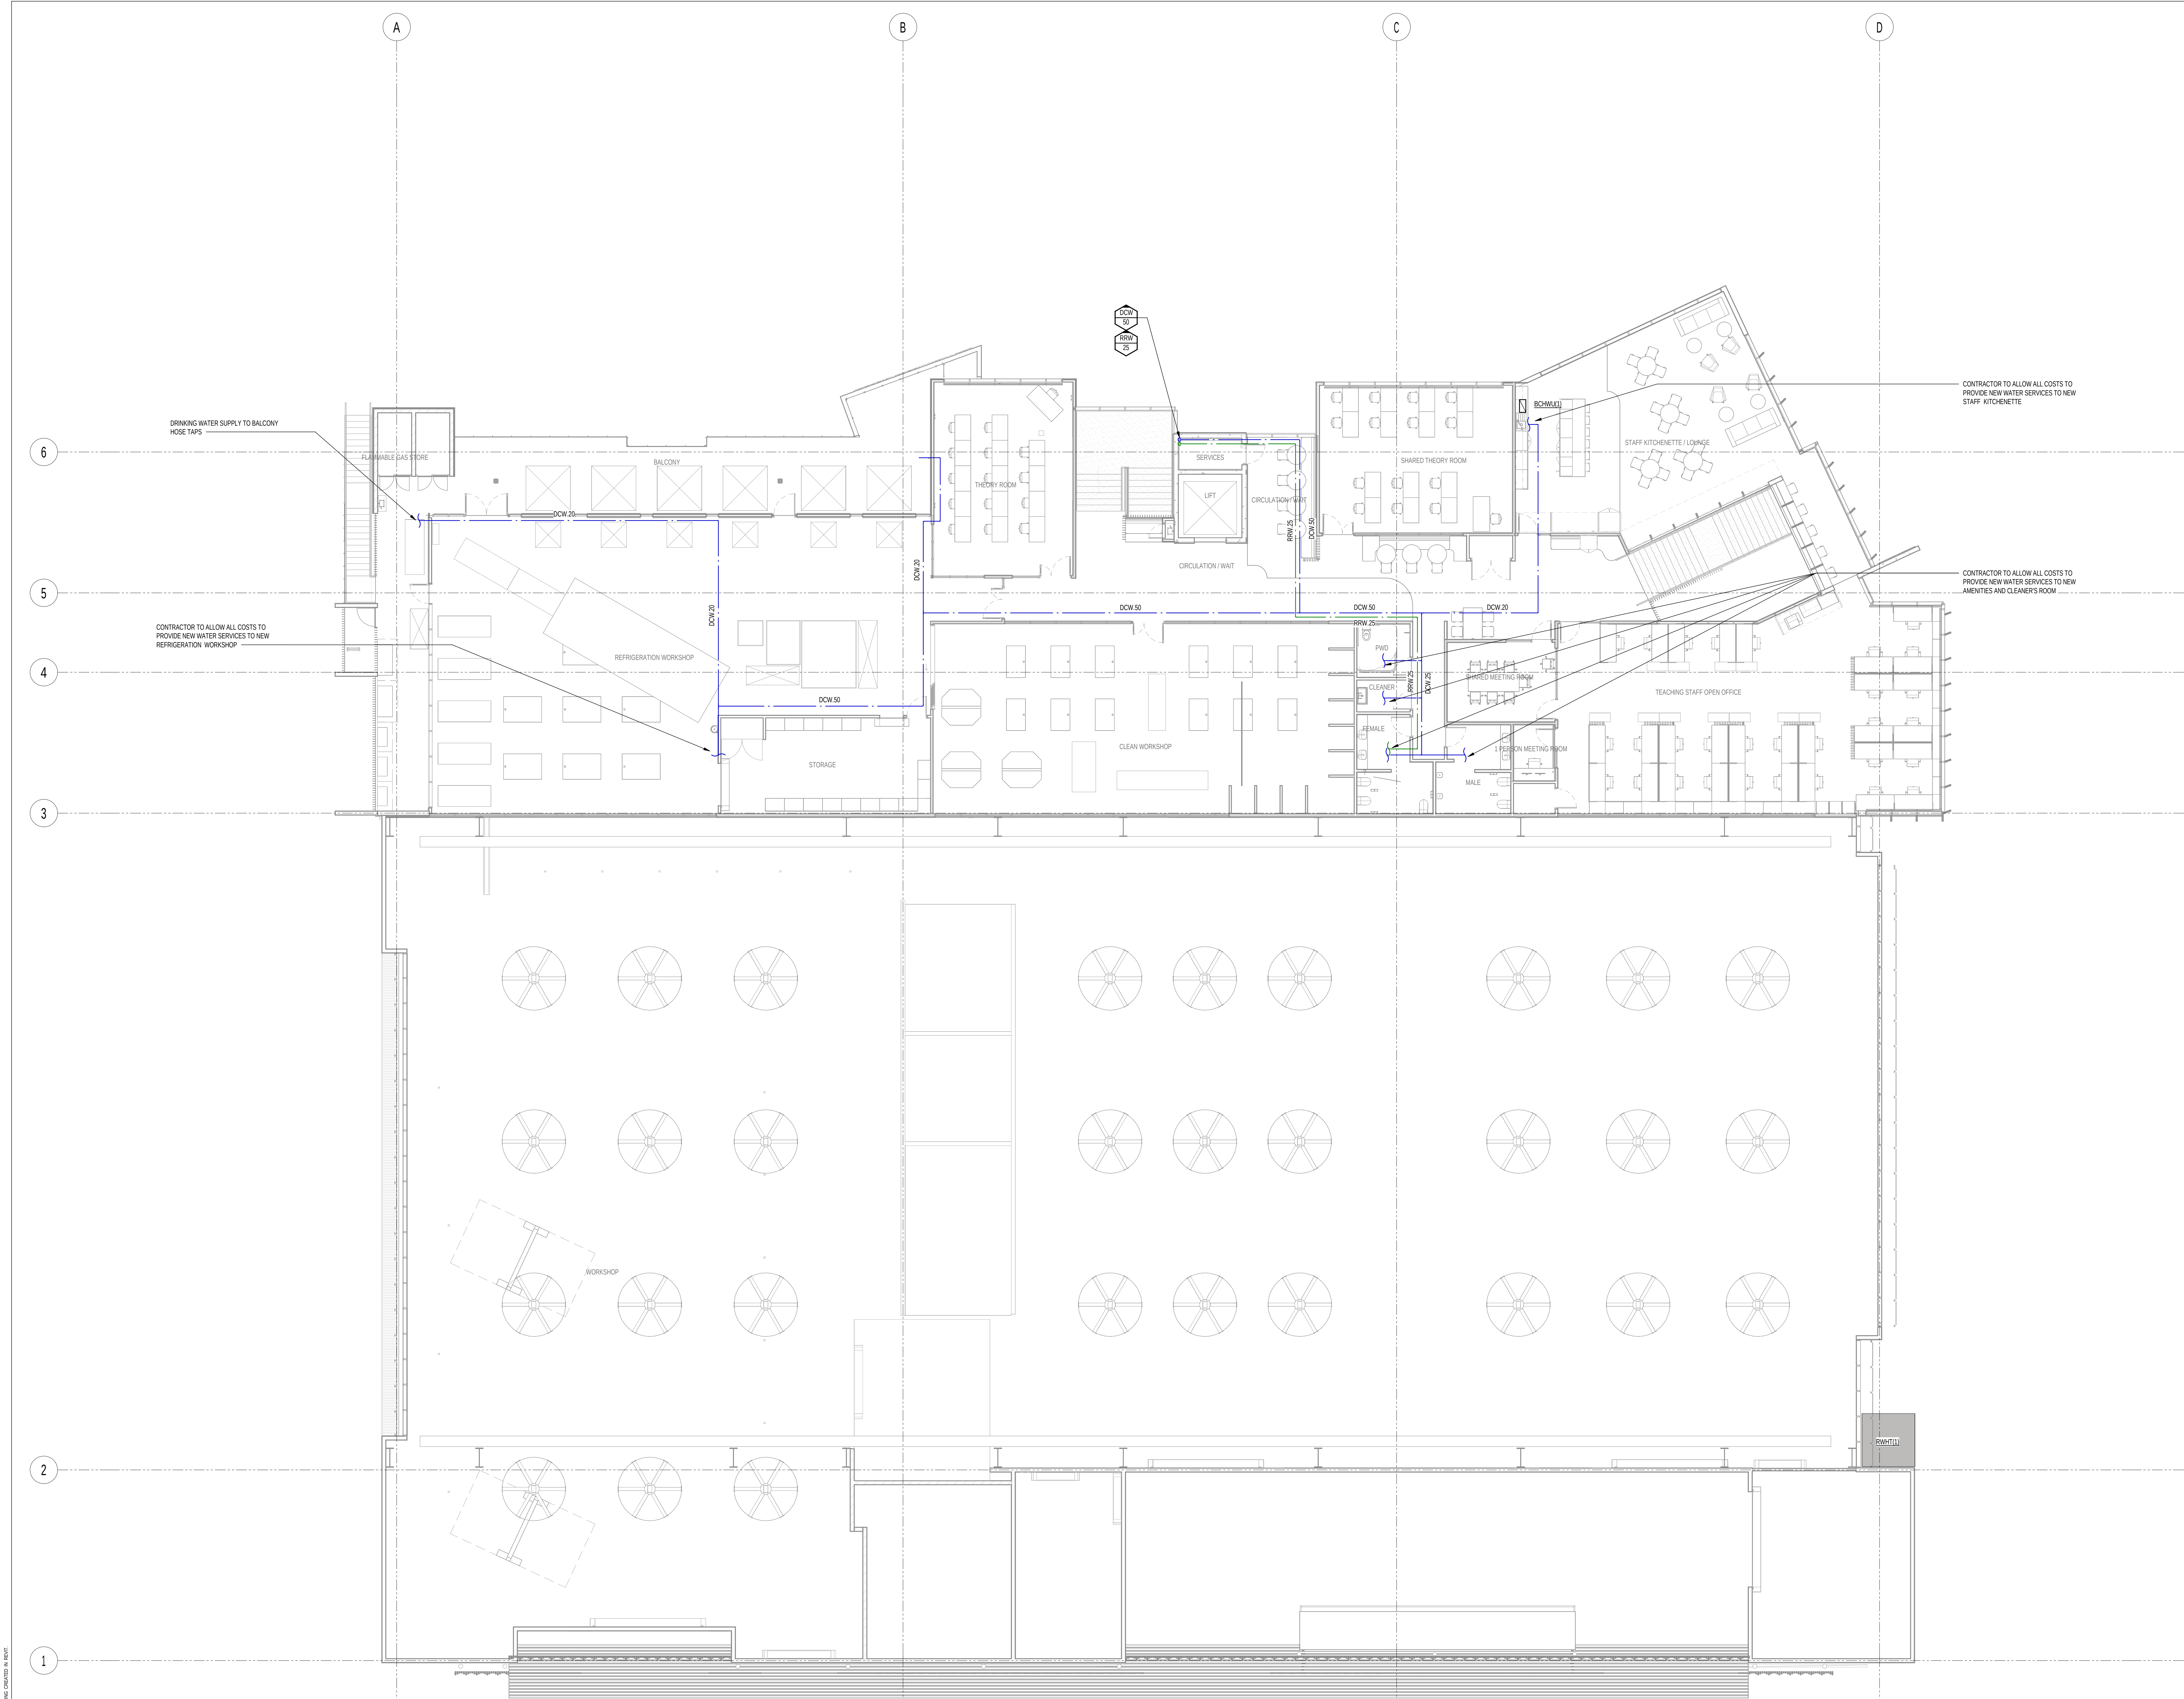

INFORMATION REFLECTED ON THIS DRAWING REPRESENTS HYDRAULIC SERVICES DESIGN DEVELOPED FOR D&C TENDER ADVICE ONLY, AND SHOULD NOT BE REGARDED AS COMPLETE. THE D&C CONTRACTOR SHOULD REFER TO ALL ASSOCIATED ARCHITECTURAL AND OTHER DISCIPLINE DRAWINGS, PROJECT BRIEFS AND CLIENT REQUIREMENTS AND MAKE ADEQUATE ALLOWANCES FOR ALL NECESSARY HYDRAULIC SERVICES WORKS TO MEET THESE REQUIREMENTS, EQUIPMENT SCHEDULES AND COMPLIANCE WITH THE NCC & APPROPRIATE AUSTRALIAN STANDARDS

WATER NOTES:

1. ALLOW ALL COSTS TO RETICULATE ALL HOT AND COLD WATER FROM AREA ISOLATION OR TMV TO FIXTURES WITHIN THE ROOM.
2. ALL FIXTURES ARE TO HAVE MINI ISOLATION VALVES AT POINT OF CONNECTION FOR TAPWARE WITH FLEXIBLE HOSES, OR ARE TO BE ISOLATED BY MEANS OF ISOLATING ONLY THE ROOM INDEPENDENTLY FROM THE REMAINDER OF THE BUILDING.
3. ALL PENETRATIONS OR CAST THROUGH CONCRETE STRUCTURE ARE TO BE APPROVED BY THE STRUCTURAL ENGINEER.
4. ALL REDUNDANT PENETRATIONS THROUGH STRUCTURAL ELEMENTS ARE TO BE MADE GOOD TO THE SATISFACTION OF THE STRUCTURAL ENGINEER.
5. SERVICES PASSING THROUGH A FIRE RATED STRUCTURE SHALL HAVE FIRE COLLARS (OR OTHER APPROVED FIRE PROTECTION METHOD) RATED TO THE MINIMUM FRL OF THE STRUCTURE IT IS PENETRATING.
6. WHERE METAL PIPEWORK PASSES THROUGH STRUCTURE WHICH IS TO BE FIRE RATED, MINIMISE THE PENETRATION SIZE AND PACK AROUND PIPEWORK WITH APPROVED INTUMESCENT SEALANT TO THE NCC C4015 AND THE MANUFACTURERS REQUIREMENTS TO ENSURE OPENINGS ARE COMPLETELY CLOSED IN THE EVENT OF A FIRE.
7. DOCUMENTATION MAY NOT INDICATE ALL LOCATIONS OF REQUIRED VALVING. FINAL REQUIREMENTS TO BE DOCUMENTED IN FURTHER DESIGN DEVELOPMENT.
8. WHERE REQUIRED PROVIDE CEILING ACCESS PANELS TO MAINTAIN ACCESS TO ALL VALVING, METERS, TMVS ETC.
9. PROVIDE BACKFLOW PREVENTION DEVICES AS REQUIRED TO ENSURE THAT ZONE PROTECTION IS RETAINED IN ACCORDANCE WITH AS/NZS3500.1 AND LOCAL AUTHORITY REQUIREMENTS.
10. SERVICES PASSING THROUGH A FIRE RATED STRUCTURE SHALL HAVE FIRE COLLARS (OR OTHER APPROVED FIRE PROTECTION METHOD) RATED TO THE MINIMUM FRL OF THE STRUCTURE IT IS PENETRATING.
11. WHERE METAL PIPEWORK PASSES THROUGH STRUCTURE WHICH IS TO BE FIRE RATED, MINIMISE THE PENETRATION SIZE AND PACK AROUND PIPEWORK WITH APPROVED INTUMESCENT SEALANT TO THE NCC C4015 AND THE MANUFACTURERS REQUIREMENTS TO ENSURE OPENINGS ARE COMPLETELY CLOSED IN THE EVENT OF A FIRE.
12. CONTRACTOR TO REFER TO STRUCTURAL DRAWINGS BEFORE PENETRATING THROUGH SLAB. ALLOW ALL COSTS FOR PENETRATIONS AND REINSTATEMENT AS REQUIRED.
13. CONTRACTOR TO COORDINATE PROVISIONS WITH FINAL FFEE LAYOUT PROVIDED BY ARCHITECT.

B	12.02.2026	SH	ISSUED FOR D&C TENDER	AA	SM
A	10.02.2026	SH	ISSUED FOR D&C TENDER	AA	SM
REV	DATE	BY	DESCRIPTION	CHK	APP

DESIGN DEVELOPMENT



900 Ann Street, Level 12, Fortitude Valley 4006
Tel: +61-7-3854-6200 Fax: +61-7-3854-6500
<http://www.wsp.com>

CLIENT: CQU

ARCHITECT: THOMSON ADSETT / PEDDLE THORP

PROJECT: CQU ROCKHAMPTON TAFE CONSOLIDATION

TITLE: HYDRAULIC SERVICES
NEW TRADES BUILDING - LEVEL 01 - WATER
SERVICES LAYOUT

SCALE @ A1	CHECKED	APPROVED
1:100	AA	SM
PROJECT NUMBER	DRAWN	DATE
PS229518	SH	JAN 2026

DRAWING NO: NTB-HY-DR-520-L01-00-00

REV

B

© WSP Australia Pty Ltd