




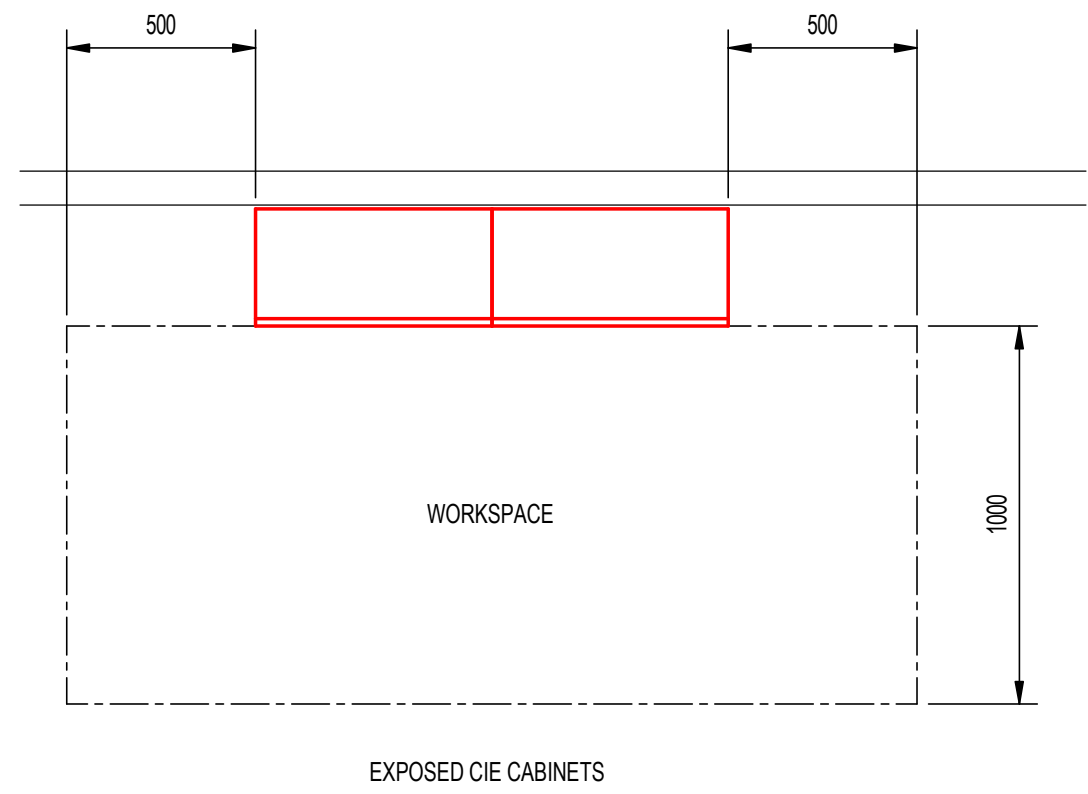


CLEARANCES AROUND EXPOSED PANELS
1:20

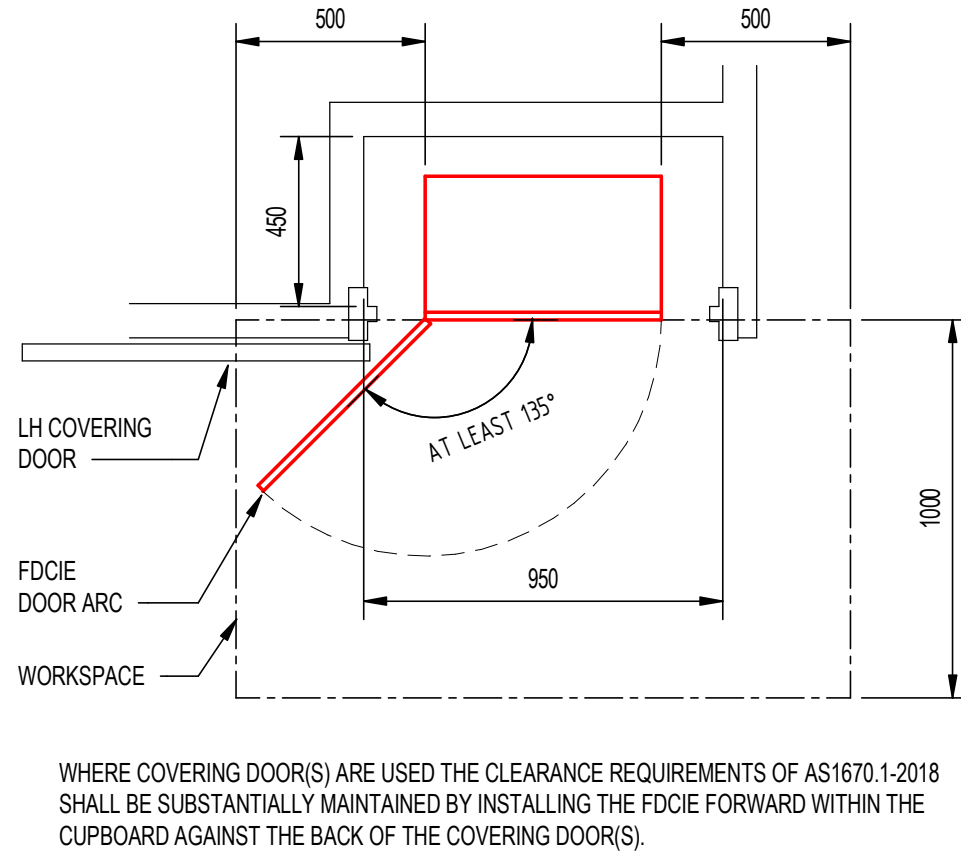


FDCE FIRE PANEL CUPBOARD DETAIL
1:20

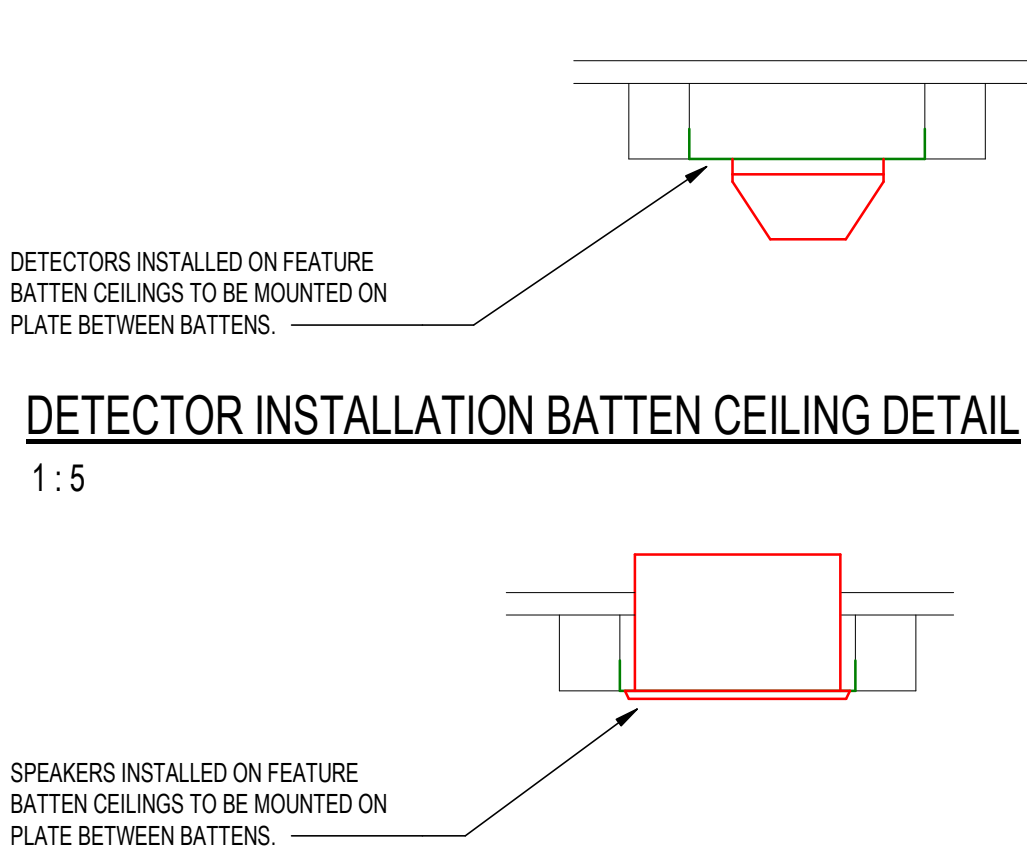

DETECTOR INSTALLATION BATTEN CEILING DETAIL
1:5

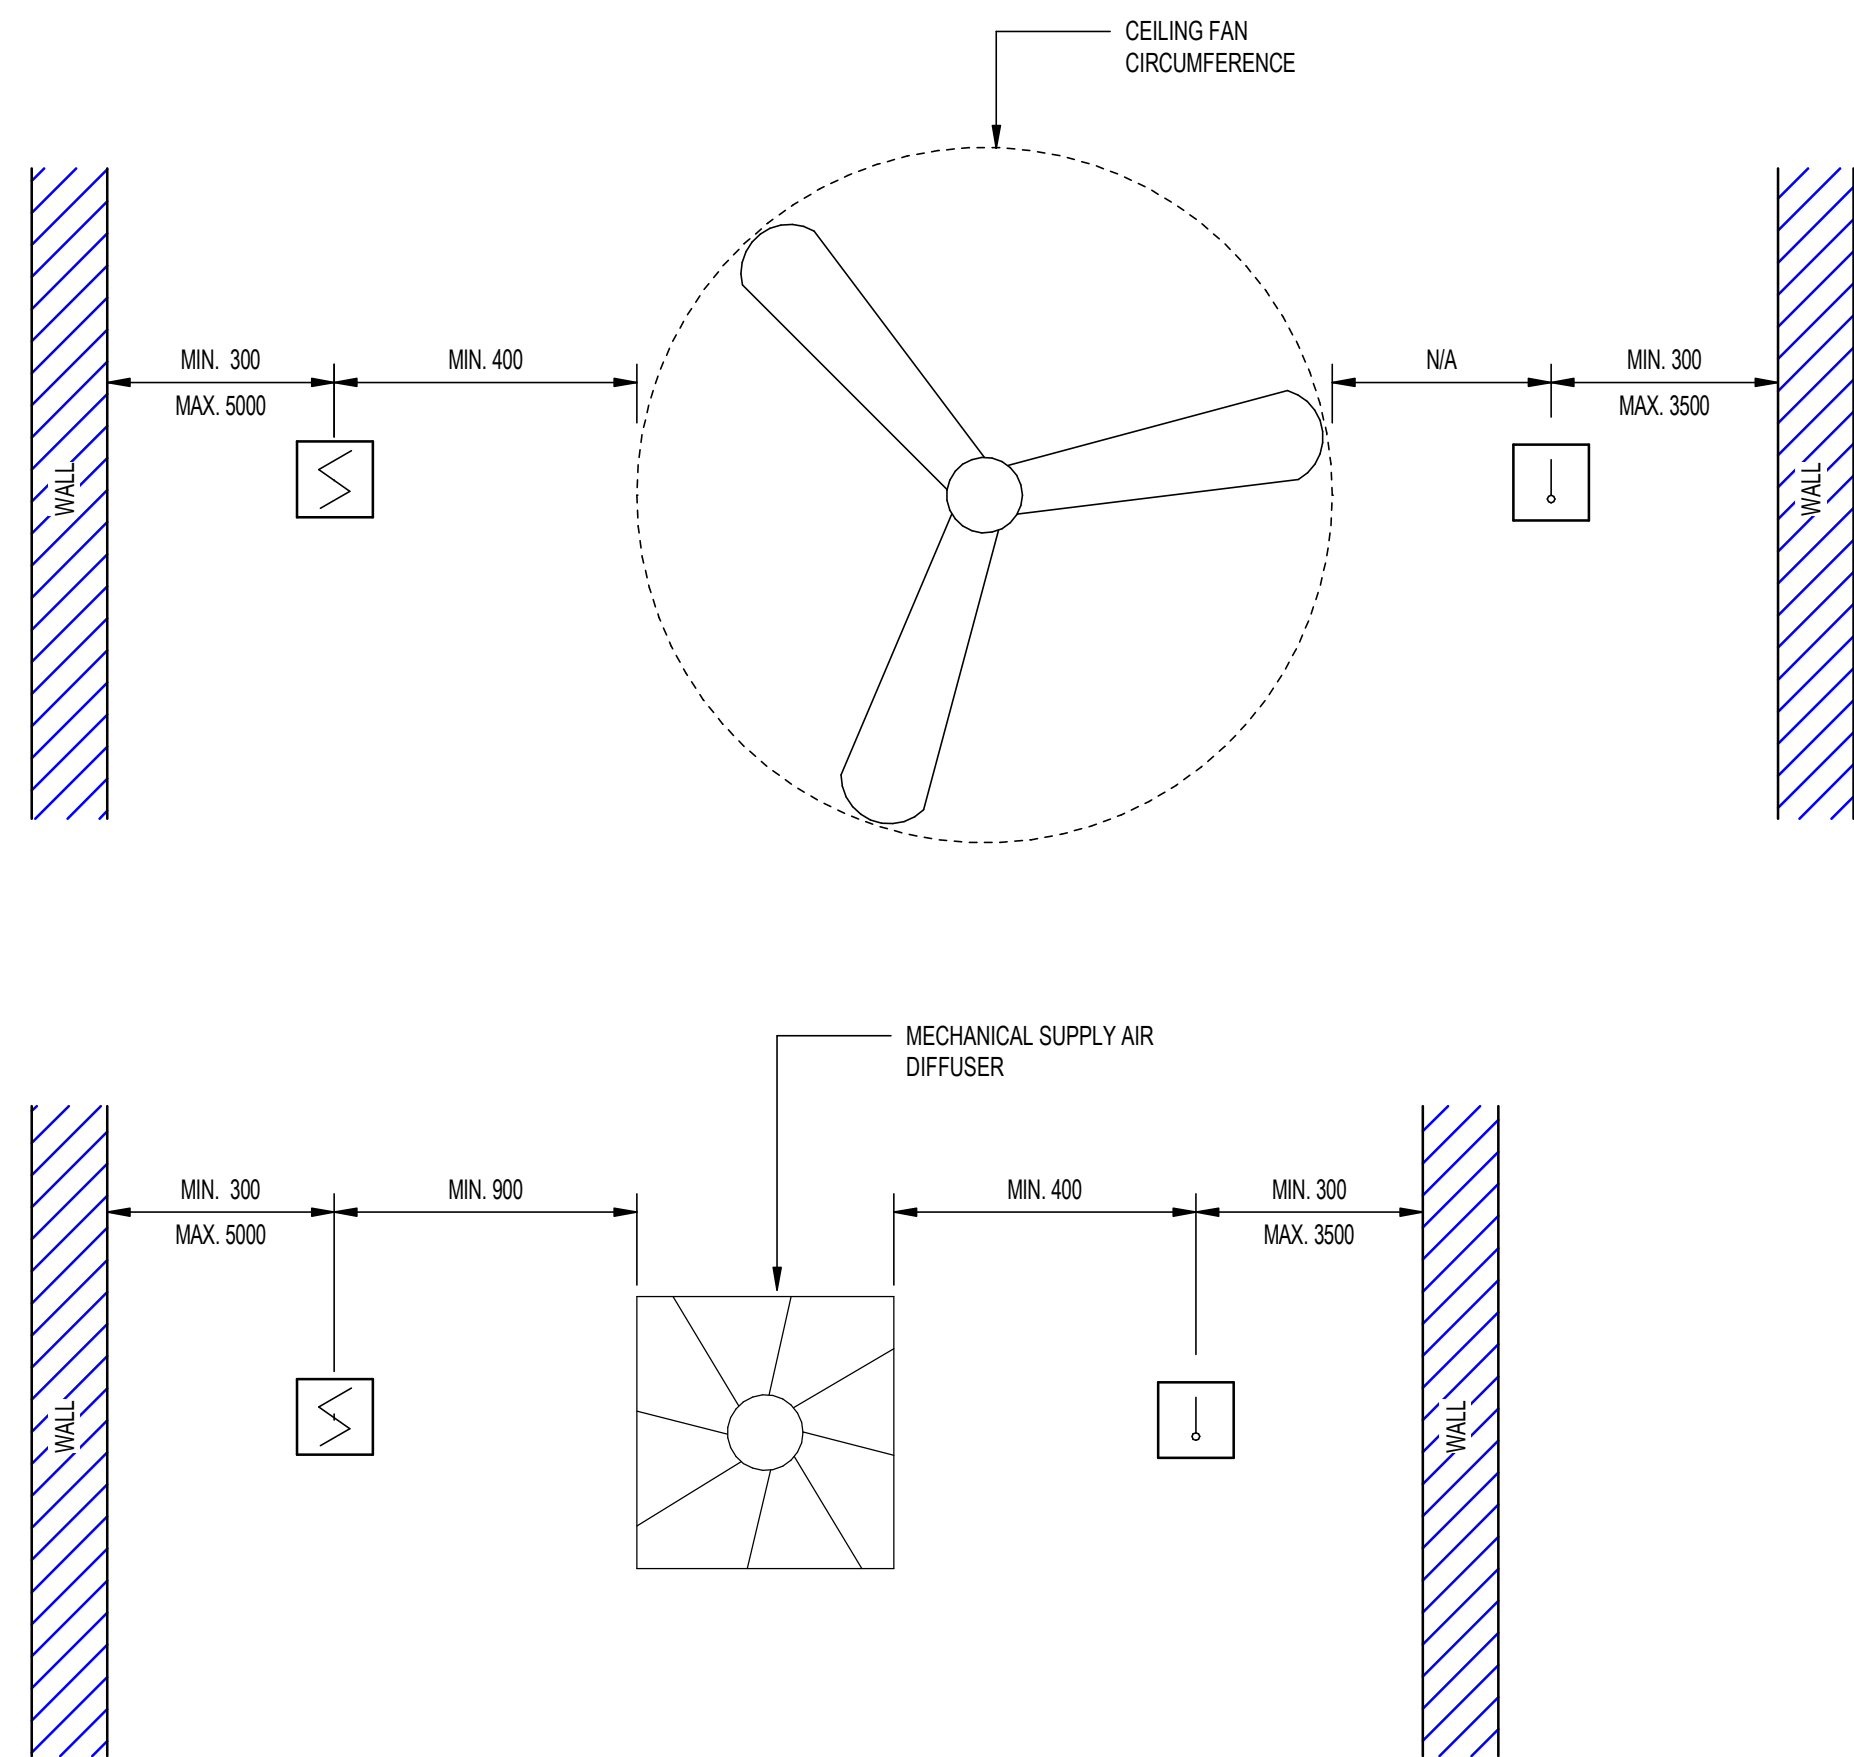


STANDARD FIRE DETECTION SPACING REQUIREMENTS
1:10

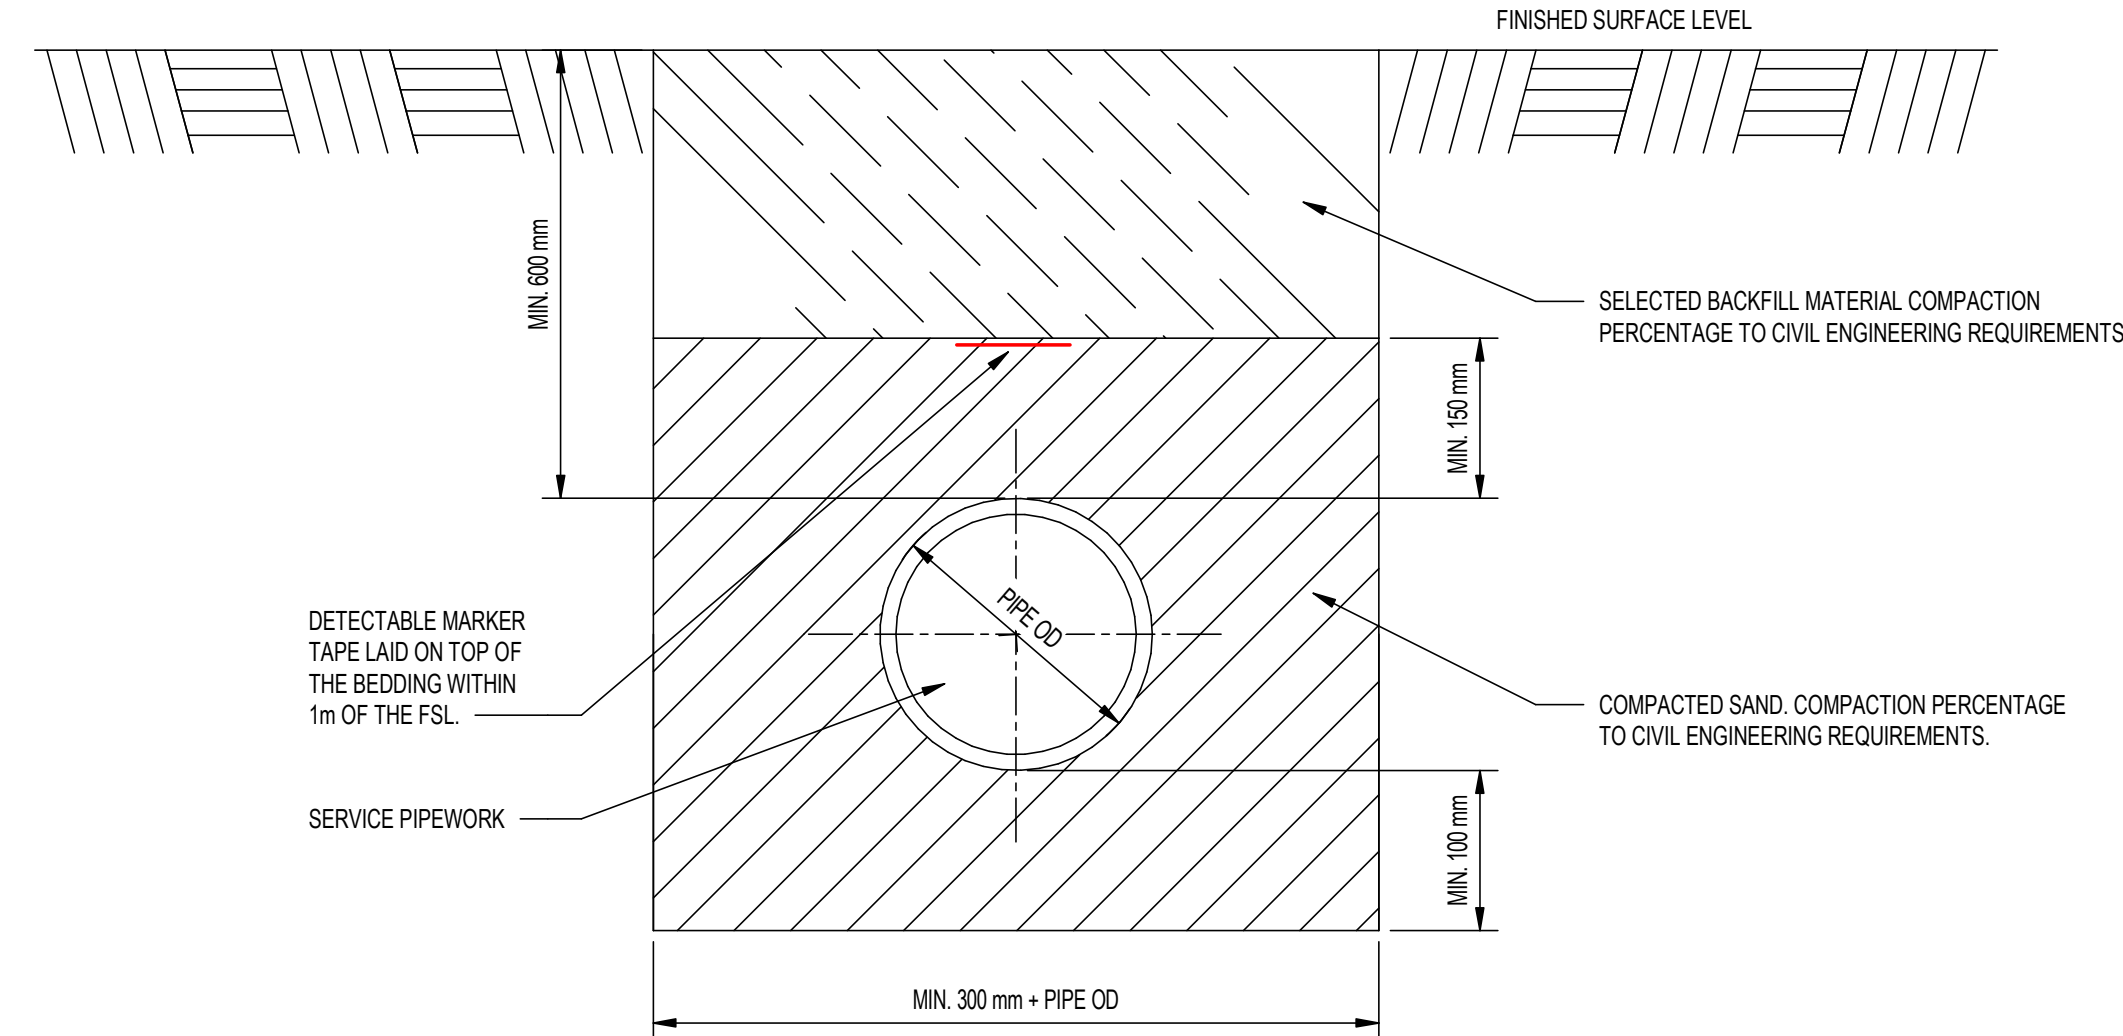


UNDERGROUND FIRE SERVICES TRENCH DETAIL
1:5


INFORMATION REFLECTED ON THIS DRAWING REPRESENTS FIRE SERVICES DESIGN DEVELOPED FOR D&C TENDER ADVISE ONLY, AND SHOULD NOT BE REGARDED AS COMPLETE. THE D&C CONTRACTOR SHOULD REFER TO ALL ASSOCIATED ARCHITECTURAL AND OTHER DISCIPLINE DRAWINGS, PROJECT BRIEFS AND CLIENT REQUIREMENTS AND MAKE ADEQUATE ALLOWANCES FOR ALL NECESSARY FIRE SERVICES WORKS TO MEET THESE REQUIREMENTS, EQUIPMENT SCHEDULES AND COMPLIANCE WITH THE NCC & APPROPRIATE AUSTRALIAN STANDARDS

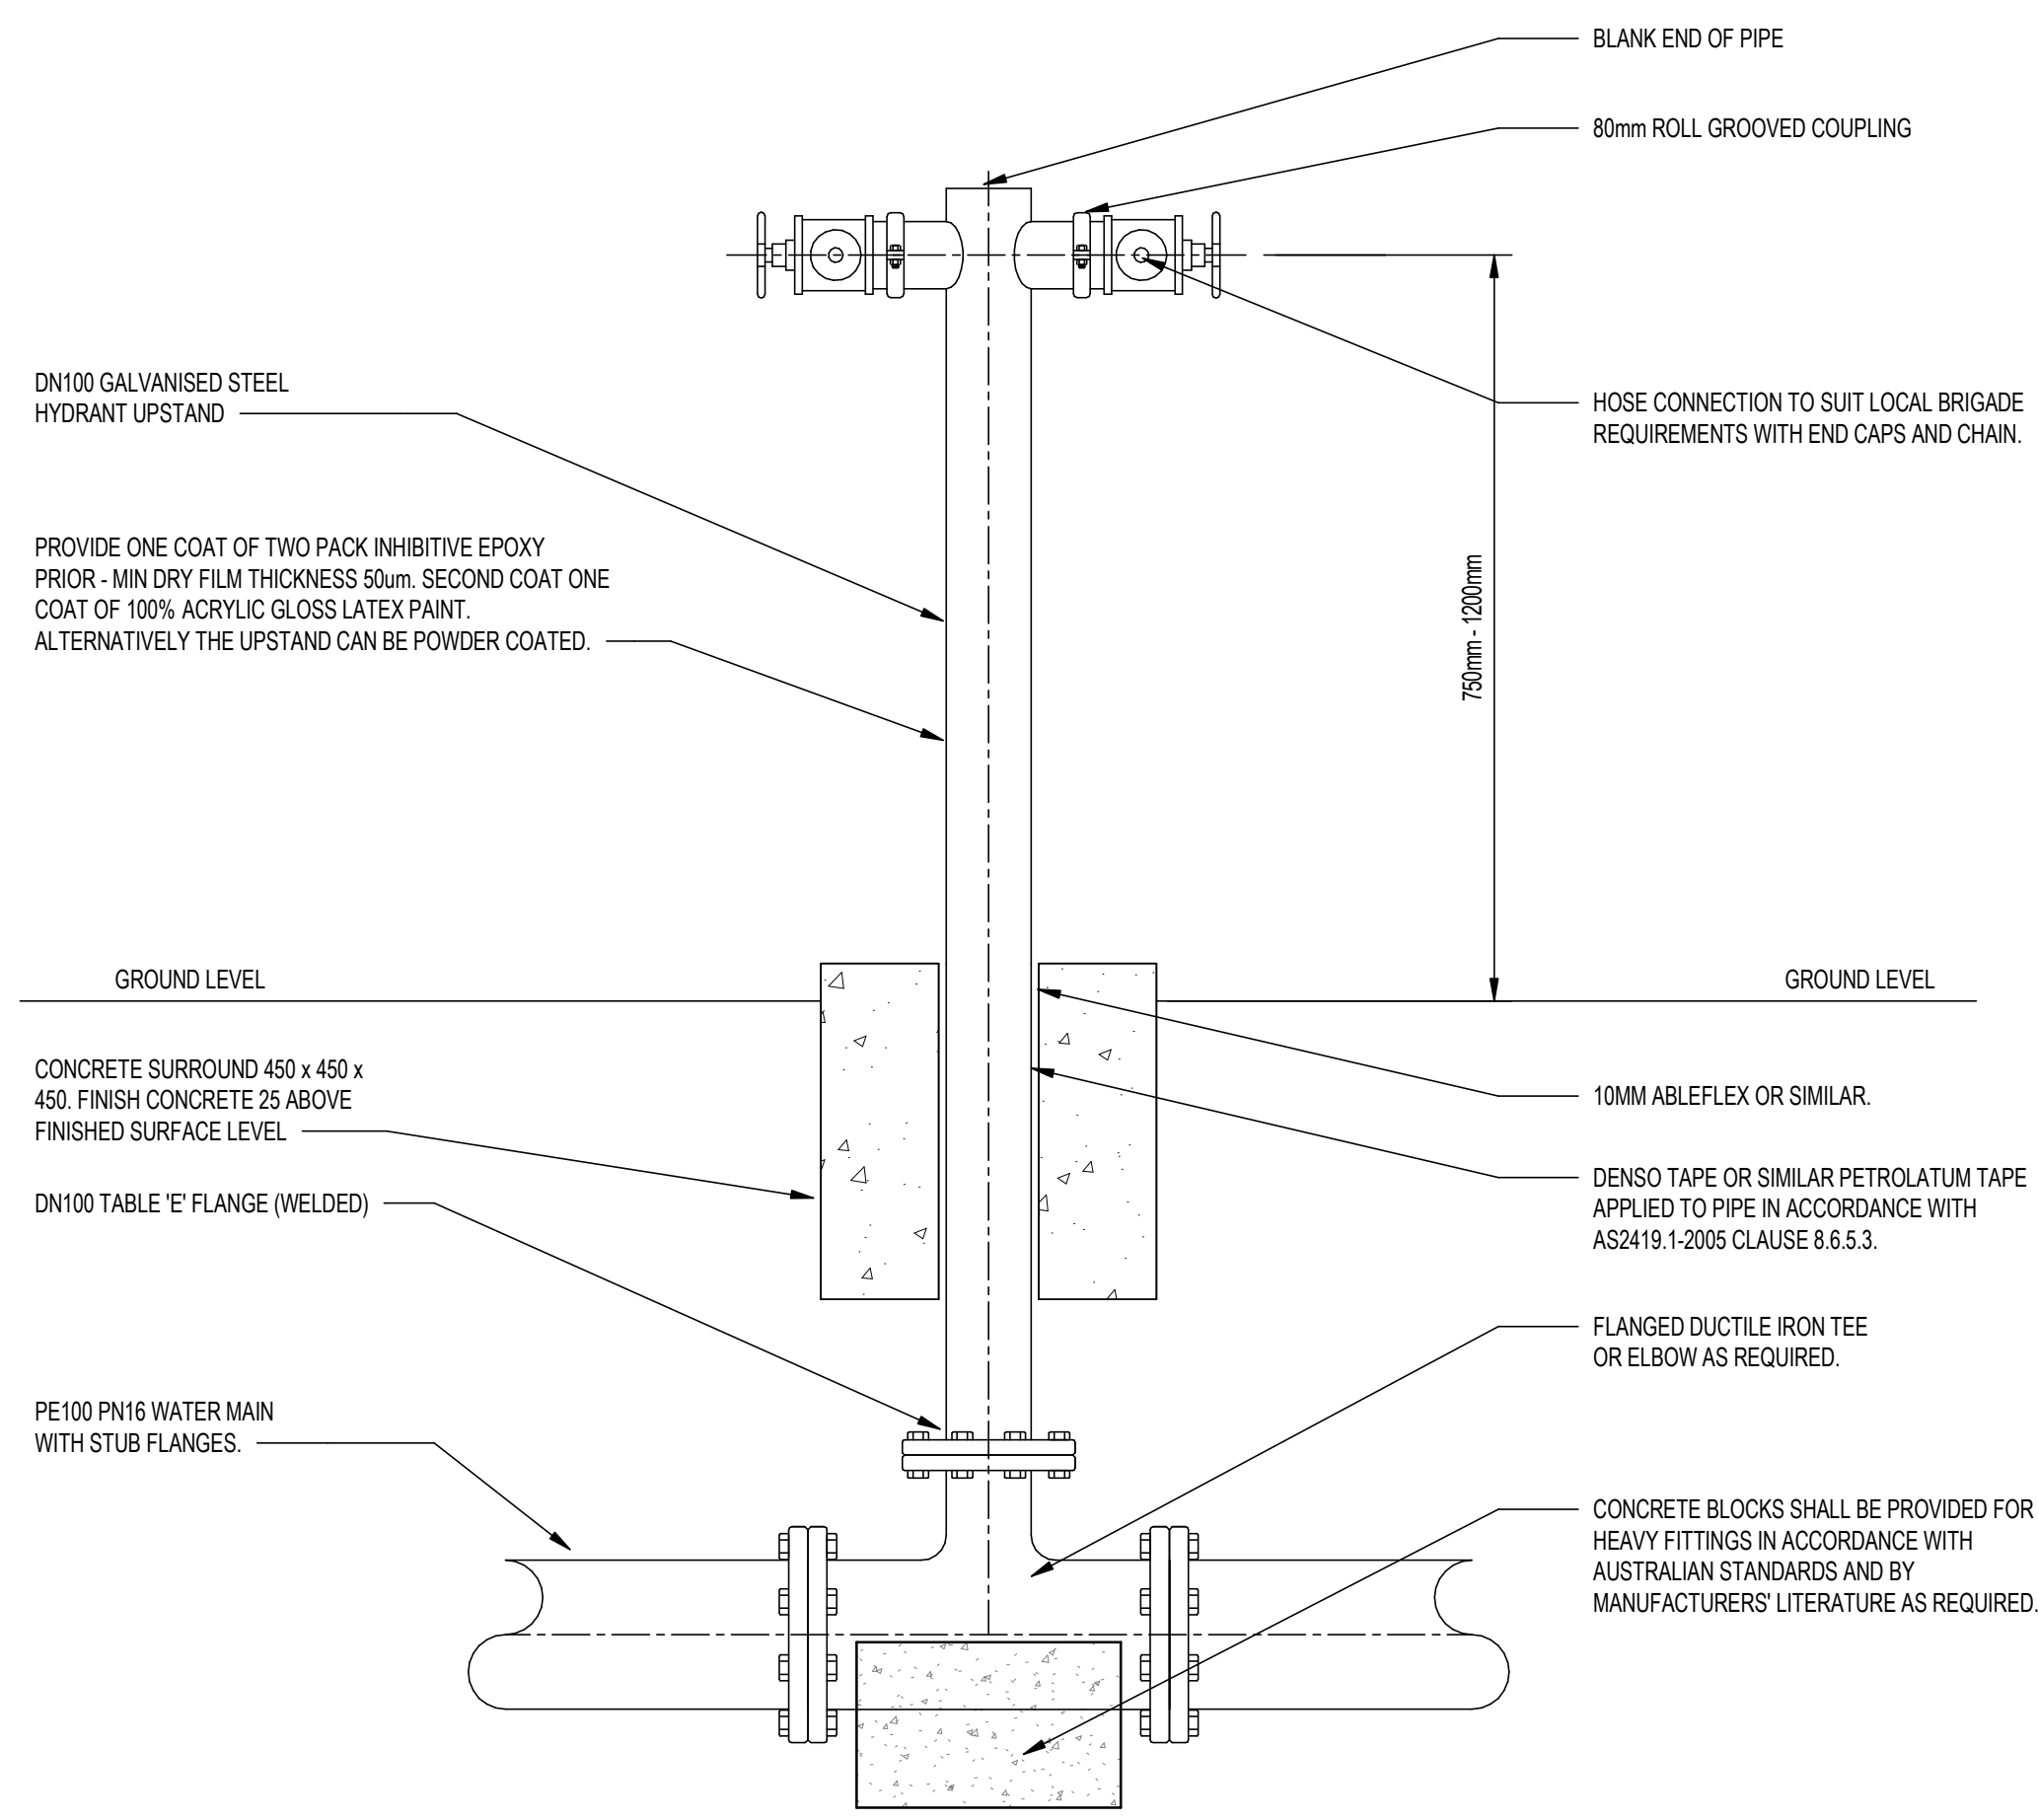

DOUBLE PILLAR ATTACK HYDRANT DETAIL
1:10


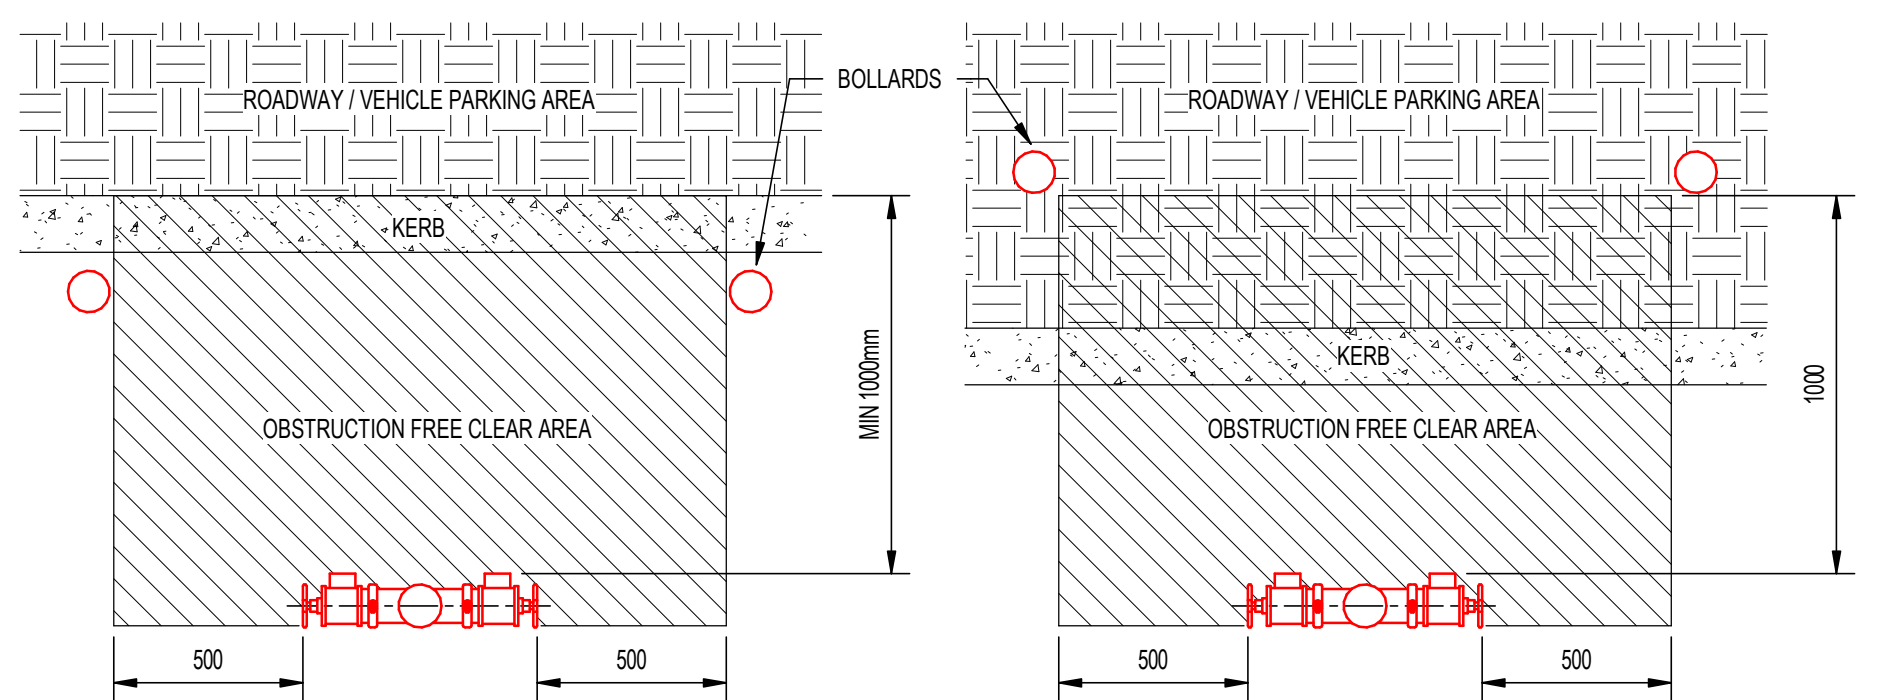


DOUBLE PILLAR EXTERNAL HYDRANT BOLLARDS DETAIL
1:20

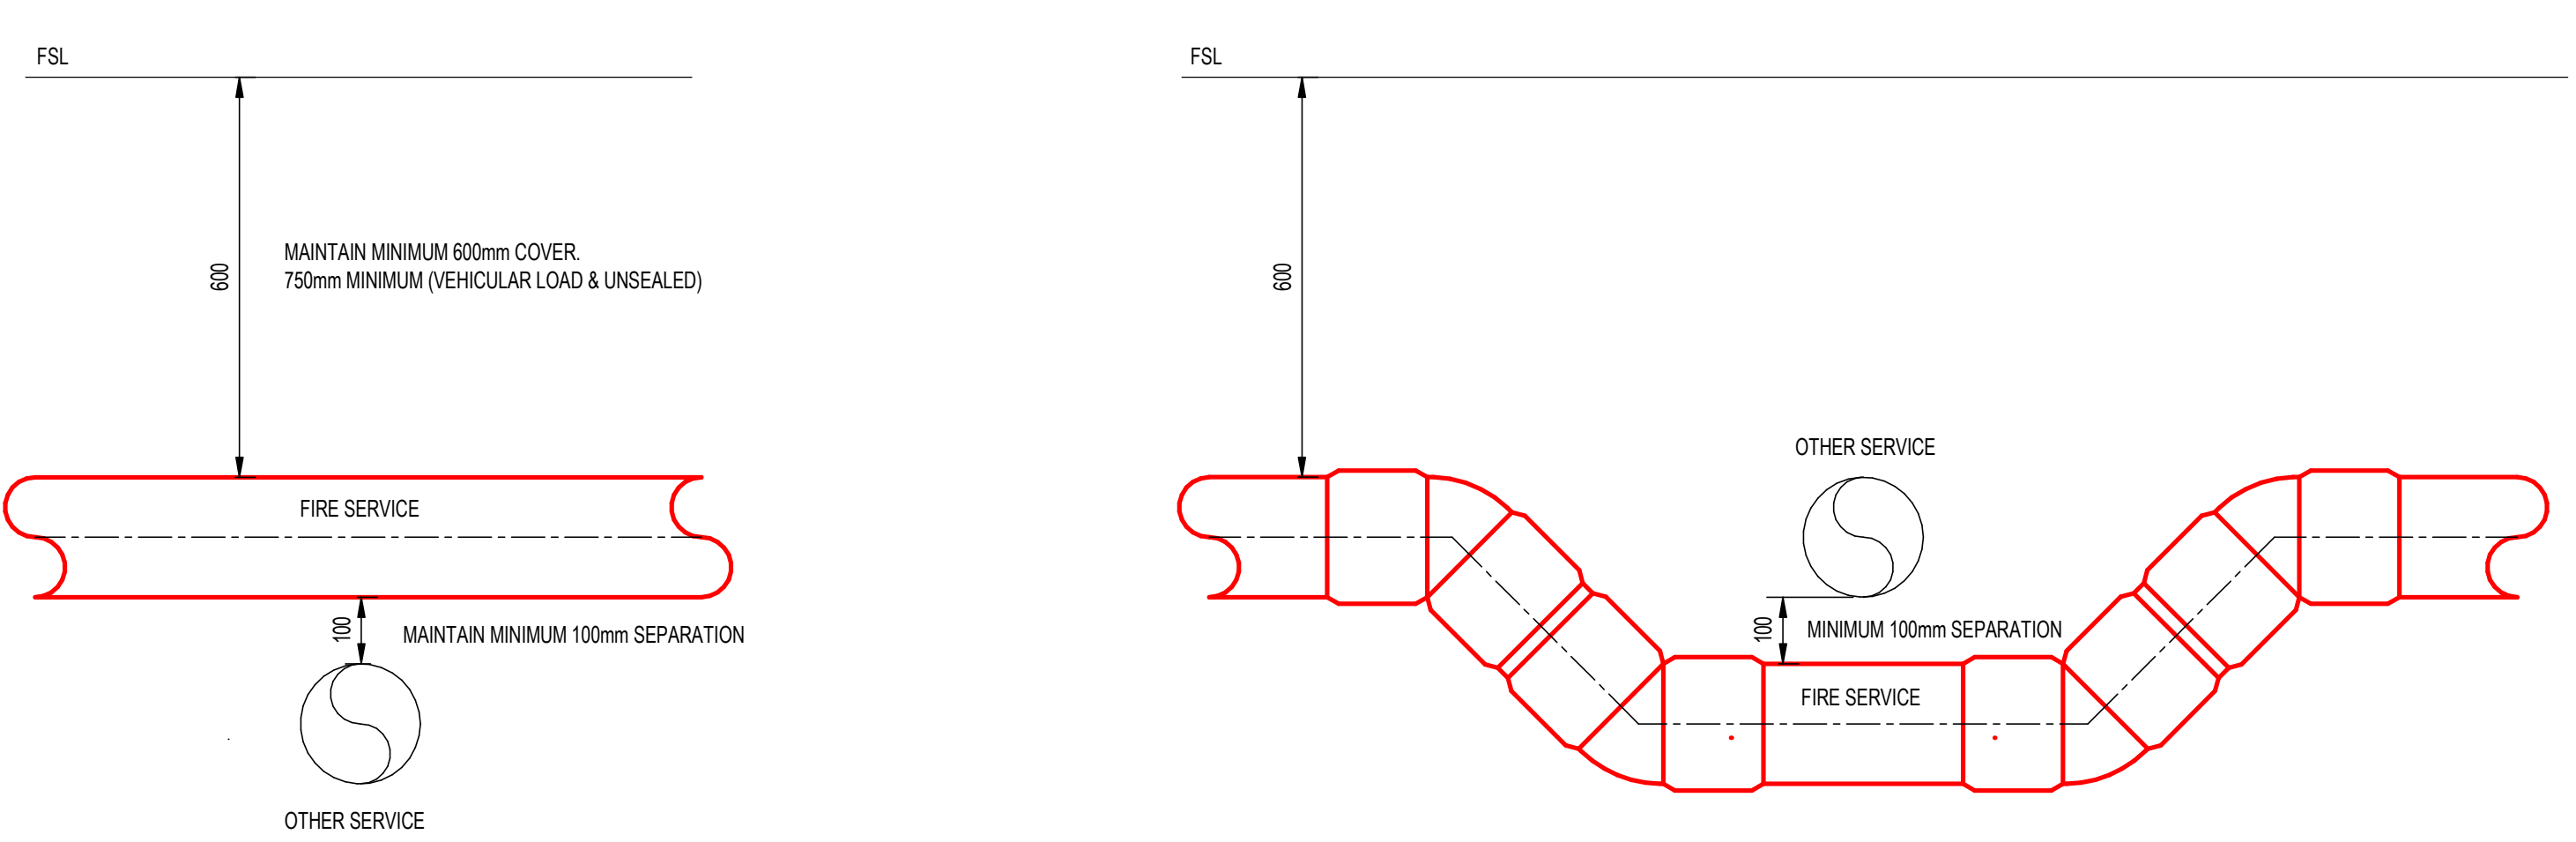


MINIMUM DEPTH OF COVER FOR BURIED PIPES
1:10


BURIED PIPES MINIMUM HORIZONTAL SEPARATION REQUIREMENTS PARALLEL TRENCH
1:10

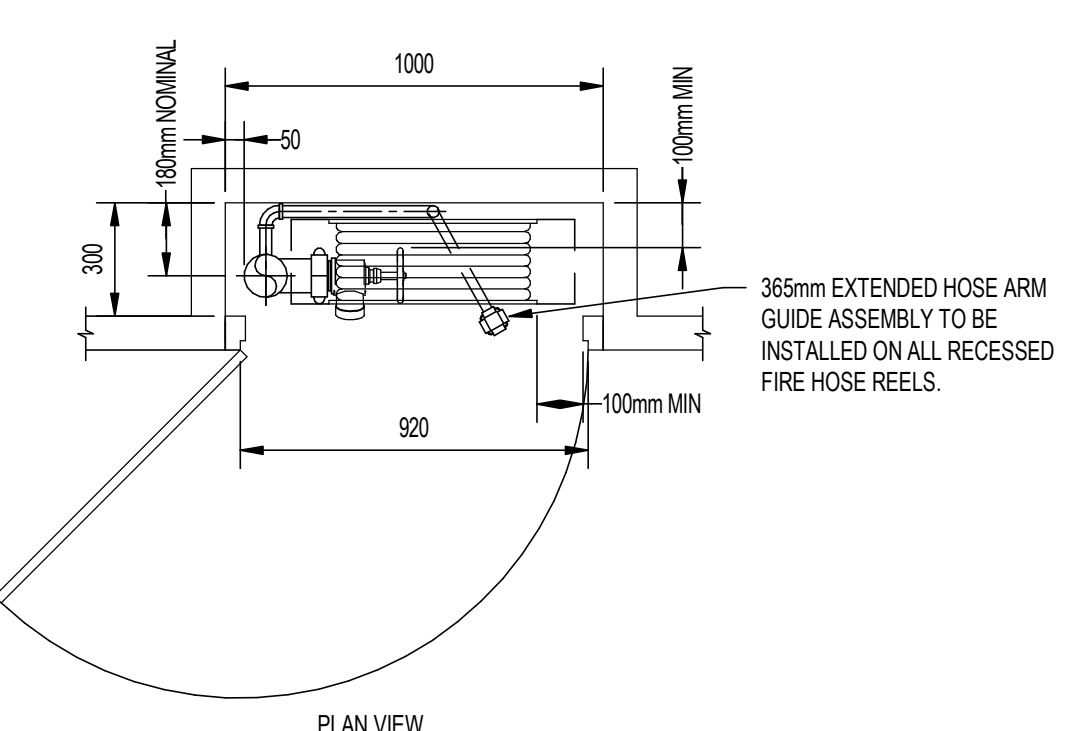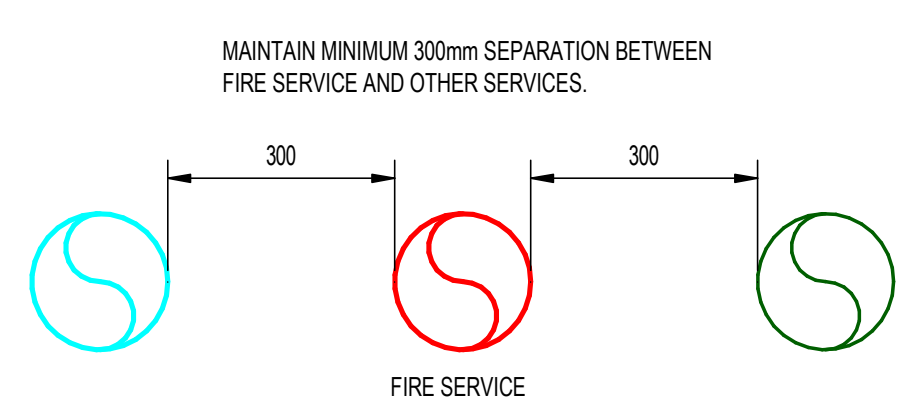


NOTE:
• ENSURE ALL CLEARANCES REQUIRED BY AS 2419.1 ARE MAINTAINED INCLUDING HYDRANT HAND WHEEL 100mm CLEARANCES
• ENSURE HYDRANT OUTLET IS NOT MORE THAN 30° INCLINED DOWN FROM THE HORIZONTAL PLANE

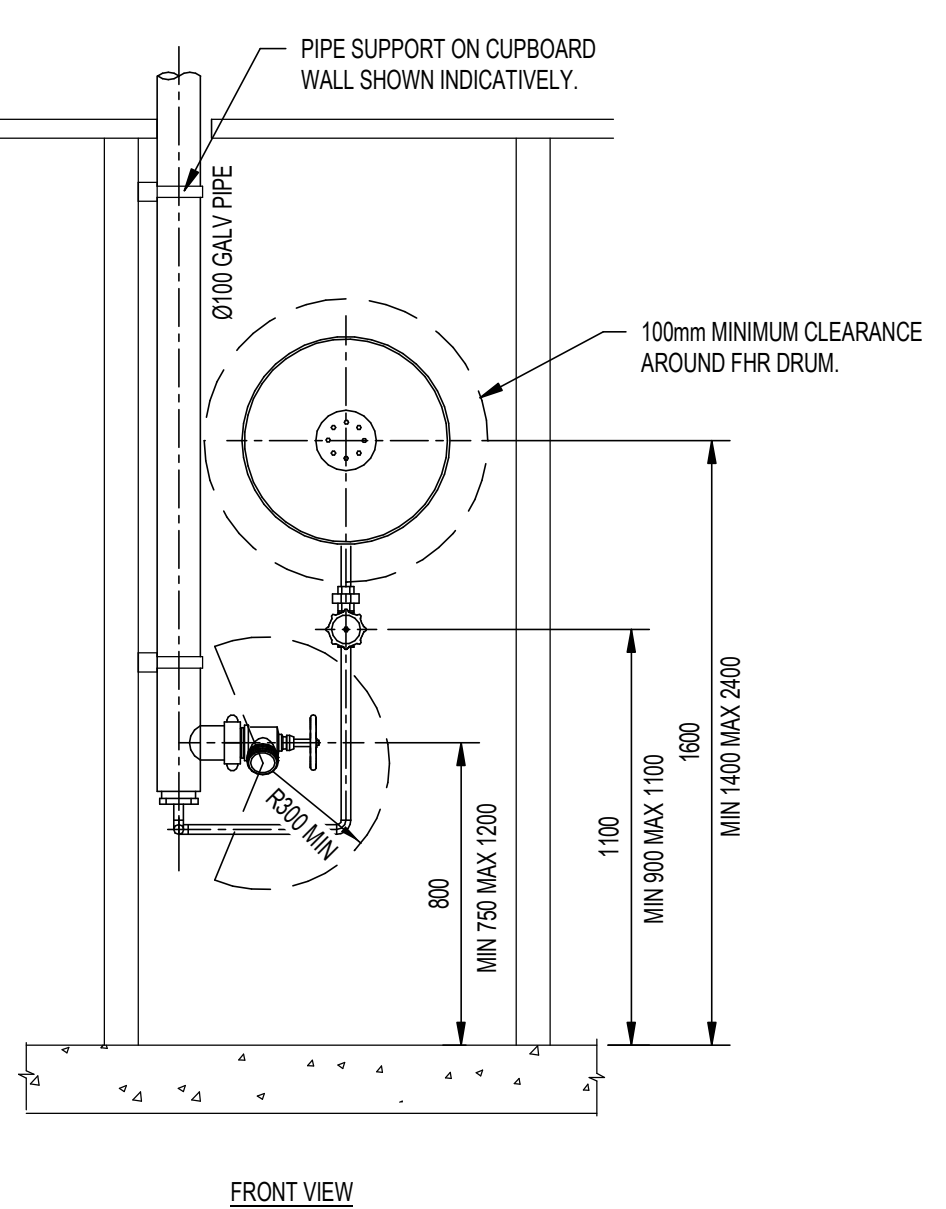


HYDRANT & HOSE REEL CUPBOARD DETAIL
1:20

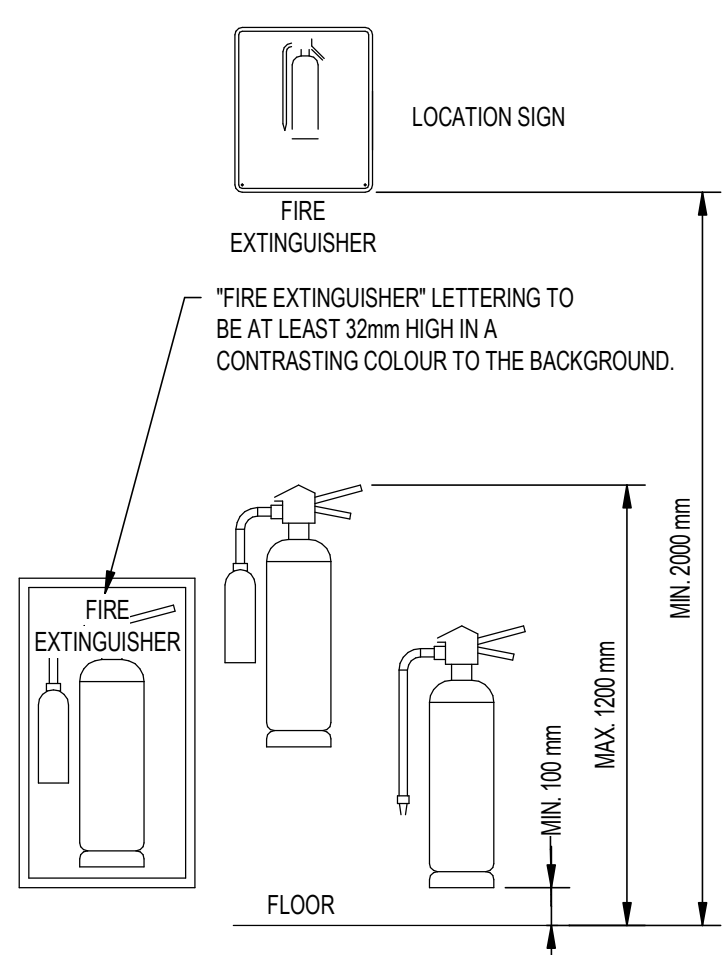

FIRE EXTINGUISHER MOUNTING HEIGHT AND SIGNAGE DETAIL
1:20

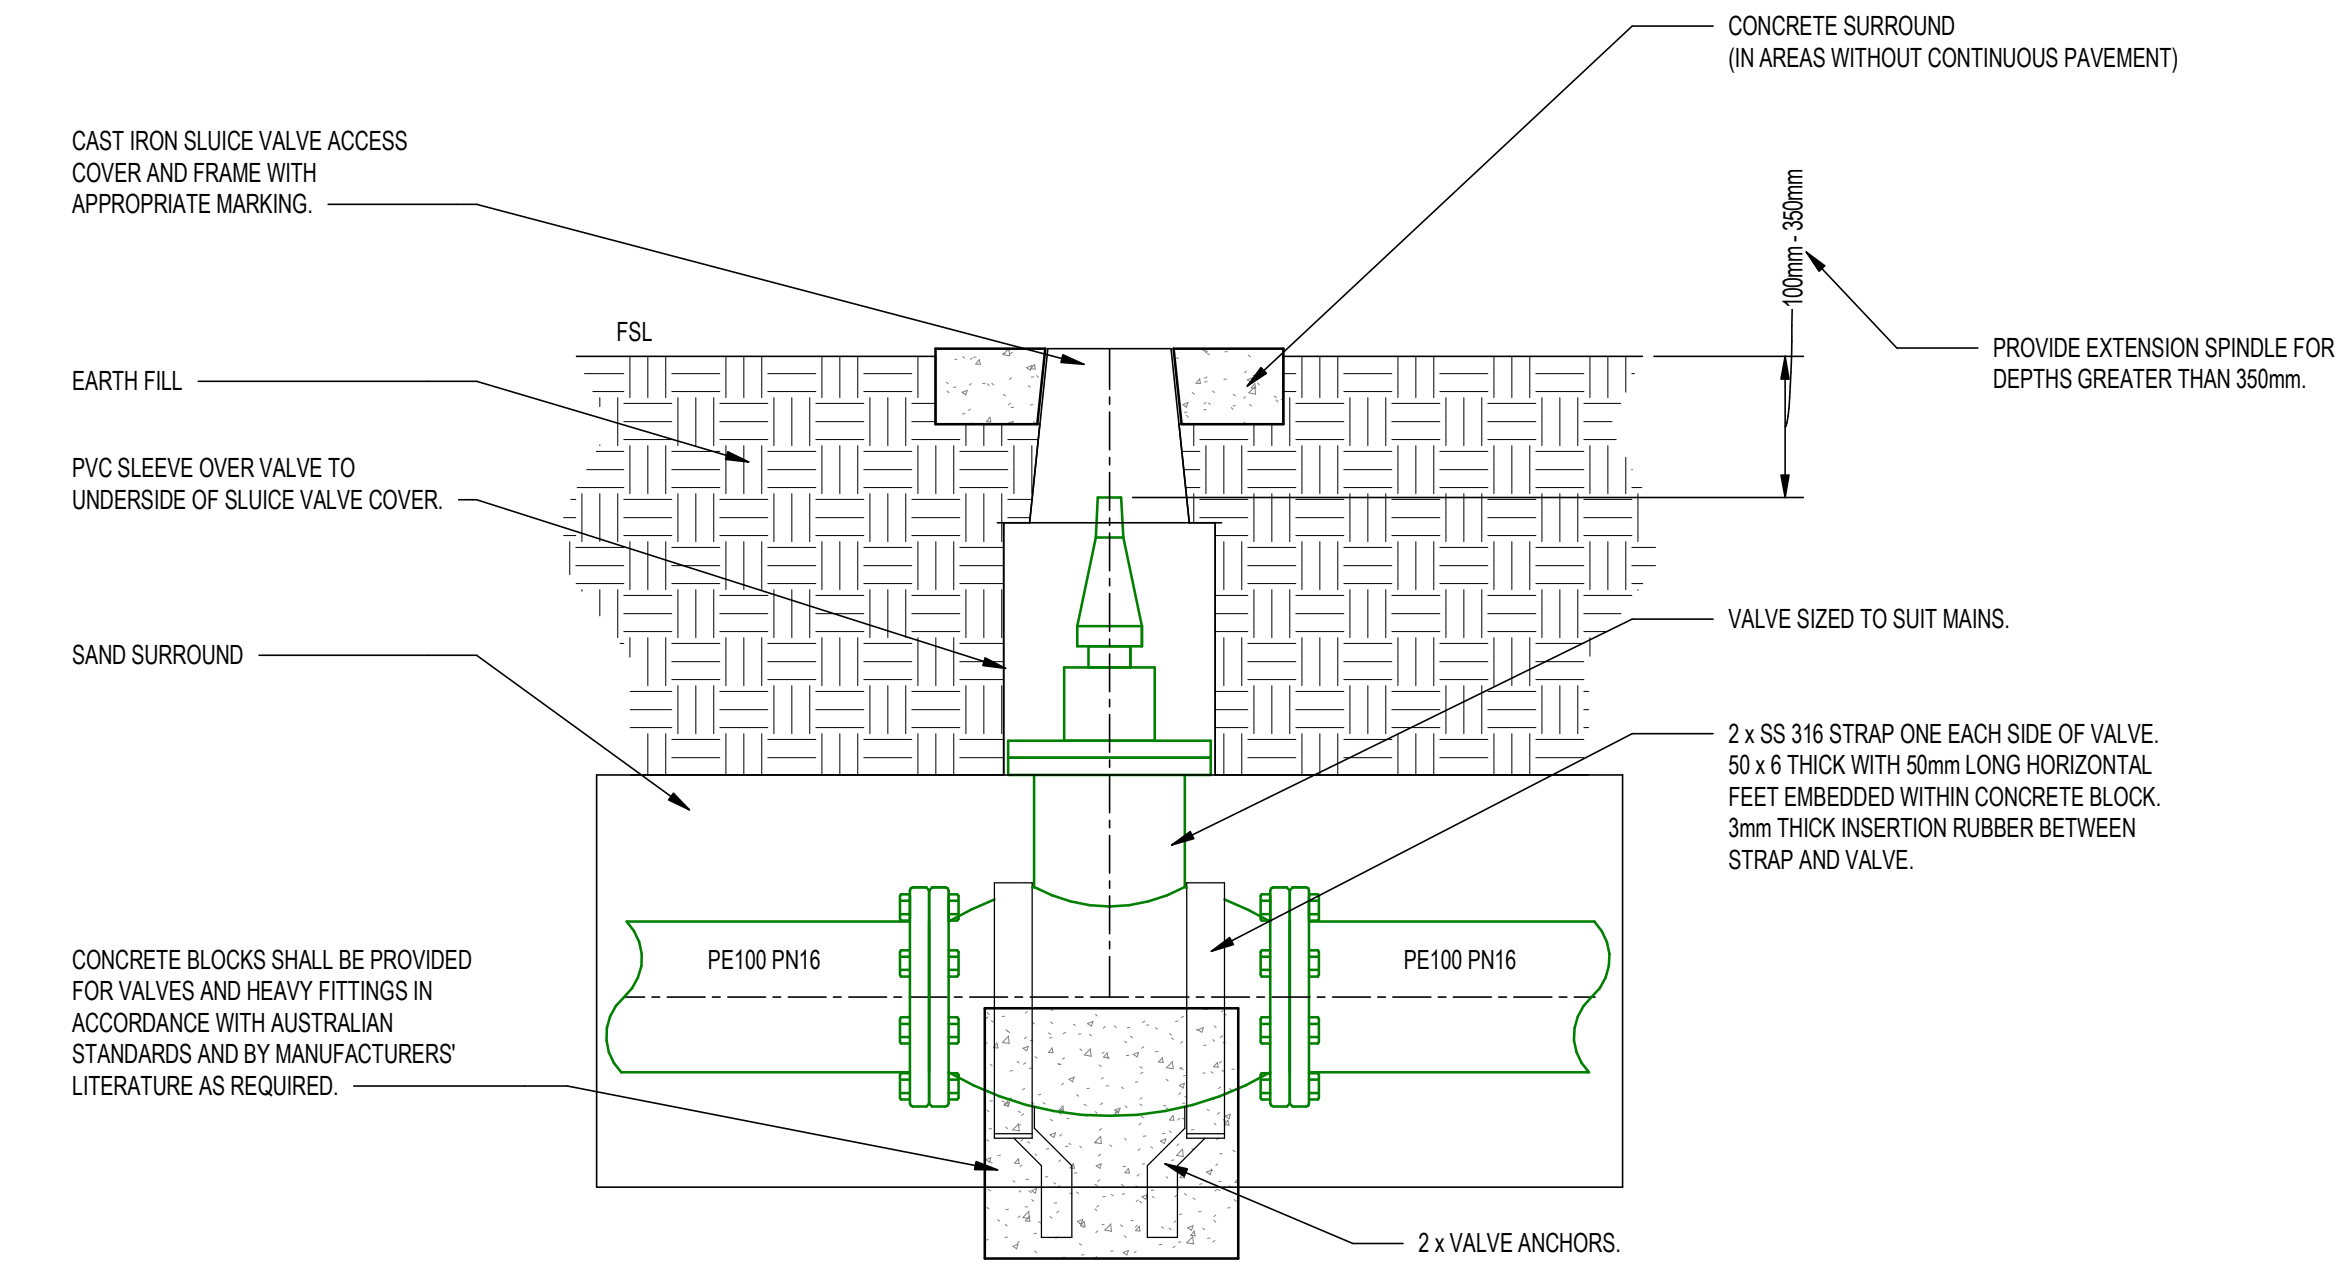

NON-TRAFFICABLE BELOW GROUND SLUICE VALVE DETAIL
1:10

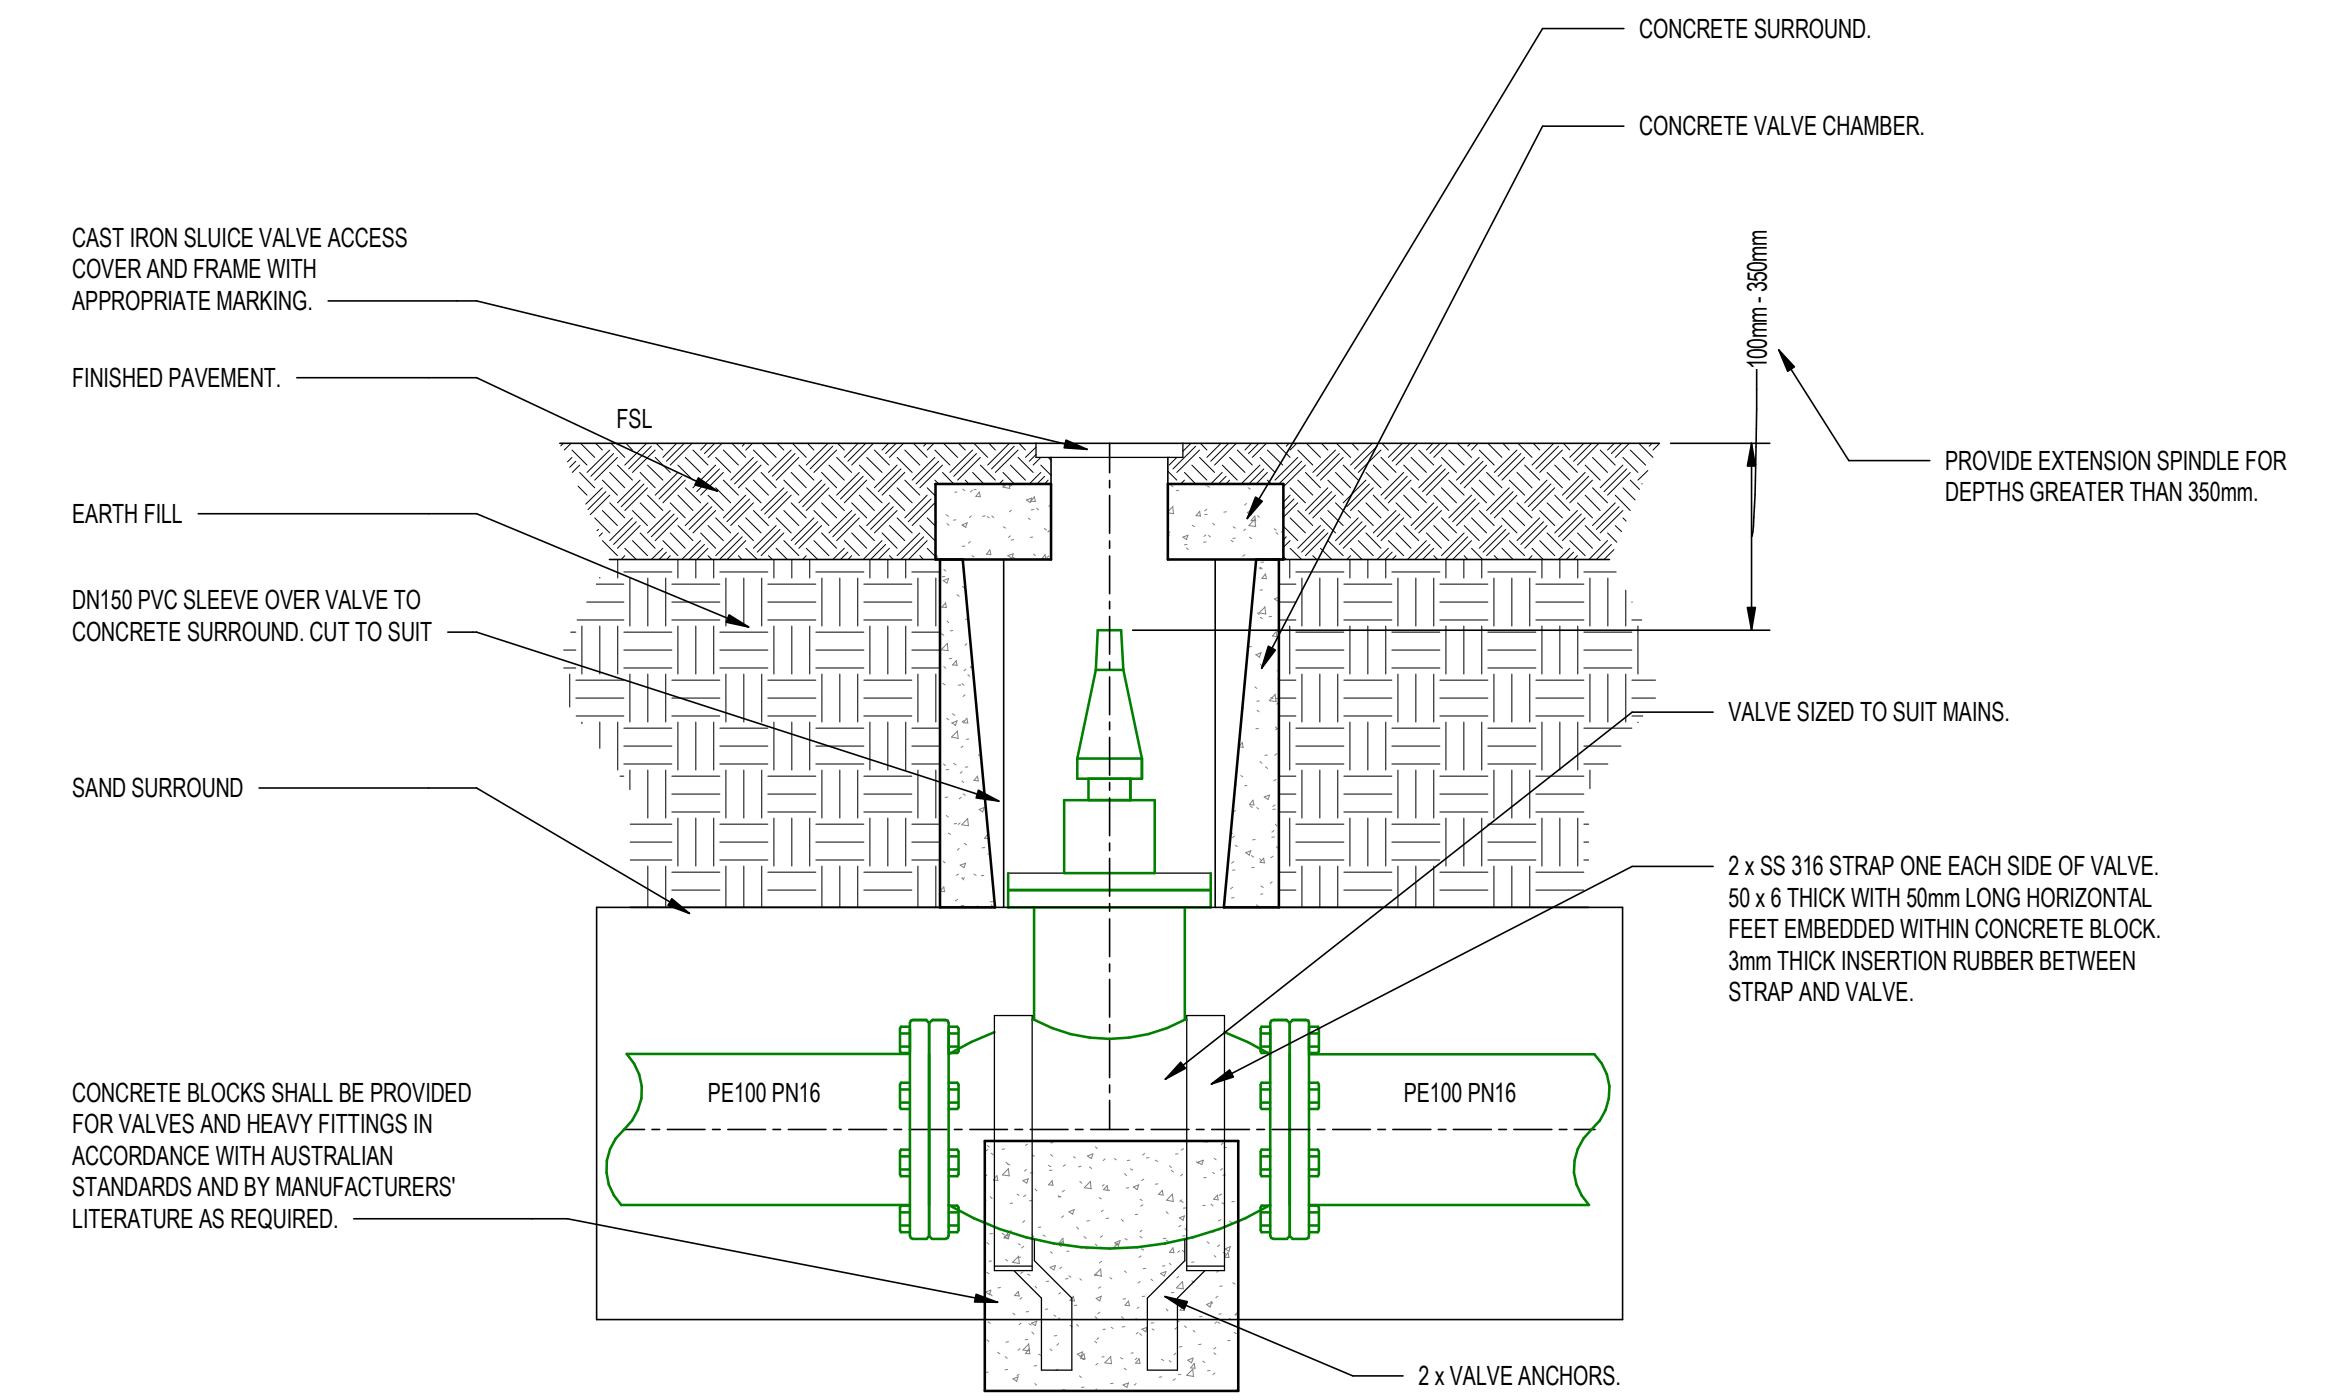

TRAFFICABLE BELOW GROUND SLUICE VALVE DETAIL
1:10

B 12/02/2026 JO ISSUED FOR D&C TENDER JS SM			
A 10/02/2026 JO DRAFT SET, 2D BASIS FOR REVIEW JS SM			
REV	DATE	BY	DESCRIPTION
DRAWING STATUS: DESIGN DEVELOPMENT			
900 Ann Street, Level 12, Fortitude Valley 4006 Tel: +61-7-3854-6200 Fax: +61-7-3854-6500 http://www.wsp.com			
CLIENT: CQU			
ARCHITECT: THOMSON ADSETT / PEDDLE THORP			
PROJECT: CQU ROCKHAMPTON TAFE CONSOLIDATION			
TITLE: FIRE PROTECTION SERVICES TYPICAL DETAILS			
SCALE @ A1	AS SHOWN	CHECKED: JS	APPROVED: SM
PROJECT NUMBER: PS229518	DRAWN: JO	DATE: JAN 2026	REV:
DRAWING No: 00-FP-DR-100-A00-00-01			B
© WSP Australia Pty Ltd			