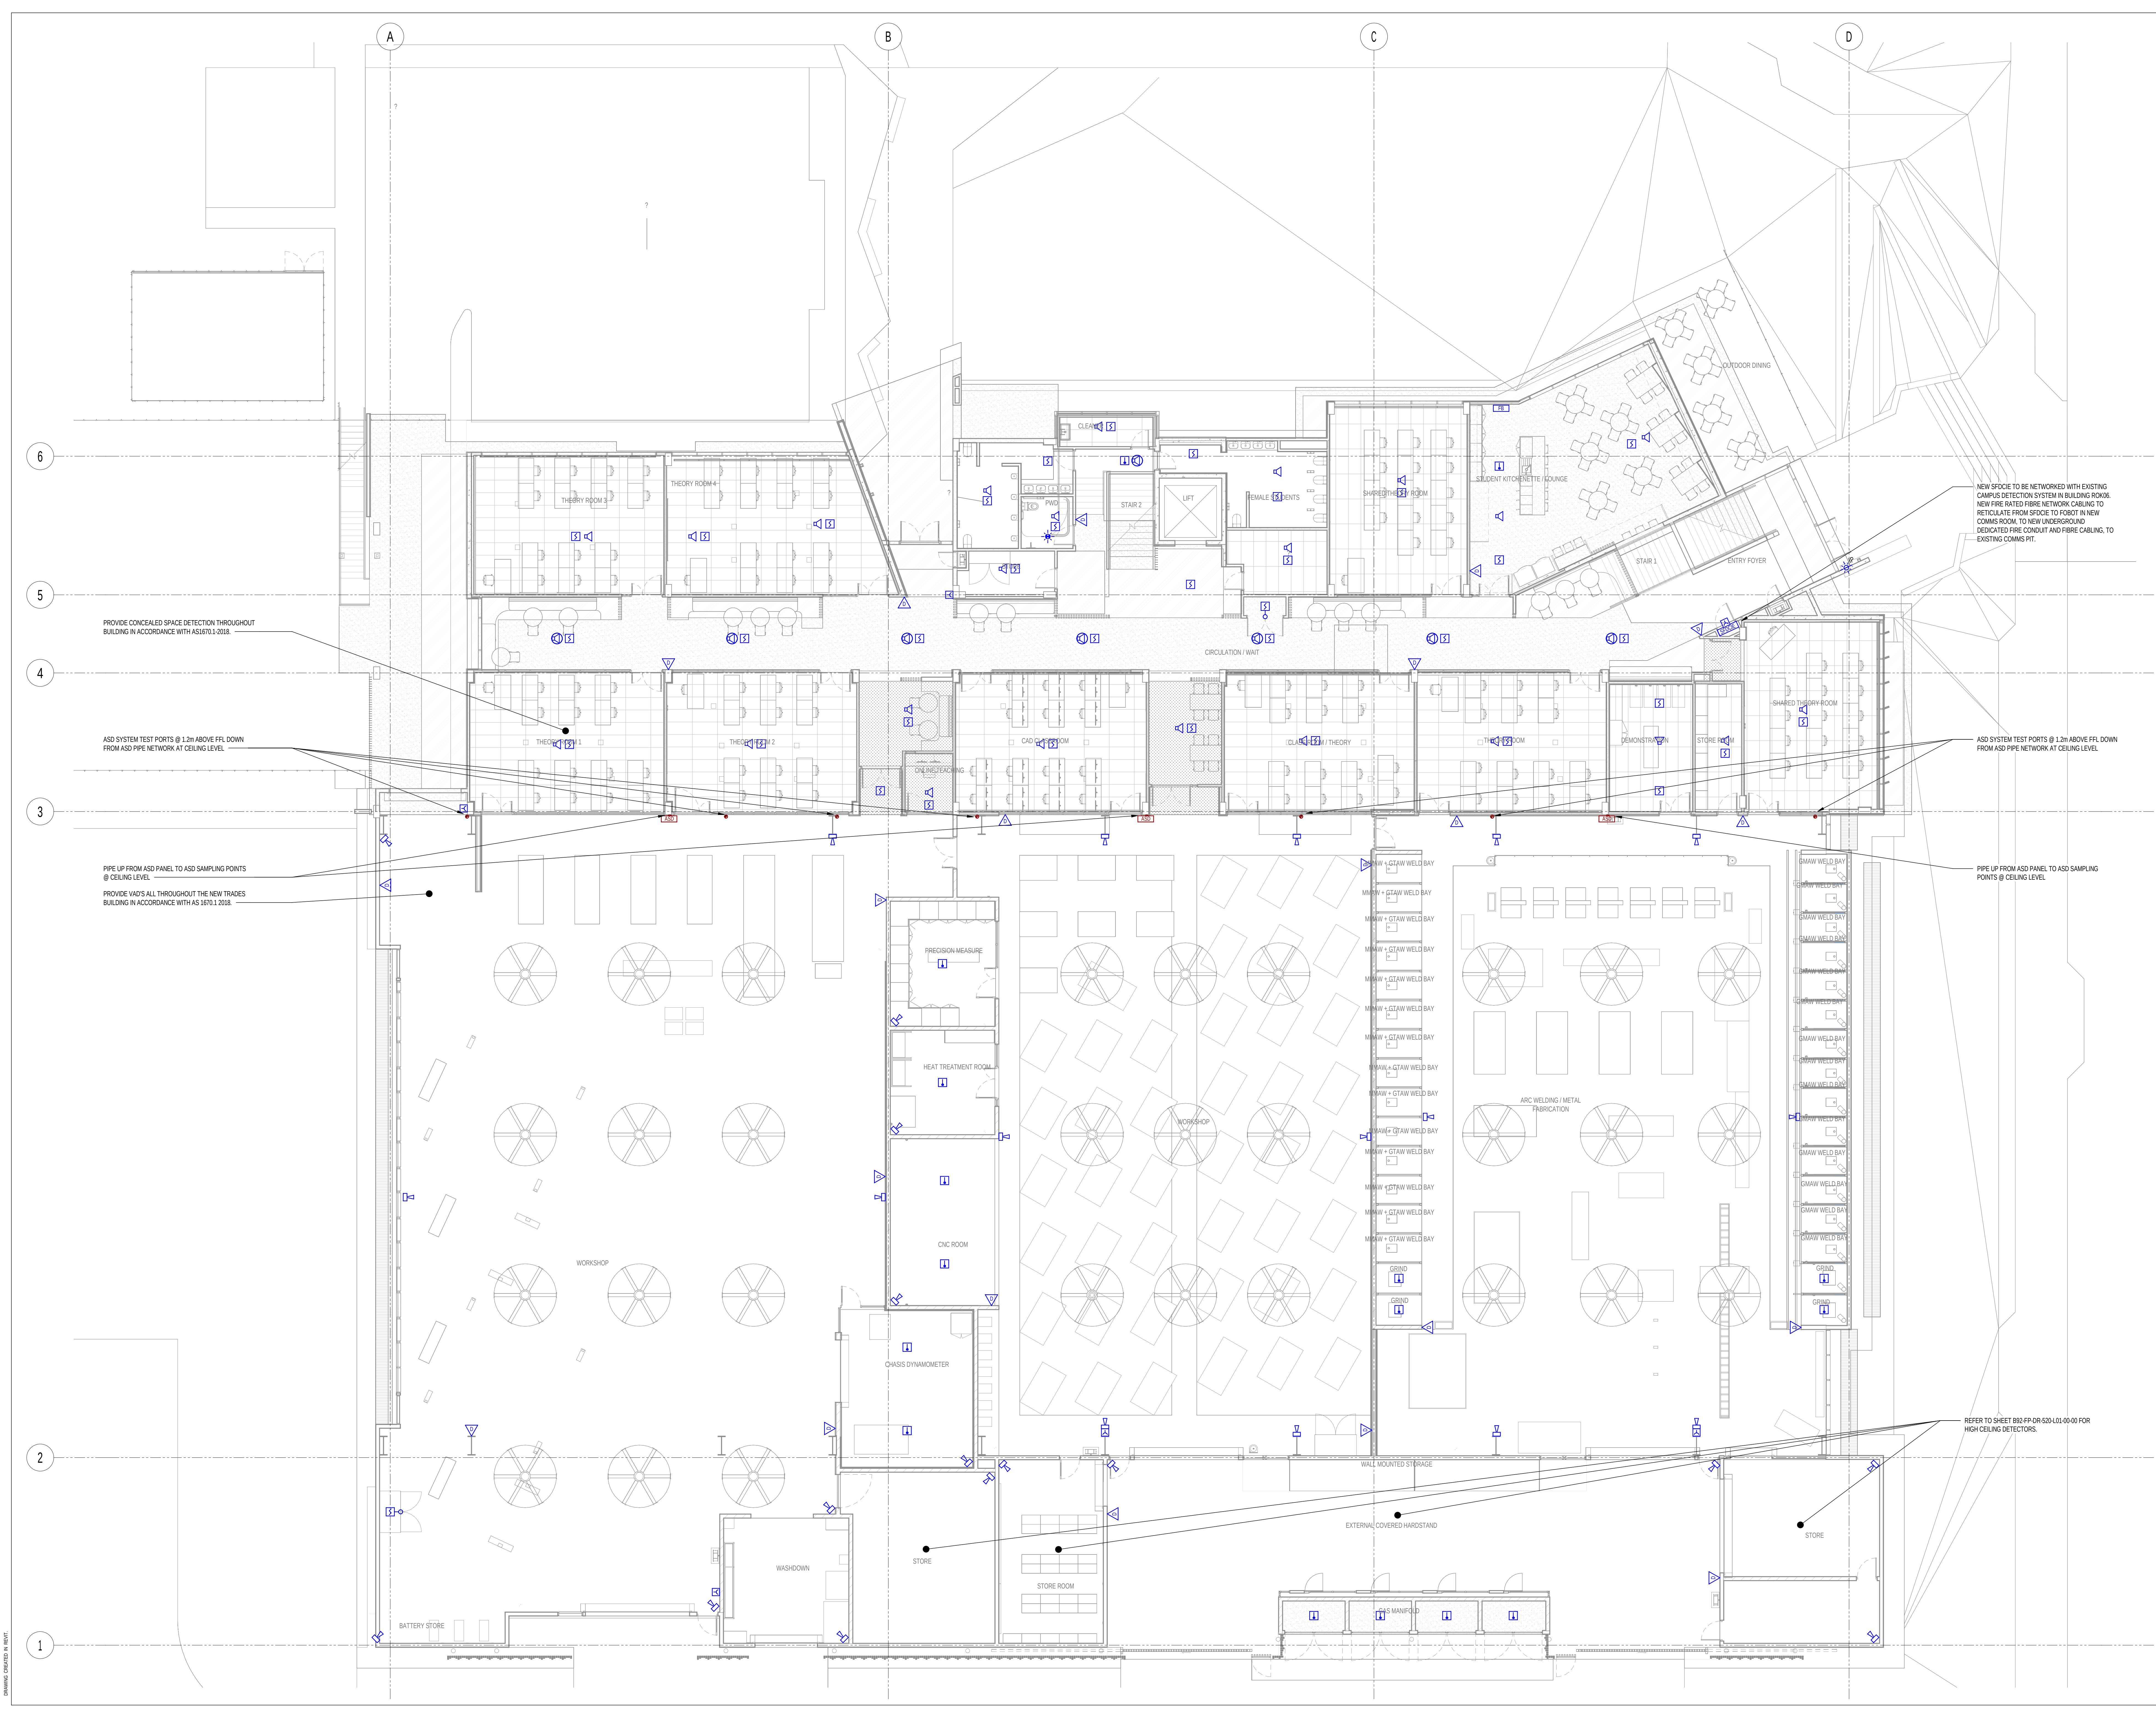


DESIGN CRITERIA & GENERAL NOTES:

1. DRAWINGS TO BE READ IN CONJUNCTION WITH THE FIRE ENGINEERING BRIEF (FEB) AND CERTIFIER'S ICA ASSESSMENT REPORT.
2. DRAWINGS TO BE READ IN CONJUNCTION WITH THE FIRE PROTECTION SERVICES REPORT, ARCHITECTURAL, STRUCTURAL, CIVIL AND ALL OTHER BUILDING SERVICES DOCUMENTATION.
3. FIRE SERVICES TO BE PROVIDED IN ACCORDANCE WITH NCC 2022 AND FIRE SAFETY ENGINEERING BRIEF.
4. FIRE DETECTION AND ALARM SYSTEM TO BE PROVIDED IN ACCORDANCE WITH AS 1570.1-2018.
5. PORTABLE FIRE EQUIPMENT TO BE PROVIDED IN ACCORDANCE WITH AS 2444:2001.
6. ENSURE CONCEALED SPACE SMOKE DETECTORS ARE INSTALLED WITHIN 1.5M OF ALL POWERED EQUIPMENT WITHIN THE CONCEALED SPACE.

INFORMATION REFLECTED ON THIS DRAWING REPRESENTS FIRE SERVICES DESIGN DEVELOPED FOR D&C TENDER ADVISE ONLY, AND SHOULD NOT BE REGARDED AS COMPLETE. THE D&C CONTRACTOR SHOULD REFER TO ALL ASSOCIATED ARCHITECTURAL AND OTHER DISCIPLINE DRAWINGS, PROJECT BRIEFS AND CLIENT REQUIREMENTS AND MAKE ADEQUATE ALLOWANCES FOR ALL NECESSARY FIRE SERVICES WORKS TO MEET THESE REQUIREMENTS, EQUIPMENT SCHEDULES AND COMPLIANCE WITH THE NCC & APPROPRIATE AUSTRALIAN STANDARDS

PROVIDE CONCEALED SPACE DETECTION THROUGHOUT BUILDING IN ACCORDANCE WITH AS1570.1:2018.

ASD SYSTEM TEST PORTS @ 1.2m ABOVE FFL DOWN FROM ASD PIPE NETWORK AT CEILING LEVEL

PIPE UP FROM ASD PANEL TO ASD SAMPLING POINTS @ CEILING LEVEL

PROVIDE VAD'S ALL THROUGHOUT THE NEW TRADES BUILDING IN ACCORDANCE WITH AS 1570.1:2018.

NEW SPOKE TO BE NETWORKED WITH EXISTING CAMPUS DETECTION SYSTEM IN BUILDING F0006. NEW FIRE RATED FIBRE NETWORK CABLEING TO RETICULATE FROM SPOKE TO FIBRE IN NEW COMMS ROOM, TO NEW UNDERGROUND DEDICATED FIRE CONDUIT AND FIBRE CABLEING, TO EXISTING COMMS PIT.

ASD SYSTEM TEST PORTS @ 1.2m ABOVE FFL DOWN FROM ASD PIPE NETWORK AT CEILING LEVEL

PIPE UP FROM ASD PANEL TO ASD SAMPLING POINTS @ CEILING LEVEL

REFER TO SHEET B92-FP-DR-520-L00-00-00 FOR HIGH CEILING DETECTORS.

B	12.02.2026	RG	ISSUED FOR D&C TENDER	JS	SM
A	10.02.2026	RG	DRAWING FOR REVIEW	JS	SM
REV	DATE	BY	DESCRIPTION	CHK	APP

DRAWING STATUS: DESIGN DEVELOPMENT



900 Ann Street, Level 12, Fortitude Valley 4006
Tel: +61-7-3854-6200 Fax: +61-7-3854-6500
<http://www.wsp.com>

CLIENT: CQU

ARCHITECT: THOMSON ADSETT / PEDDLE THORP

PROJECT: CQU ROCKHAMPTON TAFE CONSOLIDATION

TITLE: FIRE PROTECTION SERVICES
NEW TRADES BUILDING - GROUND LEVEL - DRY
FIRE LAYOUT

SCALE @ A0	CHECKED: JS	APPROVED: SM
PROJECT NUMBER: PS229518	DRAWN: RG	DATE: JAN 2026

DRAWING NO: B92-FP-DR-520-L00-00-00

© WSP Australia Pty Ltd