


DESIGN CRITERIA & GENERAL NOTES:

1. DRAWINGS TO BE READ IN CONJUNCTION WITH THE FIRE ENGINEERING BRIEF (FEB) AND CERTIFIER'S ICA ASSESSMENT REPORT.
2. DRAWINGS TO BE READ IN CONJUNCTION WITH THE FIRE PROTECTION SERVICES REPORT, ARCHITECTURAL, STRUCTURAL, CIVIL AND ALL OTHER BUILDING SERVICES DOCUMENTATION.
3. FIRE SERVICES TO BE PROVIDED IN ACCORDANCE WITH NCC 2022 AND FIRE SAFETY ENGINEERING BRIEF.
4. FIRE DETECTION AND ALARM SYSTEM TO BE PROVIDED IN ACCORDANCE WITH AS 1570.1-2018.
5. PORTABLE FIRE EQUIPMENT TO BE PROVIDED IN ACCORDANCE WITH AS 2444-2001.
6. ENSURE CONCEALED SPACE SMOKE DETECTORS ARE INSTALLED WITHIN 1.5M OF ALL POWERED EQUIPMENT WITHIN THE CONCEALED SPACE.

INFORMATION REFLECTED ON THIS DRAWING REPRESENTS FIRE SERVICES DESIGN DEVELOPED FOR D&C TENDER ADVISE ONLY, AND SHOULD NOT BE REGARDED AS COMPLETE. THE D&C CONTRACTOR SHOULD REFER TO ALL ASSOCIATED ARCHITECTURAL AND OTHER DISCIPLINE DRAWINGS, PROJECT BRIEFS AND CLIENT REQUIREMENTS AND MAKE ADEQUATE ALLOWANCES FOR ALL NECESSARY FIRE SERVICES WORKS TO MEET THESE REQUIREMENTS, EQUIPMENT SCHEDULES AND COMPLIANCE WITH THE NCC & APPROPRIATE AUSTRALIAN STANDARDS

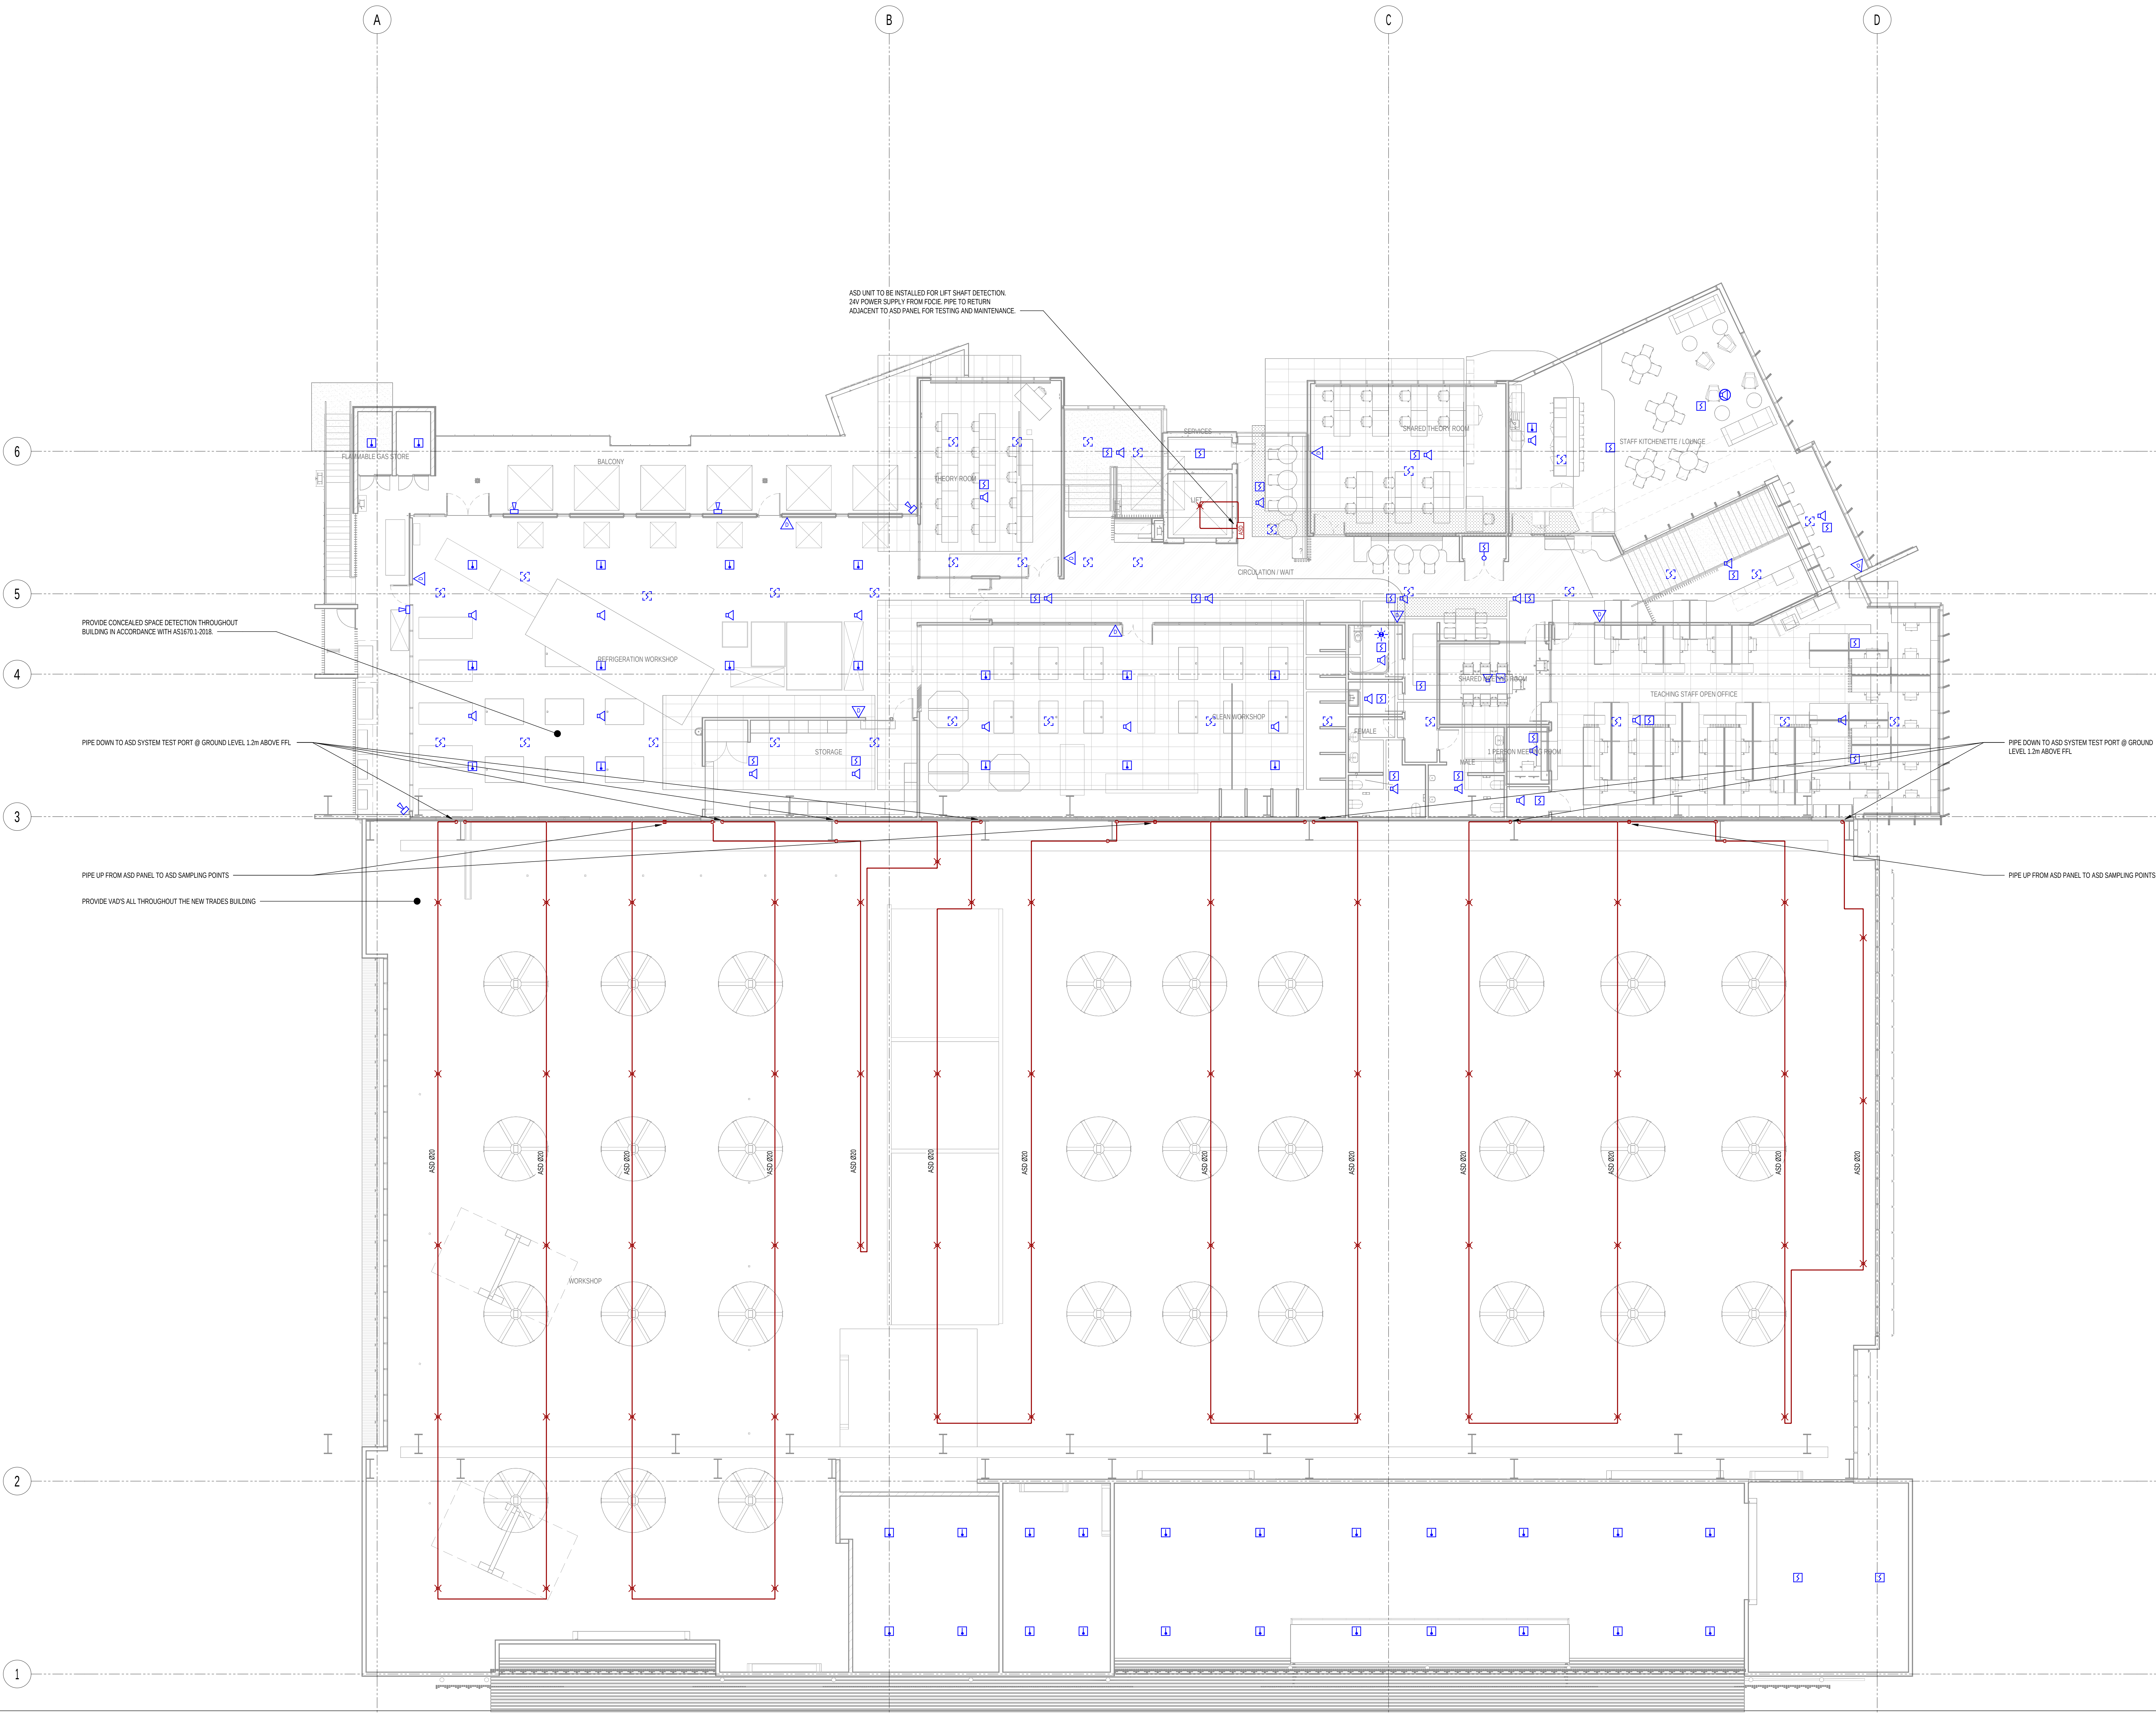

B	12.02.2026	RG	ISSUED FOR D&C TENDER	JS	SM
A	10.02.2026	RG	DRAWING FOR REVIEW	JS	SM
REV	DATE	BY	DESCRIPTION	CHK	APP

DESIGN DEVELOPMENT



900 Ann Street, Level 12, Fortitude Valley 4006
Tel: +61-7-3854-6200 Fax: +61-7-3854-6500
<http://www.wsp.com>

CLIENT: CQU

ARCHITECT: THOMSON ADSETT / PEDDLE THORP

PROJECT: CQU ROCKHAMPTON TAFE CONSOLIDATION

TITLE: FIRE PROTECTION SERVICES

NEW TRADES BUILDING - LEVEL 01 - DRY FIRE

LAYOUT

SCALE @ A1	1:100	CHECKED	JS	APPROVED	SM
PROJECT NUMBER	PS229518	DRAWN	RG	DATE	JAN 2026

DRAWING NO.	B92-FP-DR-520-L01-00-00	REV	B
-------------	-------------------------	-----	---

© WSP Australia Pty Ltd