


DESIGN CRITERIA & GENERAL NOTES:

- DRAWINGS TO BE READ IN CONJUNCTION WITH THE FIRE ENGINEERING BRIEF (FER) AND CERTIFIER'S ICA ASSESSMENT REPORT.
- DRAWINGS TO BE READ IN CONJUNCTION WITH THE FIRE PROTECTION SERVICES REPORT, ARCHITECTURAL, STRUCTURAL, CIVIL AND ALL OTHER BUILDING SERVICES DOCUMENTATION.
- FIRE SERVICES TO BE PROVIDED IN ACCORDANCE WITH NCC 2022 AND FIRE SAFETY ENGINEERING BRIEF.
- FIRE DETECTION AND ALARM SYSTEM TO BE PROVIDED IN ACCORDANCE WITH AS 1570.1:2018.

INFORMATION REFLECTED ON THIS DRAWING REPRESENTS FIRE SERVICES DESIGN DEVELOPED FOR D&C TENDER ADVISE ONLY, AND SHOULD NOT BE REGARDED AS COMPLETE. THE D&C CONTRACTOR SHOULD REFER TO ALL ASSOCIATED ARCHITECTURAL AND OTHER DISCIPLINE DRAWINGS, PROJECT BRIEFS AND CLIENT REQUIREMENTS AND MAKE ADEQUATE ALLOWANCES FOR ALL NECESSARY FIRE SERVICES WORKS TO MEET THESE REQUIREMENTS, EQUIPMENT SCHEDULES AND COMPLIANCE WITH THE NCC & APPROPRIATE AUSTRALIAN STANDARDS

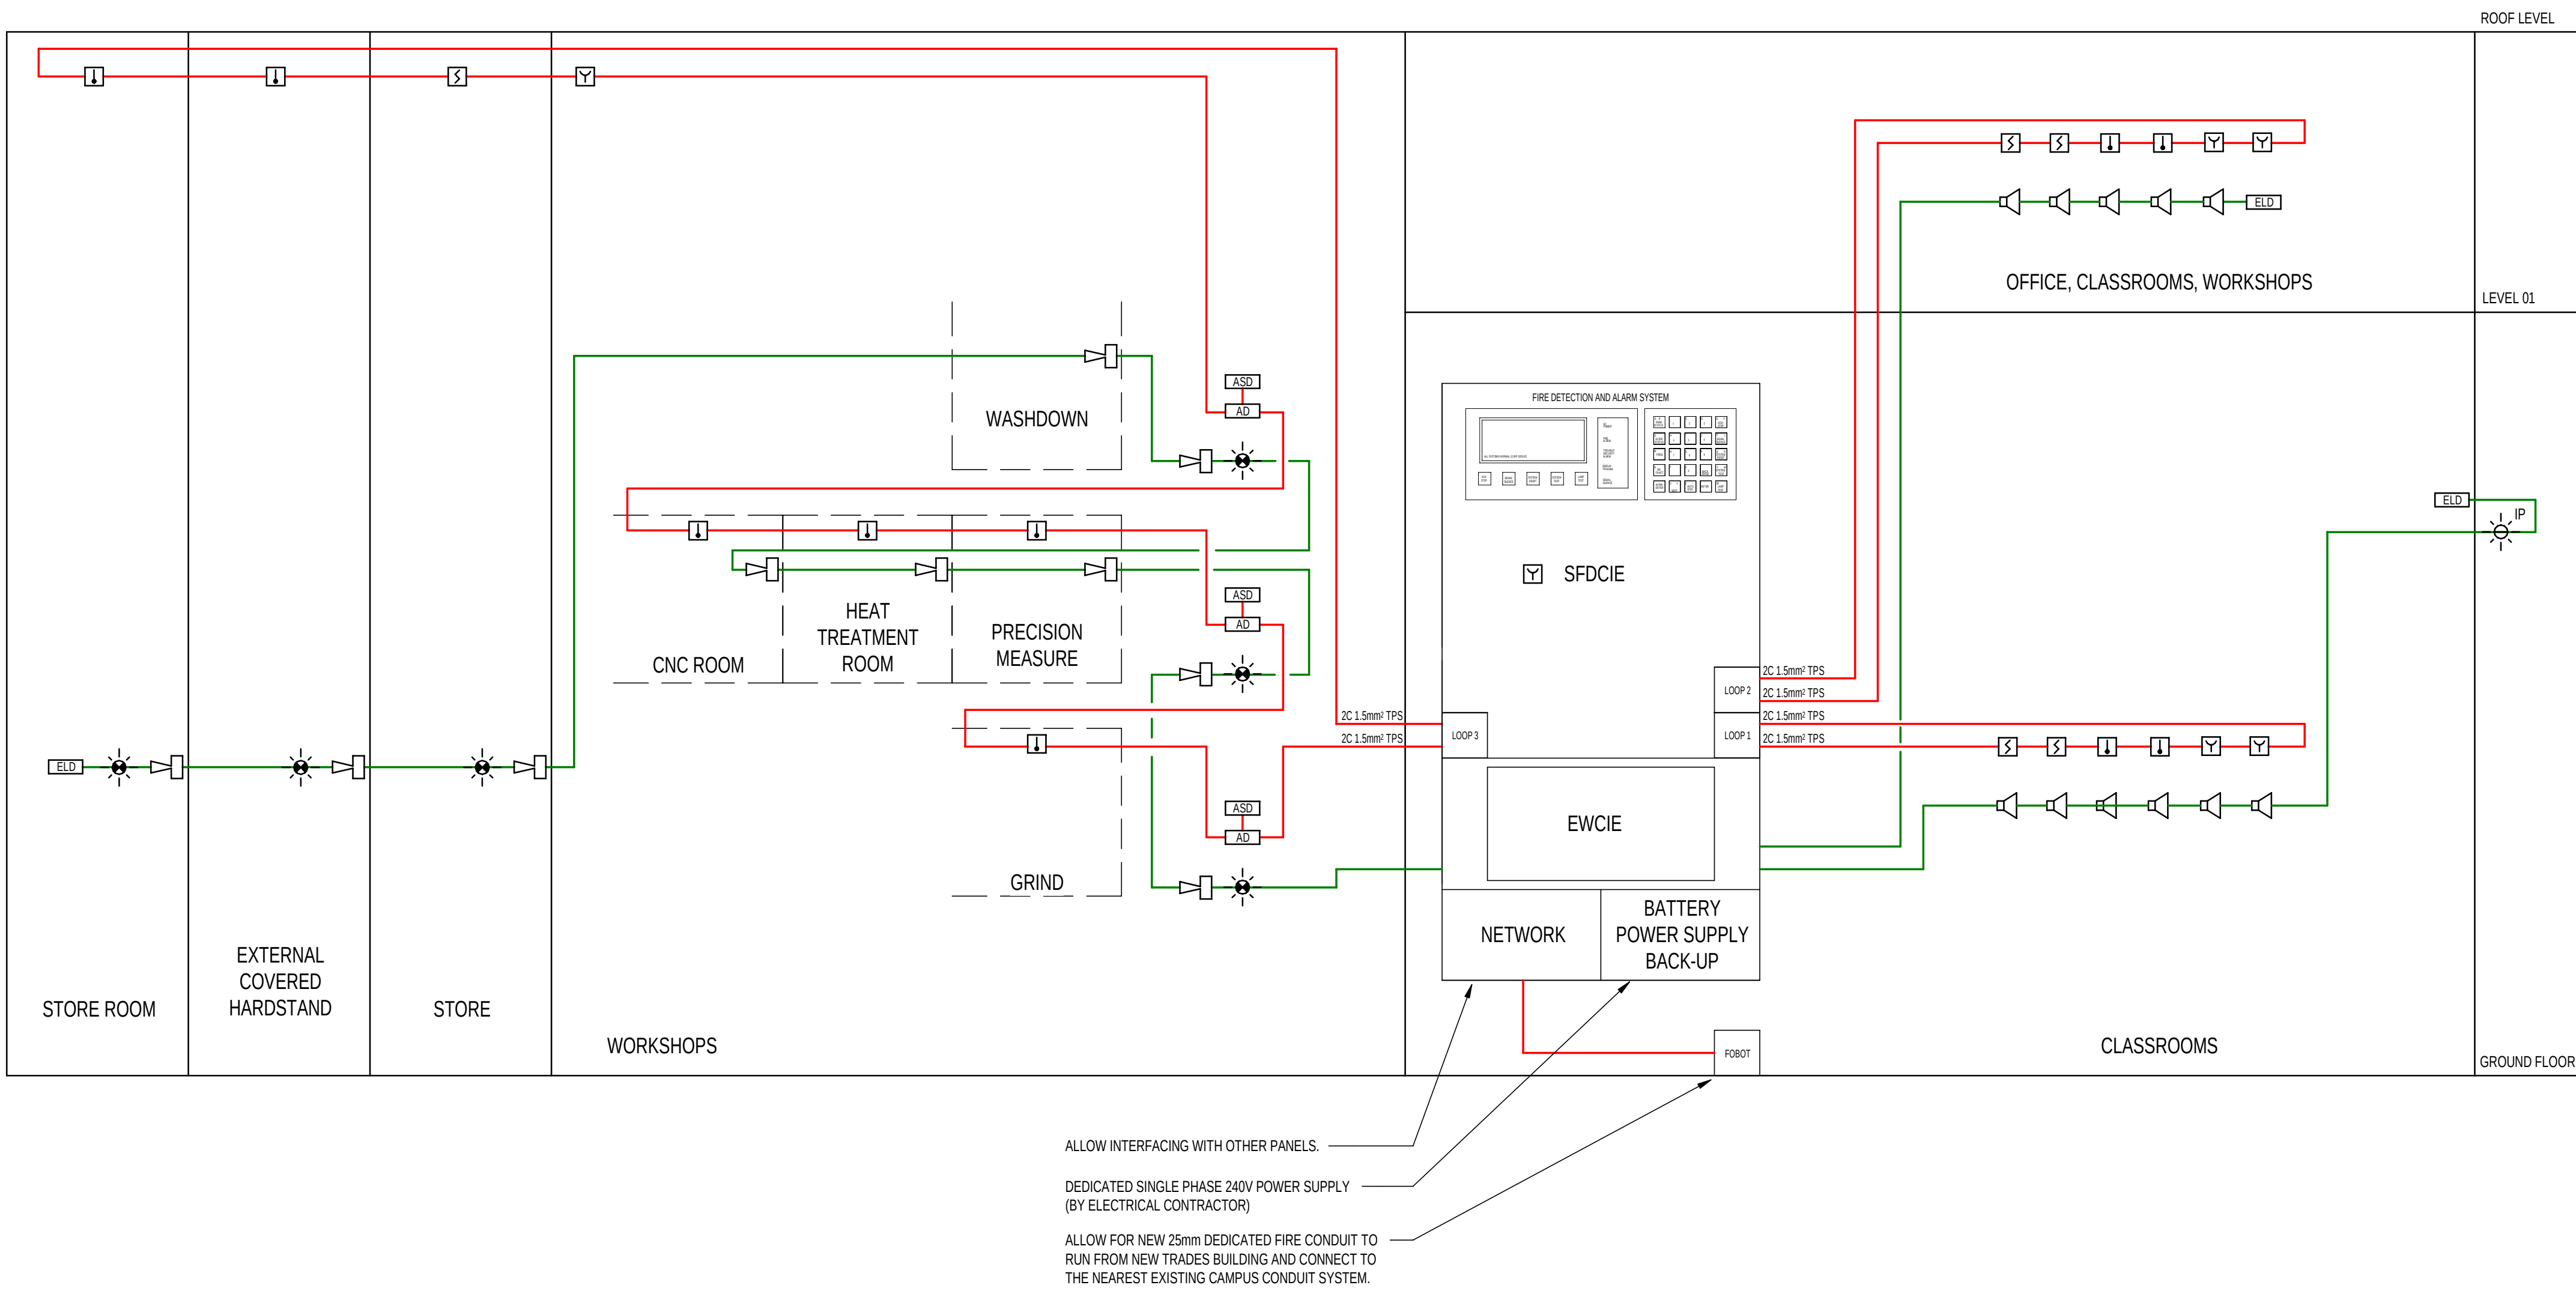

B	12.02.2026	RG	ISSUED FOR D&C TENDER	JS	SM
A	10.02.2026	RG	DRAFT FOR REVIEW	JS	SM
REV	DATE	BY	DESCRIPTION	CHK	APP

DRAWING STATUS: DESIGN DEVELOPMENT



900 Ann Street, Level 12, Fortitude Valley 4006
Tel: +61-7-3854-6200 Fax: +61-7-3854-6500
<http://www.wsp.com>

CLIENT: CQU

ARCHITECT: THOMSON ADSETT / PEDDLE THORP

PROJECT: CQU ROCKHAMPTON TAFE CONSOLIDATION

TITLE: FIRE PROTECTION SERVICES
NEW TRADES BUILDING - DRY FIRE SCHEMATICS


SCALE: B/A	N.T.S	CHECKED: JS	APPROVED: SM
PROJECT NUMBER: PS229518	DRAWN: RG	DATE: JAN 2026	REV:

DRAWING NO: B92-FP-DR-200-A00-00-00


© WSP Australia Pty Ltd



- INFORMATION REFLECTED ON THIS DRAWING
REPRESENTS FIRE SERVICES DESIGN DEVELOPED
FOR D&C TENDER ADVISE ONLY, AND SHOULD NOT BE
REGARDED AS COMPLETE. THE D&C CONTRACTOR
SHOULD REFER TO ALL ASSOCIATED ARCHITECTURAL
AND OTHER DISCIPLINE DRAWINGS, PROJECT BRIEFS
AND CLIENT REQUIREMENTS AND MAKE ADEQUATE
ALLOWANCES FOR ALL NECESSARY FIRE SERVICES
WORKS TO MEET THESE REQUIREMENTS, EQUIPMENT
SCHEDULES AND COMPLIANCE WITH THE NCC &
APPROPRIATE AUSTRALIAN STANDARDS



DESIGN DEVELOPMENT

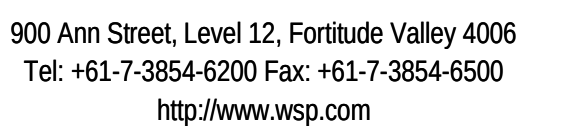

CLIENT: CQU

ARCHITECT: THOMSON ADSETT / PEDDLE THORP

PROJECT:

CQU ROCKHAMPTON TAFE CONSOLIDATION


TITLE:

FIRE PROTECTION SERVICES
NEW TRADES BUILDING - GROUND LEVEL - WET
FIRE LAYOUT - SHEET 1

SCALE @ A0: 1:100	CHECKED: JS	APPROVED: SM
PROJECT NUMBER: PS229518	DRAWN: RG	DATE: JAN 2026

DRAWING No:	REV:
B92-FP-DR-510-L00-00-00	B

© WSP Australia Pty Ltd



DESIGN CRITERIA & GENERAL NOTES:

- DRAWINGS TO BE READ IN CONJUNCTION WITH THE FIRE ENGINEERING BRIEF (FEB) AND CERTIFIER'S ICA ASSESSMENT REPORT.
- DRAWINGS TO BE READ IN CONJUNCTION WITH THE FIRE PROTECTION SERVICES REPORT, ARCHITECTURAL, STRUCTURAL, CIVIL AND ALL OTHER BUILDING SERVICES DOCUMENTATION.
- FIRE SERVICES TO BE PROVIDED IN ACCORDANCE WITH NCC 2022 AND FIRE SAFETY ENGINEERING BRIEF.
- FIRE HYDRANT SYSTEM TO BE PROVIDED IN ACCORDANCE WITH AS 2419.1:2021.
- FIRE HOSE REELS TO BE PROVIDED IN ACCORDANCE WITH AS 2442:2005.

INFORMATION REFLECTED ON THIS DRAWING REPRESENTS FIRE SERVICES DESIGN DEVELOPED FOR D&C TENDER ADVISE ONLY, AND SHOULD NOT BE REGARDED AS COMPLETE. THE D&C CONTRACTOR SHOULD REFER TO ALL ASSOCIATED ARCHITECTURAL AND OTHER DISCIPLINE DRAWINGS, PROJECT BRIEFS AND CLIENT REQUIREMENTS AND MAKE ADEQUATE ALLOWANCES FOR ALL NECESSARY FIRE SERVICES WORKS TO MEET THESE REQUIREMENTS, EQUIPMENT SCHEDULES AND COMPLIANCE WITH THE NCC, & APPROPRIATE AUSTRALIAN STANDARDS

B	12.02.2026	RG	ISSUED FOR D&C TENDER	JS	SM
A	10.02.2026	RG	DRAWING FOR REVIEW	JS	SM
REV	DATE	BY	DESCRIPTION	CHK	APP

DESIGN DEVELOPMENT



900 Ann Street, Level 12, Fortitude Valley 4006
Tel: +61-7-3854-6200 Fax: +61-7-3854-6500
<http://www.wsp.com>

CLIENT:

CQU

ARCHITECT:

THOMSON ADSETT / PEDDLE THORP

PROJECT:

CQU ROCKHAMPTON TAFE CONSOLIDATION

TITLE:

FIRE PROTECTION SERVICES
NEW TRADES BUILDING - GROUND LEVEL - WET
FIRE LAYOUT - SHEET 2

SCALE @ A1	CHECKED	APPROVED
1:100	JS	SM
PROJECT NUMBER	DRAWN	DATE
PS229518	RG	JAN 2026
DRAWING NO.	REV	

B92-FP-DR-510-L00-00-01

B


© WSP Australia Pty Ltd

FOR CONTINUATION REFER DWG B92-FP-DR-510-L00-00-00

DN25 FHR SUPPLY PIPE DOWN FROM LEVEL 1 (TYP)

CONNECT NEW EXTERNAL HYDRANT INTO EXISTING UNDERGROUND HYDRANT MAIN PIPEWORK.
RELOCATE EXISTING DUAL PILLAR FIRE HYDRANT AWAY FROM NEW BUILDING FOOTPRINT. INSTALL HYDRANT ADJACENT TO NEW ROAD AND FOOTPATH.

EXISTING DN180 PE100 UNDERGROUND RING MAIN PIPEWORK
EXISTING INGROUND ISOLATION VALVES TO BE RETAINED. CONNECT NEW RING MAIN PIPEWORK TO EXISTING VALVE AND EXTEND AROUND NEW TRADES BUILDING.
CONNECT NEW EXTERNAL HYDRANT INTO NEW RING MAIN PIPEWORK.
NEW DUAL PILLAR EXTERNAL HYDRANT

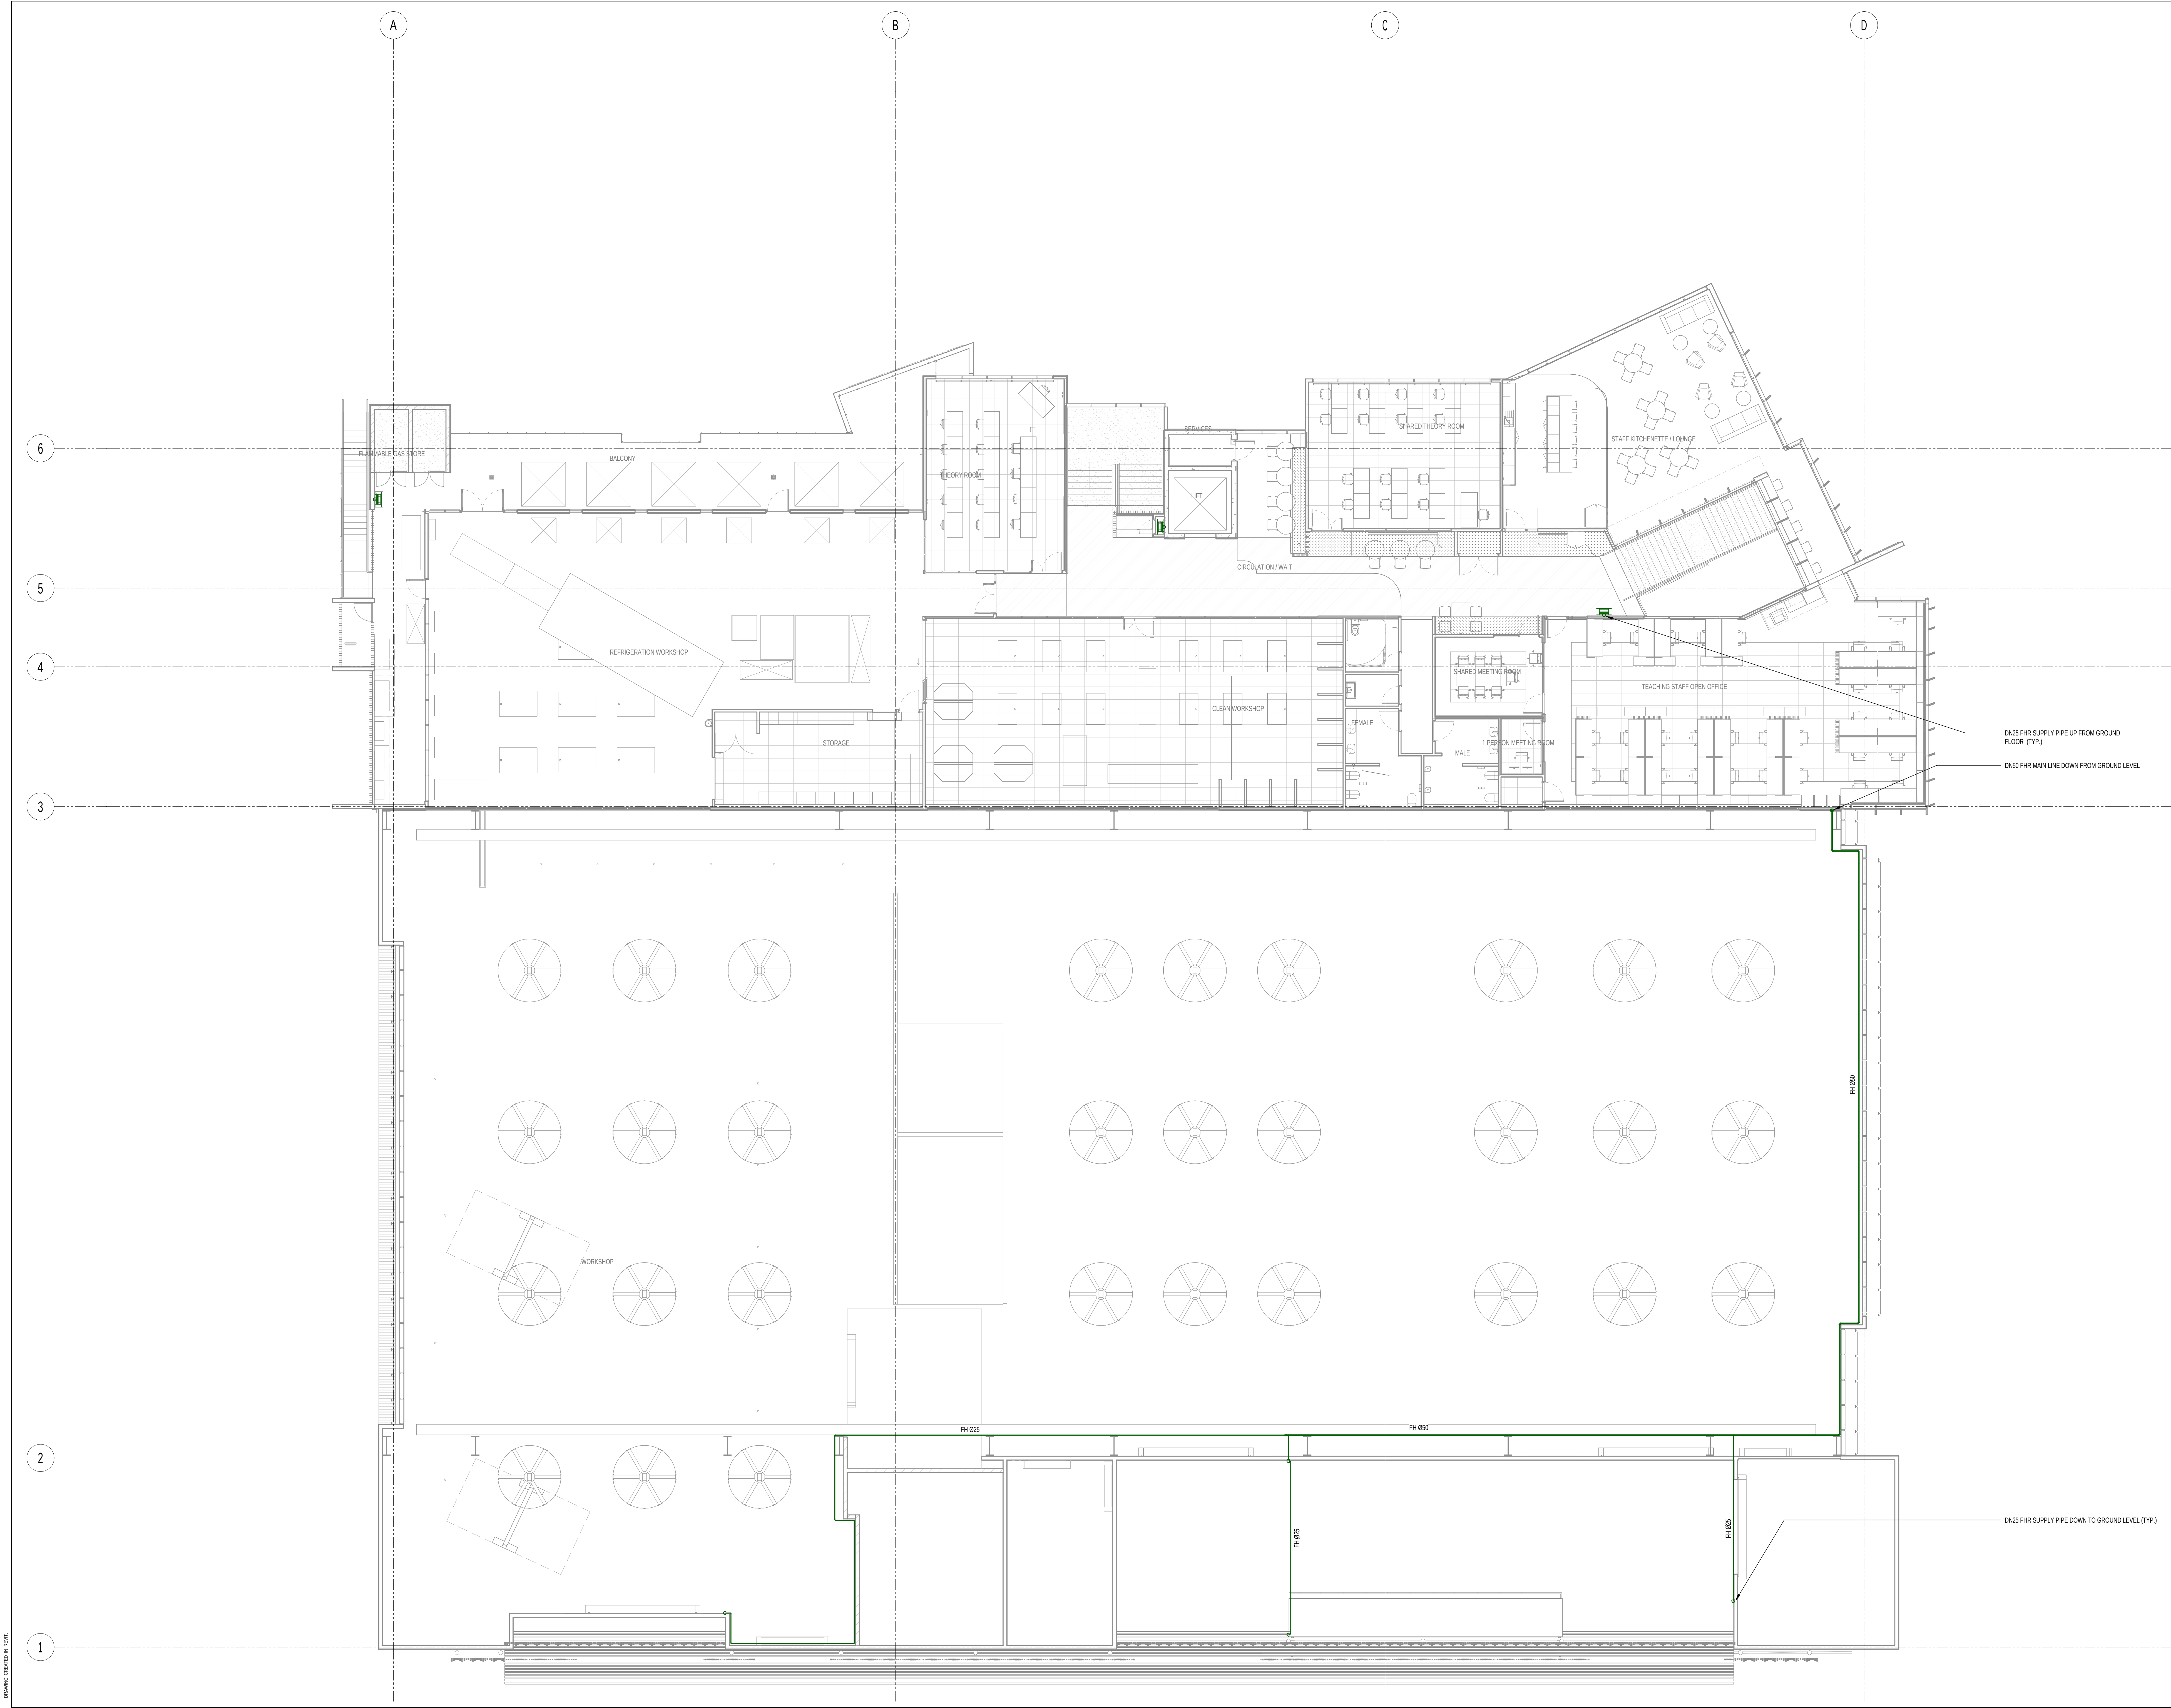

DESIGN CRITERIA & GENERAL NOTES:

- DRAWINGS TO BE READ IN CONJUNCTION WITH THE FIRE ENGINEERING BRIEF (FEB) AND CERTIFIER'S ICA ASSESSMENT REPORT.
- DRAWINGS TO BE READ IN CONJUNCTION WITH THE FIRE PROTECTION SERVICES REPORT, ARCHITECTURAL, STRUCTURAL, CIVIL AND ALL OTHER BUILDING SERVICES DOCUMENTATION.
- FIRE SERVICES TO BE PROVIDED IN ACCORDANCE WITH NCC 2022 AND FIRE SAFETY ENGINEERING BRIEF.
- FIRE HYDRANT SYSTEM TO BE PROVIDED IN ACCORDANCE WITH AS 2419.1:2021.
- FIRE HOSE REELS TO BE PROVIDED IN ACCORDANCE WITH AS 2442:2005.

INFORMATION REFLECTED ON THIS DRAWING REPRESENTS FIRE SERVICES DESIGN DEVELOPED FOR D&C TENDER ADVICE ONLY, AND SHOULD NOT BE REGARDED AS COMPLETE. THE D&C CONTRACTOR SHOULD REFER TO ALL ASSOCIATED ARCHITECTURAL AND OTHER DISCIPLINE DRAWINGS, PROJECT BRIEFS AND CLIENT REQUIREMENTS AND MAKE ADEQUATE ALLOWANCES FOR ALL NECESSARY FIRE SERVICES WORKS TO MEET THESE REQUIREMENTS, EQUIPMENT SCHEDULES AND COMPLIANCE WITH THE NCC, & APPROPRIATE AUSTRALIAN STANDARDS

B	12.02.2026	RG	ISSUED FOR D&C TENDER	JS	SM
A	10.02.2026	RG	DRAWING FOR REVIEW	JS	SM
REV	DATE	BY	DESCRIPTION	CHK	APP

DESIGN DEVELOPMENT



900 Ann Street, Level 12, Fortitude Valley 4006
Tel: +61-7-3854-6200 Fax: +61-7-3854-6500
<http://www.wsp.com>

CLIENT: CQU

ARCHITECT: THOMSON ADSETT / PEDDLE THORP


PROJECT: CQU ROCKHAMPTON TAFE CONSOLIDATION

TITLE: FIRE PROTECTION SERVICES
NEW TRADES BUILDING - LEVEL 01 - WET FIRE LAYOUT

SCALE @ A1	CHECKED	APPROVED
1:100	JS	SM
PROJECT NUMBER	DRAWN	DATE
PS229518	RG	JAN 2026

DRAWING NO.	REV
B92-FP-DR-510-L01-00-00	B

© WSP Australia Pty Ltd



DESIGN CRITERIA & GENERAL NOTES:

1. DRAWINGS TO BE READ IN CONJUNCTION WITH THE FIRE ENGINEERING BRIEF (FEB) AND CERTIFIER'S ICA ASSESSMENT REPORT.
2. DRAWINGS TO BE READ IN CONJUNCTION WITH THE FIRE PROTECTION SERVICES REPORT, ARCHITECTURAL, STRUCTURAL, CIVIL AND ALL OTHER BUILDING SERVICES DOCUMENTATION.
3. FIRE SERVICES TO BE PROVIDED IN ACCORDANCE WITH NCC 2022 AND FIRE SAFETY ENGINEERING BRIEF.
4. FIRE DETECTION AND ALARM SYSTEM TO BE PROVIDED IN ACCORDANCE WITH AS 1870.1:2018.
5. PORTABLE FIRE EQUIPMENT TO BE PROVIDED IN ACCORDANCE WITH AS 2444:2001.
6. ENSURE CONCEALED SPACE SMOKE DETECTORS ARE INSTALLED WITHIN 1.5M OF ALL POWERED EQUIPMENT WITHIN THE CONCEALED SPACE.

INFORMATION REFLECTED ON THIS DRAWING REPRESENTS FIRE SERVICES DESIGN DEVELOPED FOR D&C TENDER ADVISE ONLY, AND SHOULD NOT BE REGARDED AS COMPLETE. THE D&C CONTRACTOR SHOULD REFER TO ALL ASSOCIATED ARCHITECTURAL AND OTHER DISCIPLINE DRAWINGS, PROJECT BRIEFS AND CLIENT REQUIREMENTS AND MAKE ADEQUATE ALLOWANCES FOR ALL NECESSARY FIRE SERVICES WORKS TO MEET THESE REQUIREMENTS, EQUIPMENT SCHEDULES AND COMPLIANCE WITH THE NCC & APPROPRIATE AUSTRALIAN STANDARDS

B	12.02.2026	RG	ISSUED FOR D&C TENDER	JS	SM
A	10.02.2026	RG	DRAWING FOR REVIEW	JS	SM
REV	DATE	BY	DESCRIPTION	CHK	APP

DRAWING STATUS: DESIGN DEVELOPMENT




900 Ann Street, Level 12, Fortitude Valley 4006
Tel: +61-7-3854-6200 Fax: +61-7-3854-6500
<http://www.wsp.com>

CLIENT: CQU
ARCHITECT: THOMSON ADSETT / PEDDLE THORP
PROJECT: CQU ROCKHAMPTON TAFE CONSOLIDATION
TITLE: FIRE PROTECTION SERVICES
NEW TRADES BUILDING - GROUND LEVEL - DRY
FIRE LAYOUT

SCALE @ A0: 1:100	CHECKED: JS	APPROVED: SM
PROJECT NUMBER: PS229518	DRAWN: RG	DATE: JAN 2026


DRAWING NO: B92-FP-DR-520-L00-00-00	REV: B
-------------------------------------	--------



DESIGN CRITERIA & GENERAL NOTES:

1. DRAWINGS TO BE READ IN CONJUNCTION WITH THE FIRE ENGINEERING BRIEF (FEB) AND CERTIFIER'S ICA ASSESSMENT REPORT.
2. DRAWINGS TO BE READ IN CONJUNCTION WITH THE FIRE PROTECTION SERVICES REPORT, ARCHITECTURAL, STRUCTURAL, CIVIL AND ALL OTHER BUILDING SERVICES DOCUMENTATION.
3. FIRE SERVICES TO BE PROVIDED IN ACCORDANCE WITH NCC 2022 AND FIRE SAFETY ENGINEERING BRIEF.
4. FIRE DETECTION AND ALARM SYSTEM TO BE PROVIDED IN ACCORDANCE WITH AS 1570.1-2018.
5. PORTABLE FIRE EQUIPMENT TO BE PROVIDED IN ACCORDANCE WITH AS 2444-2001.
6. ENSURE CONCEALED SPACE SMOKE DETECTORS ARE INSTALLED WITHIN 1.5M OF ALL POWERED EQUIPMENT WITHIN THE CONCEALED SPACE.

INFORMATION REFLECTED ON THIS DRAWING REPRESENTS FIRE SERVICES DESIGN DEVELOPED FOR D&C TENDER ADVISE ONLY, AND SHOULD NOT BE REGARDED AS COMPLETE. THE D&C CONTRACTOR SHOULD REFER TO ALL ASSOCIATED ARCHITECTURAL AND OTHER DISCIPLINE DRAWINGS, PROJECT BRIEFS AND CLIENT REQUIREMENTS AND MAKE ADEQUATE ALLOWANCES FOR ALL NECESSARY FIRE SERVICES WORKS TO MEET THESE REQUIREMENTS, EQUIPMENT SCHEDULES AND COMPLIANCE WITH THE NCC & APPROPRIATE AUSTRALIAN STANDARDS

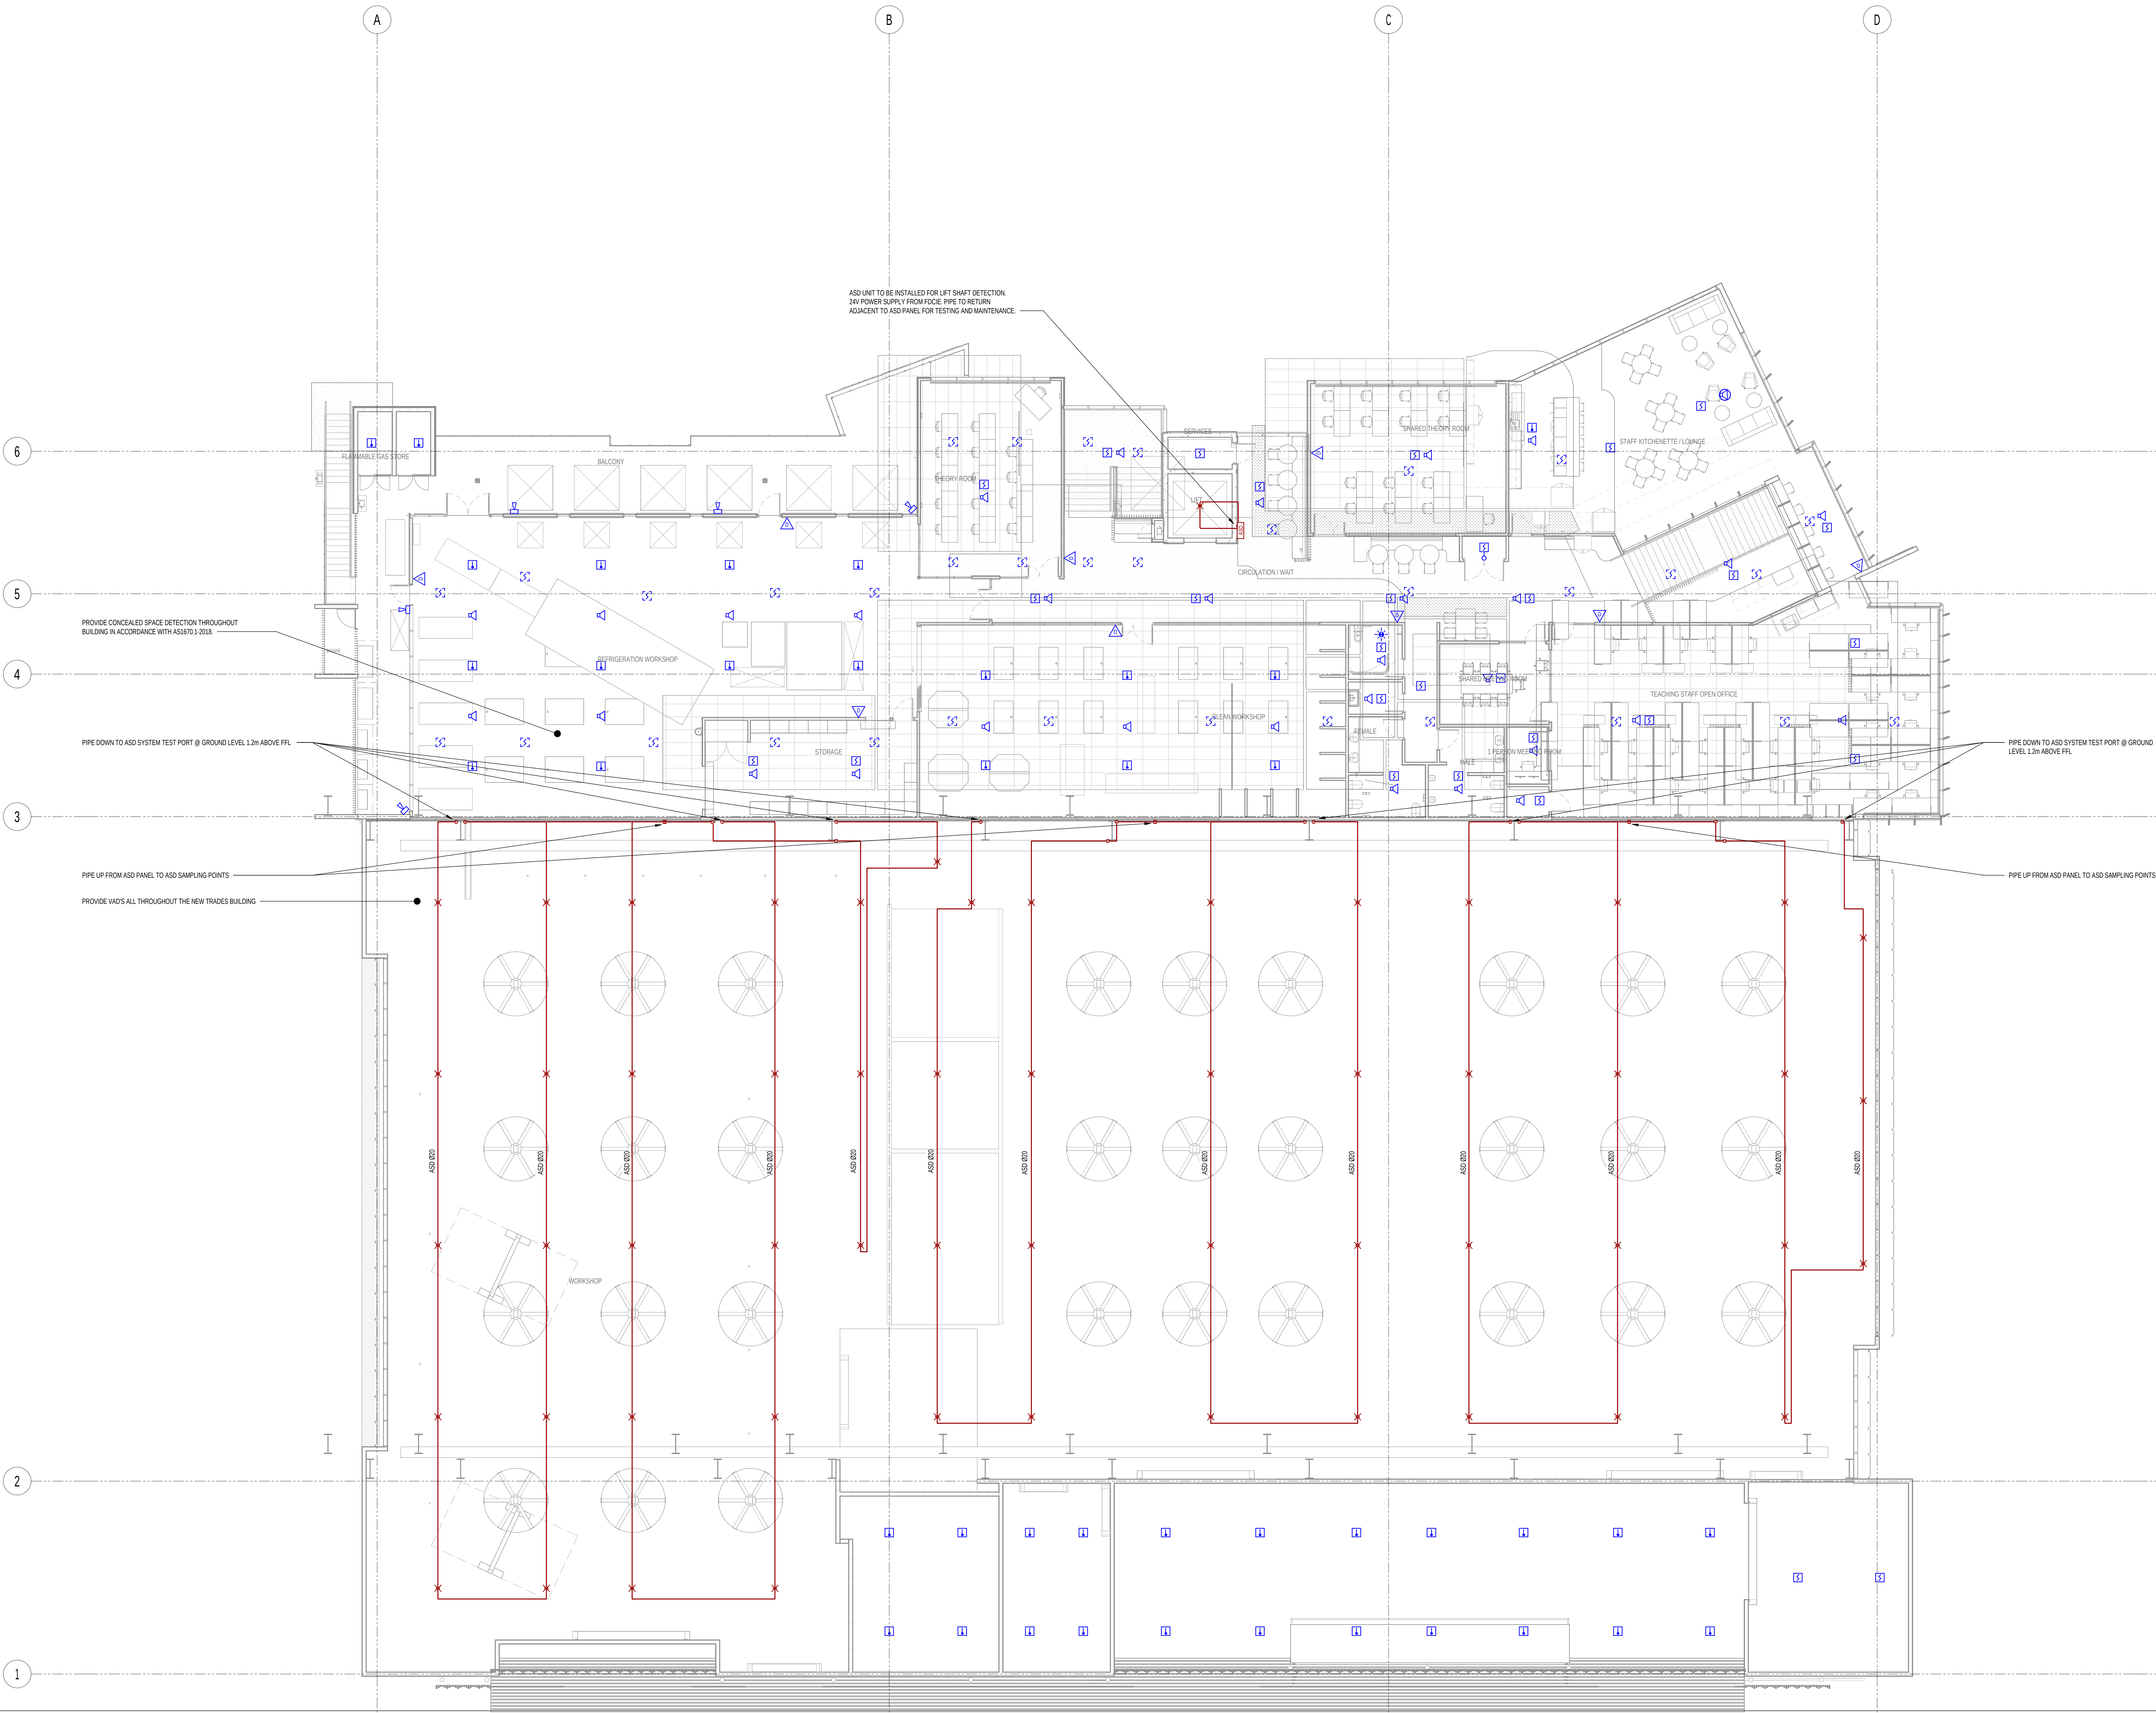

B	12.02.2026	RG	ISSUED FOR D&C TENDER	JS	SM
A	10.02.2026	RG	ISSUED FOR D&C TENDER	JS	SM
REV	DATE	BY	DESCRIPTION	CHK	APP

DRAWING STATUS: DESIGN DEVELOPMENT



900 Ann Street, Level 12, Fortitude Valley 4006
Tel: +61-7-3854-6200 Fax: +61-7-3854-6500
<http://www.wsp.com>

CLIENT: CQU

ARCHITECT: THOMSON ADSETT / PEDDLE THORP

PROJECT: CQU ROCKHAMPTON TAFE CONSOLIDATION

TITLE: FIRE PROTECTION SERVICES
NEW TRADES BUILDING - LEVEL 01 - DRY FIRE LAYOUT

SCALE @ A1: 1:100	CHECKED: JS	APPROVED: SM
PROJECT NUMBER: PS229518	DRAWN: RG	DATE: JAN 2026

DRAWING NO: B92-FP-DR-520-L01-00-00	REV: B
-------------------------------------	--------

© WSP Australia Pty Ltd