

**CQU ROCKHAMPTON
TAFE
CONSOLIDATION -
STAGE 2**

ROCKHAMPTON, QUEENSLAND


for



A	12/02/26	ISSUED FOR TENDER	BS
1	30/01/26	DRAFT 60% ISSUE	BS
rev/	date	details	init.

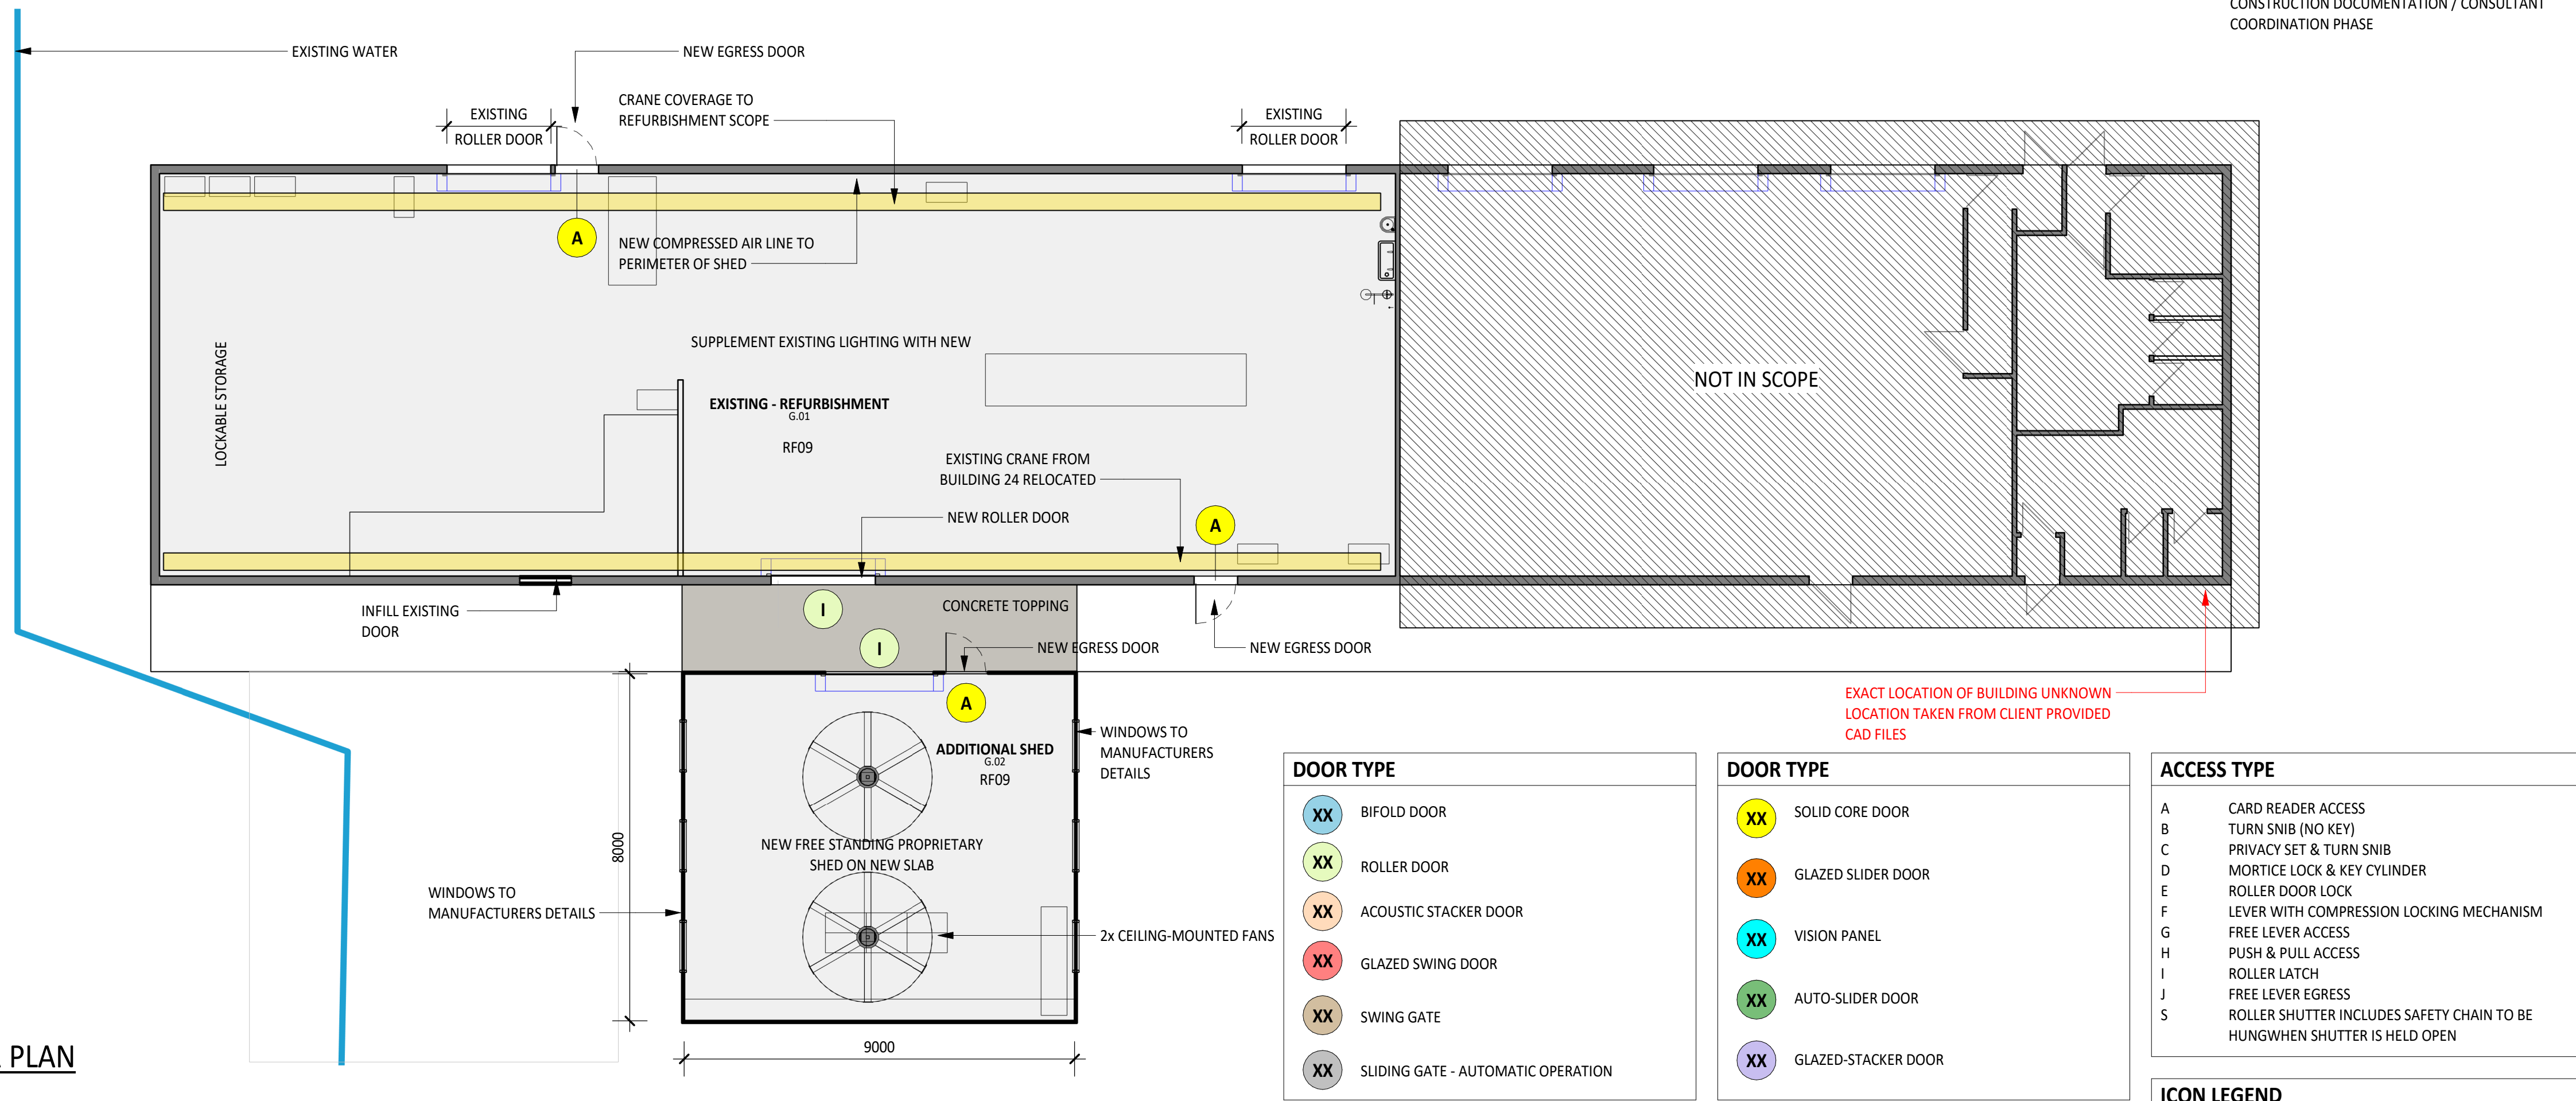
drawn	date
BS	30/01/26
checked	date
Checker	30/01/26
verified	date
BS	30/01/26

scale

**ENGINEERING
DEPARTMENT GA PLANS**scale
1 : 100 @ A1
revision
A
sheet no.
CQU-ROK-21A-G-ARC-21-00

original sheet size - A1 (594mm x 841mm)

NOTE: LAYOUT OF SHED BASED OFF AS BUILT DRAWINGS PROVIDED BY CLIENT. CONTRACTOR TO ALLOW FOR SITE VISIT TO ASSESS CURRENT CONDITION AND LAYOUT OF SHED BEFORE CONSTRUCTION DOCUMENTATION / CONSULTANT COORDINATION PHASE



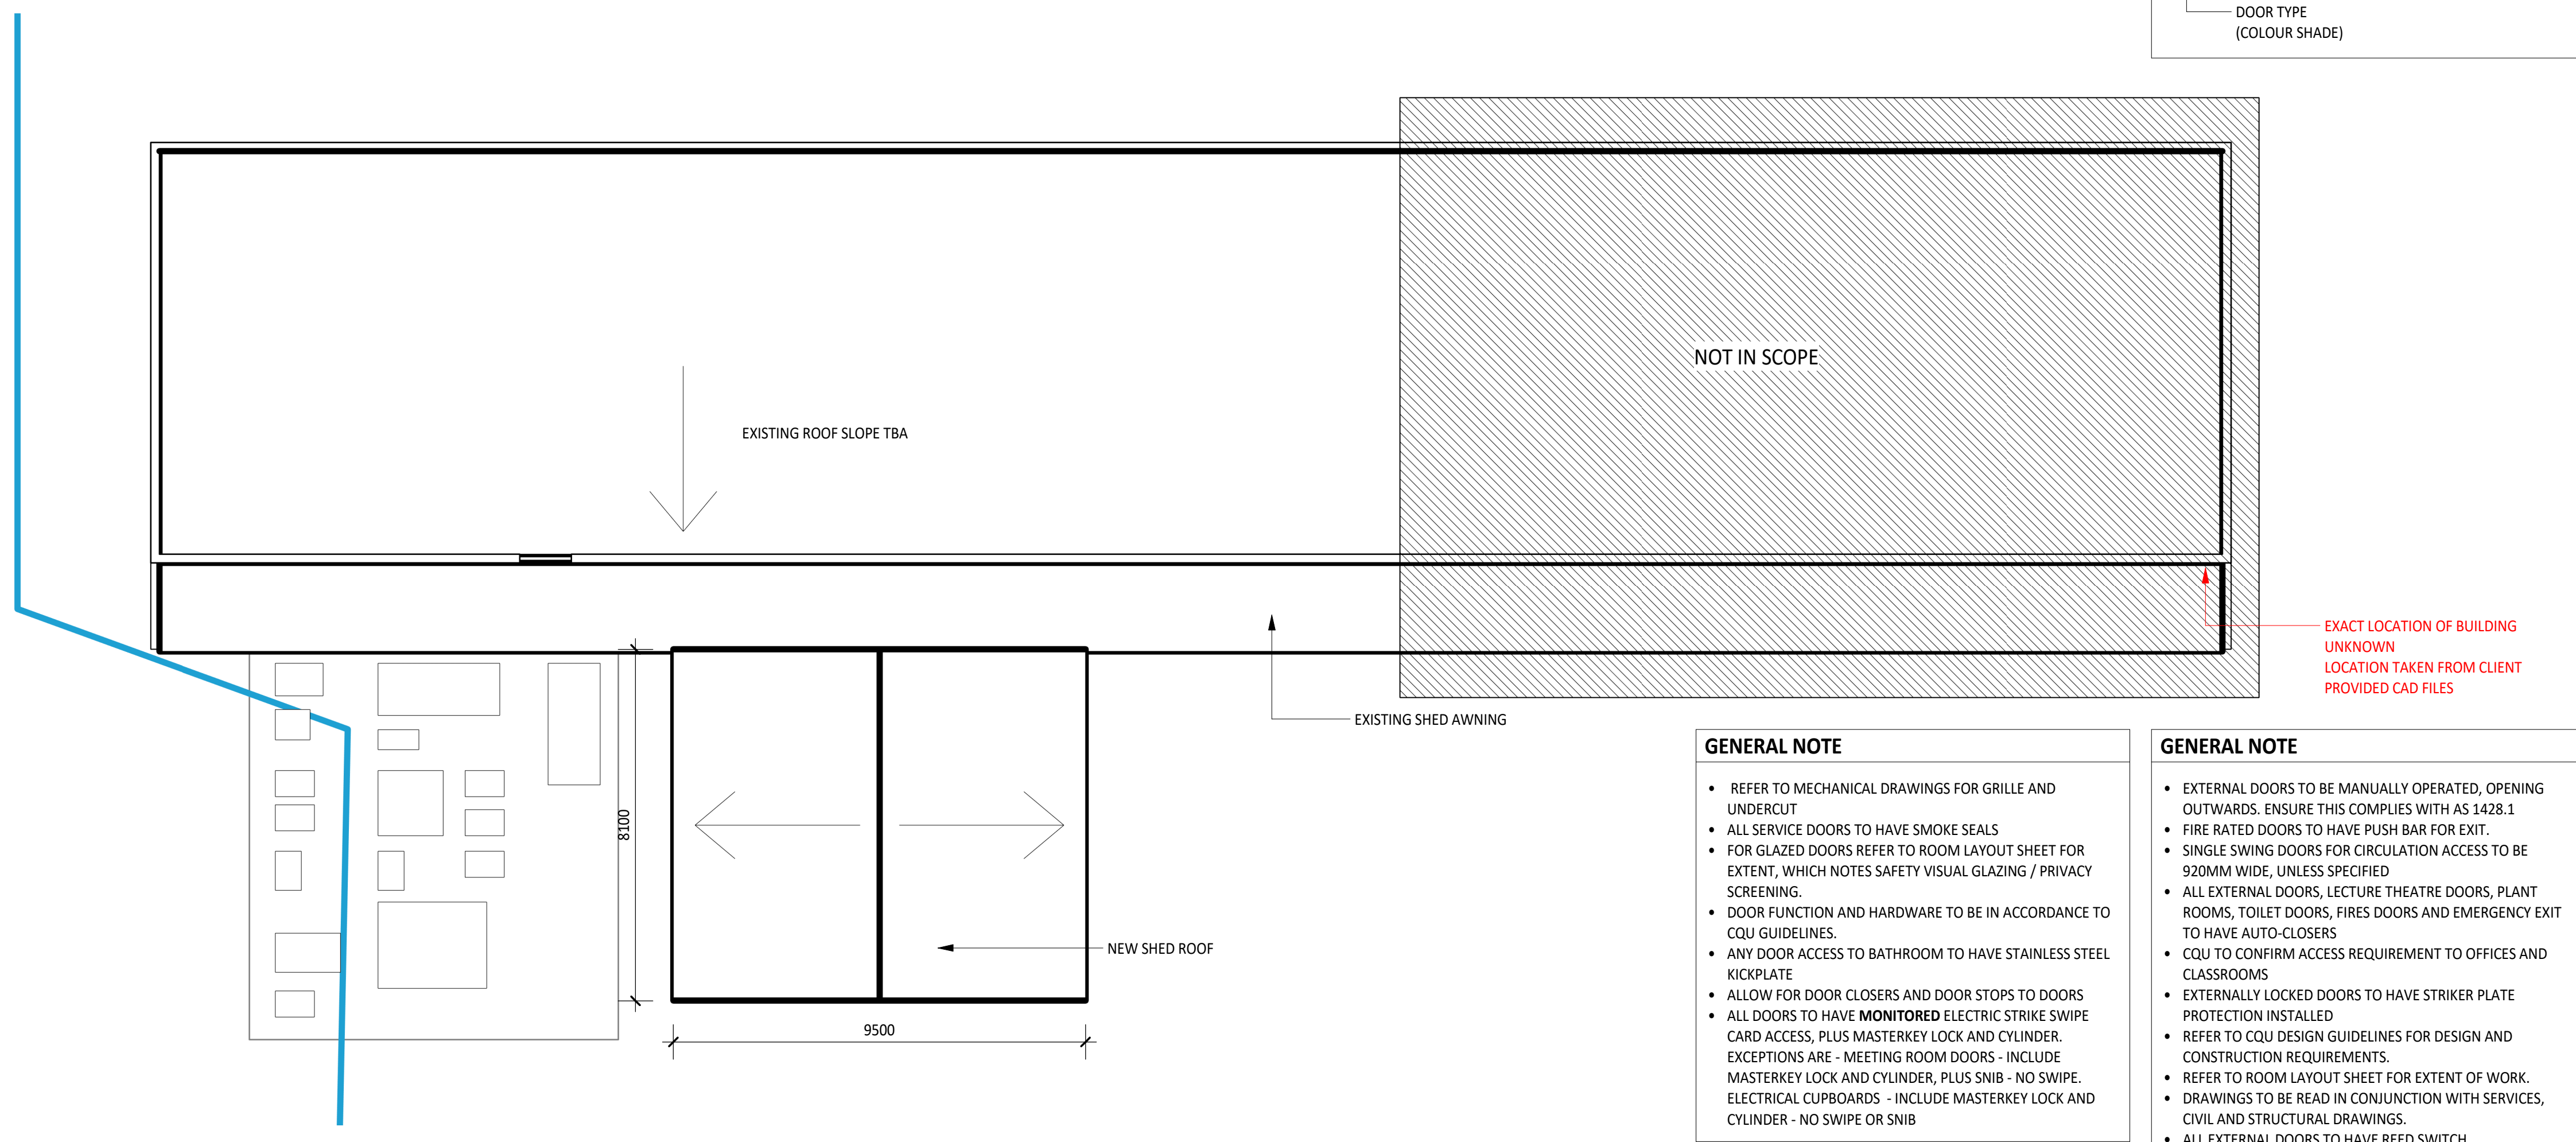
DOOR TYPE	
XX	BIFOLD DOOR
XX	ROLLER DOOR
XX	ACOUSTIC STACKER DOOR
XX	GLAZED SWING DOOR
XX	SWING GATE
XX	SLIDING GATE - AUTOMATIC OPERATION

DOOR TYPE	
XX	SOLID CORE DOOR
XX	GLAZED SLIDER DOOR
XX	VISION PANEL
XX	AUTO-SLIDER DOOR
XX	GLAZED-STACKER DOOR

ACCESS TYPE	
A	CARD READER ACCESS
B	TURN SNIB (NO KEY)
C	PRIVACY SET & TURN SNIB
D	MORTICE LOCK & KEY CYLINDER
E	ROLLER DOOR LOCK
F	LEVER WITH COMPRESSION LOCKING MECHANISM
G	FREE LEVER ACCESS
H	PUSH & PULL ACCESS
I	ROLLER LATCH
J	FREE LEVER EGRESS
S	ROLLER SHUTTER INCLUDES SAFETY CHAIN TO BE HUNG WHEN SHUTTER IS HELD OPEN

ICON LEGEND

XX	ACCESS TYPE (TYPE MARK)
XX	DOOR TYPE (COLOUR SHADE)

**GENERAL NOTE**

- REFER TO MECHANICAL DRAWINGS FOR GRILLE AND UNDERCUT
- ALL SERVICE DOORS TO HAVE SMOKE SEALS
- FOR GLAZED DOORS REFER TO ROOM LAYOUT SHEET FOR EXTENT, WHICH NOTES SAFETY VISUAL GLAZING / PRIVACY SCREENING.
- DOOR FUNCTION AND HARDWARE TO BE IN ACCORDANCE TO CQU GUIDELINES.
- ANY DOOR ACCESS TO BATHROOM TO HAVE STAINLESS STEEL KICKPLATE
- ALLOW FOR DOOR CLOSERS AND DOOR STOPS TO DOORS
- ALL DOORS TO HAVE **MONITORED** ELECTRIC STRIKE SWIPE CARD ACCESS, PLUS MASTERKEY LOCK AND CYLINDER. EXCEPTIONS ARE - MEETING ROOM DOORS - INCLUDE MASTERKEY LOCK AND CYLINDER, PLUS SNIB - NO SWIPE. ELECTRICAL CUPBOARDS - INCLUDE MASTERKEY LOCK AND CYLINDER - NO SWIPE OR SNIB

GENERAL NOTE

- EXTERNAL DOORS TO BE MANUALLY OPERATED, OPENING OUTWARDS. ENSURE THIS COMPLIES WITH AS 1428.1
- FIRE RATED DOORS TO HAVE PUSH BAR FOR EXIT.
- SINGLE SWING DOORS FOR CIRCULATION ACCESS TO BE 920MM WIDE, UNLESS SPECIFIED
- ALL EXTERNAL DOORS, LECTURE THEATRE DOORS, PLANT ROOMS, TOILET DOORS, FIRES DOORS AND EMERGENCY EXIT TO HAVE AUTO-CLOSERS
- CQU TO CONFIRM ACCESS REQUIREMENT TO OFFICES AND CLASSROOMS
- EXTERNALLY LOCKED DOORS TO HAVE STRIKER PLATE PROTECTION INSTALLED
- REFER TO CQU DESIGN GUIDELINES FOR DESIGN AND CONSTRUCTION REQUIREMENTS.
- REFER TO ROOM LAYOUT SHEET FOR EXTENT OF WORK.
- DRAWINGS TO BE READ IN CONJUNCTION WITH SERVICES, CIVIL AND STRUCTURAL DRAWINGS.
- ALL EXTERNAL DOORS TO HAVE REED SWITCH

ISSUED FOR TENDER