


INFORMATION REFLECTED ON THIS DRAWING REPRESENTS HYDRAULIC SERVICES DESIGN DEVELOPED FOR D&C TENDER ADVISE ONLY, AND SHOULD NOT BE REGARDED AS COMPLETE. THE D&C CONTRACTOR SHOULD REFER TO ALL ASSOCIATED ARCHITECTURAL AND OTHER DISCIPLINE DRAWINGS, PROJECT BRIEFS AND CLIENT REQUIREMENTS AND MAKE ADEQUATE ALLOWANCES FOR ALL NECESSARY HYDRAULIC SERVICES WORKS TO MEET THESE REQUIREMENTS, EQUIPMENT SCHEDULES AND COMPLIANCE WITH THE NCC & APPROPRIATE AUSTRALIAN STANDARDS

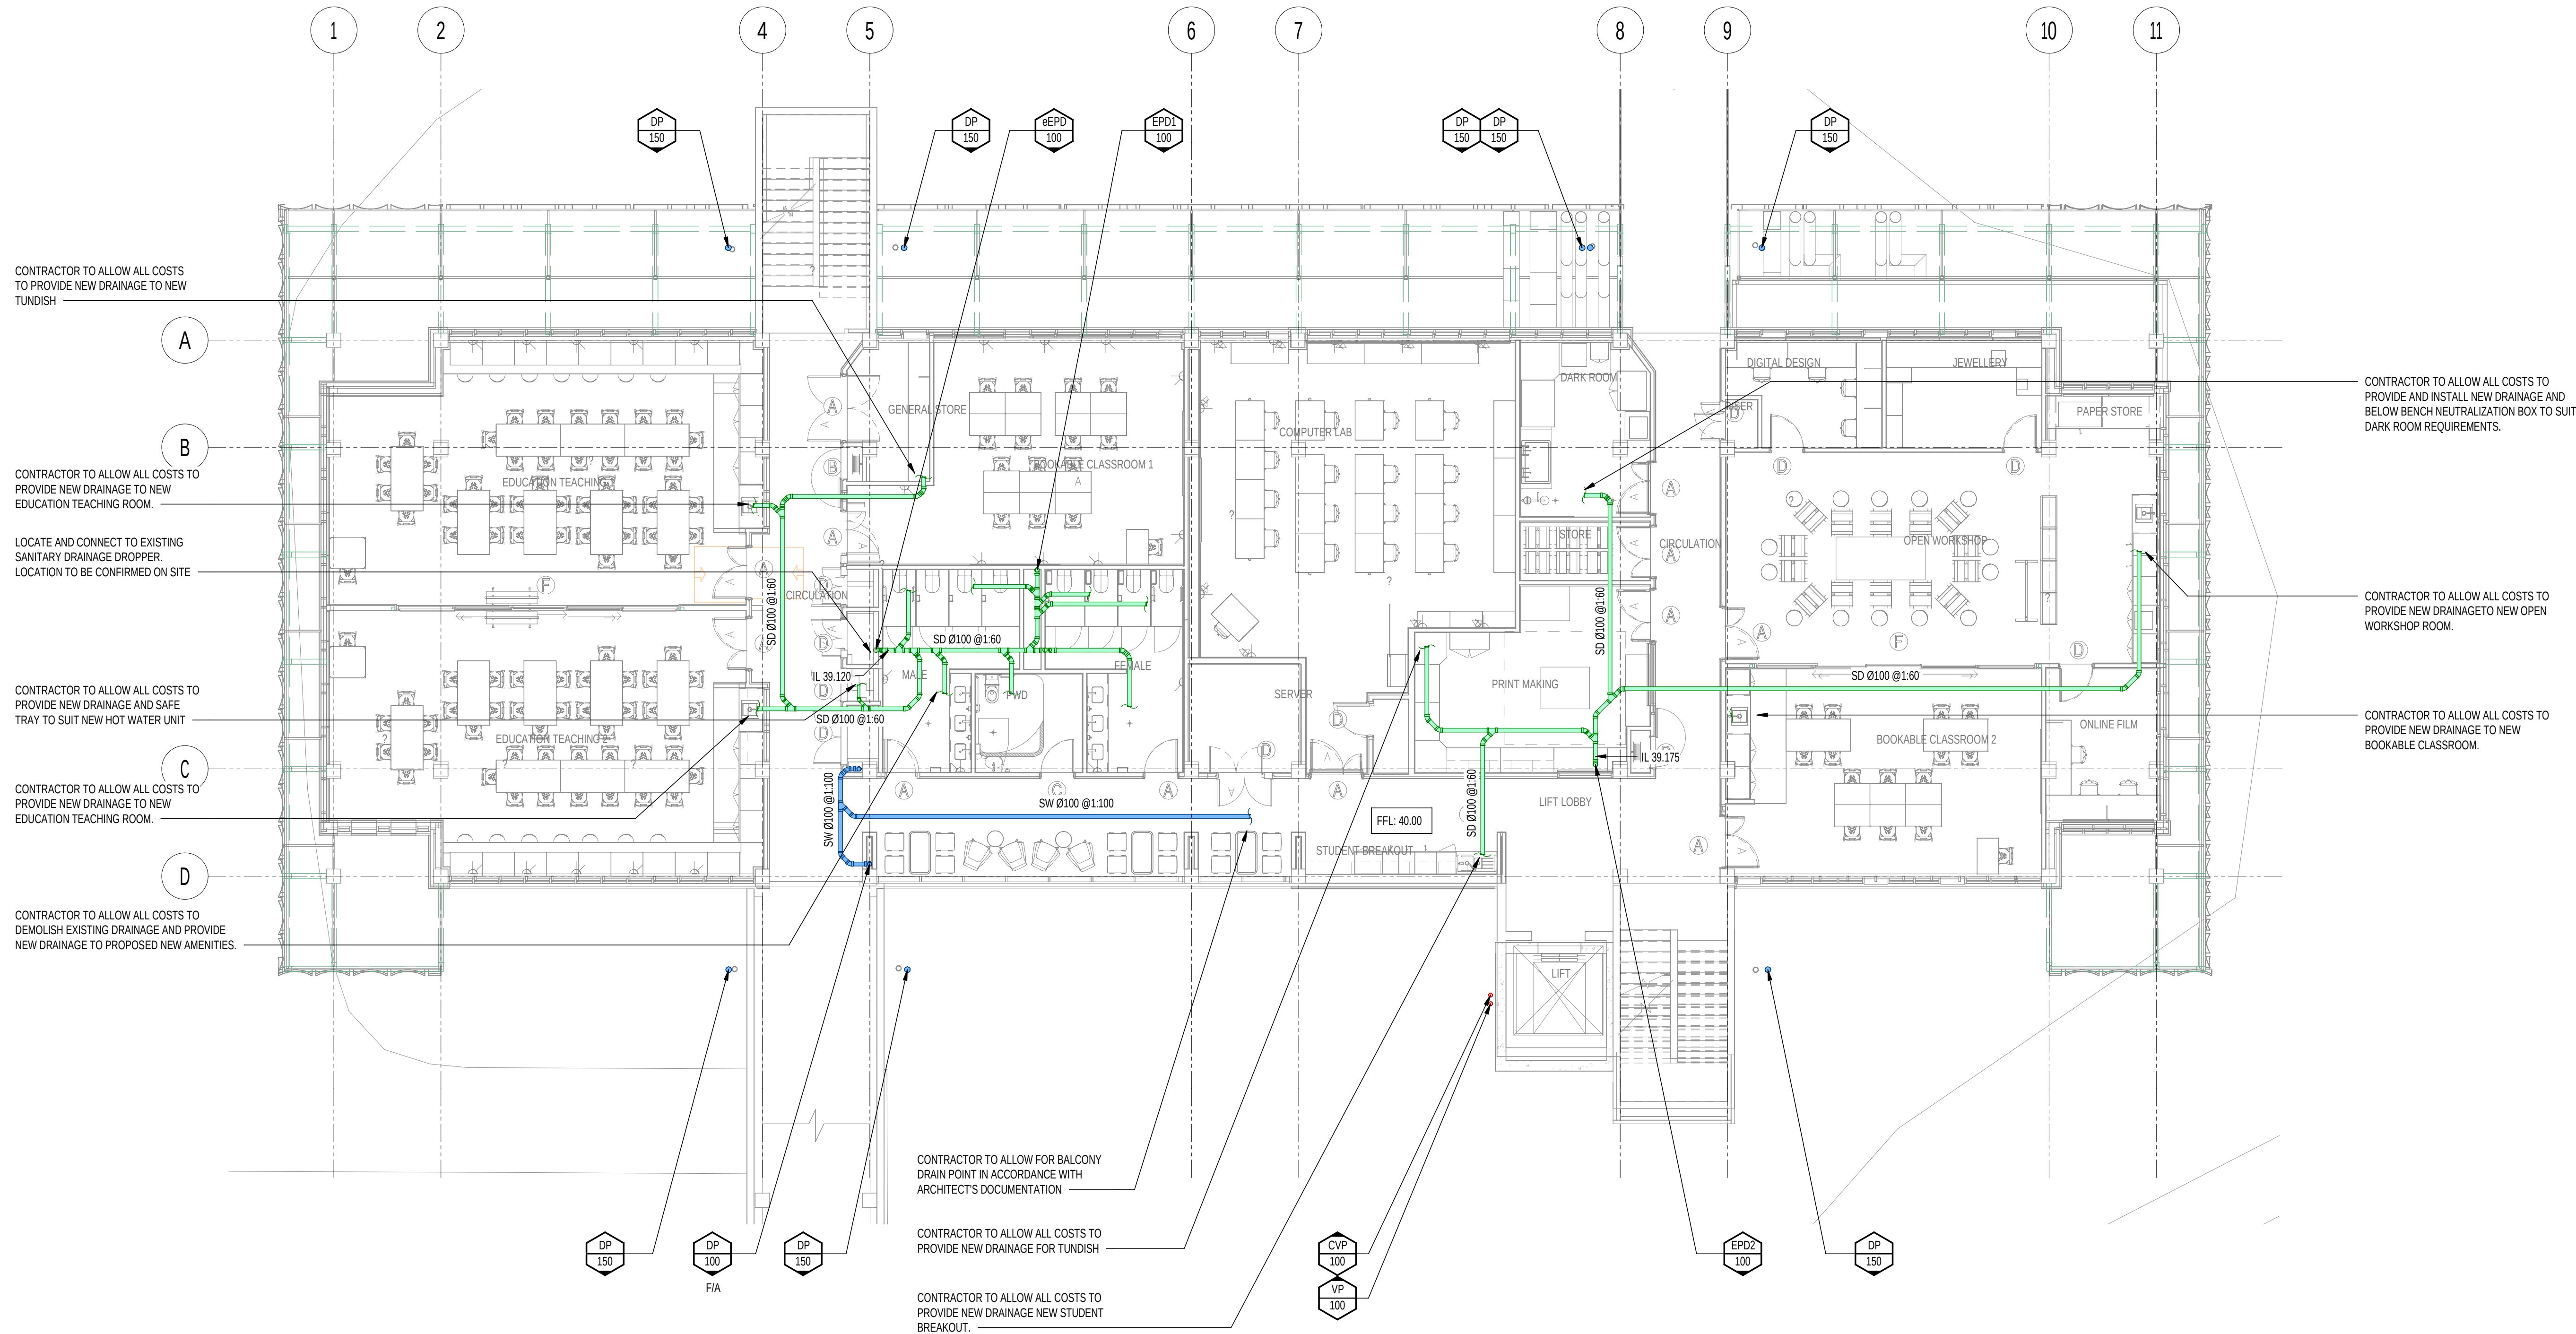

EXISTING SERVICES
SERVICES SHOWN AS EXISTING HAVE BEEN INTERPOLATED FROM RECORD DRAWINGS. CONTRACTOR TO VERIFY LOCATIONS AND LEVELS PRIOR TO COMMENCEMENT OF WORK.

DRAINAGE NOTES:

1. ALLOW ALL COSTS TO CONNECT SANITARY DRAINAGE TO ALL FIXTURES AS REQUIRED.
2. CO-ORDINATE ALL FLOOR WASTE LOCATIONS WITH ARCHITECT AND IN COMPLIANCE WITH THE MCC, AS/NZS3500.2, AS1428.1
3. ALLOW FOR PROVISION OF AN IDS IN COMPLIANCE WITH AS/NZS3500.2 AND TO ALLOW COMPLETE DRAIN ACCESS TO ALL DRAIN LINES COLLECTING MULTIPLE FIXTURES.
4. DOCUMENTATION MAY NOT INDICATE ALL VENTING REQUIREMENTS AND SHALL BE FINALISED DURING FURTHER DESIGN DEVELOPMENT. VENTING REQUIREMENTS TO BE IN ACCORDANCE WITH AS/NZS3500.2
5. ALL PENETRATIONS OR CAST THROUGH CONCRETE STRUCTURE ARE TO BE APPROVED BY THE STRUCTURAL ENGINEER.
6. ALL REDUNDANT PENETRATIONS THROUGH STRUCTURAL ELEMENTS ARE TO BE MADE GOOD TO THE SATISFACTION OF THE STRUCTURAL ENGINEER.
7. SERVICES PASSING THROUGH A FIRE RATED STRUCTURE SHALL HAVE FIRE COLLARS (OR OTHER APPROVED FIRE PROTECTION METHOD) RATED TO THE MINIMUM FR₀ OF THE STRUCTURE IT IS PENETRATING.
8. WHERE PLASTIC SLIDES AND PIPEWORK PASS THROUGH STRUCTURE WHICH IS TO BE FIRE RATED, PROVIDE APPROVED FIRE COLLARS INSTALLED TO THE MCC C4015 AND THE MANUFACTURERS REQUIREMENTS TO ENSURE OPENINGS ARE COMPLETELY CLOSED IN THE EVENT OF A FIRE.
9. SERVICES PASSING THROUGH A FIRE RATED STRUCTURE SHALL HAVE FIRE COLLARS (OR OTHER APPROVED FIRE PROTECTION METHOD) RATED TO THE MINIMUM FR₀ OF THE STRUCTURE IT IS PENETRATING.
10. VERIFY THAT ALL MECHANICAL DISCHARGE TEMPERATURES DO NOT EXCEED THE MAXIMUM ASSOCIATED WITH THE PIPEWORK MATERIAL. MECHANICAL CONTRACTOR TO PROVIDE DRAIN TEMPERING VALVE PRIOR TO DISCHARGE AS REQUIRED.
11. CO-ORDINATE WITH ARCHITECT, AND PROVIDE THRESHOLD PROTECTION AT ALL ENTRY POINTS TO THE BUILDING AS REQUIRED TO PREVENT THE INGRESS OF WIND DRIVEN RAIN.
12. CONTRACTOR TO ALLOW TO CO-ORDINATE ALL NEW SANITARY DRAINAGE WITH EXISTING MECHANICAL SERVICES.

B	12.02.2026	SH	ISSUED FOR D&C TENDER	AA	SM
A	18.02.2026	SH	DRAFT FOR REVIEW	AA	SM
REV	DATE	BY	DESCRIPTION	CHK	APP

DESIGN DEVELOPMENT



900 Ann Street, Level 12, Fortitude Valley 4006
Tel: +61-7-3854-6200 Fax: +61-7-3854-6500
<http://www.wsp.com>

CLIENT:

CQU

ARCHITECT:

THOMSON ADSETT / PEDDLE THORP

PROJECT:

CQU ROCKHAMPTON TAFE CONSOLIDATION

TITLE:

HYDRAULIC SERVICES
BUILDING 33 - LEVEL 01 - DRAINAGE LAYOUT

SCALE & NO:

1:100

CHECKED:

AA

APPROVED:

SM

PROJECT NUMBER:

PS229518

DRAWN:

SH

DATE:

JAN 2026

DRAWING NO:

B33-HY-DR-510-L01-00-00

REV:

B

© WSP Australia Pty Ltd