


NOTES:

- FCU-33-L1-08 AND FCU-33-L1-11  
SUPPLY DUCT RUNS TO HAVE A MINIMUM 2M OF 75mm THICK  
ACOUSTIC LINING BEFORE FIRST TAKE-OFF. RA PLENUMS TO BE  
INTERNALLY LINED WITH 75mm THICK ACOUSTIC LINING. RETURN  
DUCT RUNS TO HAVE MINIMUM 1M OF 75MM THICK ACOUSTIC LINING  
AND ONE LINED ELBOW BEFORE FIRST TAKE-OFF.
- FCU-33-L1-01 TO 07, FCU-33-L1-09 TO 10, FCU-33-L1-12 AND FCU-33-  
L1-13. SUPPLY DUCT RUNS TO HAVE A MINIMUM 2M OF 75mm THICK  
ACOUSTIC LINING BEFORE FIRST TAKE-OFF. RA PLENUMS TO BE  
INTERNALLY LINED WITH 75mm THICK ACOUSTIC LINING. RETURN  
DUCT RUNS TO HAVE MINIMUM 1M OF 75MM THICK ACOUSTIC LINING  
AND ONE LINED ELBOW BEFORE FIRST TAKE-OFF. FCUs TO BE  
WRAPPED EXTERNALLY IN ACOUSTIC INSULATION, MINIMUM  
SURFACE MASS DENSITY OF 9kg/m<sup>2</sup>.

INFORMATION REFLECTED ON THIS DRAWING  
REPRESENTS MECHANICAL SERVICES DESIGN  
DEVELOPED FOR D&C TENDER ADVISE ONLY, AND  
SHOULD NOT BE REGARDED AS COMPLETE. THE D&C  
CONTRACTOR SHOULD REFER TO ALL ASSOCIATED  
ARCHITECTURAL AND OTHER DISCIPLINE DRAWINGS,  
PROJECT BRIEFS AND CLIENT REQUIREMENTS AND  
MAKE ADEQUATE ALLOWANCES FOR ALL NECESSARY  
MECHANICAL SERVICES WORKS TO MEET THESE  
REQUIREMENTS, EQUIPMENT SCHEDULES AND  
COMPLIANCE WITH THE NCC & APPROPRIATE  
AUSTRALIAN STANDARDS

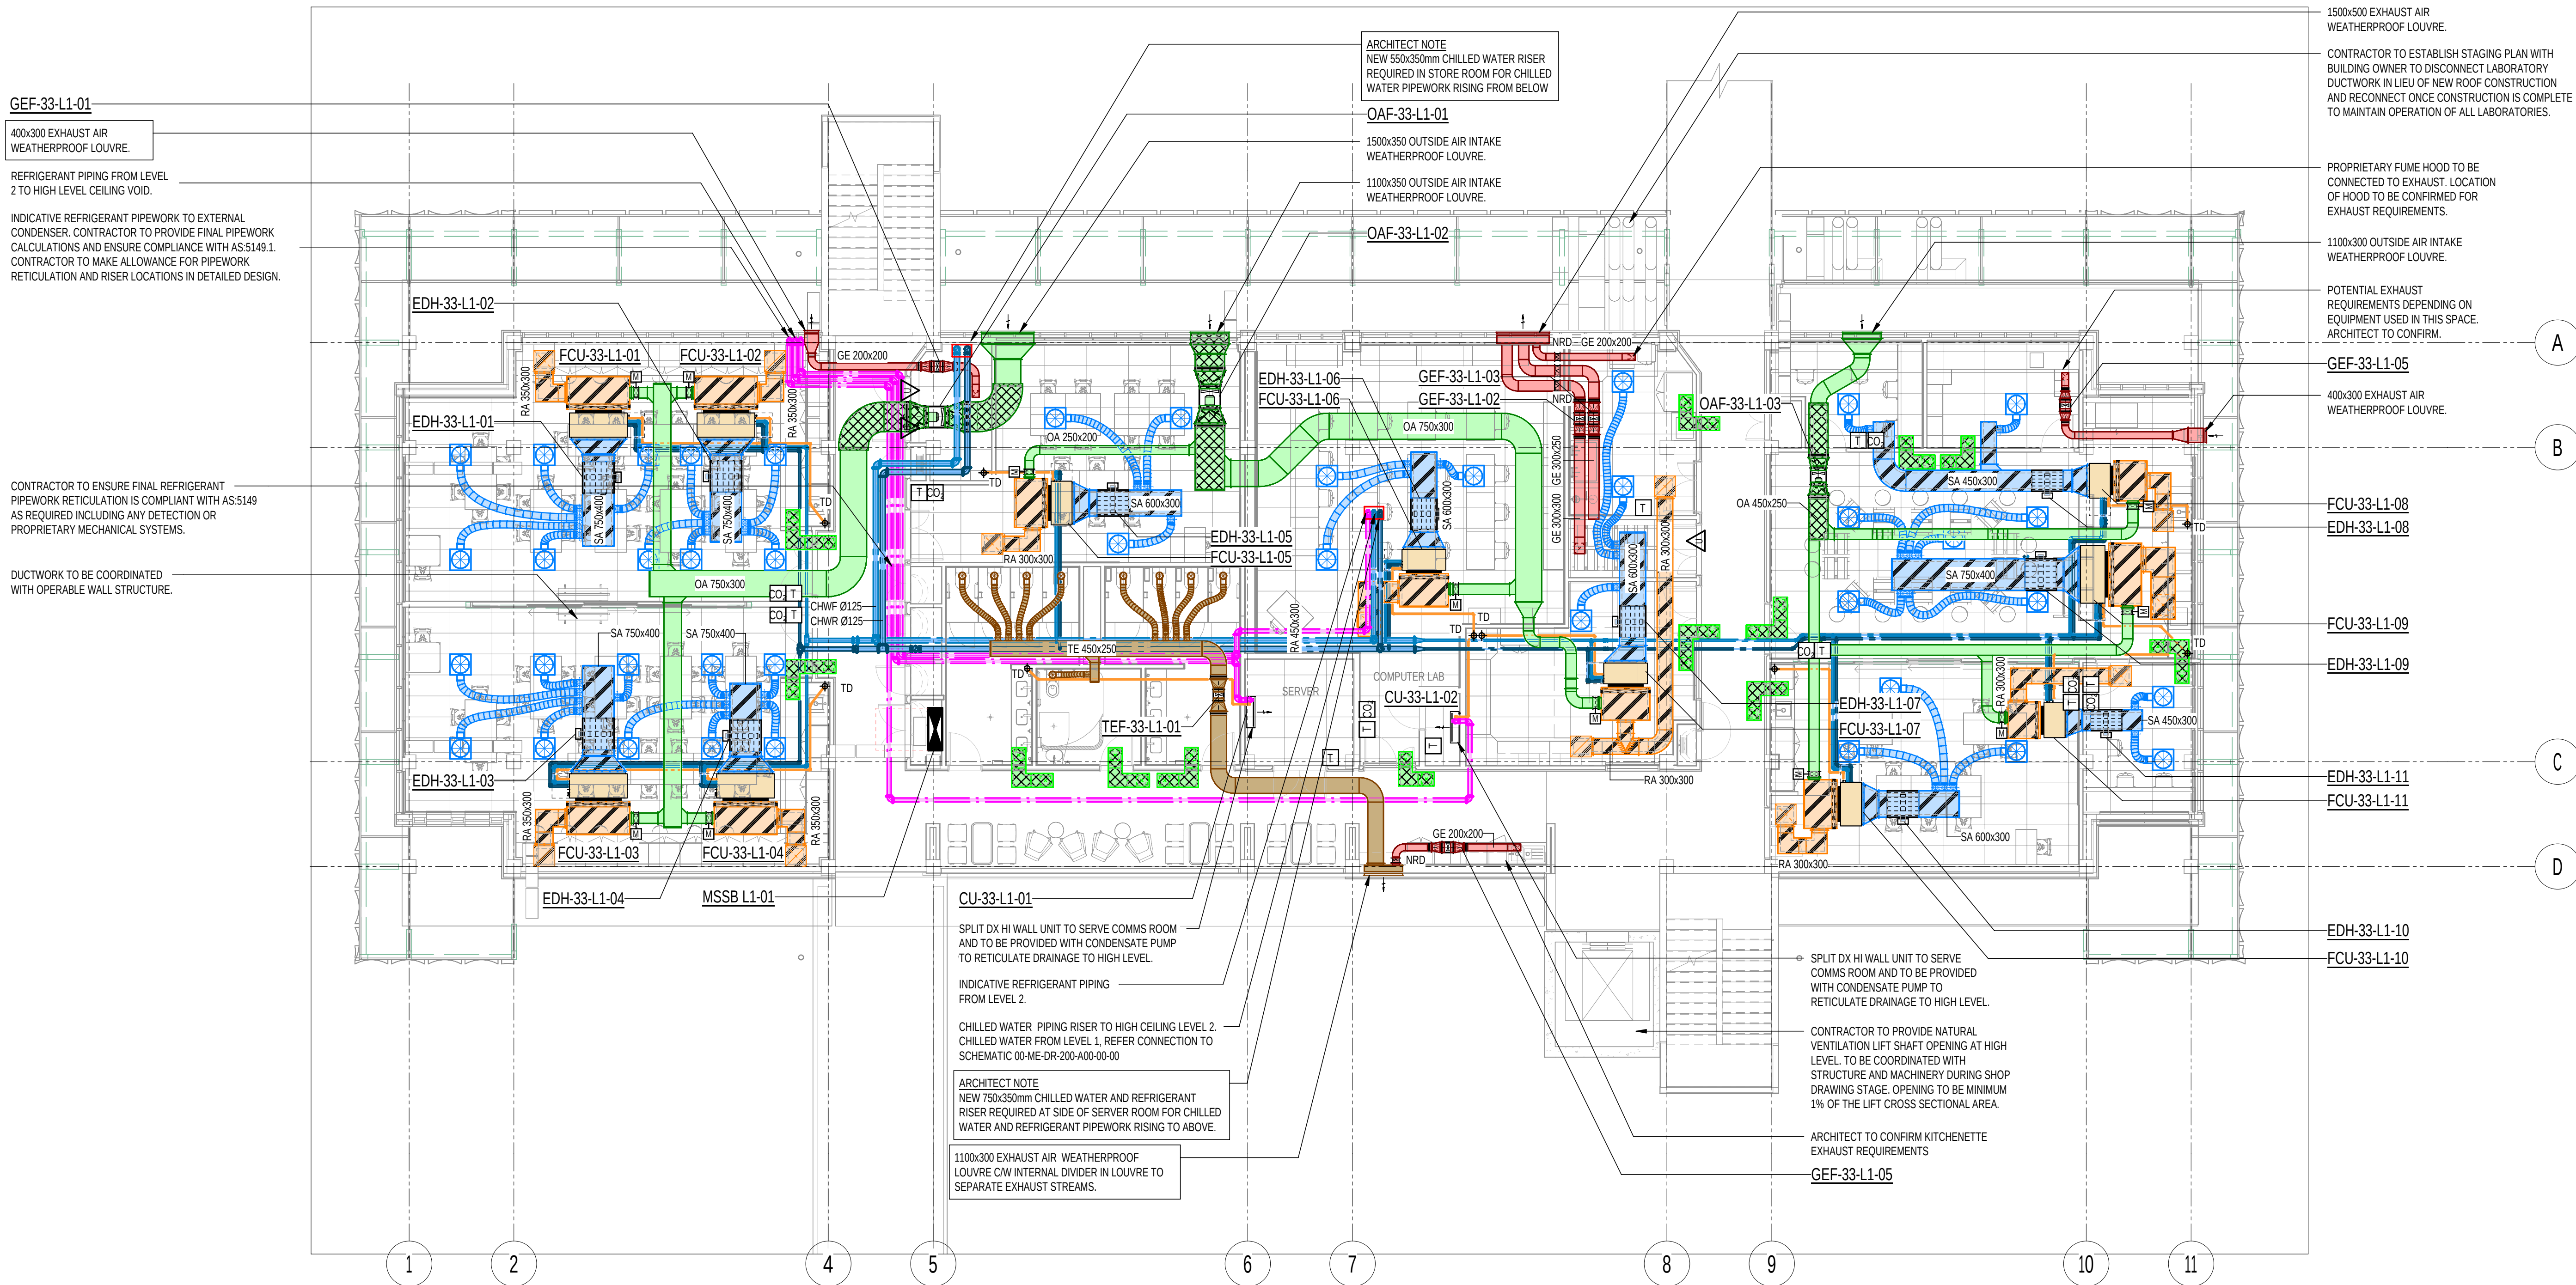

|     |            |    |                       |     |     |
|-----|------------|----|-----------------------|-----|-----|
| B   | 12.02.2026 | RD | ISSUED FOR D&C TENDER | MB  | SM  |
| A   | 10.02.2026 | RD | DRAFT FOR D&C TENDER  | MB  | SM  |
| REV | DATE       | BY | DESCRIPTION           | CHK | APP |

DESIGN DEVELOPMENT



900 Ann Street, Level 12, Fortitude Valley 4006  
Tel: +61-7-3854-6200 Fax: +61-7-3854-6500  
<http://www.wsp.com>

CLIENT:

CQU

ARCHITECT:

THOMSON ADSETT / PEDDLE THORP

PROJECT:

CQU ROCKHAMPTON TAFE CONSOLIDATION

TITLE:

MECHANICAL SERVICES  
BUILDING 33 - LEVEL 01 - HVAC LAYOUT

SCALE @ A1:

1:100

CHECKED:

MB

APPROVED:

SM

PROJECT NUMBER:

PS229518

DRAWN:

RD

DATE:

FEB 2026

DRAWING NO.:

B33-ME-DR-510-L01-00-00

REV:

B

© WSP Australia Pty Ltd