




NOTES:

1. FCU-33-L2-01 TO FCU-33-L2-22:
SUPPLY DUCT RUNS TO HAVE A MINIMUM 2M OF 75mm THICK ACUSTIC LINING BEFORE FIRST TAKE-OFF. RA PLENUMS TO BE INTERNALLY LINED WITH 25mm THICK ACUSTIC LINING. RETURN DUCT RUNS TO HAVE MINIMUM 1M OF 75MM THICK ACUSTIC LINING AND ONE LINED ELBOW BEFORE FIRST TAKE-OFF. FCUs TO BE WRAPPED EXTERNALLY IN ACUSTIC INSULATION, MINIMUM SURFACE MASS DENSITY OF 5kg/m².

INFORMATION REFLECTED ON THIS DRAWING REPRESENTS MECHANICAL SERVICES DESIGN DEVELOPED FOR D&C TENDER ADVISE ONLY, AND SHOULD NOT BE REGARDED AS COMPLETE. THE D&C CONTRACTOR SHOULD REFER TO ALL ASSOCIATED ARCHITECTURAL AND OTHER DISCIPLINE DRAWINGS, PROJECT BRIEFS AND CLIENT REQUIREMENTS AND MAKE ADEQUATE ALLOWANCES FOR ALL NECESSARY MECHANICAL SERVICES WORKS TO MEET THESE REQUIREMENTS, EQUIPMENT SCHEDULES AND COMPLIANCE WITH THE NCC & APPROPRIATE AUSTRALIAN STANDARDS

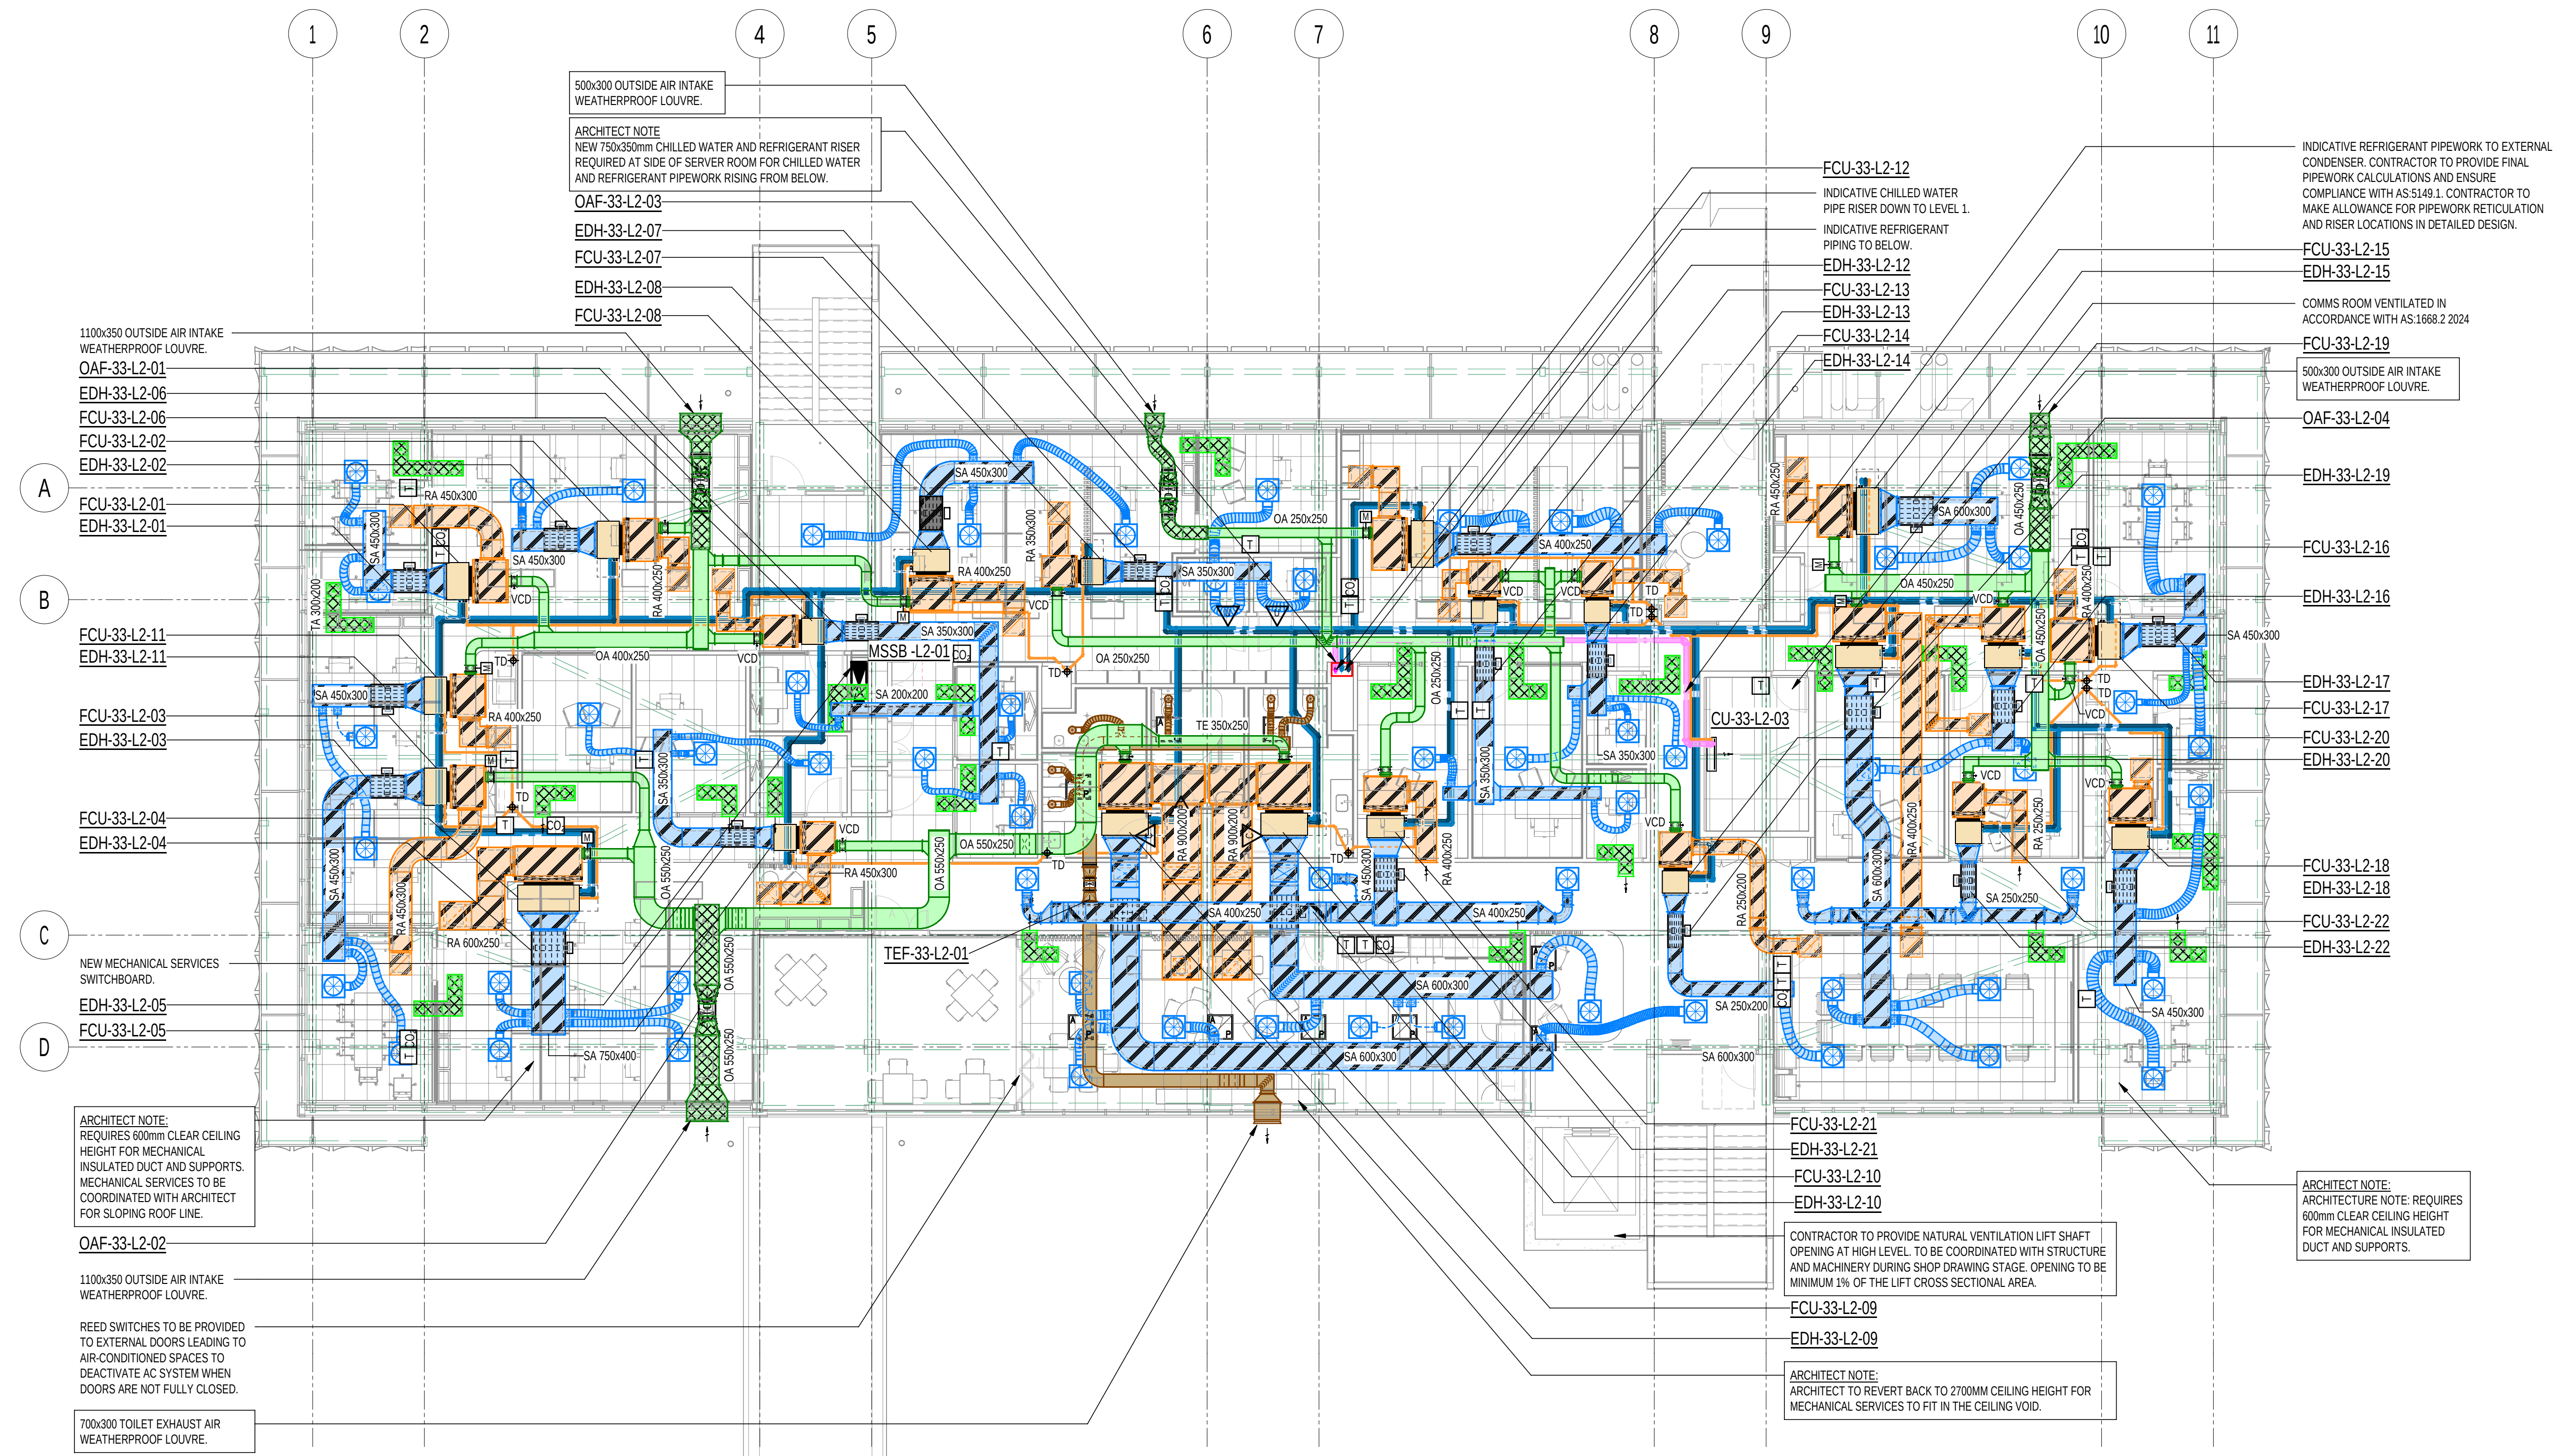

B	12.02.2026	RD	ISSUED FOR D&C TENDER	MB	SM
A	10.02.2026	RD	DRAFT FOR D&C REVIEW	MB	SM
REV	DATE	BY	DESCRIPTION	CHK	APP

DESIGN DEVELOPMENT



900 Ann Street, Level 12, Fortitude Valley 4006
Tel: +61-7-3854-6200 Fax: +61-7-3854-6500
<http://www.wsp.com>

CLIENT:

CQU

ARCHITECT:

THOMSON ADSETT / PEDDLE THORP

PROJECT:

CQU ROCKHAMPTON TAFE CONSOLIDATION

TITLE:

MECHANICAL SERVICES
BUILDING 33 - LEVEL 02 - HVAC LAYOUT

SCALE @ A1:

1:100

CHECKED:

MB

APPROVED:

SM

PROJECT NUMBER:

PS229518

DRAWN:

RD

DATE:

FEB 2026

DRAWING NO:

B33-ME-DR-510-L02-00-00

REV:

B

© WSP Australia Pty Ltd