
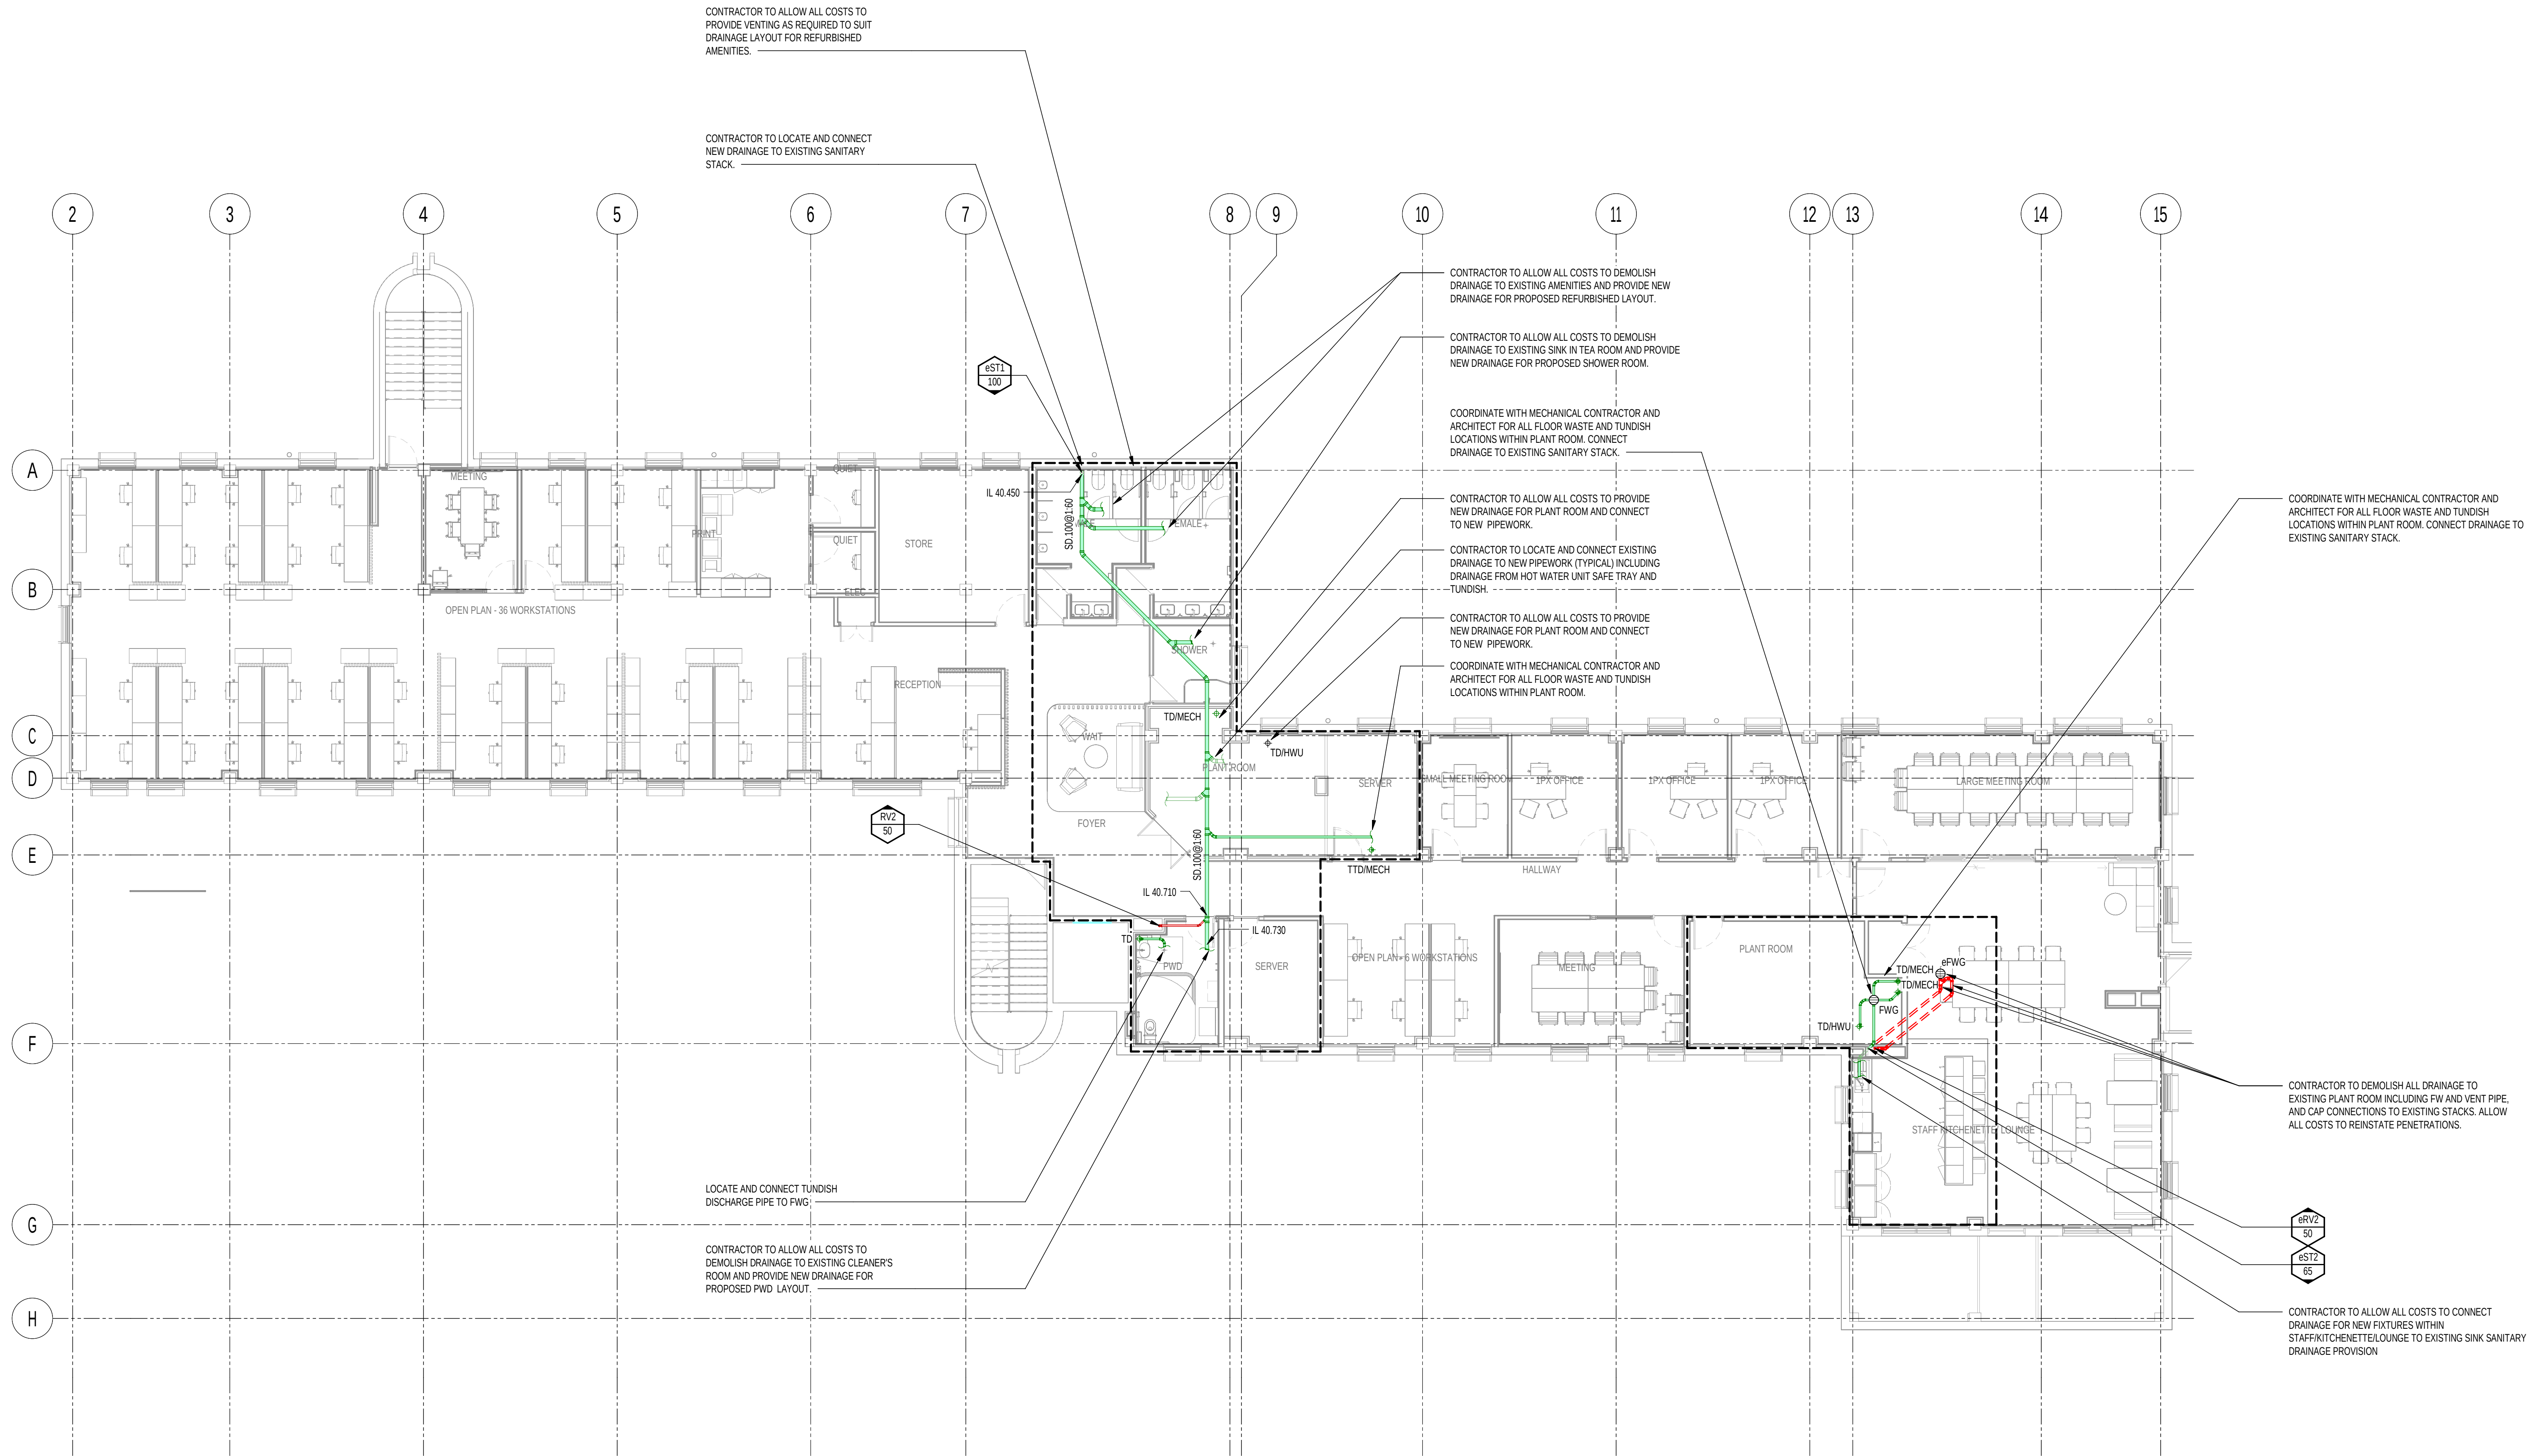




INFORMATION REFLECTED ON THIS DRAWING REPRESENTS HYDRAULIC SERVICES DESIGN DEVELOPED FOR D&C TENDER ADVISE ONLY, AND SHOULD NOT BE REGARDED AS COMPLETE. THE D&C CONTRACTOR SHOULD REFER TO ALL ASSOCIATED ARCHITECTURAL AND OTHER DISCIPLINE DRAWINGS, PROJECT BRIEFS AND CLIENT REQUIREMENTS AND MAKE ADEQUATE ALLOWANCES FOR ALL NECESSARY HYDRAULIC SERVICES WORKS TO MEET THESE REQUIREMENTS, EQUIPMENT SCHEDULES AND COMPLIANCE WITH THE NCC & APPROPRIATE AUSTRALIAN STANDARDS

DRAINAGE NOTES:

1. ALLOW ALL COSTS TO CONNECT SANITARY DRAINAGE TO ALL FIXTURES AS REQUIRED.
2. CO-ORDINATE ALL FLOOR WASTE LOCATIONS WITH ARCHITECT AND IN COMPLIANCE WITH THE NCC, AS/NZS3500.2, AS1428.1.
3. ALLOW FOR PROVISION OF AN KVS IN COMPLIANCE WITH AS/NZS3500.2 AND TO ALLOW COMPLETE DRAIN ACCESS TO ALL DRAIN LINES COLLECTING MULTIPLE FIXTURES.
4. DOCUMENTATION MAY NOT INDICATE ALL VENTING REQUIREMENTS AND SHALL BE FINALISED DURING FURTHER DESIGN DEVELOPMENT. VENTING REQUIREMENTS TO BE IN ACCORDANCE WITH AS/NZS3500.2.
5. ALL PENETRATIONS OR CAST THROUGH CONCRETE STRUCTURE ARE TO BE APPROVED BY THE STRUCTURAL ENGINEER.
6. ALL REDUNDANT PENETRATIONS THROUGH STRUCTURAL ELEMENTS ARE TO BE MADE GOOD TO THE SATISFACTION OF THE STRUCTURAL ENGINEER.
7. SERVICES PASSING THROUGH A FIRE RATED STRUCTURE SHALL HAVE FIRE COLLARS (OR OTHER APPROVED FIRE PROTECTION METHOD) RATED TO THE MINIMUM FRL OF THE STRUCTURE IT IS PENETRATING.
8. WHERE PLASTIC SLEEVES AND PIPEWORK PASS THROUGH STRUCTURE WHICH IS TO BE FIRE RATED, PROVIDE APPROVED FIRE COLLARS INSTALLED TO THE NCC CADIS AND THE MANUFACTURERS REQUIREMENTS TO ENSURE OPENINGS ARE COMPLETELY CLOSED IN THE EVENT OF A FIRE.
9. VERIFY THAT ALL MECHANICAL DISCHARGE TEMPERATURES DO NOT EXCEED THE MAXIMUM ASSOCIATED WITH THE PIPEWORK MATERIAL. MECHANICAL CONTRACTOR TO PROVIDE DRAIN TEMPERING VALVE PRIOR TO DISCHARGE AS REQUIRED.
10. ALL PLANT ROOM FLOOR WASTES TO INCLUDE "GRATE SEAL" ONE WAY VALVE TO PREVENT ODOUR IN THE EVENT OF FLOOR WASTE TRAP DEPLETION.
11. LOCATION OF EXISTING SERVICES IN CEILINGS HAS NOT BEEN VERIFIED. THE CONTRACTOR SHALL ALLOW ALL COSTS TO LOCATE, IDENTIFY & COORDINATE EXISTING SERVICES WITH PROPOSED WORKS REFLECTED ON THESE & OTHER CONSULTANT DOCUMENTS.
12. CO-ORDINATE WITH ARCHITECT, AND PROVIDE THRESHOLD PROTECTION AT ALL ENTRY POINTS TO THE BUILDING AS REQUIRED TO PREVENT THE INGRESS OF WIND DRIVEN RAIN.

B	12.02.2026	SH	ISSUED FOR D&C TENDER	AA	SM
A	18.02.2026	SH	DRAFT FOR REVIEW	AA	SM
REV	DATE	BY	DESCRIPTION	CHK	APP

DESIGN DEVELOPMENT



900 Ann Street, Level 12, Fortitude Valley 4006
Tel: +61-7-3854-6200 Fax: +61-7-3854-6500
<http://www.wsp.com>

CLIENT:

CQU

ARCHITECT:

THOMSON ADSETT / PEDDLE THORP

PROJECT:

CQU ROCKHAMPTON TAFE CONSOLIDATION

TITLE:

HYDRAULIC SERVICES
BUILDING 19 - LEVEL 03 - DRAINAGE LAYOUT

SCALE @ A1:

1:100

CHECKED:

AA

APPROVED:

SM

PROJECT NUMBER:

PS229518

DRAWN:

SH

DATE:

JAN 2026

DRAWING NO.:

B19-HY-DR-510-L03-00-00

REV:

B

© WSP Australia Pty Ltd