


INFORMATION REFLECTED ON THIS DRAWING REPRESENTS HYDRAULIC SERVICES DESIGN DEVELOPED FOR D&C TENDER ADVISE ONLY, AND SHOULD NOT BE REGARDED AS COMPLETE. THE D&C CONTRACTOR SHOULD REFER TO ALL ASSOCIATED ARCHITECTURAL AND OTHER DISCIPLINE DRAWINGS, PROJECT BRIEFS AND CLIENT REQUIREMENTS AND MAKE ADEQUATE ALLOWANCES FOR ALL NECESSARY HYDRAULIC SERVICES WORKS TO MEET THESE REQUIREMENTS, EQUIPMENT SCHEDULES AND COMPLIANCE WITH THE NCC & APPROPRIATE AUSTRALIAN STANDARDS

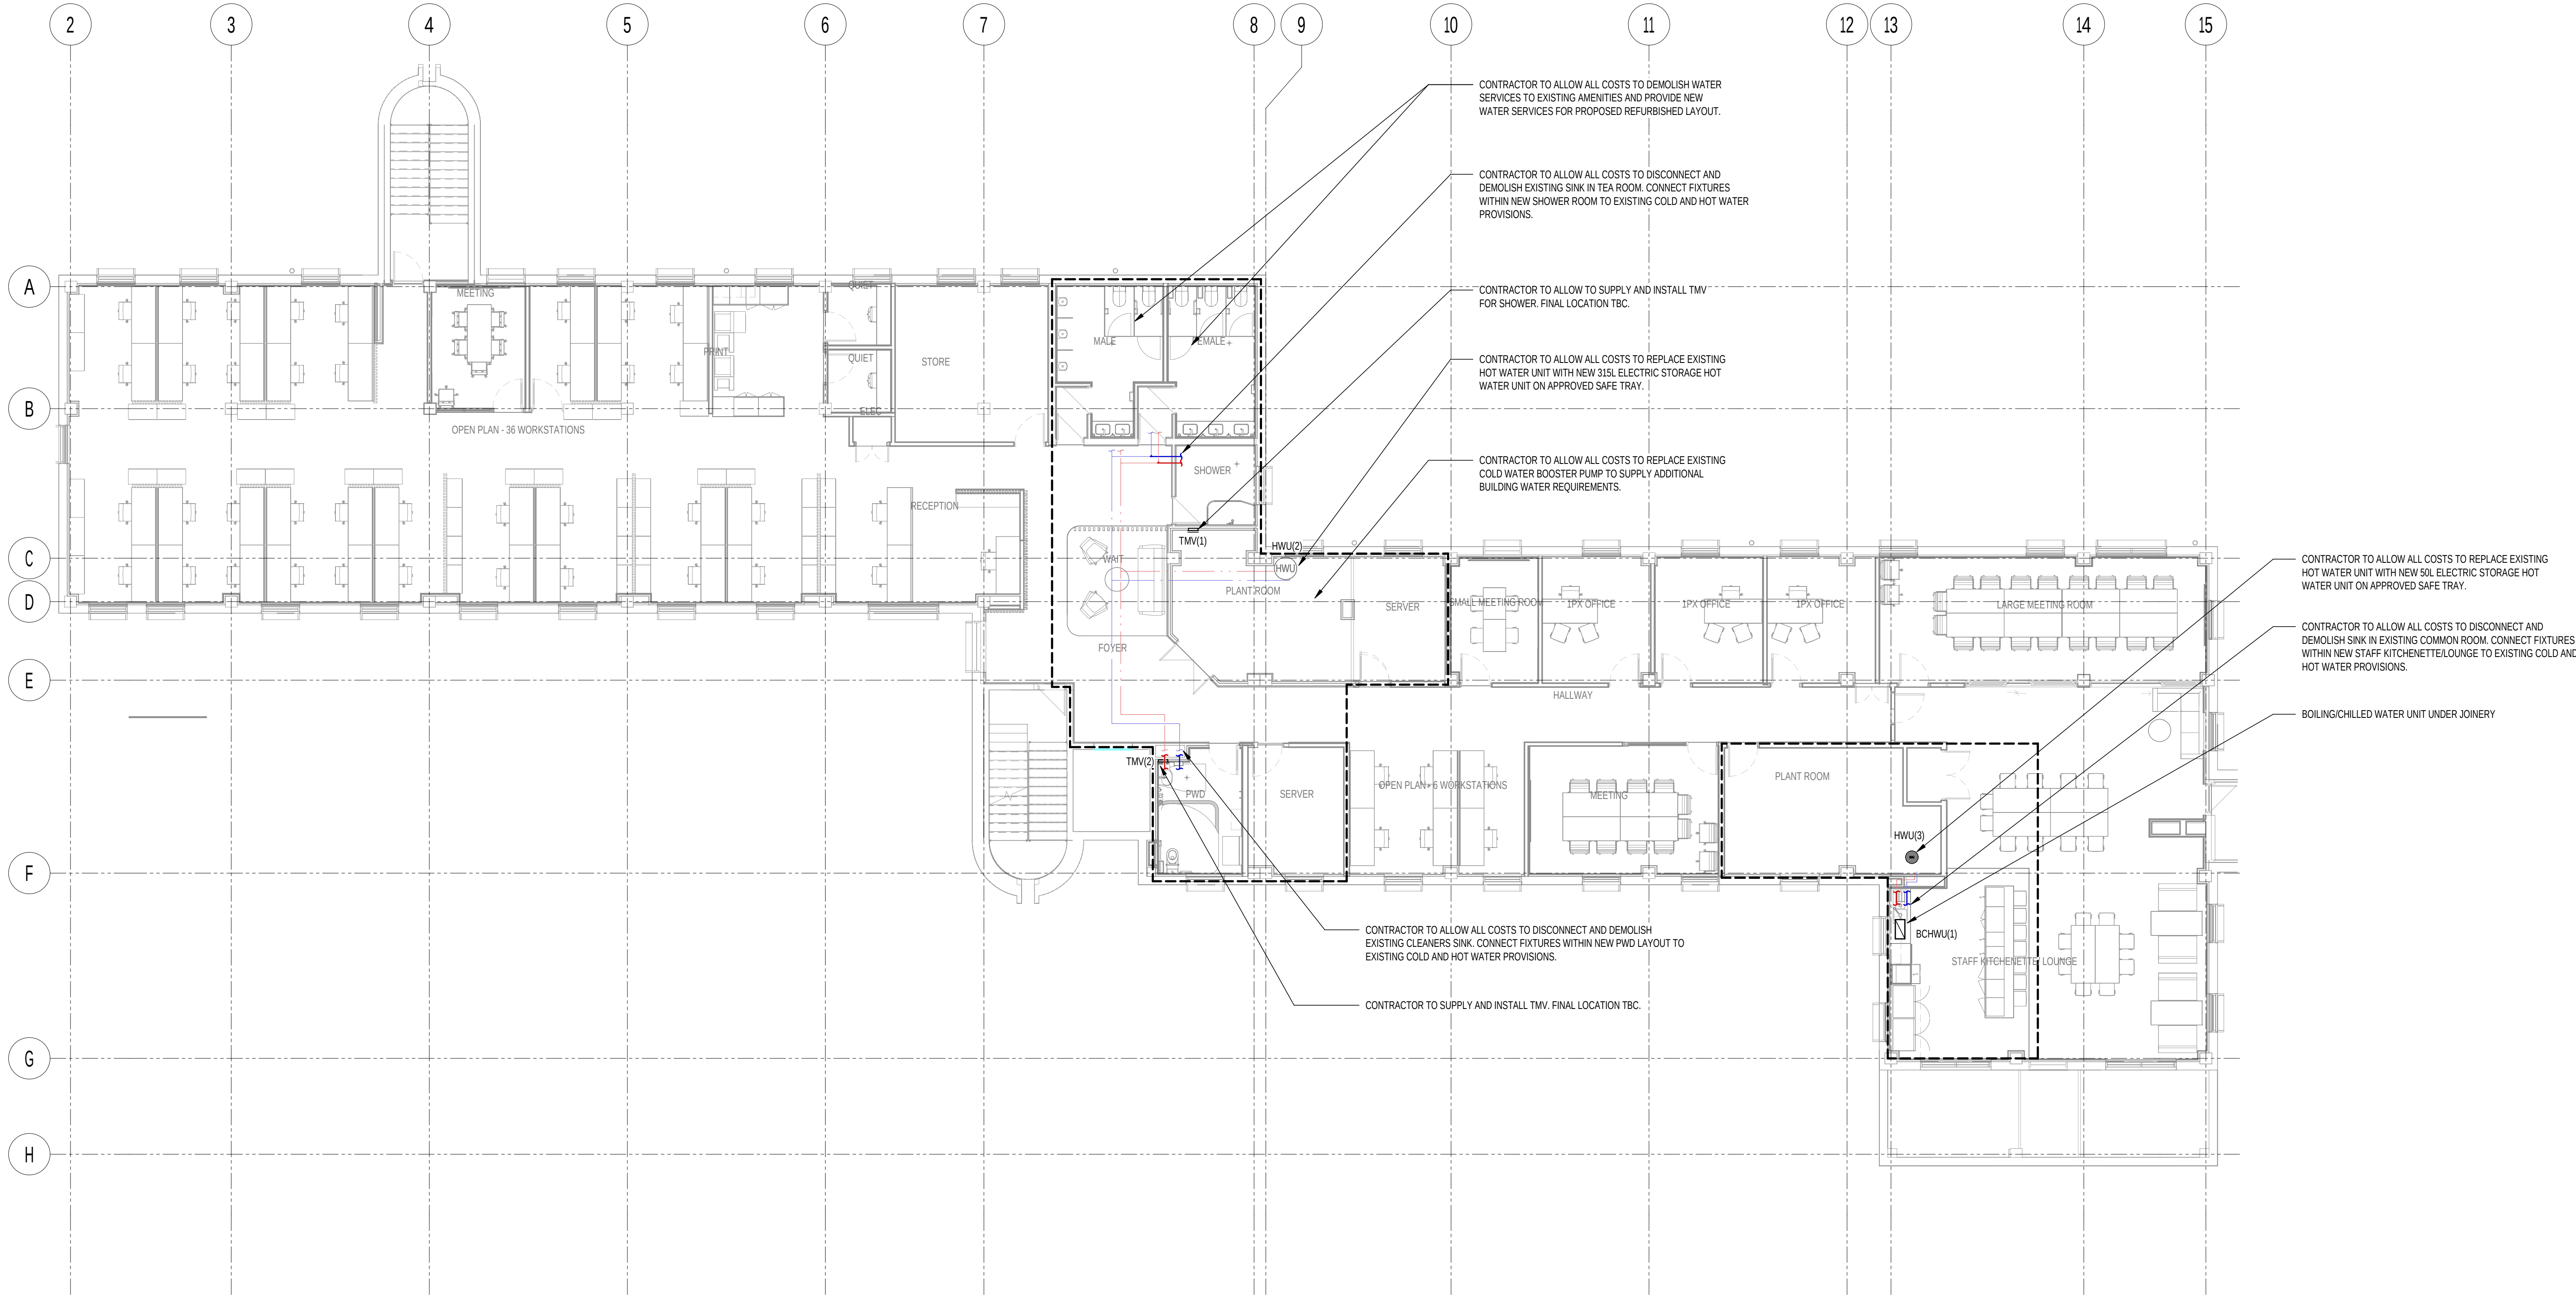

WATER NOTES:

1. ALLOW ALL COSTS TO RETICULATE ALL HOT AND COLD WATER FROM AREA ISOLATION OR TMV TO FIXTURES WITHIN THE ROOM.
2. HOT WATER DEAD LEG LENGTH FROM CIRCULATION LOOP SHALL NOT EXCEED THE MAXIMUM VOLUME PRESCRIBED IN AS/NZS 3500.4.
3. ALL FIXTURES ARE TO HAVE MINI ISOLATION VALVES AT POINT OF CONNECTION FOR TAPWARE WITH FLEXIBLE HOSES, OR ARE TO BE ISOLATED BY MEANS OF ISOLATING ONLY THE ROOM INDEPENDENTLY FROM THE REMANDER OF THE BUILDING.
4. ALL PENETRATIONS OR CAST THROUGH CONCRETE STRUCTURE ARE TO BE APPROVED BY THE STRUCTURAL ENGINEER.
5. ALL REDUNDANT PENETRATIONS THROUGH STRUCTURAL ELEMENTS ARE TO BE MADE GOOD TO THE SATISFACTION OF THE STRUCTURAL ENGINEER.
6. SERVICES PASSING THROUGH A FIRE RATED STRUCTURE SHALL HAVE FIRE COLLARS (OR OTHER APPROVED FIRE PROTECTION METHOD) RATED TO THE MINIMUM FRL OF THE STRUCTURE IT IS PENETRATING.
7. WHERE METAL PIPEWORK PASSES THROUGH STRUCTURE WHICH IS TO BE FIRE RATED, MINIMISE THE PENETRATION SIZE AND PACK AROUND PIPEWORK WITH APPROVED INTUMESCENT SEALANT TO THE NCC C4015 AND THE MANUFACTURERS REQUIREMENTS TO ENSURE OPENINGS ARE COMPLETELY CLOSED IN THE EVENT OF A FIRE.
8. PROVIDE PRESSURE REDUCTION AS REQUIRED TO ENSURE THAT ALL FIXTURES HAVE A PRESSURE WITHIN THE MAXIMUM AND MINIMUM ALLOWABLE PRESSURES SPECIFIED IN THE SPECIFICATION. ALL PRESSURE REDUCTION ON MAIN LINES SHALL HAVE N+1 REDUNDANCY (INSTALLED IN PARALLEL) WITH UPSTREAM AND DOWNSTREAM ISOLATION OF EACH VALVE.
9. DOCUMENTATION MAY NOT INDICATE ALL LOCATIONS OF REQUIRED VALVING. FINAL REQUIREMENTS TO BE DOCUMENTED IN FURTHER DESIGN DEVELOPMENT.
10. WHERE REQUIRED PROVIDE CEILING ACCESS PANELS TO MAINTAIN ACCESS TO ALL VALVING, METERS, TMV'S ETC.
11. PROVIDE BACKFLOW PREVENTION DEVICES AS REQUIRED TO ENSURE THAT ZONE PROTECTION IS RETAINED IN ACCORDANCE WITH AS/NZS3500.1 AND LOCAL AUTHORITY REQUIREMENTS.

B	12.02.2026	SH	ISSUED FOR D&C TENDER	AA	SM
A	18.02.2026	SH	ISSUED FOR REVIEW	AA	SM
REV	DATE	BY	DESCRIPTION	CHK	APP

DESIGN DEVELOPMENT



900 Ann Street, Level 12, Fortitude Valley 4006
Tel: +61-7-3854-6200 Fax: +61-7-3854-6500
<http://www.wsp.com>

CLIENT:

CQU

ARCHITECT:

THOMSON ADSETT / PEDDLE THORP

PROJECT:

CQU ROCKHAMPTON TAFE CONSOLIDATION

TITLE:

HYDRAULIC SERVICES
BUILDING 19 - LEVEL 03 - WATER LAYOUT

SCALE @ A1:

1:100

CHECKED:

AA

APPROVED:

SM

PROJECT NUMBER:

PS229518

DRAWN:

SH

DATE:

JAN 2026

DRAWING NO.:

B19-HY-DR-520-L03-00-00

REV:

B

© WSP Australia Pty Ltd