


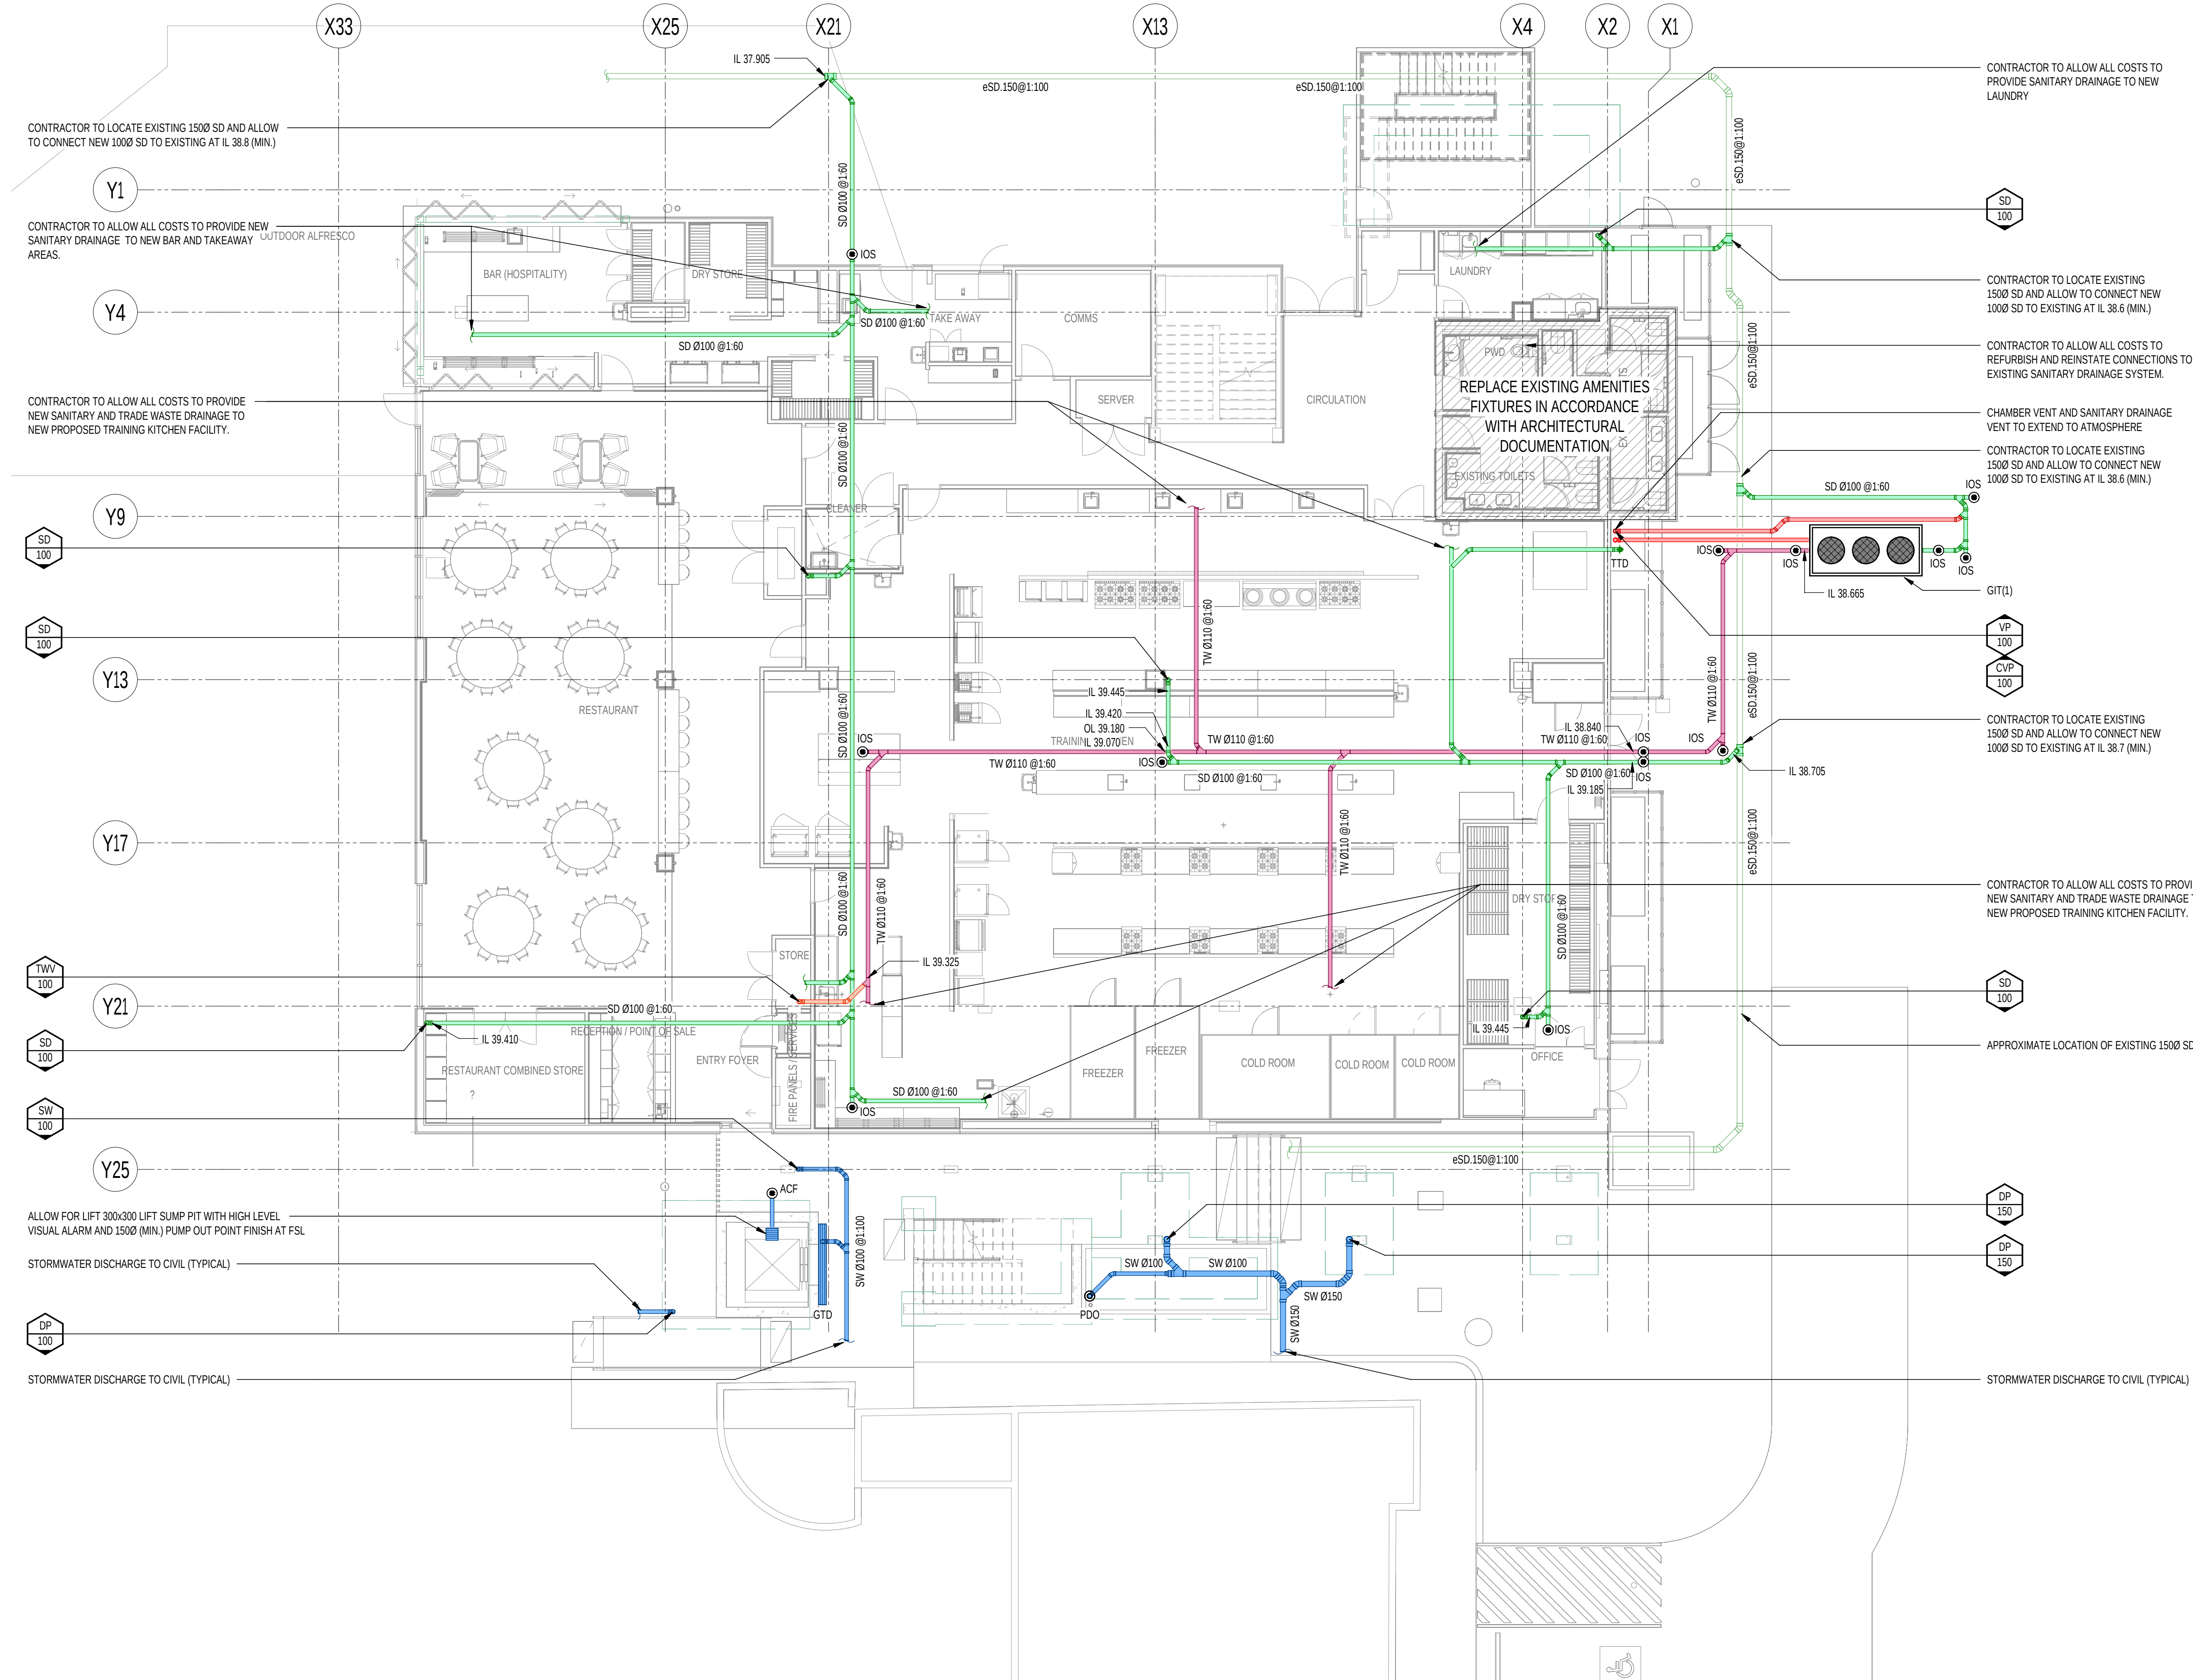

EXISTING SERVICES
SERVICES SHOWN AS EXISTING HAVE BEEN INTERPOLATED FROM RECORD DRAWINGS. CONTRACTOR TO VERIFY LOCATIONS AND LEVELS PRIOR TO COMMENCEMENT OF WORK.

INFORMATION REFLECTED ON THIS DRAWING REPRESENTS HYDRAULIC SERVICES DESIGN DEVELOPED FOR D&C TENDER ADVISE ONLY, AND SHOULD NOT BE REGARDED AS COMPLETE. THE D&C CONTRACTOR SHOULD REFER TO ALL ASSOCIATED ARCHITECTURAL AND OTHER DISCIPLINE DRAWINGS, PROJECT BRIEFS AND CLIENT REQUIREMENTS AND MAKE ADEQUATE ALLOWANCES FOR ALL NECESSARY HYDRAULIC SERVICES WORKS TO MEET THESE REQUIREMENTS, EQUIPMENT SCHEDULES AND COMPLIANCE WITH THE NCC & APPROPRIATE AUSTRALIAN STANDARDS

- DRAINAGE NOTES:**
1. ALLOW ALL COSTS TO CONNECT SANITARY DRAINAGE TO ALL FIXTURES AS REQUIRED.
 2. CO-ORDINATE ALL FLOOR WASTE LOCATIONS WITH ARCHITECT AND IN COMPLIANCE WITH THE NCC, AS/NZS3500.2, AS1428.1.
 3. ALLOW FOR PROVISION OF AN IOS IN COMPLIANCE WITH AS/NZS3500.2 AND TO ALLOW COMPLETE DRAIN ACCESS TO ALL DRAIN LINES COLLECTING MULTIPLE FIXTURES.
 4. DOCUMENTATION MAY NOT INDICATE ALL VENTING REQUIREMENTS AND SHALL BE FINALISED DURING FURTHER DESIGN DEVELOPMENT. VENTING REQUIREMENTS TO BE IN ACCORDANCE WITH AS/NZS3500.2.
 5. ALL PENETRATIONS OR CAST THROUGH CONCRETE STRUCTURE ARE TO BE APPROVED BY THE STRUCTURAL ENGINEER.
 6. ALLOW FOR DRAINAGE ARTICULATION AS REQUIRED AND SUBJECT TO THE FINAL SITE SOIL CLASSIFICATION IN ACCORDANCE WITH AS2870.
 7. VERIFY THAT ALL MECHANICAL DISCHARGE TEMPERATURES DO NOT EXCEED THE MAXIMUM ASSOCIATED WITH THE PIPEWORK MATERIAL. MECHANICAL CONTRACTOR TO PROVIDE DRAIN TEMPERING VALVE PRIOR TO DISCHARGE AS REQUIRED.
 8. CO-ORDINATE WITH ARCHITECT, AND PROVIDE THRESHOLD PROTECTION AT ALL ENTRY POINTS TO THE BUILDING AS REQUIRED TO PREVENT THE INGRESS OF WIND DRIVEN RAIN.
 9. CONTRACTOR TO COORDINATE PROVISIONS WITH FINAL FIRE LAYOUT PROVIDED BY KITCHEN CONTRACTOR (OR ARCHITECT).

B	12.02.2020	SH	DESIGNED FOR D&C TENDER	AA	SM
A	10.02.2020	SH	DRAWN FOR D&C TENDER	AA	SM
REV	DATE	BY	DESCRIPTION	CHK	APP

DESIGN DEVELOPMENT



900 Ann Street, Level 12, Fortitude Valley 4006
Tel: +61-7-3854-6200 Fax: +61-7-3854-6500
<http://www.wsp.com>

CLIENT: CQU

ARCHITECT: THOMSON ADSETT / PEDDLE THORP

PROJECT: CQU ROCKHAMPTON TAFE CONSOLIDATION


TITLE: HYDRAULIC SERVICES
BUILDING 36 - GROUND LEVEL - DRAINAGE LAYOUT

SCALE @ A1	1:100	CHECKED: AA	APPROVED: SM
PROJECT NUMBER: PS229518	DRAWN: SH	DATE: JAN 2020	REV:

B36-HY-DR-510-L00-00-00


B

© WSP Australia Pty Ltd

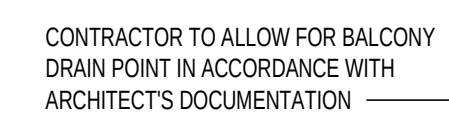


DRAINAGE NOTES:

1. ALLOW ALL COSTS TO CONNECT SANITARY DRAINAGE TO ALL FIXTURES AS REQUIRED.
2. CO-ORDINATE WITH FLOOR SLAB LOCATIONS WITH ARCHITECT AND IN COMPLIANCE WITH THE NCC (AS3500.2, AS1428.1).
3. ALLOW FOR PROVISION OF AN INLET IN COMPLIANCE WITH AS/NZS3500.2.1 TO ALLOW COMPLETE DRAIN ACCESS TO ALL DRAIN LINES INCLUDING MULTIPLE FIXTURES.
4. DOCUMENTATION MAY NOT INDICATE ALL VENTING REQUIREMENTS AND SHALL BE DETERMINED DURING FLOOR CONSTRUCTION DEVELOPMENT. VENTING REQUIREMENTS TO BE IN ACCORDANCE WITH AS/NZS3500.2.1.
5. ALL PENETRATIONS OR CAST THROUGH CONCRETE STRUCTURE ARE TO BE APPROVED BY THE STRUCTURAL ENGINEER.
6. ALL REDUNDANT PENETRATIONS THROUGH STRUCTURAL ELEMENTS ARE TO BE MADE GOOD TO THE SATISFACTION OF THE STRUCTURAL ENGINEER.
7. SERVICES PASSING THROUGH A FIRE RATED STRUCTURE SHALL HAVE FIRE STOPPING (OR OTHER APPROVED FIRE PROTECTION METHOD) RATED TO THE MINIMUM RFL OF THE STRUCTURE IT IS PENETRATING.
8. WHERE PLASTIC SEULITES AND PIPEWORK PASS THROUGH STRUCTURE WHICH IS TO BE FIRE RATED, PROVIDE APPROVED FIRE COLLARS INSTALLED TO THE NCC CODES AND THE MANUFACTURERS REQUIREMENTS TO ENSURE OBTAINING COMPLETELY CLOSED SYSTEMS.
9. VERIFY THAT ALL MECHANICAL DISCHARGE TEMPERATURES DO NOT EXCEED THE MAXIMUM ASSOCIATED WITH THE PIPEWORK MATERIAL. MECHANICAL CONTRACTOR TO PROVIDE DRAIN TEMPERING VALVE PRIOR TO DISCHARGE AS REQUIRED.
10. CO-ORDINATE WITH ARCHITECT, AND PROVIDE THRESHOLD PROTECTION AT ALL ENTRY POINTS TO THE BUILDING AS REQUIRED TO PREVENT THE INGRESS OF WIND DRIVEN RAIN.



INFORMATION REFLECTED ON THIS DRAWING REPRESENTS HYDRAULIC SERVICES DESIGN DEVELOPED FOR D&C TENDER ADVISE ONLY, AND SHOULD NOT BE REGARDED AS COMPLETE. THE D&C CONTRACTOR SHOULD REFER TO ALL ASSOCIATED ARCHITECTURAL AND OTHER DISCIPLINE DRAWINGS, PROJECT BRIEFS AND CLIENT REQUIREMENTS AND MAKE ADEQUATE ALLOWANCES FOR ALL NECESSARY HYDRAULIC SERVICES WORKS TO MEET THESE REQUIREMENTS, EQUIPMENT SCHEDULES AND COMPLIANCE WITH THE NCC & APPROPRIATE AUSTRALIAN STANDARDS

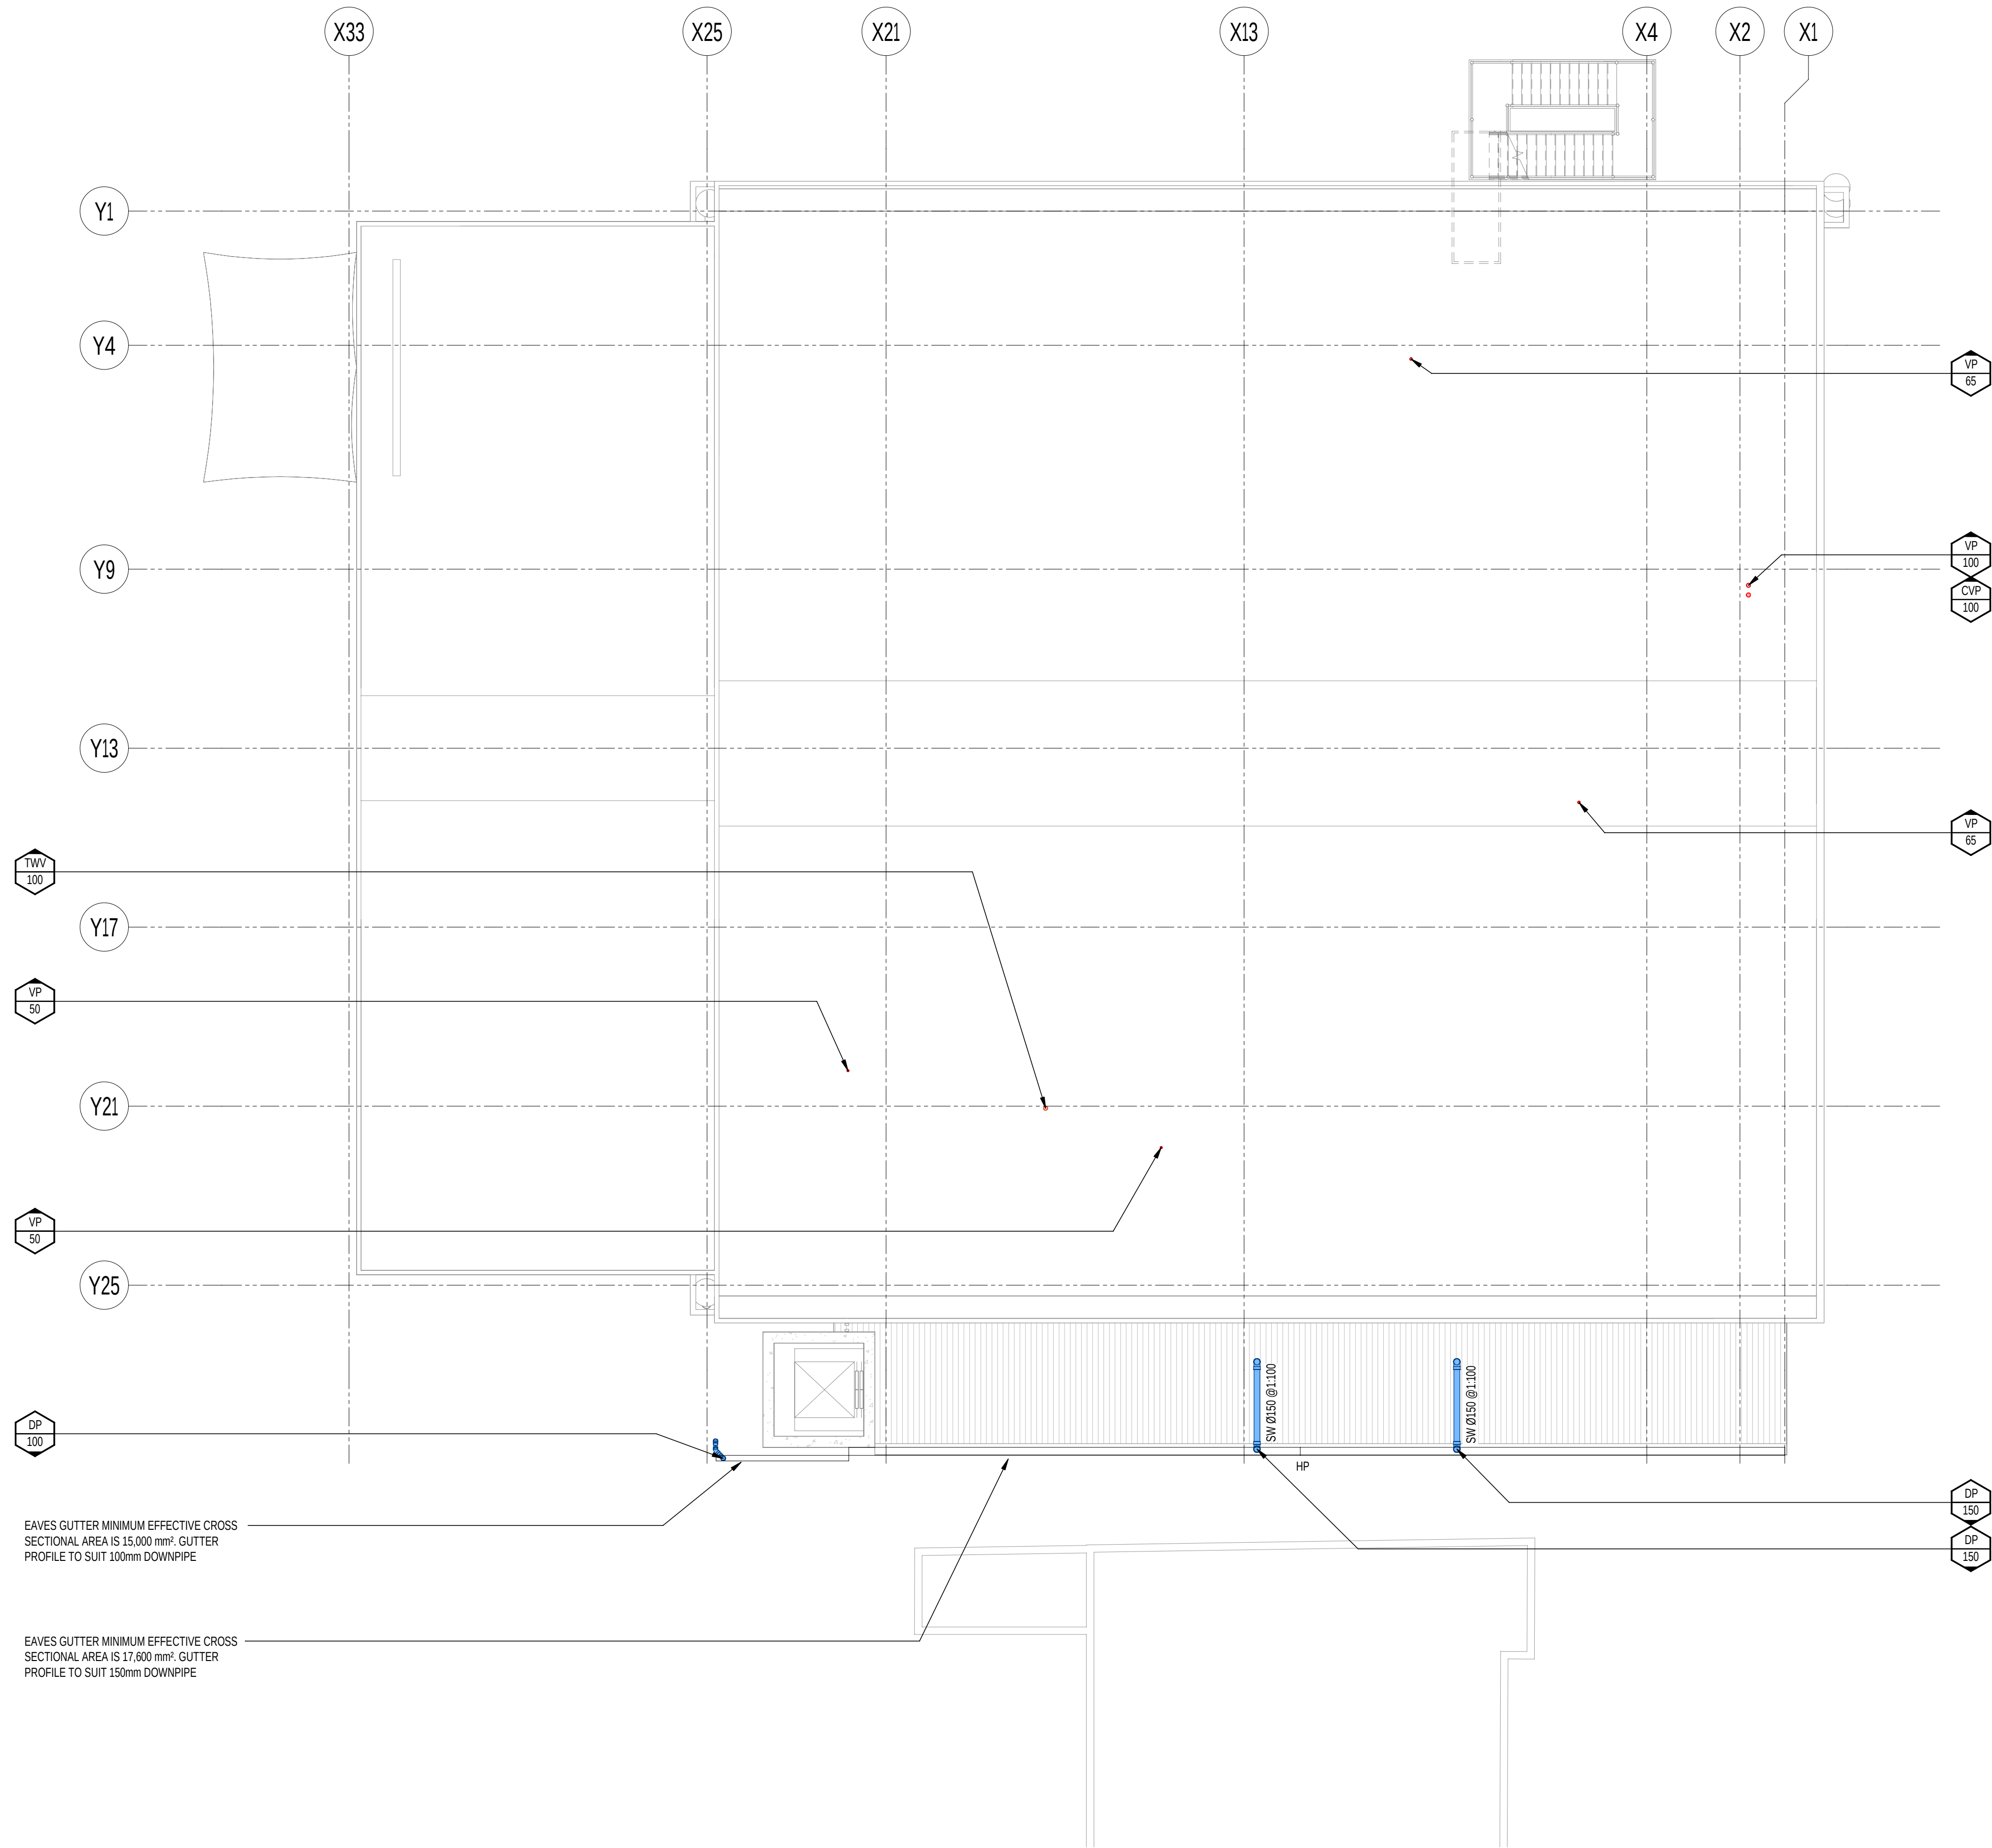

DRAINAGE NOTES:

1. DOCUMENTATION MAY NOT INDICATE ALL VENTING REQUIREMENTS AND SHALL BE FINALISED DURING FURTHER DESIGN DEVELOPMENT. VENTING REQUIREMENTS TO BE IN ACCORDANCE WITH AS/NZS3500.2.
2. ALL WORKS TO BE CO-ORDINATED ON SITE WITH MECHANICAL CONTRACTOR PRIOR TO INSTALLING.
3. FINAL LOCATION OF ALL FITTINGS AND FIXTURES TO BE CO-ORDINATED ON SITE WITH ALL SERVICES.

B		12.02.2026	SH	DESIGNED FOR D&C TENDER	AA	SM
A		18.02.2026	SH	DRAWN FOR REVIEW	AA	SM
REV	DATE	BY	DESCRIPTION	CHK	APP	

DRAWING STATUS: DESIGN DEVELOPMENT



900 Ann Street, Level 12, Fortitude Valley 4006
Tel: +61-7-3854-6200 Fax: +61-7-3854-6500
<http://www.wsp.com>

CLIENT: CQU

ARCHITECT: THOMSON ADSETT / PEDDLE THORP


PROJECT: CQU ROCKHAMPTON TAFE CONSOLIDATION

TITLE: HYDRAULIC SERVICES
BUILDING 36 - ROOF LEVEL - DRAINAGE LAYOUT


SCALE @ A1	1:100	CHECKED: AA	APPROVED: SM
PROJECT NUMBER:	PS229518	DRAWN: SH	DATE: JAN 2026

DRAWING NO: B36-HY-DR-510-LRF-00-00

© WSP Australia Pty Ltd



INFORMATION REFLECTED ON THIS DRAWING REPRESENTS HYDRAULIC SERVICES DESIGN DEVELOPED FOR D&C TENDER ADVISE ONLY, AND SHOULD NOT BE REGARDED AS COMPLETE. THE D&C CONTRACTOR SHOULD REFER TO ALL ASSOCIATED ARCHITECTURAL AND OTHER DISCIPLINE DRAWINGS, PROJECT BRIEFS AND CLIENT REQUIREMENTS AND MAKE ADEQUATE ALLOWANCES FOR ALL NECESSARY HYDRAULIC SERVICES WORKS TO MEET THESE REQUIREMENTS, EQUIPMENT SCHEDULES AND COMPLIANCE WITH THE NCC & APPROPRIATE AUSTRALIAN STANDARDS

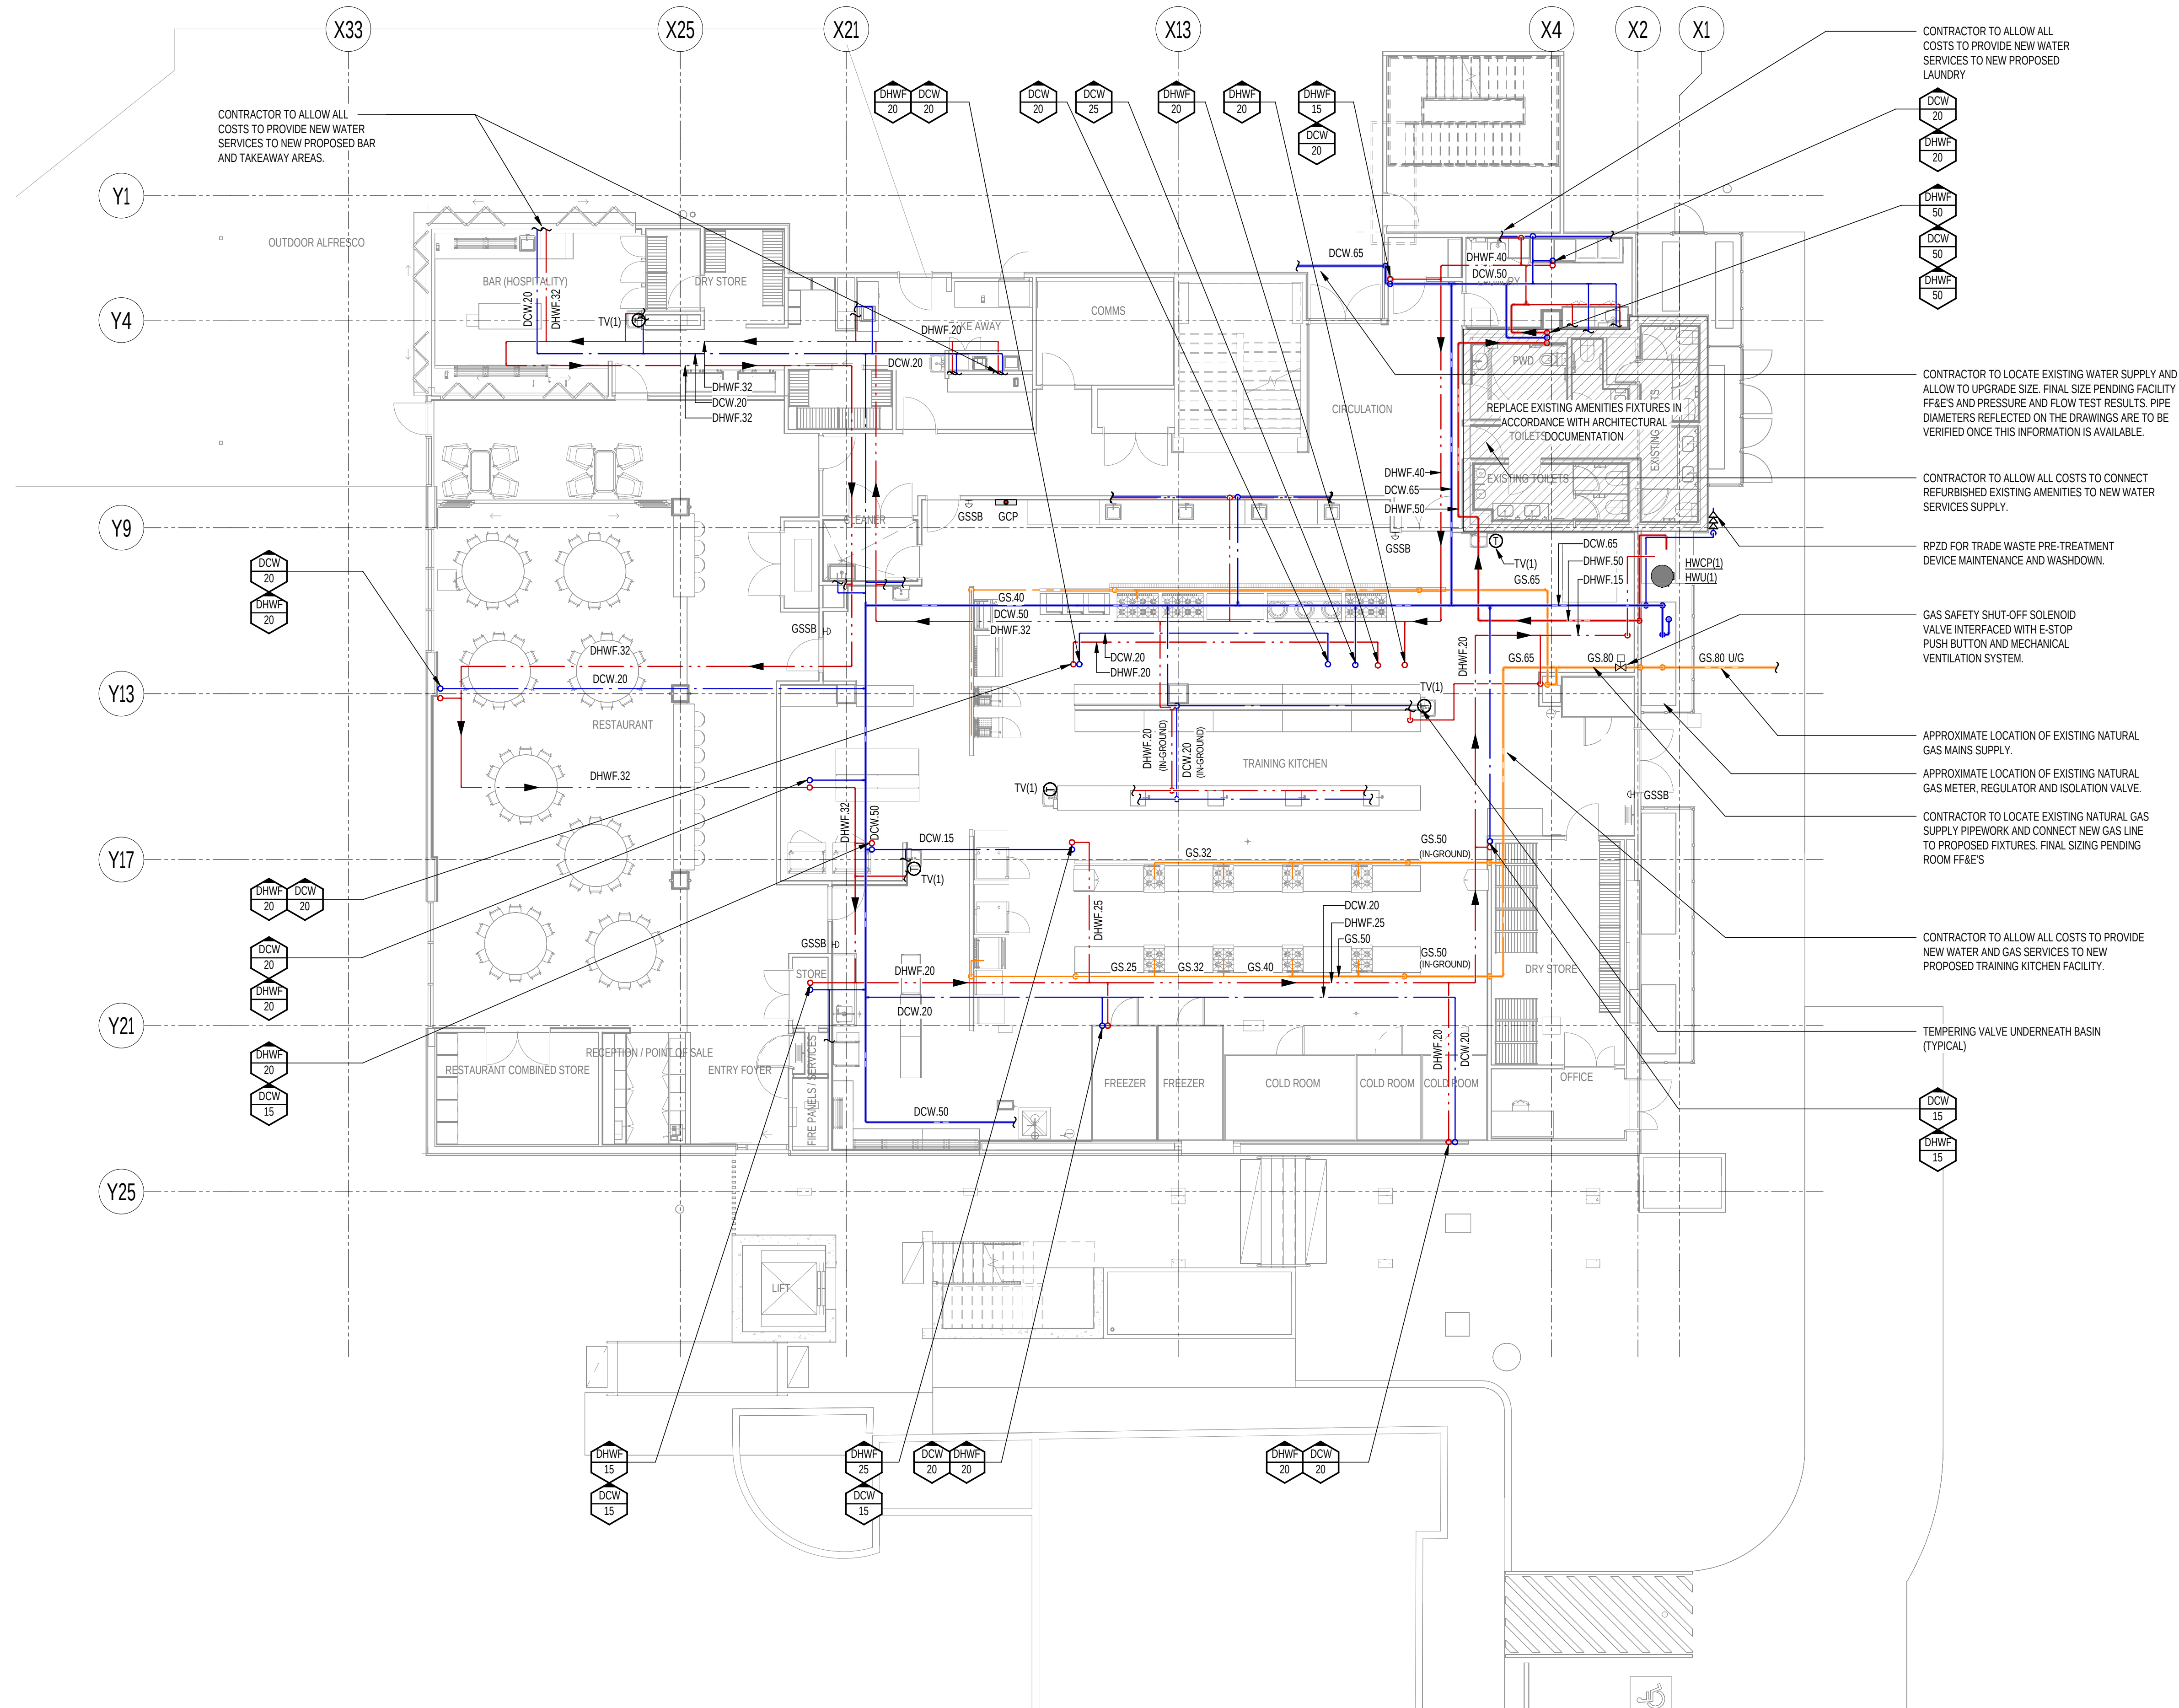

EXISTING SERVICES
SERVICES SHOWN AS EXISTING HAVE BEEN INTERPOLATED FROM RECORD DRAWINGS. CONTRACTOR TO VERIFY LOCATIONS AND LEVELS PRIOR TO COMMENCEMENT OF WORK.

- WATER NOTES:**
1. ALLOW ALL COSTS TO RETICULATE ALL HOT AND COLD WATER FROM AREA ISOLATION OR TMV TO FIXTURES WITHIN THE ROOM.
 2. HOT WATER DEAD LEG LENGTH FROM CIRCULATION LOOP SHALL NOT EXCEED THE MAXIMUM VOLUME PRESCRIBED IN AS/NZS 3804.
 3. ALL FIXTURES ARE TO HAVE MIN ISOLATION VALVES AT POINT OF CONNECTION FOR TAPWARE WITH FLEXIBLE HOSES, OR ARE TO BE ISOLATED BY MEANS OF ISOLATING ONLY THE ROOM INDEPENDENTLY FROM THE REMAINDER OF THE BUILDING.
 4. ALL PENETRATIONS OR CAST THROUGH CONCRETE STRUCTURE ARE TO BE APPROVED BY THE STRUCTURAL ENGINEER.
 5. PROVIDE PRESSURE REDUCTION AS REQUIRED TO ENSURE THAT ALL FIXTURES HAVE A PRESSURE WITHIN THE MAXIMUM AND MINIMUM ALLOWABLE PRESSURES SPECIFIED IN THE SPECIFICATION. ALL PRESSURE REDUCTION ON MAIN LINES SHALL HAVE IN REDUNDANCY (INSTALLED IN PARALLEL) WITH UPSTREAM AND DOWNSTREAM ISOLATION OF EACH VALVE.
 6. DOCUMENTATION MAY NOT INDICATE ALL LOCATIONS OF REQUIRED VALVING. FINAL REQUIREMENTS TO BE DOCUMENTED IN FURTHER DESIGN DEVELOPMENT.
 7. WHERE REQUIRED PROVIDE CEILING ACCESS PANELS TO MAINTAIN ACCESS TO ALL VALVING, METERS, TMV'S ETC.
 8. PROVIDE BACKFLOW PREVENTION DEVICES AS REQUIRED TO ENSURE THAT ZONE PROTECTION IS RETAINED IN ACCORDANCE WITH AS/NZS550.1 AND LOCAL AUTHORITY REQUIREMENTS.
 9. CONTRACTOR TO REFER TO STRUCTURAL DRAWINGS BEFORE CONCRETE CUTTING. ALLOW ALL COSTS FOR CUTTING AND REINSTATEMENT AS REQUIRED.
 10. CONTRACTOR TO COORDINATE PROVISIONS WITH FINAL F&E LAYOUT PROVIDED BY KITCHEN CONTRACTOR (OR ARCHITECT).

B	12.02.2026	SH	ISSUED FOR D&C TENDER	AA	SM
A	10.02.2026	SH	DRAFT FOR D&C REVIEW	AA	SM
REV	DATE	BY	DESCRIPTION	CHK	APP

DESIGN DEVELOPMENT



900 Ann Street, Level 12, Fortitude Valley 4006
Tel: +61-7-3854-6200 Fax: +61-7-3854-6500
<http://www.wsp.com>

CLIENT: CQU
ARCHITECT: THOMSON ADSETT / PEDDLE THORP



PROJECT: CQU ROCKHAMPTON TAFE CONSOLIDATION

TITLE: HYDRAULIC SERVICES
BUILDING 36 - GROUND LEVEL - WATER SERVICES LAYOUT

SCALE @ A1	1:100	CHECKED: AA	APPROVED: SM
PROJECT NUMBER: PS229518	DRAWN: SH	DATE: JAN 2026	

DRAWING NO: B36-HY-DR-520-L00-00-00	REV: B
-------------------------------------	--------

© WSP Australia Pty Ltd

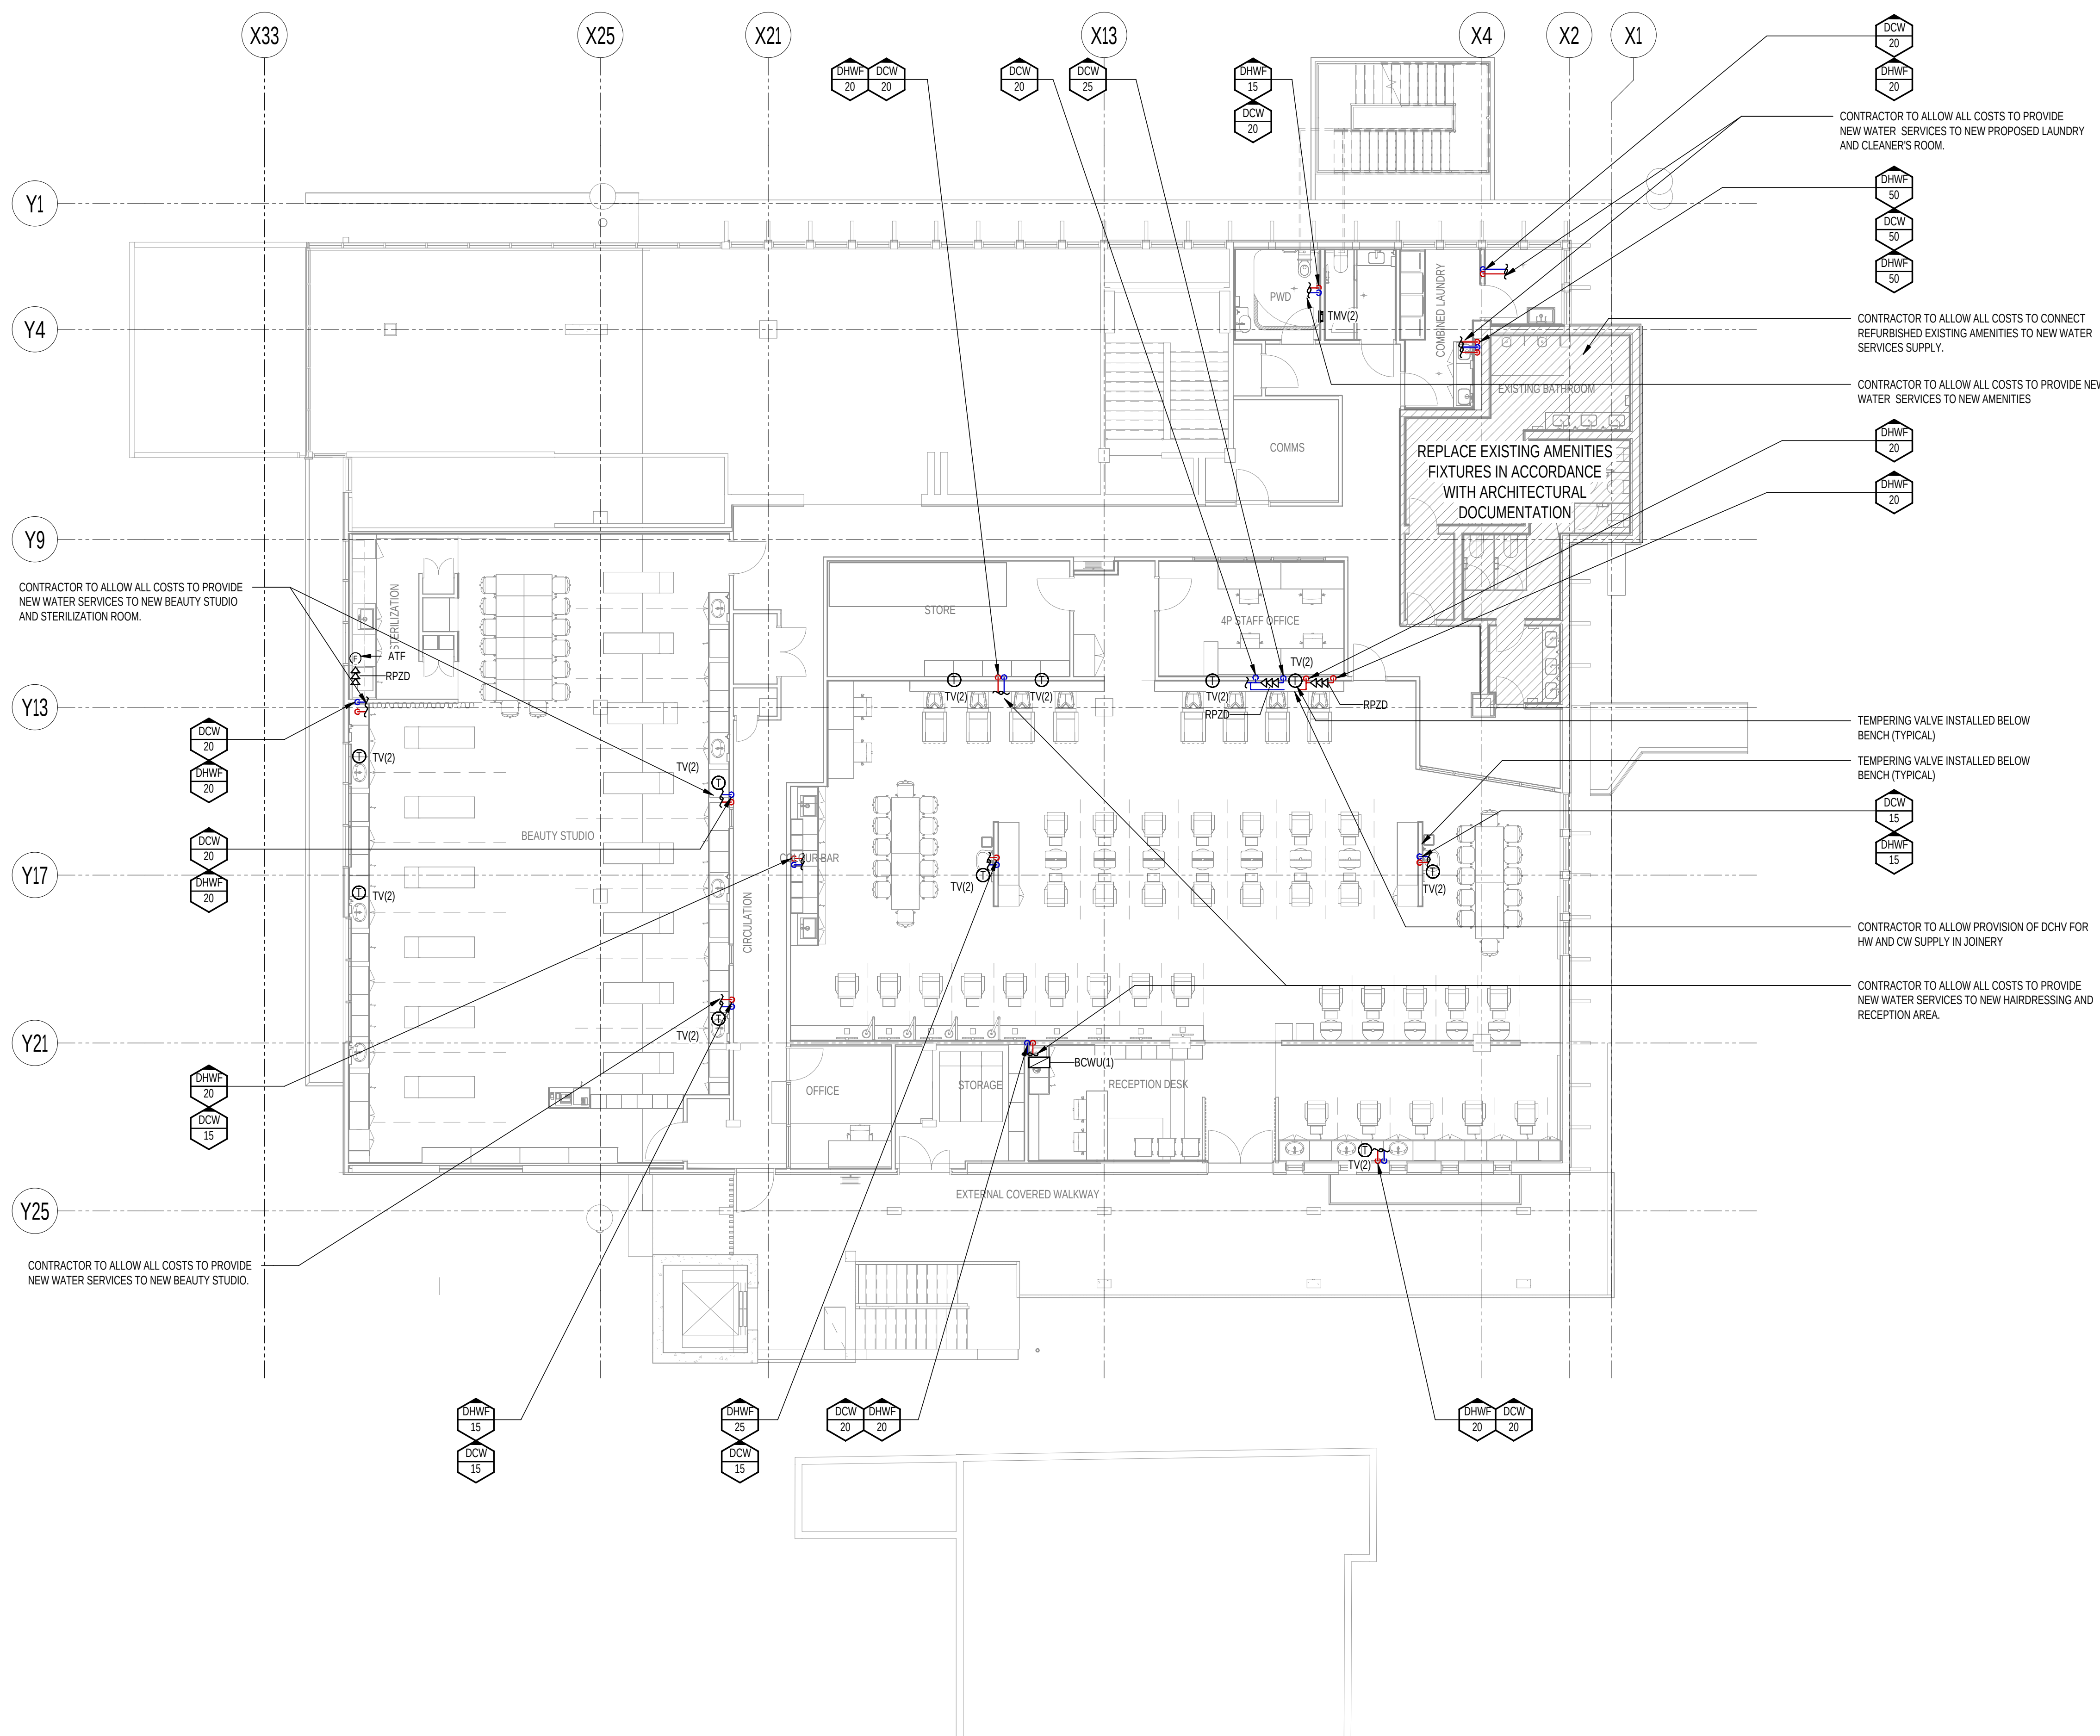

INFORMATION REFLECTED ON THIS DRAWING REPRESENTS HYDRAULIC SERVICES DESIGN DEVELOPED FOR D&C TENDER ADVISE ONLY, AND SHOULD NOT BE REGARDED AS COMPLETE. THE D&C CONTRACTOR SHOULD REFER TO ALL ASSOCIATED ARCHITECTURAL AND OTHER DISCIPLINE DRAWINGS, PROJECT BRIEFS AND CLIENT REQUIREMENTS AND MAKE ADEQUATE ALLOWANCES FOR ALL NECESSARY HYDRAULIC SERVICES WORKS TO MEET THESE REQUIREMENTS, EQUIPMENT SCHEDULES AND COMPLIANCE WITH THE NCC & APPROPRIATE AUSTRALIAN STANDARDS

WATER NOTES:

1. ALLOW ALL COSTS TO RETICULATE ALL HOT AND COLD WATER FROM AREA ISOLATION OR TMV TO FIXTURES WITHIN THE ROOM.
2. ALL FIXTURES ARE TO HAVE MINI ISOLATION VALVES AT POINT OF CONNECTION FOR TAPWARE WITH FLEXIBLE HOSES, OR ARE TO BE ISOLATED BY MEANS OF ISOLATING ONLY THE ROOM INDEPENDENTLY FROM THE REMAINDER OF THE BUILDING.
3. ALL PENETRATIONS OR CAST THROUGH CONCRETE STRUCTURE ARE TO BE APPROVED BY THE STRUCTURAL ENGINEER.
4. ALL REDUNDANT PENETRATIONS THROUGH STRUCTURAL ELEMENTS ARE TO BE MADE GOOD TO THE SATISFACTION OF THE STRUCTURAL ENGINEER.
5. SERVICES PASSING THROUGH A FIRE RATED STRUCTURE SHALL HAVE FIRE COLLARS (OR OTHER APPROVED FIRE PROTECTION METHOD) RATED TO THE MINIMUM FRL OF THE STRUCTURE IT IS PENETRATING.
6. WHERE METAL PIPEWORK PASSES THROUGH STRUCTURE WHICH IS TO BE FIRE RATED, MINIMISE THE PENETRATION SIZE AND PACK AROUND PIPEWORK WITH APPROVED INTUMESCENT SEALANT TO THE NCC C4015 AND THE MANUFACTURERS REQUIREMENTS TO ENSURE OPENINGS ARE COMPLETELY CLOSED IN THE EVENT OF A FIRE.
7. PROVIDE PRESSURE REDUCTION AS REQUIRED TO ENSURE THAT ALL FIXTURES HAVE A PRESSURE WITHIN THE MAXIMUM AND MINIMUM ALLOWABLE PRESSURES SPECIFIED IN THE SPECIFICATION. ALL PRESSURE REDUCTION ON MAIN LINES SHALL HAVE N+1 REDUNDANCY (INSTALLED IN PARALLEL) WITH UPSTREAM AND DOWNSTREAM ISOLATION OF EACH VALVE.
8. DOCUMENTATION MAY NOT INDICATE ALL LOCATIONS OF REQUIRED VALVING. FINAL REQUIREMENTS TO BE DOCUMENTED IN FURTHER DESIGN DEVELOPMENT.
9. WHERE REQUIRED PROVIDE CEILING ACCESS PANELS TO MAINTAIN ACCESS TO ALL VALVING, METERS, TMV'S ETC.
10. PROVIDE BACKFLOW PREVENTION DEVICES AS REQUIRED TO ENSURE THAT ZONE PROTECTION IS RETAINED IN ACCORDANCE WITH AS/NZS3500.1 AND LOCAL AUTHORITY REQUIREMENTS.

B	12.02.2026	SH	ISSUED FOR D&C TENDER	AA	SM
A	10.02.2026	SH	DRAFT FOR REVIEW	AA	SM
REV	DATE	BY	DESCRIPTION	CHK	APP

DESIGN DEVELOPMENT



900 Ann Street, Level 12, Fortitude Valley 4006
Tel: +61-7-3854-6200 Fax: +61-7-3854-6500
<http://www.wsp.com>

CLIENT:

CQU

ARCHITECT:

THOMSON ADSETT / PEDDLE THORP

PROJECT:

CQU ROCKHAMPTON TAFE CONSOLIDATION

TITLE:

HYDRAULIC SERVICES
BUILDING 36 - LEVEL 01 - WATER SERVICES
LAYOUT

SCALE @ A1:

1:100

CHECKED:

AA

APPROVED:

SM

PROJECT NUMBER:

PS229518

DRAWN:

SH

DATE:

JAN 2026

DRAWING NO:

B36-HY-DR-520-L01-00-00

REV:

B

© WSP Australia Pty Ltd