
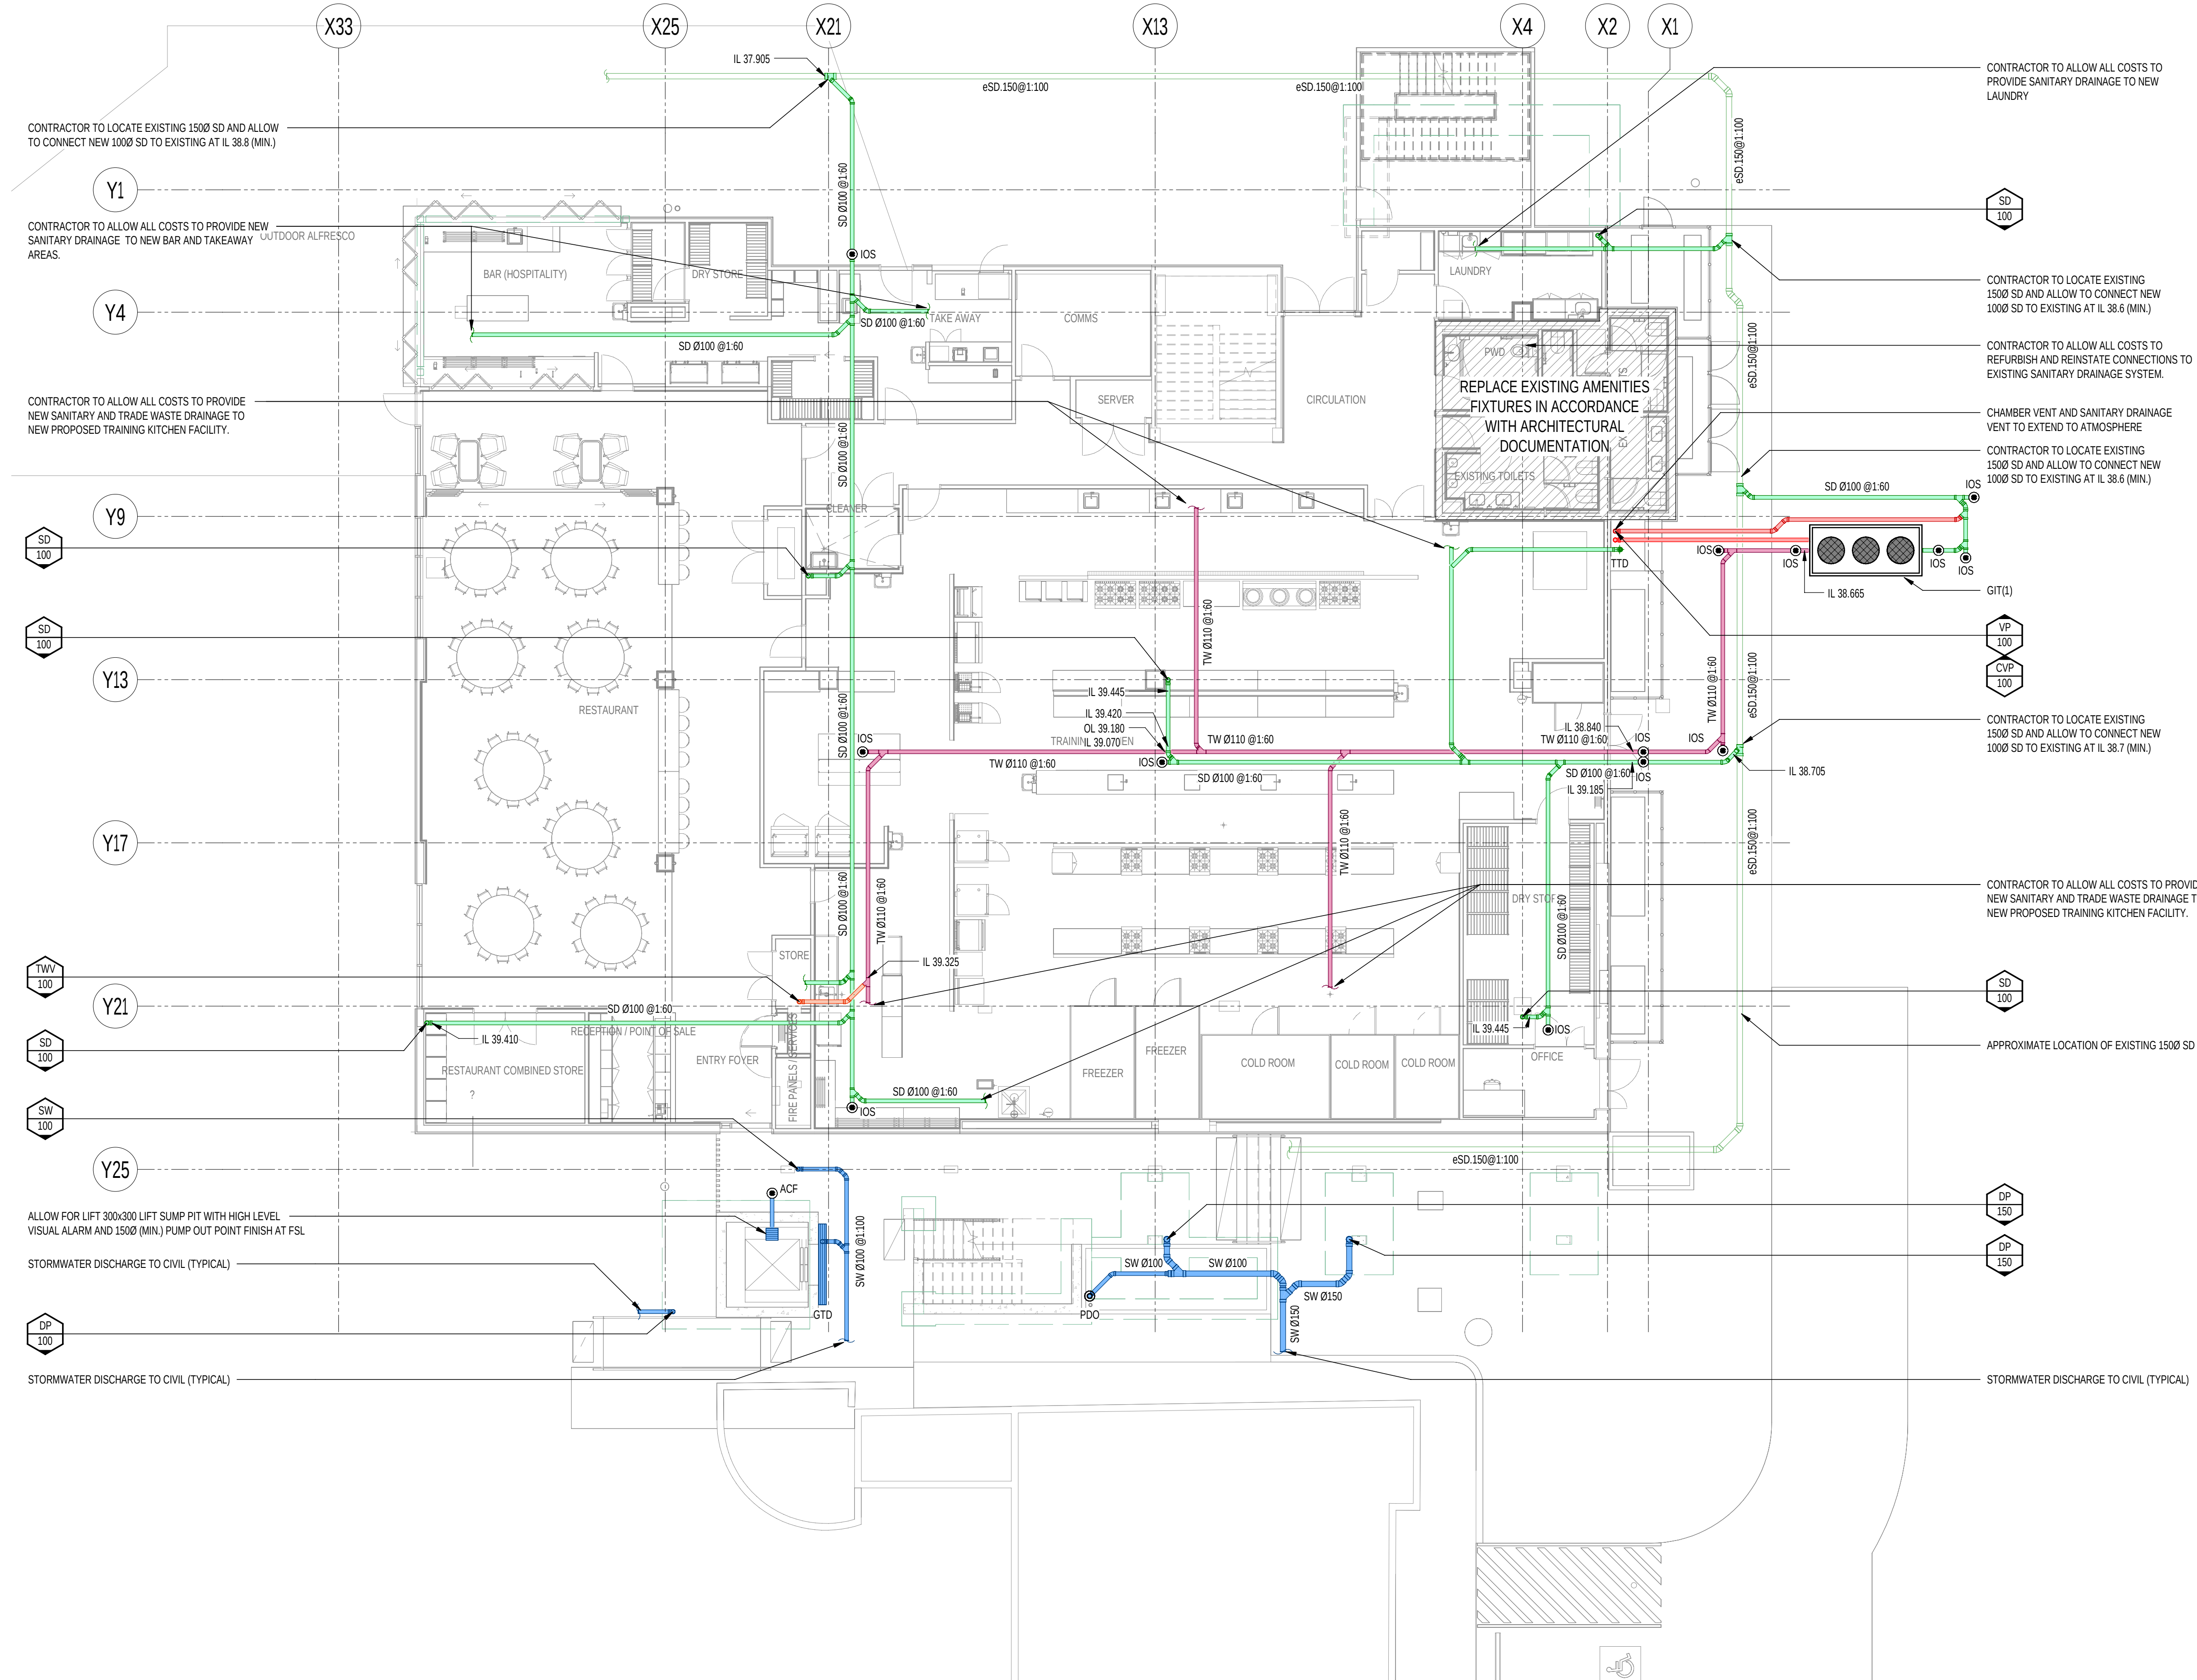




**EXISTING SERVICES**  
SERVICES SHOWN AS EXISTING HAVE BEEN INTERPOLATED FROM RECORD DRAWINGS. CONTRACTOR TO VERIFY LOCATIONS AND LEVELS PRIOR TO COMMENCEMENT OF WORK.

INFORMATION REFLECTED ON THIS DRAWING REPRESENTS HYDRAULIC SERVICES DESIGN DEVELOPED FOR D&C TENDER ADVISE ONLY, AND SHOULD NOT BE REGARDED AS COMPLETE. THE D&C CONTRACTOR SHOULD REFER TO ALL ASSOCIATED ARCHITECTURAL AND OTHER DISCIPLINE DRAWINGS, PROJECT BRIEFS AND CLIENT REQUIREMENTS AND MAKE ADEQUATE ALLOWANCES FOR ALL NECESSARY HYDRAULIC SERVICES WORKS TO MEET THESE REQUIREMENTS, EQUIPMENT SCHEDULES AND COMPLIANCE WITH THE NCC & APPROPRIATE AUSTRALIAN STANDARDS

- DRAINAGE NOTES:**
1. ALLOW ALL COSTS TO CONNECT SANITARY DRAINAGE TO ALL FIXTURES AS REQUIRED.
  2. CO-ORDINATE ALL FLOOR WASTE LOCATIONS WITH ARCHITECT AND IN COMPLIANCE WITH THE NCC, AS/NZS3500.2, AS1428.1.
  3. ALLOW FOR PROVISION OF AN IOS IN COMPLIANCE WITH AS/NZS3500.2 AND TO ALLOW COMPLETE DRAIN ACCESS TO ALL DRAIN LINES COLLECTING MULTIPLE FIXTURES.
  4. DOCUMENTATION MAY NOT INDICATE ALL VENTING REQUIREMENTS AND SHALL BE FINALISED DURING FURTHER DESIGN DEVELOPMENT. VENTING REQUIREMENTS TO BE IN ACCORDANCE WITH AS/NZS3500.2.
  5. ALL PENETRATIONS OR CAST THROUGH CONCRETE STRUCTURE ARE TO BE APPROVED BY THE STRUCTURAL ENGINEER.
  6. ALLOW FOR DRAINAGE ARTICULATION AS REQUIRED AND SUBJECT TO THE FINAL SITE SOIL CLASSIFICATION IN ACCORDANCE WITH AS2870.
  7. VERIFY THAT ALL MECHANICAL DISCHARGE TEMPERATURES DO NOT EXCEED THE MAXIMUM ASSOCIATED WITH THE PIPEWORK MATERIAL. MECHANICAL CONTRACTOR TO PROVIDE DRAIN TEMPERING VALVE PRIOR TO DISCHARGE AS REQUIRED.
  8. CO-ORDINATE WITH ARCHITECT, AND PROVIDE THRESHOLD PROTECTION AT ALL ENTRY POINTS TO THE BUILDING AS REQUIRED TO PREVENT THE INGRESS OF WIND DRIVEN RAIN.
  9. CONTRACTOR TO COORDINATE PROVISIONS WITH FINAL FIRE LAYOUT PROVIDED BY KITCHEN CONTRACTOR (OR ARCHITECT).

|     |            |    |                         |     |     |
|-----|------------|----|-------------------------|-----|-----|
| B   | 12.02.2026 | SH | DESIGNED FOR D&C TENDER | AA  | SM  |
| A   | 10.02.2026 | SH | DRAWN FOR D&C TENDER    | AA  | SM  |
| REV | DATE       | BY | DESCRIPTION             | CHK | APP |

DESIGN DEVELOPMENT



900 Ann Street, Level 12, Fortitude Valley 4006  
Tel: +61-7-3854-6200 Fax: +61-7-3854-6500  
<http://www.wsp.com>

CLIENT: CQU

ARCHITECT: THOMSON ADSETT / PEDDLE THORP

PROJECT: CQU ROCKHAMPTON TAFE CONSOLIDATION

TITLE: HYDRAULIC SERVICES  
BUILDING 36 - GROUND LEVEL - DRAINAGE LAYOUT

|                          |           |                |              |
|--------------------------|-----------|----------------|--------------|
| SCALE @ A1               | 1:100     | CHECKED: AA    | APPROVED: SM |
| PROJECT NUMBER: PS229518 | DRAWN: SH | DATE: JAN 2026 | REV:         |

B36-HY-DR-510-L00-00-00

B

© WSP Australia Pty Ltd