


NOTES.

- FCU-36-G-01, FCU-36-G-06 TO 13 & FCU-36-G-15 TO 16.
SUPPLY DUCT RUNS TO HAVE A MINIMUM 2M OF 75mm THICK ACOUSTIC LINING BEFORE FIRST TAKE-OFF. RA PLENUMS TO BE INTERNALLY LINED WITH 75mm THICK ACOUSTIC LINING. RETURN DUCT RUNS TO HAVE MINIMUM 1M OF 75mm THICK ACOUSTIC LINING AND ONE UNID ELBOW BEFORE FIRST TAKE-OFF.
- FCU-36-G-02 TO 05.
SUPPLY DUCT RUNS TO HAVE A MINIMUM 2.5M OF 75mm THICK ACOUSTIC LINING BEFORE FIRST TAKE-OFF. RA PLENUMS TO BE INTERNALLY LINED WITH 75mm THICK ACOUSTIC LINING. RETURN DUCT RUNS TO HAVE MINIMUM 1M OF 75mm THICK ACOUSTIC LINING AND ONE UNID ELBOW BEFORE FIRST TAKE-OFF. FCU TO BE WRAPPED EXTERNALLY IN ACOUSTIC INSULATION, MINIMUM SURFACE MASS DENSITY OF 5kg/m².

INFORMATION REFLECTED ON THIS DRAWING REPRESENTS MECHANICAL SERVICES DESIGN DEVELOPED FOR D&C TENDER ADVISE ONLY, AND SHOULD NOT BE REGARDED AS COMPLETE. THE D&C CONTRACTOR SHOULD REFER TO ALL ASSOCIATED ARCHITECTURAL AND OTHER DISCIPLINE DRAWINGS, PROJECT BRIEFS AND CLIENT REQUIREMENTS AND MAKE ADEQUATE ALLOWANCES FOR ALL NECESSARY MECHANICAL SERVICES WORKS TO MEET THESE REQUIREMENTS. EQUIPMENT SCHEDULES AND COMPLIANCE WITH THE NCC & APPROPRIATE AUSTRALIAN STANDARDS

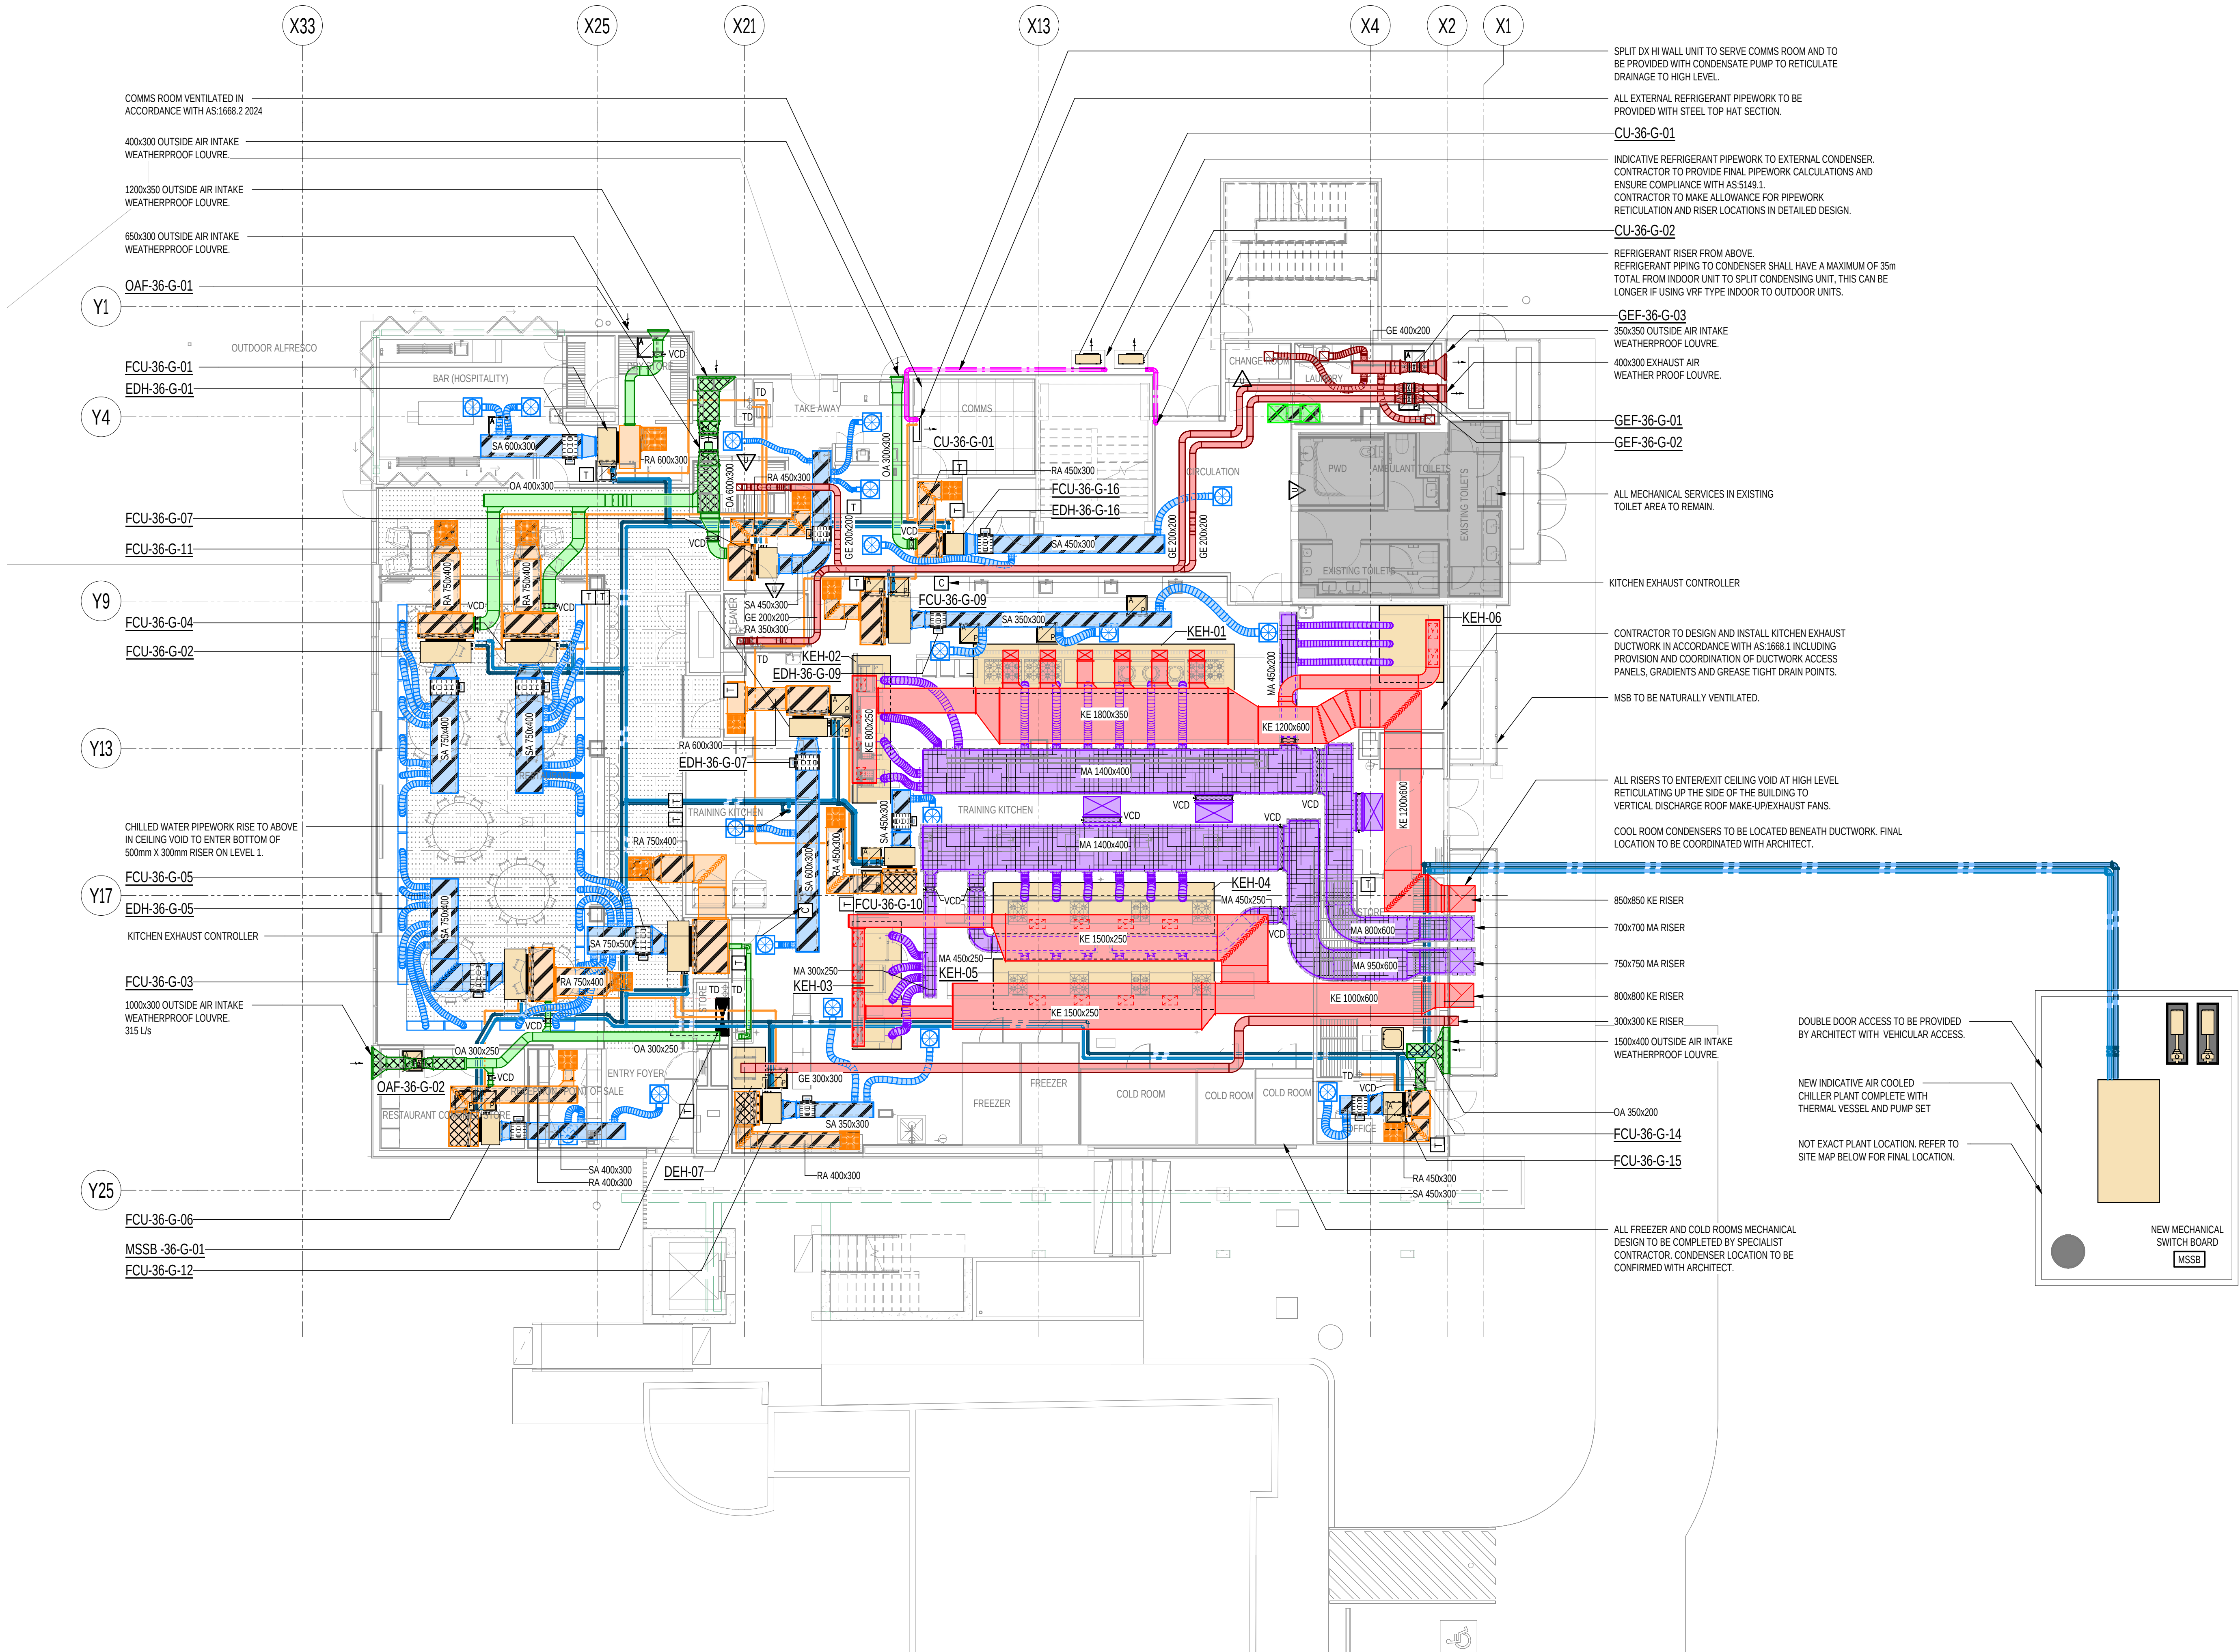

CHILLED WATER PIPE
RETICULATION TO
CHILLED WATER PLANT.

BUILDING 36 CENTRAL
CHILLER PLANT COMPOUND.



B	12.02.2026	RD	ISSUED FOR D&C TENDER	MB	SM
A	16.02.2026	RD	DRAFT FOR D&C REVIEW	MB	SM
REV	DATE	BY	DESCRIPTION	CHK	APP

DRAWING STATUS: DESIGN DEVELOPMENT



900 Ann Street, Level 12, Fortitude Valley 4006
Tel: +61-7-3854-6200 Fax: +61-7-3854-6500
<http://www.wsp.com>

CLIENT: CQU

ARCHITECT: THOMSON ADSETT / PEDDLE THORP

PROJECT: CQU ROCKHAMPTON TAFE CONSOLIDATION

TITLE: MECHANICAL SERVICES
BUILDING 36 - GROUND LEVEL - HVAC LAYOUT

SCALE @ A1	CHECKED	APPROVED
1:100	MB	SM
PROJECT NUMBER: PS229518	DRAWN: RD	DATE: FEB 2026
DRAWING NO:	REV:	

B36-ME-DR-510-L00-00-00

B

© WSP Australia Pty Ltd