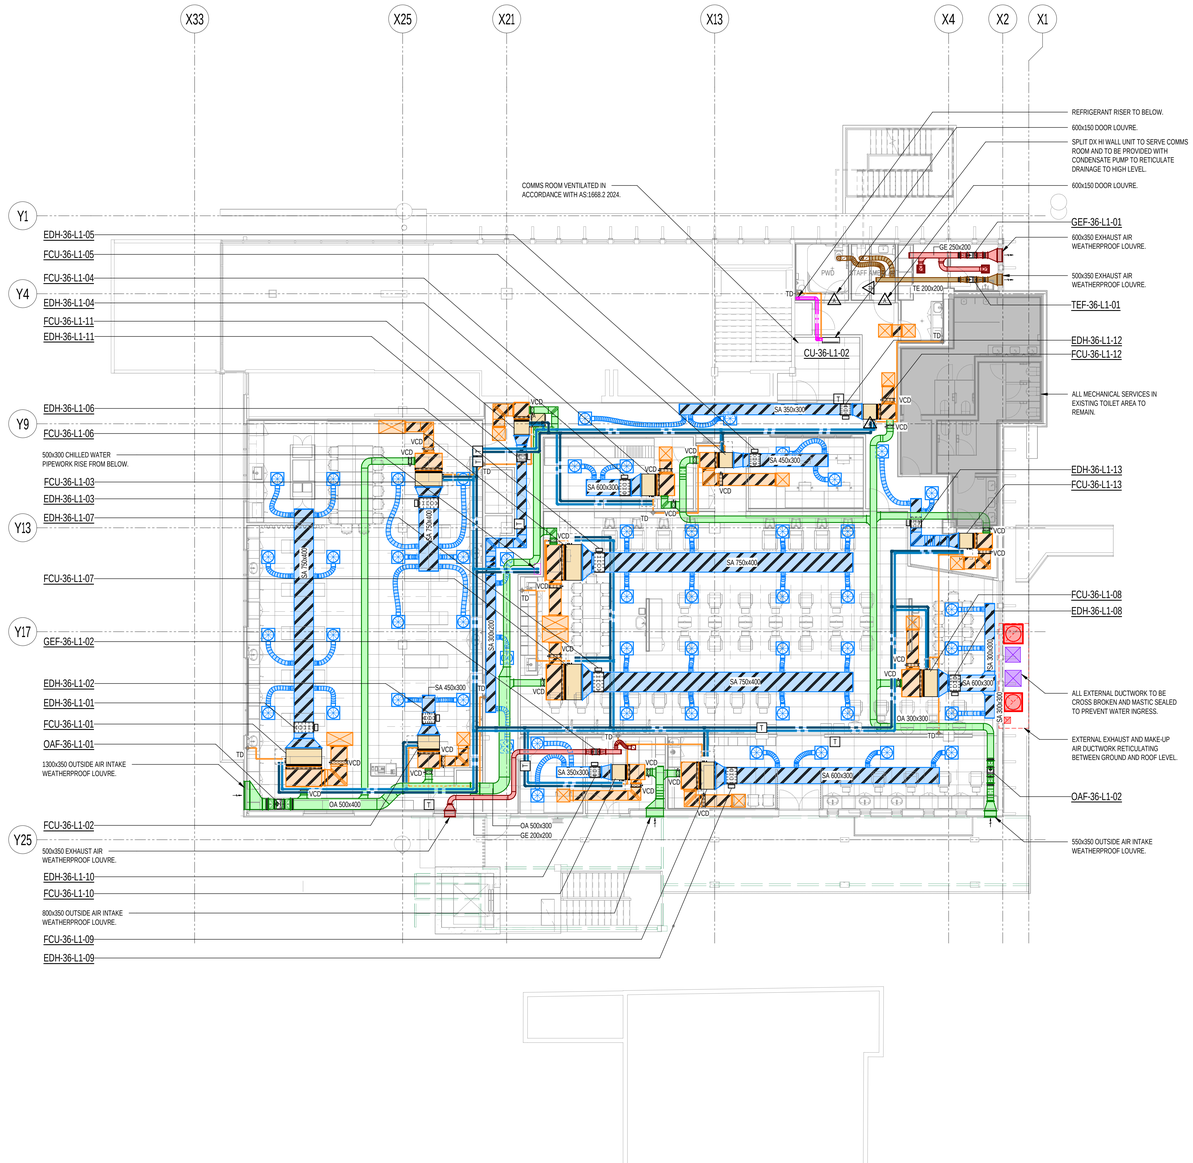

NOTES:

1. FCU-36-L1-04, FCU-36-L1-10 TO 13.
   SUPPLY DUCT RUNS TO HAVE A MINIMUM 1.5M OF 75mm THICK ACOUSTIC LINING BEFORE FIRST TAKE-OFF. RA PLENUMS TO BE INTERNALLY LINED WITH 75mm THICK ACOUSTIC LINING. RETURN DUCT RUNS TO HAVE MINIMUM 1M OF 75MM THICK ACOUSTIC LINING AND ONE LINED ELBOW BEFORE FIRST TAKE-OFF.

2. FCU-36-L1-05.
   SUPPLY DUCT RUNS TO HAVE A MINIMUM 2M OF 75mm THICK ACOUSTIC LINING BEFORE FIRST TAKE-OFF. RA PLENUMS TO BE INTERNALLY LINED WITH 75mm THICK ACOUSTIC LINING. RETURN DUCT RUNS TO HAVE MINIMUM 1M OF 75MM THICK ACOUSTIC LINING AND ONE LINED ELBOW BEFORE FIRST TAKE-OFF.

3. FCU-36-L1-02.
   SUPPLY DUCT RUNS TO HAVE A MINIMUM 1.5M OF 75mm THICK ACOUSTIC LINING BEFORE FIRST TAKE-OFF. RA PLENUMS TO BE INTERNALLY LINED WITH 75mm THICK ACOUSTIC LINING. RETURN DUCT RUNS TO HAVE MINIMUM 1M OF 75MM THICK ACOUSTIC LINING AND ONE LINED ELBOW BEFORE FIRST TAKE-OFF. FCUs TO BE WRAPPED EXTERNALLY IN ACCOUSTIC INSULATION, MINIMUM SURFACE MASS DENSITY OF 9kg/m^2.

4. FCU-36-L1-01, FCU-36-L1-03, FCU-36-L1-06 TO 09 & FCU-36-L1-09.
   SUPPLY DUCT RUNS TO HAVE A MINIMUM 2M OF 75mm THICK ACOUSTIC LINING BEFORE FIRST TAKE-OFF. RA PLENUMS TO BE INTERNALLY LINED WITH 75mm THICK ACOUSTIC LINING. RETURN DUCT RUNS TO HAVE MINIMUM 1M OF 75MM THICK ACOUSTIC LINING AND ONE LINED ELBOW BEFORE FIRST TAKE-OFF.

INFORMATION REFLECTED ON THIS DRAWING REPRESENTS MECHANICAL SERVICES DESIGN DEVELOPED FOR D&C TENDER ADVICE ONLY, AND SHOULD NOT BE REGARDED AS COMPLETE. THE D&C CONTRACTOR SHOULD REFER TO ALL ASSOCIATED ARCHITECTURAL AND OTHER DISCIPLINE DRAWINGS, PROJECT BRIEFS AND CLIENT REQUIREMENTS AND MAKE ADEQUATE ALLOWANCES FOR ALL NECESSARY MECHANICAL SERVICES WORKS TO MEET THESE REQUIREMENTS, EQUIPMENT SCHEDULES AND COMPLIANCE WITH THE NCC & APPROPRIATE AUSTRALIAN STANDARDS

REV	DATE	BY	DESCRIPTION	CHK	APP
B	12.02.2026	RD	ISSUED FOR D&C TENDER	MB	SM
A	30.01.2026	RD	DRAFT 60% DD ISSUE FOR REVIEW	MB	SM

DRAWING STATUS: DESIGN DEVELOPMENT

900 Ann Street, Level 12, Fortitude Valley 4006
Tel: +61-7-3854-6200 Fax: +61-7-3854-6500
http://www.wsp.com

CLIENT: CQU

ARCHITECT: THOMSON ADSETT / PEDDLE THORP

PROJECT: CQU ROCKHAMPTON TAFE CONSOLIDATION

TITLE: MECHANICAL SERVICES
BUILDING 36 - LEVEL 01 - HVAC LAYOUT

SCALE @ A0	CHECKED:	APPROVED:
1:100	MB	SM
PROJECT NUMBER	DRAWN:	DATE:
PS229518	RD	JAN 2026

DRAWING No: B36-ME-DR-510-L01-00-00 REV: B

© WSP Australia Pty Ltd

DRAWING CREATED IN REVIT.