

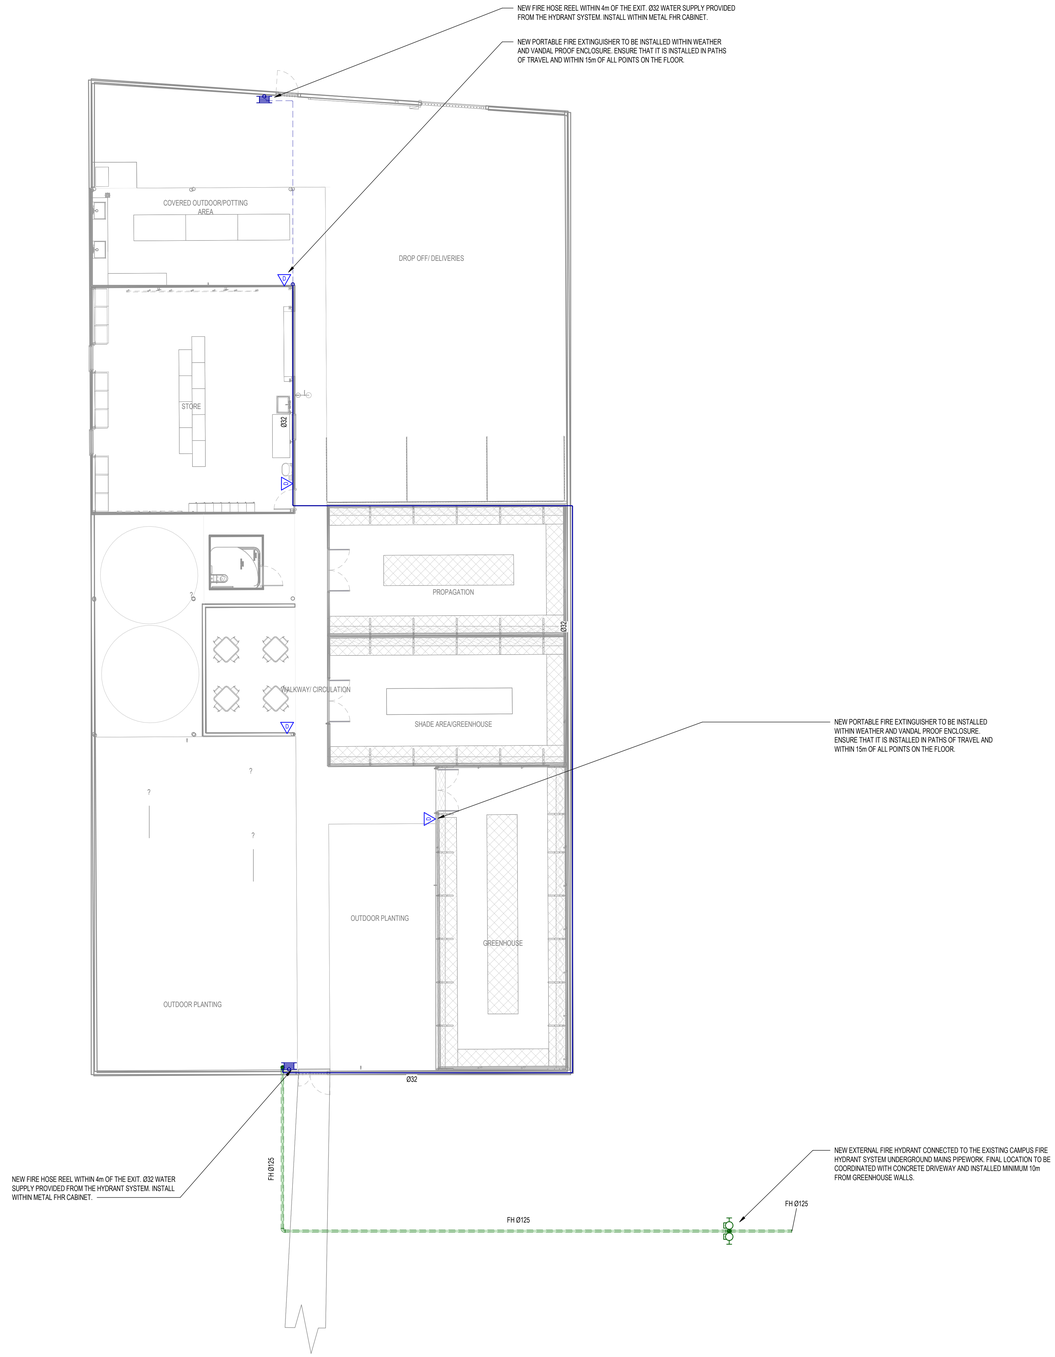

DESIGN CRITERIA & GENERAL NOTES:

1. DRAWINGS TO BE READ IN CONJUNCTION WITH THE FIRE ENGINEERING BRIEF (FEB) AND CERTIFIERS' BCA ASSESSMENT REPORT.
2. DRAWINGS TO BE READ IN CONJUNCTION WITH THE FIRE PROTECTION SERVICES REPORT, ARCHITECTURAL, STRUCTURAL, CIVIL AND ALL OTHER BUILDING SERVICES DOCUMENTATION.
3. FIRE SERVICES TO BE PROVIDED IN ACCORDANCE WITH NCC 2022 AND FIRE SAFETY ENGINEERING BRIEF.
4. FIRE HYDRANT SYSTEM TO BE PROVIDED IN ACCORDANCE WITH AS 2419.1-2021.
5. FIRE HOSE REELS TO BE PROVIDED IN ACCORDANCE WITH AS 2441-2005.
6. PORTABLE FIRE EQUIPMENT TO BE PROVIDED IN ACCORDANCE WITH AS 2444-2001.

INFORMATION REFLECTED ON THIS DRAWING REPRESENTS FIRE SERVICES DESIGN DEVELOPED FOR D&C TENDER ADVICE ONLY, AND SHOULD NOT BE REGARDED AS COMPLETE. THE D&C CONTRACTOR SHOULD REFER TO ALL ASSOCIATED ARCHITECTURAL AND OTHER DISCIPLINE DRAWINGS, PROJECT BRIEFS AND CLIENT REQUIREMENTS AND MAKE ADEQUATE ALLOWANCES FOR ALL NECESSARY FIRE SERVICES WORKS TO MEET THESE REQUIREMENTS, EQUIPMENT SCHEDULES AND COMPLIANCE WITH THE NCC & APPROPRIATE AUSTRALIAN STANDARDS

REV	DATE	BY	DESCRIPTION	CHK	APP
B	12.02.2026	JO	ISSUED FOR D&C TENDER	JS	SM
A	30.01.2026	JO	DRAFT 60% DD ISSUE FOR REVIEW	JS	SM

DRAWING STATUS: DESIGN DEVELOPMENT

900 Ann Street, Level 12, Fortitude Valley 4006
Tel: +61-7-3854-6200 Fax: +61-7-3854-6500
http://www.wsp.com

CLIENT: CQU

ARCHITECT: THOMSON ADSETT / PEDDLE THORP

PROJECT: CQU ROCKHAMPTON TAFE CONSOLIDATION

TITLE: FIRE PROTECTION SERVICES
HORTICULTURE BUILDING - GROUND LEVEL - WET FIRE LAYOUT

SCALE @ A0	CHECKED	APPROVED
1:100	JS	SM
PROJECT NUMBER	DRAWN	DATE
PS229518	JO	JAN 2026

DRAWING No: B76-FP-DR-510-L00-00-00 REV: B

© WSP Australia Pty Ltd

DRAWING CREATED IN REVIT