


LEGEND OF SYMBOLS


DUCTWORK & ACCESSORIES

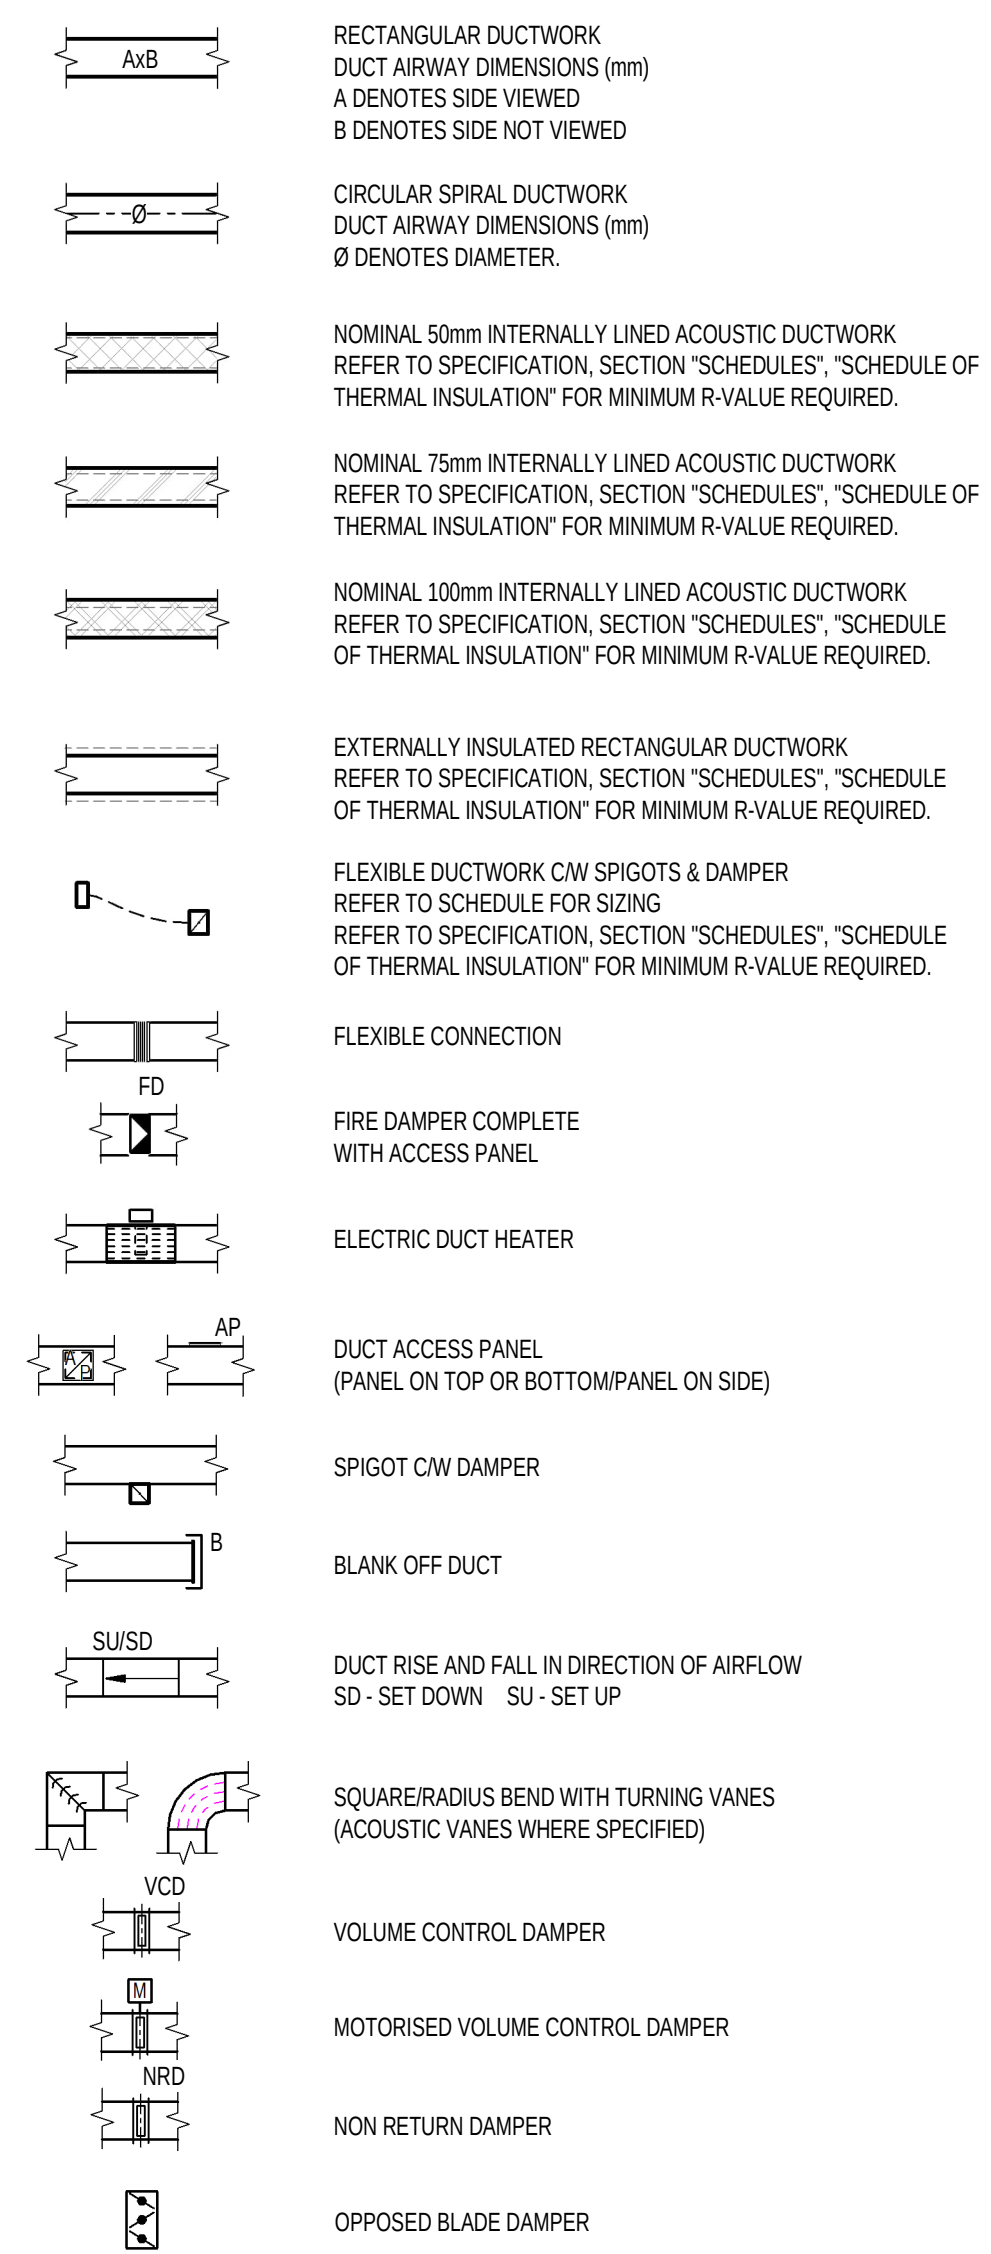

MECHANICAL DUCTWORK SYSTEMS

VISUAL STYLE	DUCT SYSTEM TYPE
GE 600x200	EXHAUST AIR - GENERAL
KE 600x200	KITCHEN EXHAUST
MA 600x200	MAKE-UP AIR
OA 600x200	OUTSIDE AIR
RA 600x200	RETURN AIR
SA 600x200	SUPPLY AIR
TE 600x200	TOILET EXHAUST
TA 600x200	TRANSFER AIR


AIR DISTRIBUTION

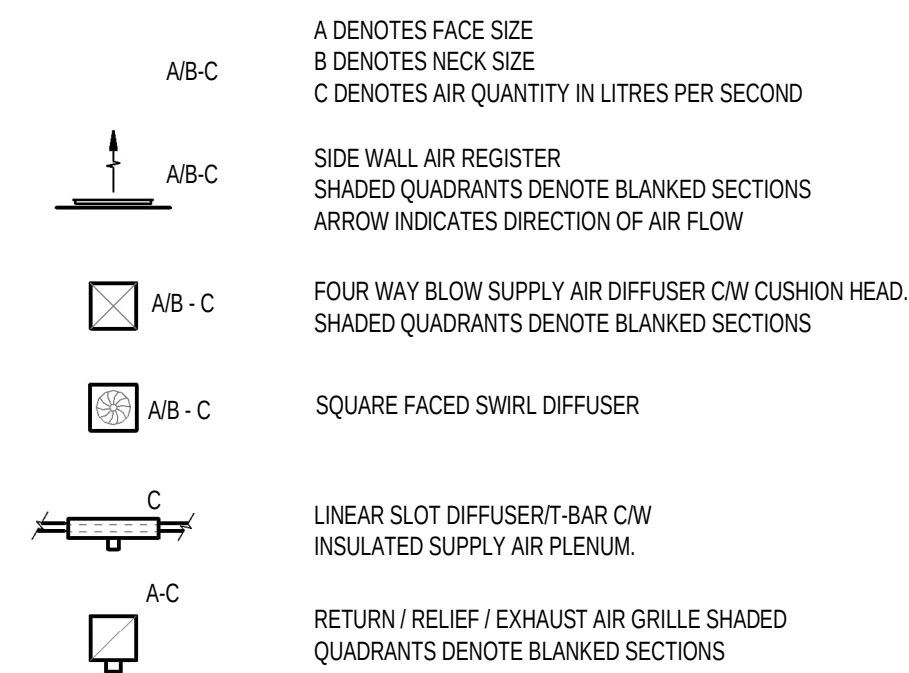

AIR FILTRATION




ELECTRICAL




AIR SCHEMATIC

REFER DUCTWORK & ACCESSORIES AND CONTROLS

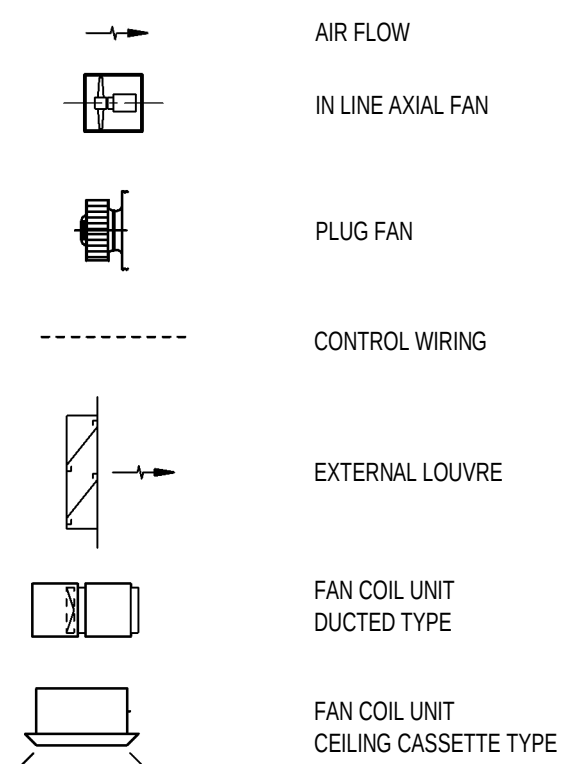

CONTROLS

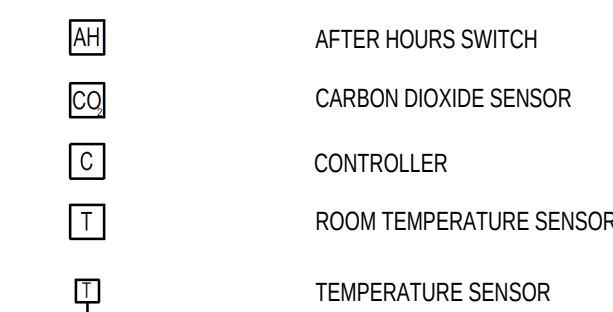


DOOR GRILLE SCHEDULE

TYPE	DIMENSION (NOM)	L/S
△	600x150	0 - 90
△	600x200	91 - 110
△	600x250	111 - 130
△	600x300	131 - 170
△	600x450	171 - 250
△	600x600	251 - 325
△	25mm UNDERCUT	-

FLEXIBLE DUCT SCHEDULE

SIZE (mm)	AIR QUANTITY RANGE (L/s)
Ø150	0 - 40
Ø200	41 - 85
Ø250	86 - 140
Ø300	141 - 230
Ø350	231 - 320
Ø400	321 - 440
Ø450	441 - 560
Ø500	561 - 700

SCHEMATIC PIPEWORK

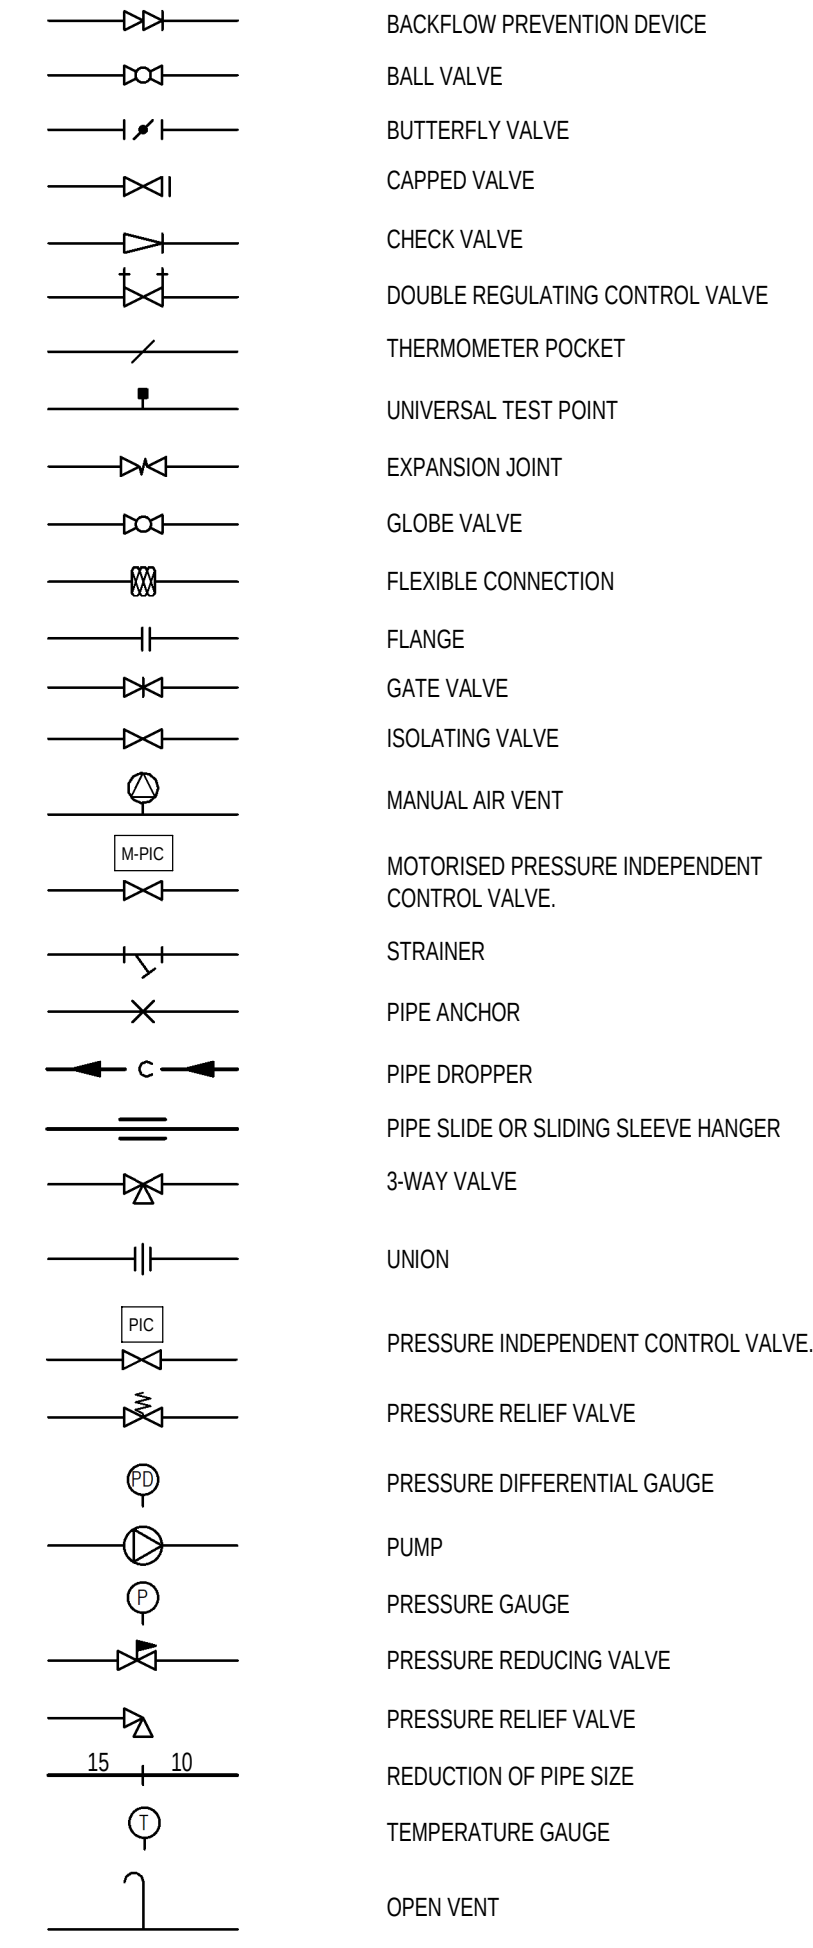

MECHANICAL PIPEWORK SYSTEMS


NEW (>50)	PIPE SYSTEM TYPE
—	CHILLED WATER FLOW
—	CHILLED WATER RETURN
—	CONDENSATE DRAIN
—	REFRIGERANT DISCHARGE

FLEXIBLE DUCTWORK

AIR TRANSFER / AIR RELIEF


SIZE (mm)	AIR QUANTITY RANGE (L/s)
Ø150	0 - 30
Ø200	31 - 50
Ø250	51 - 75
Ø300	76 - 110
Ø350	111 - 150

WORKS-IN-CONNECTION (BY OTHERS)

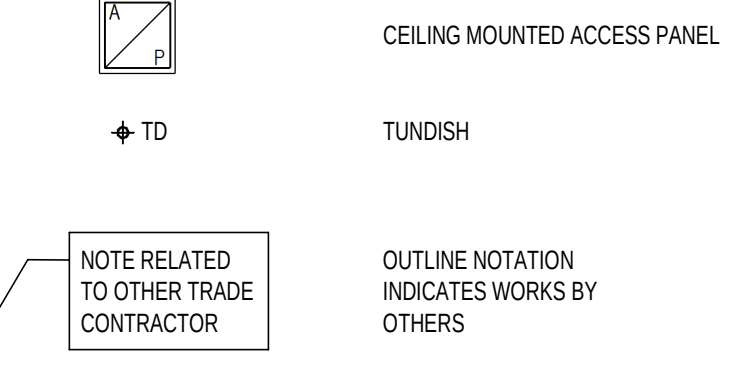

NOMENCLATURE (GENERAL)

CW	COMPLETE WITH
FIA	FROM ABOVE
FIB	FROM BELOW
FIR	FLOW/RETURN (SUFFY)
NONC	NORMALLY OPEN/NORMALLY CLOSED
TIA	TO ABOVE
TIB	TO BELOW
U.N.O.	UNLESS NOTED OTHERWISE

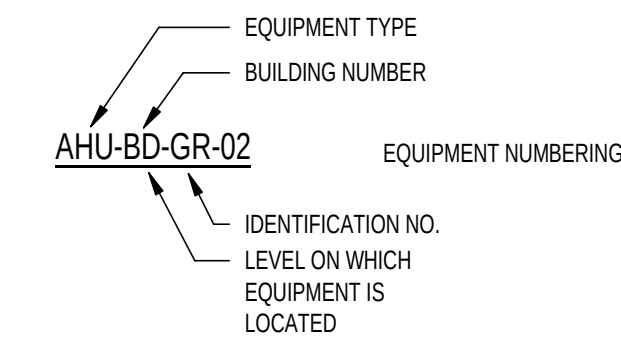


NOMENCLATURE (AIR SIDE)

ACC	AIR COOLED CONDENSER
ACU	AIR CONDITIONING UNIT
AHU	AIR HANDLING UNIT
AEK	HEAT EXCHANGER (AIR/AIR)
ATT	SOUND ATTENUATOR
CU	CONDENSING UNIT
EAG	EXHAUST AIR GRILLE
EDH	ELECTRIC DUCT HEATER
EH	EXHAUST HOOD
EA	EXHAUST AIR
FCU	FAN COIL UNIT
GE	GENERAL EXHAUST
GEF	GENERAL EXHAUST FAN
KEF	KITCHEN EXHAUST FAN
KEH	KITCHEN EXHAUST HOOD
OPU	OUTDOOR AIR PROCESSING UNIT
OAF	OUTSIDE AIR FAN
RA	RETURN AIR
RAF	RETURN AIR FAN
RF	RELIEF AIR FAN
SA	SUPPLY AIR
SAF	SUPPLY AIR FAN
SSF	SMOKE DAMPER
SSF	SMOKE SPILL FAN
TE	TOILET EXHAUST
TEF	TOILET EXHAUST FAN

NOMENCLATURE (WATER SIDE)

CC	COILING COIL
CHW	CHILLED WATER
CWP	CHILLED WATER PUMP, CONDENSER WATER PUMP
CHR	CHILLER
D	DRAIN

LINE-TYPE SCHEDULE

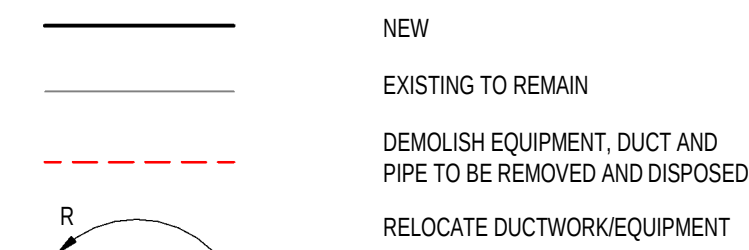

GENERAL NOTES

- DRAWINGS SHALL BE READ IN CONJUNCTION WITH THE MECHANICAL SERVICES SPECIFICATION.
- THE DRAWING INDICATES THE DESIGN INTENT OF THE MECHANICAL SERVICES INSTALLATION AND THE MANNER IN WHICH THE MECHANICAL SYSTEMS ARE TO BE SUPPLIED, INSTALLED AND COMMISSIONED. THEY DO NOT HOWEVER, PURPORT TO SHOW THE FINAL INSTALLATION WHICH MUST BE COORDINATED ON SITE WITH EXISTING ARCHITECTURE, STRUCTURE AND OTHER BUILDING SERVICES.
- MECHANICAL SERVICES CONTRACTOR SHALL CARRY OUT A SITE INSPECTION PRIOR TO SUBMISSION OF TENDER TO ENSURE A FULL UNDERSTANDING OF THE EXTENT OF THE WORK DESCRIBED IN THE DRAWING AND SPECIFICATION. NOTIFY CONSULTING ENGINEER OF ANY DISCREPANCIES AND SITE CONDITIONS WHICH MAY BE CONSIDERED TO HAVE COST IMPLICATION.
- THE ARCHITECTURAL, STRUCTURAL AND SERVICES ELEMENTS ARE TO BE FULLY UNDERSTOOD PRIOR TO THE PRODUCTION OF SHOP DRAWINGS WITH THE GUIDANCE OF THE CONTRACT DOCUMENTATION. THE WORK SHALL ALLOW FOR ALL NECESSARY COORDINATION DETAILING SUCH AS OFFSETS IN PIPE AND DUCT SYSTEMS, ALTERED SERVICES ROUTES AND LIAISON WITH CONSULTING ENGINEER AS REQUIRED. THE MECHANICAL SERVICES CONTRACTOR SHALL EXAMINE THE EXISTING STRUCTURAL AND ARCHITECTURE AND MAKE ALL NECESSARY MONETARY ALLOWANCES TO ALLOW FOR THESE ITEMS.
- PROVIDE SUITABLE ACCESS FOR REGULAR MAINTENANCE AND REPLACEMENT OF ALL MECHANICAL SYSTEMS AND PLANT. PROVIDE MANUFACTURERS SIGN OFF OF SHOP DRAWINGS AND INSTALLATION INDICATION SUFFICIENT ALLOWANCE THEREOF.
- FLEXIBLE DUCTWORK (FROM AIR DUCT SPIGOT TO CUSHION HEAD BOX) NOT TO EXCEED 6m. ALLOW TO PROVIDE SIMILAR INTERNAL DIAMETER INSULATED RIGID CIRCULAR DUCT WHERE REQUIRED - REFER FLEXIBLE DUCTWORK SCHEDULE. EXTENT OF RIGID CIRCULAR DUCTWORK NOT SHOWN ON THE DRAWING FOR CLARITY.
- SUPPLY AIR DIFFUSER SIZES ARE SHOWN FOR TENDERING PURPOSES ONLY. ALLOW TO LIASE THE EQUIPMENT MANUFACTURER FOR THE FINAL SELECTION IN TERMS OF NECK SIZE / COLLAR SIZE WITH DUE REGARD TO AIR QUANTITY, ROOM DIMENSIONS, DIFFUSER THROW, ACTIVE AND NON-ACTIVE SECTIONS AND TO ACHIEVE THE RECOMMENDED SOUND PRESSURE LEVELS AS SET OUT IN AS2107.
- ALL TRADES SHALL WORK IN CONJUNCTION WITH THE CONTRACTOR TO ENSURE THAT ALL BUILDING SERVICES INSTALLATIONS ARE COORDINATED AND INSTALLED IN A COHESIVE MANNER BETWEEN THE RESPECTIVE TRADES.
- ALL BUILDING SERVICES MOUNTED TO THE SOFFIT SHALL BE INSTALLED IN A NEAT, ORDERLY AND ALIGNED MANNER WHERE PLANT AND CABLING WORKS ARE EXPOSED TO THE ENVIRONMENT. CONSEQUENTLY ALL INSTALLATIONS SHALL BE INSTALLED TO THE DISCRETION OF THE PROJECT ARCHITECT AND SHALL REFLECT A HIGH QUALITY APPEARANCE IN ITS COMPLETED STATE.
- DIMENSIONS INDICATED IN THE DRAWINGS SHALL BE READ IN MILLIMETERS UNLESS OTHERWISE NOTED.

INFORMATION REFLECTED ON THIS DRAWING REPRESENTS MECHANICAL SERVICES DESIGN DEVELOPED FOR D&C TENDER ADVICE ONLY, AND SHOULD NOT BE REGARDED AS COMPLETE. THE D&C CONTRACTOR SHOULD REFER TO ALL ASSOCIATED ARCHITECTURAL AND OTHER DISCIPLINE DRAWINGS, PROJECT BRIEFS AND CLIENT REQUIREMENTS AND MAKE ADEQUATE ALLOWANCES FOR ALL NECESSARY MECHANICAL SERVICES WORKS TO MEET THESE REQUIREMENTS, EQUIPMENT SCHEDULES AND COMPLIANCE WITH THE NCC & APPROPRIATE AUSTRALIAN STANDARDS

B	12.02.2026	RD	DESIGNED FOR D&C TENDER	MB	SM
A	16.02.2026	RD	DESIGNED FOR D&C TENDER	MB	SM
REV	DATE	BY	DESCRIPTION	CHK	APP

DESIGN DEVELOPMENT



900 Ann Street, Level 12, Fortitude Valley 4006
Tel: +61-7-3854-6200 Fax: +61-7-3854-6500
<http://www.wsp.com>

CLIENT: CQU

ARCHITECT: THOMSON ADSETT / PEDDLE THORP

PROJECT: CQU ROCKHAMPTON TAFE CONSOLIDATION

TITLE: MECHANICAL SERVICES
GENERAL NOTES, LEGENDS & SYMBOLS

SCALE @ A1	N.T.S	CHECKED	MB	APPROVED	SM
PROJECT NUMBER	PS229518	DRAWN	RD	DATE	FEB 2026

DRAWING NO.	00-ME-DR-010-A00-00-00	REV	B
-------------	------------------------	-----	---

© WSP Australia Pty Ltd