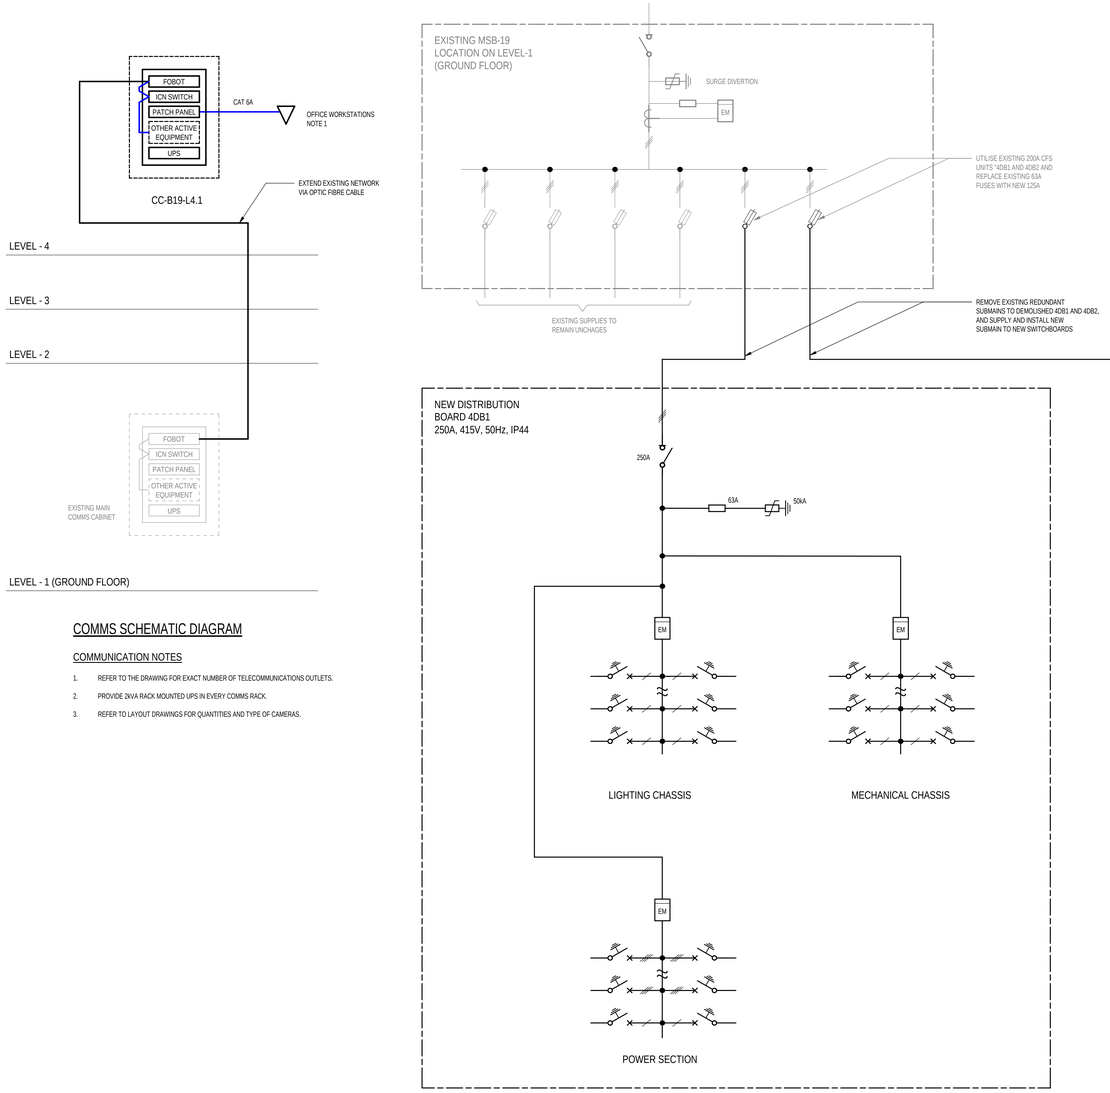


COMMS SCHEMATIC DIAGRAM

COMMUNICATION NOTES

1. REFER TO THE DRAWING FOR EXACT NUMBER OF TELECOMMUNICATIONS OUTLETS.
2. PROVIDE 2kVA RACK MOUNTED UPS IN EVERY COMMS RACK.
3. REFER TO LAYOUT DRAWINGS FOR QUANTITIES AND TYPE OF CAMERAS.

BUILDING B-19 SINGLE LINE DIAGRAM

INFORMATION REFLECTED ON THIS DRAWING REPRESENTS ELECTRICAL SERVICES DESIGN DEVELOPED FOR D&C TENDER ADVICE ONLY, AND SHOULD NOT BE REGARDED AS COMPLETE. THE D&C CONTRACTOR SHOULD REFER TO ALL ASSOCIATED ARCHITECTURAL AND OTHER DISCIPLINE DRAWINGS, PROJECT BRIEFS AND CLIENT REQUIREMENTS AND MAKE ADEQUATE ALLOWANCES FOR ALL NECESSARY ELECTRICAL SERVICES WORKS TO MEET THESE REQUIREMENTS, EQUIPMENT SCHEDULES AND COMPLIANCE WITH THE NCC & APPROPRIATE AUSTRALIAN STANDARDS

REV	DATE	BY	DESCRIPTION	CHK	APP
B	12.02.2026	MM	ISSUED FOR D&C TENDER	TP	SM
A	30.01.2026	MM	DRAFT 60% DD ISSUE FOR REVIEW	TP	SM

DRAWING STATUS:
DESIGN DEVELOPMENT

wsp
900 Ann Street, Level 12, Fortitude Valley 4006
Tel: +61-7-3854-6200 Fax: +61-7-3854-6500
http://www.wsp.com

CLIENT: CQU

ARCHITECT: THOMSON ADSETT / PEDDLE THORP

PROJECT: CQU ROCKHAMPTON TAFE CONSOLIDATION

TITLE: ELECTRICAL SERVICES
BUILDING 19 - SCHEMATICS

SCALE @ A0:	CHECKED:	APPROVED:
N.T.S	TP	SM
PROJECT NUMBER:	DRAWN:	DATE:
PS229518	MM	JAN 2026

DRAWING No: B19-EL-DR-200-A00-00-00 REV: B

© WSP Australia Pty Ltd

DRAWING CREATED IN REVIT